

TECHNICAL SPECIFICATION



AMENDMENT 1

High voltage direct current (HVDC) substation audible noise
(standards.iteh.ai)

IEC TS 61973:2012/AMD1:2019

<https://standards.iteh.ai/catalog/standards/sist/ab92623f-3f77-404b-8eb0-c4efa3721894/iec-ts-61973-2012-amd1-2019>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2019 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

[IEC TS 61973:2012/AMD1:2019](https://standards.itec.ai/catalog/standards/sist/ab92623f-3177-404b-8cb0-c4efa3721894/iec-ts-61973-2012-amd1-2019)

<https://standards.itec.ai/catalog/standards/sist/ab92623f-3177-404b-8cb0-c4efa3721894/iec-ts-61973-2012-amd1-2019>

TECHNICAL SPECIFICATION



AMENDMENT 1

High voltage direct current (HVDC) substation audible noise (standards.iteh.ai)

IEC TS 61973:2012/AMD1:2019
<https://standards.iteh.ai/catalog/standards/sist/ab92623f-3f77-404b-8eb0-c4efa3721894/iec-ts-61973-2012-amd1-2019>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.240.10; 29.240.99

ISBN 978-2-8322-6874-2

Warning! Make sure that you obtained this publication from an authorized distributor.

FOREWORD

This amendment has been prepared by IEC technical committee 115: High voltage direct current (HVDC) transmission for DC voltages above 100 kV.

The text of this amendment is based on the following documents:

DTS	Report on voting
115/197/DTS	115/207/RVDTS

Full information on the voting for the approval of this amendment can be found in the report on voting indicated in the above table.

The committee has decided that the contents of this amendment and the base publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

ITEH STANDARD PREVIEW
(standards.iteh.ai)

IMPORTANT – The “colour inside” logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this publication using a colour printer.

2 Normative references

Add the following new normative references:

IEC 60076-10, *Power transformers – Part 10: Determination of sound levels*

IEC 60076-10-1, *Power transformers – Part-10-1: Determination of sound levels – Application guide*

3.1.5 average sound pressure level

\bar{L}_{pA}

Replace the formula in Note 1 with the following:

$$\bar{L}_{pA,TOT} = 10 \lg \left(\frac{1}{N} \sum_{i=1}^N 10^{0,1 L_{p(f_j)}} \right)$$

5.4.2 At the fence surrounding the HVDC substation or at the border of the substation owner's property

Delete, under "Disadvantages", the fifth bullet point "Affected by background noise".

6.2.2 Comparison with a.c. power transformers

Replace Formula (3) and its explanation with the following:

$$L_{WA,lr} \approx 39 + 18 \lg \left(\frac{S_r}{S_p} \right) \text{ for 50 Hz power frequency} \quad (31)$$

iTeh STANDARD PREVIEW
(standards.iteh.ai)

$$L_{WA,lr} \approx 44 + 18 \lg \left(\frac{S_r}{S_p} \right) \text{ for 60 Hz power frequency} \quad (32)$$

IEC TS 61973:2012/AMD1:2019
<https://standards.iteh.ai/catalog/standards/sist/ab92623f-3f77-404b-8eb0-c4efa3721894/iec-ts-61973-2012-amd1-2019>

where

$L_{WA,lr}$ is the estimated A-weighted sound power level of the transformer at rated current and rated frequency at the short-circuit condition;

S_r is the rated power in MVA;

S_p is the reference power of 1 MVA.

7.2.1 General

Add, at the end of the subclause, the following text:

The typical twelve-pulse and dual twelve-pulse HVDC substation layouts are shown in Annex B.

10.3.4 Sound intensity measurement

Replace, in the explanation for Formula (28) " \bar{I}_r is sound intensity in direction r " with the following new explanation:

\bar{I}_r is sound intensity in direction r ;

Replace Formula (30) with the following:

$$W = \oint_A \bar{I} dA$$


Annexes

Add, after Annex A, the following new Annex B:

Annex B (informative)

Typical twelve-pulse and dual twelve-pulse HVDC substation layouts

The converter valve hall is the largest building in the HVDC substation, so its layout is very important. The typical twelve-pulse HVDC substation layout is shown in Figure B.1.

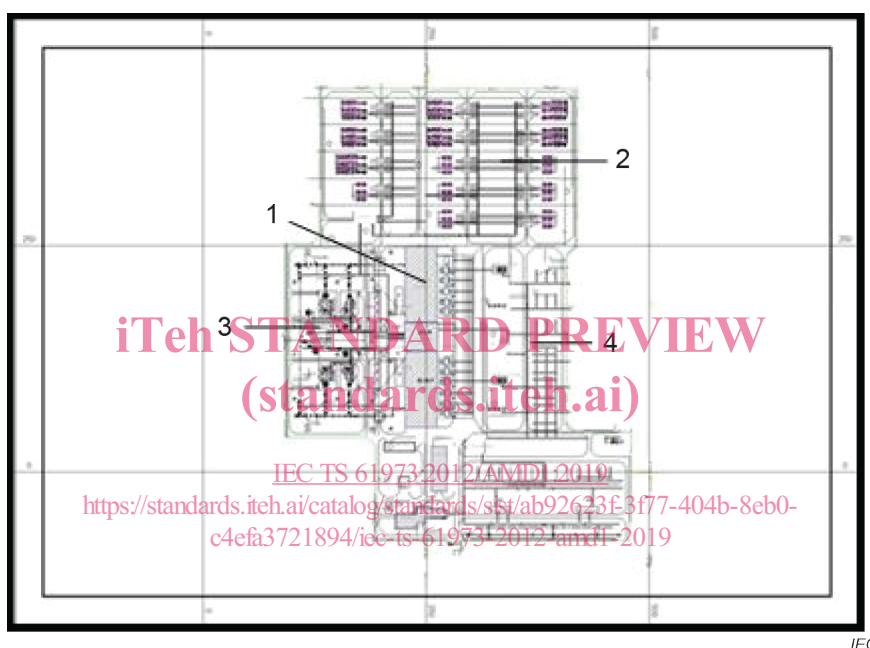


Key

- 1 valve hall and transformer
- 2 AC filter
- 3 DC switch yard
- 4 AC switch yard

Figure B.1 – Example of typical twelve-pulse HVDC substation layout

For the dual twelve-pulse forms, the valve hall can be arranged in face-to-face form, the converter transformers arranged on the inside of the buildings, which have significance for controlling the noise of the HVDC substation. The typical dual twelve-pulse HVDC substation layout is shown in Figure B.2.

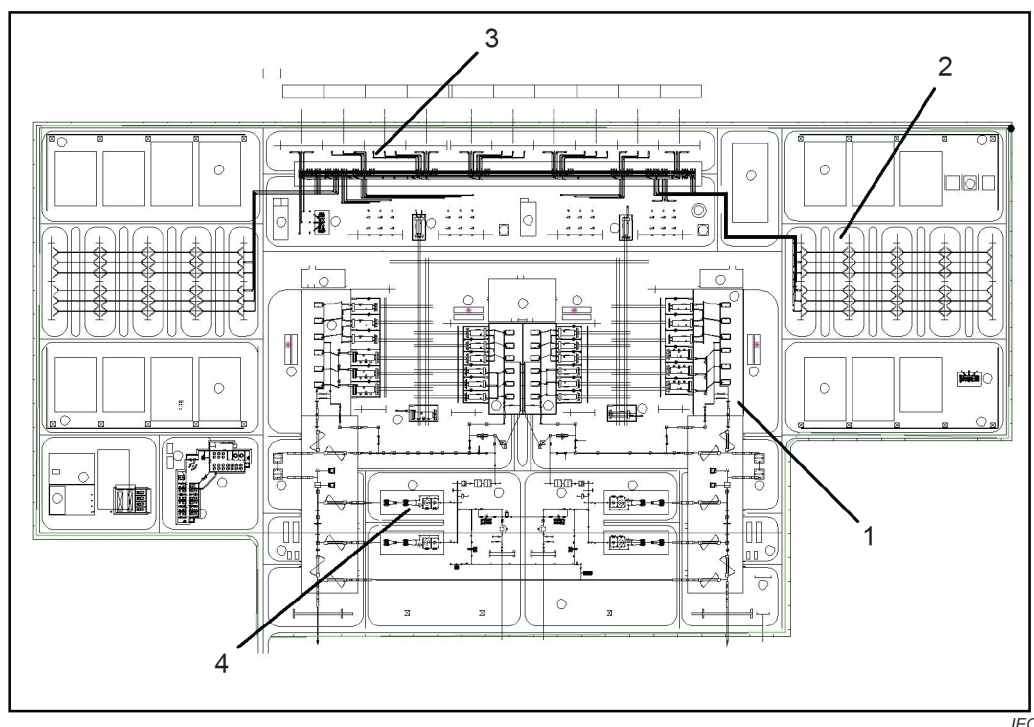

Key

- 1 valve hall and transformer
- 2 AC filter
- 3 AC switch yard
- 4 DC switch yard

iTeh STANDARD PREVIEW
(standards.iteh.ai)

<https://standards.iteh.ai/catalog/standards/sist/ab92623f-3f77-404b-8eb0-c4efa3721894/iec-ts-61973-2012-amd1-2019>

Figure B.2 – Example of dual twelve-pulse HVDC substation layout

Bibliography

Delete references [5] IEC 60076-10, *Power transformers – Part 10: Determination of sound levels* and [6] IEC 60076-10-1, *Power transformers – Part-10-1: Determination of sound levels – Application guide*

iTeh STANDARD PREVIEW **(standards.iteh.ai)**

IEC TS 61973:2012/AMD1:2019

<https://standards.iteh.ai/catalog/standards/sist/ab92623f-3f77-404b-8eb0-c4efa3721894/iec-ts-61973-2012-amd1-2019>

iTeh STANDARD PREVIEW **(standards.iteh.ai)**

IEC TS 61973:2012/AMD1:2019

<https://standards.iteh.ai/catalog/standards/sist/ab92623f-3f77-404b-8eb0-c4efa3721894/iec-ts-61973-2012-amd1-2019>