



Designation: **D6245 – 12 D6245 – 18**

# Standard Guide for Using Indoor Carbon Dioxide Concentrations to Evaluate Indoor Air Quality and Ventilation<sup>1</sup>

This standard is issued under the fixed designation D6245; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This guide describes how measured values of indoor carbon dioxide (CO<sub>2</sub>) concentrations can be used in evaluations of indoor air quality and building ventilation.

1.2 This guide describes the determination of CO<sub>2</sub> generation rates from people as a function of body size and level of physical activity.

1.3 This guide describes the experimentally-determined relationship between CO<sub>2</sub> concentrations and the acceptability of a space in terms of human body odor.

1.4 This guide describes the following uses of indoor CO<sub>2</sub> concentrations to evaluate building ventilation—mass balance analysis to determine the percent outdoor air intake at an air handler, the tracer gas decay technique to estimate whole building air change rates, and the constant injection tracer gas technique at equilibrium to estimate whole building air change rates.

1.5 This guide discusses the use of continuous monitoring of indoor and outdoor CO<sub>2</sub> concentrations as a means of evaluating building ventilation and indoor air quality.

1.6 This guide discusses some concentration measurement issues, but it does not include or recommend a method for measuring CO<sub>2</sub> concentrations.

1.7 This guide does not address the use of indoor CO<sub>2</sub> to control outdoor air intake rates.

1.8 *Units*—The values stated in SI units are to be regarded as standard. No other units of measurement are included in this standard.

1.9 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and health environmental practices and determine the applicability of regulatory limitations prior to use.*

1.10 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

## 2. Referenced Documents

2.1 *ASTM Standards:*<sup>2</sup>

[D1356 Terminology Relating to Sampling and Analysis of Atmospheres](#)

[D3249 Practice for General Ambient Air Analyzer Procedures](#)

[E741 Test Method for Determining Air Change in a Single Zone by Means of a Tracer Gas Dilution](#)

2.2 *Other Documents:*

[ASHRAE Standard 62.1 Ventilation for Acceptable Indoor Air Quality](#)<sup>3</sup>

<sup>1</sup> This guide is under the jurisdiction of ASTM Committee D22 on Air Quality and is the direct responsibility of Subcommittee D22.05 on Indoor Air. Current edition approved April 1, 2012; June 1, 2018. Published May 2012; June 2018. Originally approved in 1998. Last previous edition approved in 2007; 2012 as D6245 – 07; D6245 – 12. DOI: 10.1520/D6245-12; 10.1520/D6245-18.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

<sup>3</sup> Available from American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc., (ASHRAE), 1791 Tullie Circle, NE, Atlanta, GA 30329-30329, <http://www.ashrae.org>.

### 3. Terminology

3.1 *Definitions*—For definitions and terms used in this guide, refer to Terminology [D1356](#).

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *air change rate, n*—the total volume of air passing through a zone to and from the outdoors per unit time, divided by the volume of the zone ( $\text{s}^{-1}$ ,  $\text{h}^{-1}$ ).<sup>4</sup>

3.2.2 *bioeffluents, n*—gases emitted by people as a product of their metabolism that can result in unpleasant odors.

3.2.3 *single-zone, n*—an indoor space, or group of spaces, wherein the  $\text{CO}_2$  concentration is uniform and that only exchanges air with the outdoors.

### 4. Summary of Guide

4.1 When investigating indoor air quality and building ventilation, a number of tools are available. One such tool is the measurement and interpretation of indoor and outdoor  $\text{CO}_2$  concentrations. Using  $\text{CO}_2$  concentrations to evaluate building indoor air quality and ventilation requires the proper use of the procedures involved, as well as consideration of several factors related to building and ventilation system configuration, occupancy patterns, non-occupant  $\text{CO}_2$  sources, time and location of air sampling, and instrumentation for concentration measurement. This guide discusses ways in which  $\text{CO}_2$  concentrations can be used to evaluate building indoor air quality and ventilation.

4.2 Section [6](#) discusses the rate at which people generate  $\text{CO}_2$  and the factors that affect this rate.

4.3 Section [7](#) discusses the use of indoor concentrations of  $\text{CO}_2$  as an indicator of the acceptability of a space in terms of perceptions of human body odor.

4.4 Section [8](#) describes the use of mass balance analysis to determine the percent outdoor air intake at an air handler based on the measured  $\text{CO}_2$  concentrations in the supply, return, and outdoor air intake airstreams.

4.5 Section [9](#) describes the use of the tracer gas decay technique to determine building air change rates using occupant-generated  $\text{CO}_2$  as a tracer gas. The tracer gas decay technique is described in detail in Test Method [E741](#), and this section discusses the application of this test method to the special case of occupant-generated  $\text{CO}_2$  after the occupants have left the building.

4.6 Section [10](#) describes the use of the constant injection tracer gas technique with occupant-generated  $\text{CO}_2$  to estimate outdoor air ventilation rates. This technique is sometimes referred to as equilibrium analysis, and Section [10](#) discusses the use of this technique and the assumptions upon which it is based.

4.7 Section [11](#) discusses the use of continuous monitoring of  $\text{CO}_2$  concentrations as a means of evaluating indoor air quality and ventilation in buildings. In this discussion, continuous refers to real-time concentration measurement recorded with a datalogging device, generally over several days.

4.8 Section [12](#) discusses  $\text{CO}_2$  concentration measurement issues, including measuring outdoor concentrations, sample locations for indoor concentration measurements, establishing the uncertainty of measured concentrations, and calibration.

### 5. Significance and Use

5.1 Indoor  $\text{CO}_2$  concentrations have been described and used by some people as an indicator of indoor air quality. These uses have included both appropriate and inappropriate interpretations of indoor  $\text{CO}_2$  concentrations. Appropriate uses include estimating expected levels of occupant comfort in terms of human body odor, studying occupancy patterns, investigating the levels of contaminants that are related to occupant activity, and screening for the sufficiency of ventilation rates relative to occupancy. Inappropriate uses include the application of simple relationships to determine outdoor air ventilation rates per person from indoor  $\text{CO}_2$  concentrations without verifying the assumptions upon which these relationships are based, and the interpretation of indoor  $\text{CO}_2$  concentrations as a comprehensive indicator of indoor air quality.

5.2 Outdoor air ventilation rates affect contaminant levels in buildings and building occupants' perception of the acceptability of the indoor environment. Minimum rates of outdoor air ventilation are specified in building codes and indoor air quality standards, for example, ASHRAE Standard 62. The compliance of outdoor air ventilation rates with relevant codes and standards are often assessed as part of indoor air quality investigations in buildings. The outdoor air ventilation rate of a building depends on the size and distribution of air leakage sites, pressure differences induced by wind and temperature, mechanical system operation, and occupant behavior. Given all of this information, ventilation rates are predictable; however, many of these parameters are difficult to determine in practice. Therefore, measurement is required to determine outdoor air change rates reliably.

5.3 The measurement of  $\text{CO}_2$  concentrations has been promoted as a means of determining outdoor air ventilation rates per person. This approach, referred to in this guide as equilibrium analysis, is based on a steady-state, single-zone mass balance of  $\text{CO}_2$  in the building and is sometimes presented with little or no discussion of its limitations and the assumptions on which it is based. As a result, in some cases, the technique has been misused and indoor  $\text{CO}_2$  concentration measurements have been misinterpreted.

<sup>4</sup> A common way of expressing air change rate units is  $\text{h}^{-1}$  = air changes per hour.

5.4 When the assumptions upon which equilibrium analysis is based are valid, the technique can yield reliable measurements of outdoor air ventilation rates. In addition, indoor CO<sub>2</sub> concentrations can be used to determine other aspects of building ventilation when used properly. By applying a mass balance at an air handler, the percent outdoor air intake in the supply airstream can be determined based on the CO<sub>2</sub> concentrations in the supply, return, and outdoor air. This percentage can be multiplied by the supply airflow rate of the air handler to yield the outdoor air intake rate of the air handler. In addition, the decay of indoor CO<sub>2</sub> concentrations can be monitored in a building after the occupants have left to determine the outdoor air change rate of the building.

5.5 Continuous monitoring of indoor and outdoor CO<sub>2</sub> concentrations can be used to study some aspects of ventilation system performance, the quality of outdoor air, and building occupancy patterns.

**6. CO<sub>2</sub> Generation Rates**

6.1 Human metabolism consumes oxygen and generates CO<sub>2</sub> at rates that depend on the level of physical activity, body size, and diet.

6.2 The rate of oxygen consumption-carbon dioxide generation of an individual  $V_{eCO_2}$  in L/s of a person per person, at an air temperature of 273 K and an air pressure of 101 kPa, is given by Eq 1, the derivation of which is described in detail in Ref (1):

$$V_{O_2} = \frac{0.00276 A_D M}{(0.23 RQ + 0.77)} \tag{1}$$

$$V_{CO_2} = RQ BMR M 0.000569 \tag{1}$$

where:

- $A_D$  = DuBois surface area m<sup>2</sup>,
- $M$  = metabolic rate per unit of surface area, met (1 met = 58.2 W/m<sup>2</sup>), and
- $RQ$  = respiratory quotient.

- $RQ$  = respiratory quotient, dimensionless (defined in 6.3),
- $BMR$  = basal metabolic rate, MJ/day, and
- $M$  = metabolic rate per unit of surface area, met (dimensionless).

The DuBois surface area  $A_D$  for other values of equals about 1.8 mair temperature <sup>2</sup> for an average-sized adult and ranges from about 0.8 to 1.4 m<sup>2</sup> for elementary school aged children. Additional information on body surface area is available in the EPA Exposure Factors Handbook (2). The respiratory quotient,  $RQ$ ,  $T$  is the and pressure ratio  $P_1/V_{CO_2}$  of the volumetric is given by Eq 2 rate:

$$V_{CO_2} = RQ BMR M (T/P) 0.000211 \tag{2}$$

at which CO<sub>2</sub> is produced to the rate at which oxygen is consumed. Therefore, the CO<sub>2</sub> generation rate of an individual is equal to  $V_{O_2}$  multiplied by  $RQ$ .

6.3 The respiratory quotient,  $RQ$ , is the ratio of the volumetric rate at which CO<sub>2</sub> is produced by an individual to the rate at which oxygen is consumed. The value of  $RQ$  depends primarily on diet (2). Based on data on human nutrition in the United States, primarily the ratios of fat, protein, and carbohydrate intake,  $RQ$  equals about 0.85 (3).

6.4 Chapter 9 of the ASHRAE Fundamentals Handbook, Thermal Comfort Values of BMR are (4), contains typical met levels for a variety of activities. Some of these values are reproduced a function of sex, age, and body mass. Equations for the calculation of BMR are given in Table 1: (4).

6.5 The value of the respiratory quotient variable  $M$  (in dimensionless units of met) is used to describe the ratio of  $RQ$  the depends on diet, the level of physical activity and the physical condition of the person. human energy use associated with a particular physical activity to the BMR of an individual as discussed in detail in Ref (1). equals 0.83 for an average adult

**TABLE 1 Equations for Calculating BMR (4)**

NOTE 1— $m$  is body mass in units of kg.

| Age (y)  | BMR: MJ/day     |                 |
|----------|-----------------|-----------------|
|          | Males           | Females         |
| <3       | 0.249 m – 0.127 | 0.244 m – 0.130 |
| 3 to 10  | 0.095 m + 2.110 | 0.085 m + 2.033 |
| 10 to 18 | 0.074 m + 2.754 | 0.056 m + 2.898 |
| 18 to 30 | 0.063 m + 2.896 | 0.062 m + 2.036 |
| 30 to 60 | 0.048 m + 3.653 | 0.034 m + 3.538 |
| ≥60      | 0.049 m + 2.459 | 0.038 m + 2.755 |

<sup>5</sup> The body surface area boldface numbers  $A_D$  in parentheses <sup>2</sup> can be estimated from the formula refer to a list of references at the end of  $A_D = 0.203 H^{0.725} W^{0.425}$  where  $H$  is the body height in m and  $W$  is the body mass in kg (4).

engaged in light or sedentary activities. There are two primary references for obtaining met levels for different physical activities **RQ(5, 6increases). Tables 2 and 3** to a value of about 1 for heavy physical activity, about 5 met. Based on the expected variation in contain met levels for many common indoor activities drawn from those two references. RQ, it has only a secondary effect on CO<sub>2</sub> generation rates.

6.5 **Fig. 1** shows the dependence of oxygen consumption and CO<sub>2</sub> generation rates on physical activity in units of mets for average adults with a surface area of 1.8 m<sup>2</sup>. RQ is assumed to equal 0.83 in **Fig. 1**.

6.6 Based on **Eq 1** and **Fig. 1**, the CO<sub>2</sub> generation rate corresponding to an average-sized adult ( $A_D = 1.8 \text{ m}^2$ ) engaged in office work (1.2 met) is about 0.0052 L/s. Based on **Eq 1**, the CO<sub>2</sub> generation rate for a child ( $A_D = 1 \text{ m}^2$ ) with a physical activity level of 1.2 met is equal to 0.0029 L/s.

6.6 **Eq 1** **Table 4** can be used to estimate lists CO<sub>2</sub> generation rates based on information on body surface area that is available for ranges of ages and met levels estimated using the body mass data for males and females in the EPA Exposure Factors Handbook (27), and other sources. However, these data do not generally apply to the elderly and sick and, therefore, the user must exercise caution when considering buildings with such occupants assuming RQ is equal to 0.85.

6.7 To reflect the importance of variations in body size, that is, mass, in estimating CO<sub>2</sub> generation rates, **Fig. 1** and **Fig. 2** show the variation in  $V_{CO_2}$  with age and body mass for females and males, respectively. Each plot displays  $V_{CO_2}$  for 13 age ranges from < 1 y to ≥ 80 y and for six met levels from 1 to 4. The plotted generation rates are calculated using RQ equal to 0.85. Each vertical box-whisker plot displays the range of CO<sub>2</sub> generation rates from the 10<sup>th</sup> percentile value of body mass up to the 90<sup>th</sup> as indicated in the key to each figure.

6.8 In using **Eq 1** and **Table 4** to estimate CO<sub>2</sub> generation rates for the occupants in a given building, it is important to consider the ages, sizes and met levels of the individual occupants, as well as the ranges in each of these variables in the building population. When applying these calculations to occupied buildings, this information should be obtained via observations of the occupants to achieve more accurate estimates of the CO<sub>2</sub> generation rates.

## 7. CO<sub>2</sub> as an Indicator of Body Odor Acceptability

7.1 This section describes the use of CO<sub>2</sub> to evaluate indoor air quality in terms of human body odor acceptability and therefore, the adequacy of the ventilation rate to control body odor. The material in this section is based on a number of experimental studies in both chambers and real buildings and describes the most well-established link between indoor CO<sub>2</sub> concentrations and indoor air quality.

7.2 At the same time people are generating CO<sub>2</sub> they are also producing odor-causing bioeffluents. Similar to CO<sub>2</sub> generation, the rate of bioeffluent generation depends on the level of physical activity. Bioeffluent generation also depends on personal hygiene such as the frequency of baths or showers. Because both CO<sub>2</sub> and bioeffluent generation rates depend on physical activity, the concentrations of CO<sub>2</sub> and the odor intensity from human bioeffluents in a space exhibit a similar dependence on the number of occupants and the outdoor air ventilation rate.


7.3 Experimental studies have been conducted in chambers and in occupied buildings in which people evaluated the acceptability of the air in terms of body odor (3-8-712). These experiments studied the relationship between outdoor air ventilation rates and odor acceptability, and the results of these studies were considered in the development of most ventilation standards and guidelines (including ASHRAE Standard 62.1). This entire section is based on the results of these studies.

**TABLE 2 Metabolic Rates (M in Met) for Various Physical Activities (5)**

| Activity  | M (Met) | Range      |
|---|---------|------------|
| Calisthenics – light effort                                     | 2.8     |            |
| Calisthenics – moderate effort                                  | 3.8     |            |
| Calisthenics – vigorous effort                                  | 8.0     |            |
| Child care  |         | 2.0 to 3.0 |
| Cleaning, sweeping – moderate effort                            | 3.8     |            |
| Custodial work – light  | 2.3     |            |
| Dancing – aerobic, general                                      | 7.3     |            |
| Dancing – general   | 7.8     |            |
| Health club exercise classes – general                          | 5.0     |            |
| Kitchen activity – moderate effort                              | 3.3     |            |
| Lying or sitting quietly  |         | 1.0 to 1.3 |
| Sitting reading, writing, typing                                | 1.3     |            |
| Sitting at sporting event as spectator                          | 1.5     |            |
| Sitting tasks, light effort (for example, office work)          | 1.5     |            |
| Sitting quietly in religious service                            | 1.3     |            |
| Sleeping  | 0.95    |            |
| Standing quietly  | 1.3     |            |
| Standing tasks, light effort (for example, store clerk, filing) | 3.0     |            |
| Walking, less than 2 mph, level surface, very slow              | 2.0     |            |
| Walking, 2.8 mph to 3.2 mph, level surface, moderate pace       | 3.5     |            |

TABLE 3 Metabolic Rates (M in Met) for Additional Physical Activities (6)

| Activity                               | Males   |            | Females |            |
|--|---------|------------|---------|------------|
|  | Average | Range      | Average | Range      |
| Aerobic dancing – low intensity        | 3.51    |            | 4.24    |            |
| Aerobic dancing – high intensity       | 7.93    |            | 8.31    |            |
| Calisthenics                           | 5.44    |            |         |            |
| Child care (unspecified)               |         |            | 2.5     |            |
| Climbing stairs                        | 5.0     |            |         |            |
| Dancing                                | 5.0     |            | 5.09    |            |
| Eating and drinking                    | 1.4     |            | 1.6     |            |
| Housework (unspecified)                |         |            | 2.8     | 2.5 to 3.0 |
| Office worker – Filing                 | 1.3     |            | 1.5     |            |
| Office worker – Reading                | 1.3     |            | 1.5     |            |
| Office worker – Sitting at desk        | 1.3     |            |         |            |
| Office worker – Standing/moving around | 1.6     |            |         |            |
| Office worker – Typing                 | 1.8     |            | 1.8     |            |
| Office worker – Writing                | 1.4     |            | 1.4     |            |
| Reading                                | 1.22    |            | 1.25    |            |
| Sleeping                               | 1.0     |            | 1.0     |            |
| Sitting quietly                        | 1.2     |            | 1.2     |            |
| Sitting on a bus/train                 | 1.2     |            |         |            |
| Standing                               | 1.4     |            | 1.5     |            |
| Walking around/strolling               | 2.1     | 2.0 to 2.2 | 2.5     | 2.1 to 2.9 |
| Walking quickly                        | 3.8     |            |         |            |
| Walking slowly                         | 2.8     | 2.8 to 3.0 | 3.0     |            |

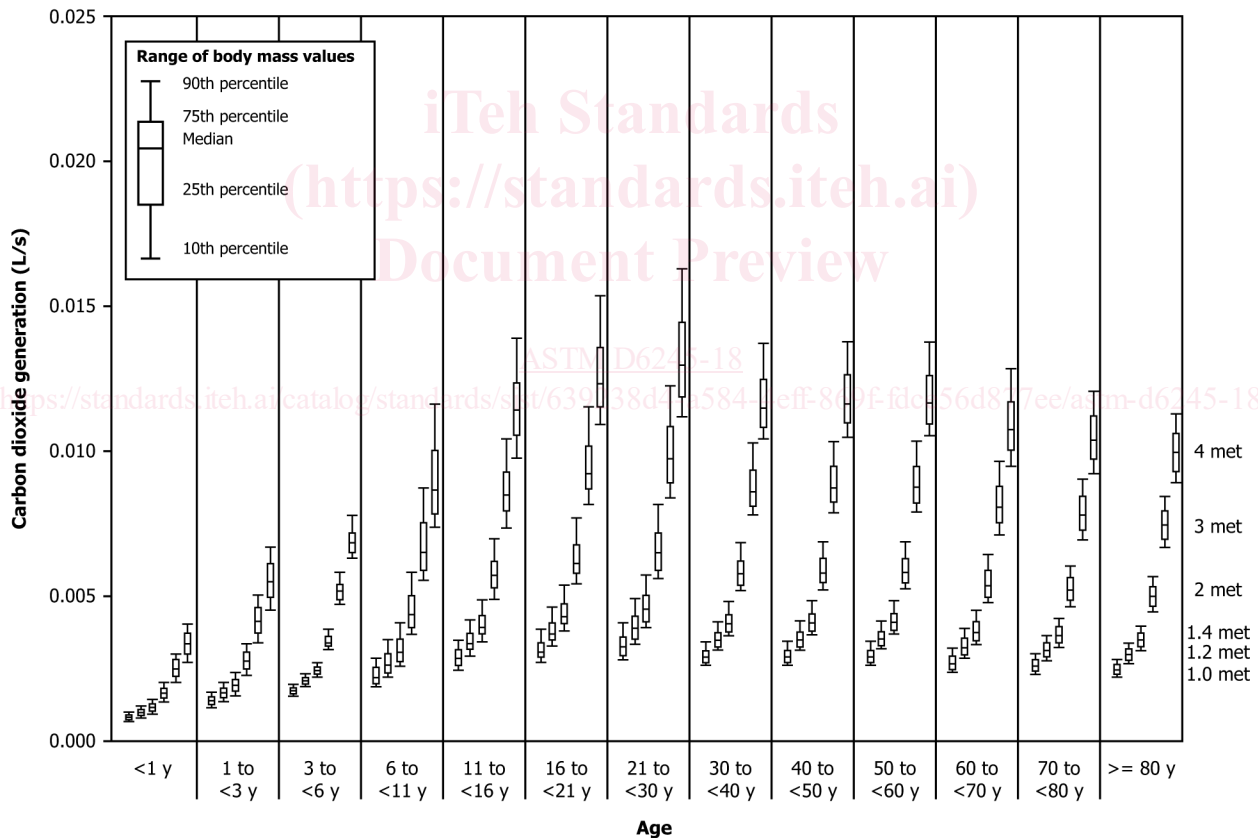

NOTE 1—Each age bin contains box-whisker plots at 1 met, 1.2 met, 1.4 met, 2 met, 3 met, and 4 met. (Based on body size data in (7).)

FIG. 1 CO<sub>2</sub> Variation, Generation and Oxygen Consumption as a Function in Carbon Dioxide Generation Rate Associated with Age, Body Mass, and Level of Physical Activity for Females

7.3.1 These studies concluded that about 7.5 L/s of outdoor air ventilation per person will control human body odor such that roughly 80 % of unadapted persons (visitors) will find the odor at an acceptable level. These studies also showed that the same level of body odor acceptability was found to occur at a CO<sub>2</sub> concentration that is about 650 ppm(v) above the outdoor concentration.



TABLE 1 Typical Met Levels for Various Activities

| Activity                    | met      |
|-----------------------------|----------|
| Seated, quiet               | —1.0     |
| Reading and writing, seated | —1.0     |
| Typing                      | —1.1     |
| Filing, seated              | —1.2     |
| Filing, standing            | —1.4     |
| Walking, at 0.89 m/s        | —2.0     |
| House cleaning              | —2.0-3.4 |
| Exercise                    | —3.0-4.0 |

TABLE 4 Carbon Dioxide Generation Rates as a Function of Occupant Sex, Age, and Met Level (Based on Body Mass Data in (7))

| Age (y)        | Mean Mass (kg) | BMR (MJ/day) | CO <sub>2</sub> Generation Rate (L/s) |        |        |        |        |        |        |
|----------------|----------------|--------------|---------------------------------------|--------|--------|--------|--------|--------|--------|
|                |                |              | Level of Physical Activity (Met)      |        |        |        |        |        |        |
|                |                |              | 1.0                                   | 1.2    | 1.4    | 1.6    | 2.0    | 3.0    | 4.0    |
| <b>Males</b>   |                |              |                                       |        |        |        |        |        |        |
| <1             | 8.0            | 1.86         | 0.0009                                | 0.0011 | 0.0013 | 0.0014 | 0.0018 | 0.0027 | 0.0036 |
| 1 to <3        | 12.8           | 3.05         | 0.0015                                | 0.0018 | 0.0021 | 0.0024 | 0.0030 | 0.0044 | 0.0059 |
| 3 to <6        | 18.8           | 3.90         | 0.0019                                | 0.0023 | 0.0026 | 0.0030 | 0.0038 | 0.0057 | 0.0075 |
| 6 to <11       | 31.9           | 5.14         | 0.0025                                | 0.0030 | 0.0035 | 0.0040 | 0.0050 | 0.0075 | 0.0100 |
| 11 to <16      | 57.6           | 7.02         | 0.0034                                | 0.0041 | 0.0048 | 0.0054 | 0.0068 | 0.0102 | 0.0136 |
| 16 to <21      | 77.3           | 7.77         | 0.0037                                | 0.0045 | 0.0053 | 0.0060 | 0.0075 | 0.0113 | 0.0150 |
| 21 to <30      | 84.9           | 8.24         | 0.0039                                | 0.0048 | 0.0056 | 0.0064 | 0.0080 | 0.0120 | 0.0160 |
| 30 to <40      | 87.0           | 7.83         | 0.0037                                | 0.0046 | 0.0053 | 0.0061 | 0.0076 | 0.0114 | 0.0152 |
| 40 to <50      | 90.5           | 8.00         | 0.0038                                | 0.0046 | 0.0054 | 0.0062 | 0.0077 | 0.0116 | 0.0155 |
| 50 to <60      | 89.5           | 7.95         | 0.0038                                | 0.0046 | 0.0054 | 0.0062 | 0.0077 | 0.0116 | 0.0154 |
| 60 to <70      | 89.5           | 6.84         | 0.0033                                | 0.0040 | 0.0046 | 0.0053 | 0.0066 | 0.0099 | 0.0133 |
| 70 to <80      | 83.9           | 6.57         | 0.0031                                | 0.0038 | 0.0045 | 0.0051 | 0.0064 | 0.0095 | 0.0127 |
| ≥80            | 76.1           | 6.19         | 0.0030                                | 0.0036 | 0.0042 | 0.0048 | 0.0060 | 0.0090 | 0.0120 |
| <b>Females</b> |                |              |                                       |        |        |        |        |        |        |
| <1             | 7.7            | 1.75         | 0.0008                                | 0.0010 | 0.0012 | 0.0014 | 0.0017 | 0.0025 | 0.0034 |
| 1 to <3        | 12.3           | 2.88         | 0.0014                                | 0.0017 | 0.0020 | 0.0022 | 0.0028 | 0.0042 | 0.0056 |
| 3 to <6        | 18.3           | 3.59         | 0.0017                                | 0.0021 | 0.0024 | 0.0028 | 0.0035 | 0.0052 | 0.0070 |
| 6 to <11       | 31.7           | 4.73         | 0.0023                                | 0.0027 | 0.0032 | 0.0037 | 0.0046 | 0.0069 | 0.0092 |
| 11 to <16      | 55.9           | 6.03         | 0.0029                                | 0.0035 | 0.0041 | 0.0047 | 0.0058 | 0.0088 | 0.0117 |
| 16 to <21      | 65.9           | 6.12         | 0.0029                                | 0.0036 | 0.0042 | 0.0047 | 0.0059 | 0.0089 | 0.0119 |
| 21 to <30      | 71.9           | 6.49         | 0.0031                                | 0.0038 | 0.0044 | 0.0050 | 0.0063 | 0.0094 | 0.0126 |
| 30 to <40      | 74.8           | 6.08         | 0.0029                                | 0.0035 | 0.0041 | 0.0047 | 0.0059 | 0.0088 | 0.0118 |
| 40 to <50      | 77.1           | 6.16         | 0.0029                                | 0.0036 | 0.0042 | 0.0048 | 0.0060 | 0.0090 | 0.0119 |
| 50 to <60      | 77.5           | 6.17         | 0.0030                                | 0.0036 | 0.0042 | 0.0048 | 0.0060 | 0.0090 | 0.0120 |
| 60 to <70      | 76.8           | 5.67         | 0.0027                                | 0.0033 | 0.0038 | 0.0044 | 0.0055 | 0.0082 | 0.0110 |
| 70 to <80      | 70.8           | 5.45         | 0.0026                                | 0.0032 | 0.0037 | 0.0042 | 0.0053 | 0.0079 | 0.0106 |
| ≥80            | 64.1           | 5.19         | 0.0025                                | 0.0030 | 0.0035 | 0.0040 | 0.0050 | 0.0075 | 0.0101 |

7.3.2 Fig. 23 shows the percent of unadapted persons (visitors) who are dissatisfied with the level of body odor in a space as a function of the CO<sub>2</sub> concentration above outdoors (813). This figure accounts only for the perception of body odor and does not account for other environmental factors that may influence the dissatisfaction of visitors to the space, such as the concentrations of other pollutants and thermal parameters. Based on the relationship in Fig. 23, the difference between indoor and outdoor CO<sub>2</sub> concentrations can be used as an indicator of the acceptability of the air in a space in terms of body odor and, therefore, as an indicator of the adequacy of the ventilation rate to control the level of body odor. However, the relationship between percent dissatisfied and CO<sub>2</sub> concentration is also dependent on the personal hygiene of the occupants of a space, that is, their frequency of bathing, as well as the societal expectations of the visitors to the space. The individuals involved in the experiments on which Fig. 23 is based were office workers and university students with modern habits of personal hygiene from the United States, Denmark, and Japan. If the occupants of a space have different levels of personal hygiene and if the visitors have different expectations, then Fig. 23 would not necessarily apply.

7.3.3 The experimentally observed relationship between percent dissatisfied and CO<sub>2</sub> concentrations in Fig. 23 was not strongly dependent on the level of physical activity (38, 510, 712). In addition, the relationship did not require that the indoor CO<sub>2</sub> concentration be at equilibrium.

7.3.4 The relationship described in Fig. 23 can also be derived based on the experimentally-determined relationship between percent dissatisfied and outdoor air ventilation rates in L/s. Based on a typical level of CO<sub>2</sub> generation per person and an assumption that the indoor CO<sub>2</sub> concentrations are at equilibrium, the outdoor air ventilation rates determined experimentally to result in a particular value of percent dissatisfied can be converted into indoor CO<sub>2</sub> concentrations to derive the relationship in Fig. 23.