

# INTERNATIONAL STANDARD

# NORME INTERNATIONALE



**Field device integration (FDI) –  
Part 3: Server**

**IT STANDARD PREVIEW**  
**(standards.iteh.ai)**

**Intégration des appareils de terrain (FDI) –  
Partie 3: Serveur**

<https://standards.iteh.ai/catalog/standards/sist/4ba690fe-6e6f-48c2-b789-d7bfl95a2edc/iec-62769-3-2021>  
[IEC 62769-3:2021](#)



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2021 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

#### IEC publications search - [webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

#### IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

#### IEC Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [sales@iec.ch](mailto:sales@iec.ch).

#### IEC online collection - [oc.iec.ch](http://oc.iec.ch)

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

#### Electropedia - [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 18 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

### A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

### A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

#### Recherche de publications IEC -

[webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études, ...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

#### IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

#### Service Clients - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: [sales@iec.ch](mailto:sales@iec.ch).

#### IEC online collection - [oc.iec.ch](http://oc.iec.ch)

Découvrez notre puissant moteur de recherche et consultez gratuitement tous les aperçus des publications. Avec un abonnement, vous aurez toujours accès à un contenu à jour adapté à vos besoins.

#### Electropedia - [www.electropedia.org](http://www.electropedia.org)

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 000 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

# INTERNATIONAL STANDARD

## NORME INTERNATIONALE



Field device integration (FDI) –  
Part 3: Server

STANDARD PREVIEW  
(standards.iteh.ai)

Intégration des appareils de terrain (FDI) –

Partie 3: Serveur

<https://standards.iteh.ai/catalog/standards/sist/4ba690fe-6e6f-48c2-b789-d7bfl95a2edc/iec-62769-3-2021>

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

COMMISSION  
ELECTROTECHNIQUE  
INTERNATIONALE

ICS 25.040.40; 35.100.05

ISBN 978-2-8322-9310-2

**Warning! Make sure that you obtained this publication from an authorized distributor.**  
**Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

## CONTENTS

FOREWORD .....	5
INTRODUCTION .....	7
1 Scope .....	8
2 Normative references .....	8
3 Terms, definitions, abbreviated terms and conventions .....	9
3.1 Terms and definitions .....	9
3.2 Abbreviated terms .....	9
3.3 Conventions .....	9
4 Overview .....	9
5 Information Model .....	10
5.1 General .....	10
5.2 Online/Offline .....	11
5.2.1 Overview .....	11
5.2.2 Transfer to device .....	11
5.2.3 Transfer from device .....	11
5.3 Access privileges .....	12
5.4 Private Parameters .....	12
5.5 Locking .....	12
5.6 EditContext .....	13
5.6.1 Concept and usage model .....	13
5.6.2 Services .....	14
5.6.3 Node IDs .....	15
5.6.4 Reading .....	15
5.6.5 Writing .....	15
5.6.6 Writing dominant and dependent Variables .....	15
5.6.7 Actions (EDD METHODS) .....	17
5.6.8 UIDs .....	18
5.6.9 Synchronization .....	18
5.7 Reading .....	18
5.7.1 General .....	18
5.7.2 Reading offline variables .....	19
5.7.3 Reading online variables .....	19
5.8 Writing .....	20
5.8.1 General .....	20
5.8.2 Write offline variables .....	21
5.8.3 Writing online variables .....	22
5.8.4 Writing to an EditContext .....	24
5.9 Subscription .....	25
5.9.1 General .....	25
5.9.2 Subscription of offline variables .....	25
5.9.3 Subscription of online variables .....	26
5.10 Device topology .....	28
5.10.1 General .....	28
5.10.2 Connection Points .....	28
5.10.3 Topology management .....	29
5.10.4 Topology scanning .....	32

5.10.5	Use of SCAN function .....	33
5.10.6	Validation of defined topology .....	34
5.11	User Interface Elements .....	34
5.11.1	User Interface Descriptions .....	34
5.11.2	User Interface Plug-ins .....	35
5.12	Actions .....	35
5.12.1	FDI Server – FDI Client interaction .....	35
5.12.2	Action state machine .....	38
5.12.3	Actions Proxies .....	40
5.12.4	Actions, EDD Actions and Actions Proxies .....	40
6	OPC UA services .....	42
6.1	OPC UA profiles .....	42
6.2	Service error information .....	42
6.2.1	Overview .....	42
6.2.2	OPC UA services and their response .....	42
6.2.3	Mappings of EDDL response codes to OPC UA service response .....	42
6.3	Parameter value update during write service request .....	43
6.4	Localization .....	44
6.5	Audit events .....	44
7	Communication .....	44
7.1	Notation .....	44
7.2	General .....	44
7.2.1	Concepts .....	44
7.2.2	Terms .....	47
7.3	Communication Service processing .....	48
7.3.1	Communication Service Invocation .....	48
7.3.2	Analyze communication path .....	48
7.3.3	Manage communication relations .....	49
7.3.4	Communication service request mapping .....	49
7.3.5	Communication service request propagation .....	50
7.3.6	Communication error handling .....	51
7.4	FDI Communication Server specific handling .....	51
7.4.1	Discovery .....	51
7.4.2	Information Model synchronization .....	52
8	Parallel Execution within the FDI Server .....	52
8.1	Motivation .....	52
8.2	Internal structure of the EDD interpreter .....	52
8.3	Rules for running an EDD entity .....	53
Annex A (informative)	FDI Server functional structure .....	54
A.1	FDI functional elements .....	54
A.2	FDI Server extension .....	55
Annex B (informative)	Access privileges and user roles .....	57
B.1	User roles and usage case .....	57
B.2	Private data usage .....	58
Annex C (informative)	Parallel execution within the FDI Server – Examples .....	59
C.1	Simple example for a synchronous execution .....	59
C.2	Example for a concurrent execution .....	59
C.3	Deadlock detection in concurrent execution .....	61

Figure 1 – FDI architecture diagram .....	8
Figure 2 – Locking services .....	13
Figure 3 – EditContext models .....	14
Figure 4 – Online EditContext state diagram for dominant and dependent Variables .....	16
Figure 5 – Offline EditContext state diagram for dominant and dependent Variables .....	17
Figure 6 – EditContext for EDD Methods .....	17
Figure 7 – Offline variable read .....	19
Figure 8 – Online variable read .....	20
Figure 9 – Offline variable write immediate .....	21
Figure 10 – Online variable write immediate .....	23
Figure 11 – Write with EditContext .....	24
Figure 12 – Offline variable subscription .....	26
Figure 13 – Online variable subscription .....	27
Figure 14 – Topology with Network objects (non-normative) .....	28
Figure 15 – Add Device to topology .....	30
Figure 16 – Remove device from topology .....	31
Figure 17 – Scan topology .....	32
Figure 18 – Action execution .....	37
Figure 19 – Action state machine .....	38
Figure 20 – System communication integration example .....	45
Figure 21 – FDI Communication Server integration example .....	46
Figure 22 – Gateway integration example .....	47
Figure 23 – Message propagation example scenario .....	50
Figure A.1 – Functional components of an FDI Server .....	54
Figure A.2 – FDI Server extensions .....	56
Figure B.1 – User roles and access privileges .....	57
Figure C.1 – Synchronous execution of two triggers .....	59
Figure C.2 – Concurrent execution of two triggers (step 1) .....	59
Figure C.3 – Concurrent execution of two triggers (step 2) .....	60
Figure C.4 – Concurrent execution of two triggers (step 3) .....	60
Figure C.5 – Concurrent execution of two triggers (step 4) .....	61
Figure C.6 – Concurrent execution of two triggers .....	61
Table 1 – Action states .....	38
Table 2 – Action state transitions .....	39
Table 3 – EDD Action types and the EDD constructs that use them .....	41
Table 4 – OPC UA severity bits and EDDL response codes TYPE .....	43

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

## FIELD DEVICE INTEGRATION (FDI) –

## Part 3: Server

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.  
<https://standards.iteh.ai/catalog/standards/sist/4ba69956-6e6f-48c2-b789-3e11a2a2cc2c/iec-62769-3-2021>
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62769-3 has been prepared by subcommittee 65E: Devices and integration in enterprise systems, of IEC technical committee 65: Industrial-process measurement, control and automation.

This second edition cancels and replaces the first edition published in 2015. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) modification of the edit context concept to harmonize the IEC 61804 and the IEC 62769 series.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
65E/760/FDIS	65E/770/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 62769 series, published under the general title *Field Device Integration (FDI)*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

## iTeh STANDARD PREVIEW

(standards.iteh.ai)

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

<https://standards.iteh.ai/catalog/standards/sist/4ba690fe-6e6f-48c2-b789-d7bf195a2ede/iec-62769-3-2021>

## INTRODUCTION

The IEC 62769 series has the general title *Field Device Integration (FDI)* and the following parts:

- Part 1: Overview
- Part 2: FDI Client
- Part 3: FDI Server
- Part 4: FDI Packages
- Part 5: FDI Information Model
- Part 6: FDI Technology Mapping
- Part 7: FDI Communication Devices
- Part 100: Profiles – Generic Protocol Extensions
- Part 101-1: Profiles – Foundation Fieldbus H1
- Part 101-2: Profiles – Foundation Fieldbus HSE
- Part 103-1: Profiles – PROFIBUS
- Part 103-4: Profiles – PROFINET
- Part 109-1: Profiles – HART and WirelessHART
- Part 115-2: Profiles – Protocol-specific Definitions for Modbus RTU
- Part 150-1: Profiles – ISA 100.11a

**ITeH STANDARD PREVIEW**  
**(standards.iteh.ai)**

[IEC 62769-3:2021](https://standards.iteh.ai/catalog/standards/sist/4ba690fe-6e6f-48c2-b789-d7bfl95a2edc/iec-62769-3-2021)

<https://standards.iteh.ai/catalog/standards/sist/4ba690fe-6e6f-48c2-b789-d7bfl95a2edc/iec-62769-3-2021>

# FIELD DEVICE INTEGRATION (FDI) –

## Part 3: Server

### 1 Scope

This part of IEC 62769 specifies the FDI Server. The overall FDI architecture is illustrated in Figure 1. The architectural components that are within the scope of this document have been highlighted in this figure.

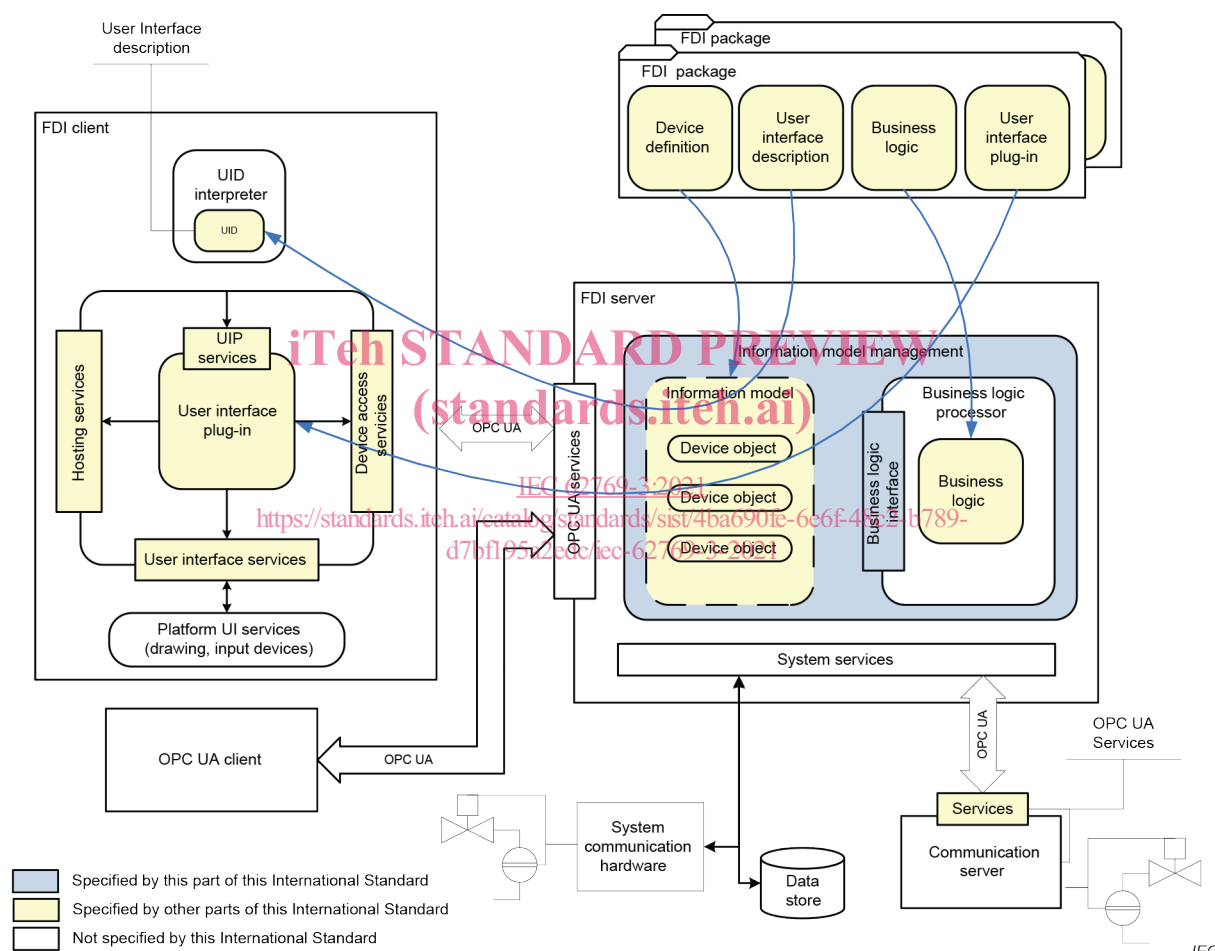


Figure 1 – FDI architecture diagram

### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61804 (all parts), *Function blocks (FB) for process control and electronic device description language (EDDL)*

IEC 61804-4:2020, *Function blocks (FB) for process control and electronic device description language (EDDL) – Part 4: EDD interpretation*

IEC 62541-4, *OPC unified architecture – Part 4: Services*

IEC 62541-7, *OPC unified architecture – Part 7: Profiles*

IEC 62769-1, *Field Device Integration (FDI) – Part 1: Overview*

IEC 62769-2, *Field Device Integration (FDI) – Part 2: FDI Client*

IEC 62769-4, *Field Device Integration (FDI) – Part 4: FDI Packages*

IEC 62769-5, *Field Device Integration (FDI) – Part 5: FDI Information Model*

IEC 62769-7, *Field Device Integration (FDI) – Part 7: Communication Devices*

### 3 Terms, definitions, abbreviated terms and conventions

#### 3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 62769-1 as well as the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

##### 3.1.1

##### **Actions Proxy**

internal FDI Server entity that encapsulates all the EDD Methods specified in an EDD Action definition

#### 3.2 Abbreviated terms

For the purposes of this document, the abbreviated terms given in IEC 62769-1 apply.

#### 3.3 Conventions

For the purposes of this document, the conventions given in IEC 62769-1 apply.

### 4 Overview

The structure for an FDI Server is shown in Figure 1.

FDI Servers that support connectivity with third-party FDI Clients shall support OPC UA. A vendor can provide both an FDI Server and one or more FDI Clients. In this case, the FDI Clients can communicate with the FDI Server through proprietary protocols.

An FDI Server communicates with devices via Native Communication (see 7.2.1) and/or Communication Devices (see IEC 62769-7).

An FDI Server provides information to FDI Clients through an Information Model (see IEC 62769-5) as follows.

- The Information Model includes information about Device Types and Device Instances. The information for a Device Instance includes offline data (engineering data), as well as online data (values from the physical device).
- The Information Model is created using information from FDI Packages. However, not all of the information in an FDI Package is reflected in the Information Model.
- Referential integrity of the Information Model is maintained using information from FDI Packages.
- FDI Packages can contain Attachments that contain device manuals and protocol-specific information (see IEC 62769-4). Those Attachments, including device manuals and protocol-specific support files, are exposed via the Information Model.
- FDI Device Packages contain information about device types (see IEC 62769-4). Each device type defined in a package is mapped to a distinct DeviceType node in the Information Model.
- FDI Profile Packages are used to provide interaction with devices for which an FDI Device Package does not exist (see IEC 62769-4).
- Multiple revisions of an FDI Package generate distinct DeviceType nodes in the Information Model (see IEC 62769-4).

FDI Packages contain digital signatures that allow an FDI Server to authenticate their contents (see IEC 62769-4). An FDI Server shall not use an FDI Package if the digital signature provided by the FDI Package is invalid.

An FDI Server shall verify the FDI Technology Version (see IEC 62769-1) of any FDI Package it uses to ensure the FDI Package is compatible with the FDI Server.

The resulting functional structure of an FDI server is described in Annex A.

## 5 Information Model

### 5.1 General

The FDI Server shall use the Device Definition of an FDI Package to maintain the Information Model.

The Device Definition can contain conditional expressions. Conditional expressions are used when a certain aspect of the Device Definition is not static but rather is dependent on the state of the device. Whenever the online or offline values of a Device Instance are modified, the FDI Server shall re-evaluate the relevant conditional expressions and modify the Information Model accordingly.

The evaluation of conditional expressions can invalidate variables in the Information Model. The FDI Server shall change the AccessLevel attribute of invalidated variables such that they are neither readable nor writable and the status of these variables shall be set to bad. Read and write service requests for invalidated variables shall return a failure.

The Device Definition can specify relationships between variables in a device. These relationships can impact the value of variables in the Information Model.

The FDI Server shall generate DataChange Notifications to any FDI Clients that are subscribing to Information Model elements that have changed.

FDI Packages provide Business Logic that is used by the FDI Server to maintain the integrity of the Information Model. The Business Logic specified in an FDI Package can invoke builtin functions that shall be implemented by the FDI Server. The builtin functions that shall be implemented by the FDI Server are specified in IEC 61804-5.

## 5.2 Online/Offline

### 5.2.1 Overview

The Information Model maintained by the FDI Server contains online and offline values. The online values reflect values in a physical component/device. The offline values reflect values stored in a configuration database.

The offline values are updated through write service requests from an FDI Client or Business Logic executed by the FDI Server. The offline values are not updated when the FDI Server reads data from the device or writes data to the device.

The online values in the Information Model are not updated through write service requests. Successful write service requests through the Information Model result in value changes in the physical devices. The online values in the Information Model will then be updated as a result of read service requests or subscriptions.

FDI Servers can provide a server-specific mechanism for creating Device Instances without the presence of physical hardware. The FDI Server creates these instances using information in FDI Packages. All read/write requests for online values for Device Instances with no physical device shall return an error.

The transfer of information between the offline values and the physical device is supported through the TransferToDevice and TransferFromDevice methods in the Information Model. These Methods shall implement the download and upload procedures, respectively, as specified in IEC 61804-4. When no implementation is provided based on IEC 61804-4, then these Methods shall return Bad\_NotSupported, as per IEC 62541-4.

The Device shall have been locked prior to invoking these methods, as specified in IEC 62769-5.

### 5.2.2 Transfer to device

The TransferToDevice method shall implement the download procedure as specified in IEC 61804-4. This transfers the offline values to the physical device.

As a general rule, the FDI Server should not change the Online variable node when writing a value to the device. The Online variable node should be updated only in the process of read operations or subscriptions. Notwithstanding, as specified in IEC 62769-5, the FDI Server will reset any cached Value for the target Nodes in the Information Model so that they will be re-read next time they are requested.

The status information returned for each variable included in the write service request is used to compose the TransferResult, as specified in IEC 62769-5.

### 5.2.3 Transfer from device

The TransferFromDevice method shall implement the upload procedure as specified in IEC 61804-4. This transfers the values from the physical device to the offline values.

If any read operations from the device fail during upload, the corresponding offline value shall not be modified.

The status information returned for each variable included in the read service request is used to compose the TransferResult, as specified in IEC 62769-5.

### 5.3 Access privileges

Systems implement security and access policies based on a number of characteristics such as user role and plant area. FDI Servers use these policies, along with information in FDI Packages, to determine the access privileges granted to the user.

The elements of an FDI Package can be associated with one or more usage attributes. The FDI Server uses these attributes to set the UserAccessLevel attribute of Variables and the UserExecutable attribute of Methods. The usage attributes in an FDI Package are simply hints to be used by the FDI Server, i.e., they may be disregarded or overridden by the FDI Server. See also Annex B.

### 5.4 Private Parameters

The Parameters and Actions specified in an FDI Package may be declared private. Private Parameters and Actions shall not be browsable; they shall only be accessible through references from other elements of an FDI Package.

More specifically, the FDI Server shall support private Parameters and Actions as follows.

- The FDI Server shall create nodes in the Information Model for the private Parameters and Actions.
- The FDI Server shall not include information about private Parameters and Actions in a response to a Browse, BrowseNext, QueryFirst, or QueryNext service request.
- The FDI Server shall return the NodeIds of private Parameters and Actions when the name of a private Parameter or Action is passed to TranslateBrowsePathsToNodeIds.
- The FDI Server shall process a read/write service request for a private Parameter in the same way as it does for public (browsable) Parameters (see 5.7 and 5.8).
- The FDI Server shall execute private Actions in the same way as it does public (browsable) Actions (see 5.12).

An example of private parameters is parameters that should only be modified through an Action. These parameters should not be visible to FDI Clients to prevent direct access. FDI Clients invoke Actions to access these private parameters.

### 5.5 Locking


The FDI Server provides locking services to grant FDI Clients exclusive access to Device and Network elements in the Information Model. The locking services consist of a set of Methods and status information. The methods, and their behavior, are specified in IEC 62769-5.

The following behavior shall be implemented by the FDI Server to support locks.

- Locking applies to both online and offline nodes.
- Once locked by one FDI Client, any attempt to write to a Parameter or to execute an Action by another FDI Client shall be rejected.
- Locking is not required for read services.
- Parameters that are locked by one FDI Client can still be read by other FDI Clients, i.e., read requests on a Parameter that is locked are not rejected.

Internal use of the locking mechanism for maintaining the Information Model integrity is FDI Server vendor-specific.

Figure 2 illustrates a locking sequence with multiple service invocations during the locked state.

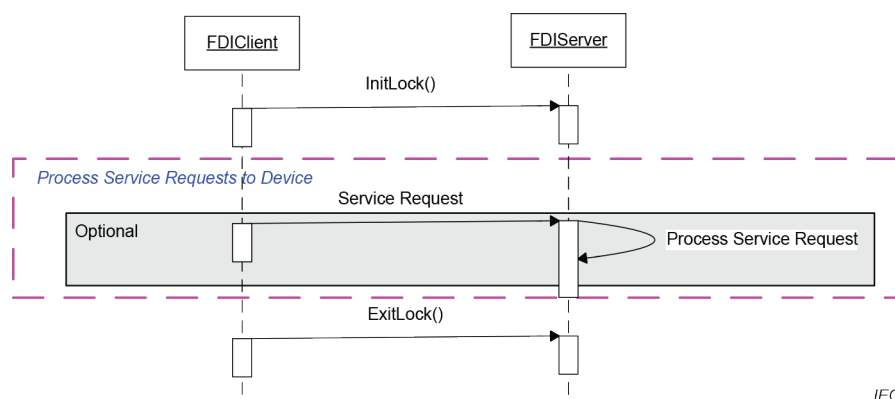

**Figure 2 – Locking services**

A service request that requires locking shall fail either partially or completely if no lock has been acquired by the FDI Client via `InitLock` prior to requesting the service. The FDI Client has to release the lock via `ExitLock` after all service requests have been completed.

A write operation will partially fail, i.e., it will return a status code for each variable in the set of variables to be written since some may belong to devices that are locked and some to devices that are not locked.

FDI Servers may queue `InitLock` requests until a service for which a lock has been created completes and the lock has been released. However, such an optimization is not part of the standard behavior required of an FDI Server.

## 5.6 EditContext

### 5.6.1 Concept and usage model

The FDI Server provides the `EditContext` model to interact with Clients during their editing task. The concept is closely related to UIDs and fulfills the needs for Server-driven UI dialogs based on EDDL rules.

An `EditContext` can be used to make changes to Variable Values visible to the Server without applying them to the online or offline representation of a Device. The Server will apply business logic associated to the edited Variable, which – in some cases – causes changes to other Variable Values (e.g. if an engineering unit is changed) or the UID (e.g. a Variable becomes invisible). Thus, the Client can use an `EditContext` to modify (edit) Parameters such as engineering units, ranges and more, verify any side effects, and re-adjust the settings before applying the changes.

An FDI Server may implement different `EditContext` strategies:

- A single `EditContext` instance for all dialogues of an FDI Client.
- Multiple `EditContext` instances.
- Hierarchical `EditContext` instances.