

INTERNATIONAL STANDARD

NORME INTERNATIONALE



Field device integration (FDI) –
Part 103-1: Profiles – PROFIBUS

STANDARD PREVIEW
(standards.iteh.ai)

Intégration des appareils de terrain (FDI) –
Partie 103-1: Profils – PROFIBUS

IEC 62769-103-1:2020
<https://standards.iteh.ai/catalog/standards/sist/1c00d0bc-10c8-4412-9434-347bc0537c62/iec-62769-103-1-2020>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2020 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22.000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67.000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Recherche de publications IEC -

webstore.iec.ch/advsearchform

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.

Electropedia - www.electropedia.org

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22.000 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary

67.000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.



INTERNATIONAL STANDARD

NORME INTERNATIONALE



Field device integration (FDI) –
Part 103-1: Profiles – PROFIBUS

STANDARD PREVIEW
(standards.iteh.ai)

Intégration des appareils de terrain (FDI) –
Partie 103-1: Profils – PROFIBUS

IEC 62769-103-1:2020
http://standards.iteh.ai/catalog/standards/sist/1c00d0bc-10c8-4412-9434-347bc0537c62/iec-62769-103-1-2020

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 25.040.40; 35.100.05

ISBN 978-2-8322-8114-7

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD	4
1 Scope	6
2 Normative references	6
3 Terms, definitions, abbreviated terms and conventions	6
3.1 Terms and definitions	6
3.2 Abbreviated terms and acronyms	7
3.3 Conventions	7
3.3.1 EDDL syntax	7
3.3.2 XML syntax	7
3.3.3 Capitalizations	7
4 Profile for PROFIBUS	8
4.1 General	8
4.2 Catalog profile	8
4.2.1 Protocol support file	8
4.2.2 CommunicationProfile definition	8
4.2.3 Profile device	9
4.2.4 Protocol version information	9
4.3 Associating a Package with a device	10
4.3.1 Device type identification mapping	10
4.3.2 Device type revision mapping	11
4.4 Information Model mapping	12
4.4.1 ProtocolType definition	12
4.4.2 DeviceType mapping	13
4.4.3 FunctionalGroup identification definition	13
4.5 Topology elements	13
4.5.1 ConnectionPoint definition	13
4.5.2 Communication Device definition	15
4.5.3 Communication service provider definition	16
4.5.4 Network definition	17
4.6 Methods	17
4.6.1 Methods for FDI Communication Servers	17
4.6.2 Methods for Gateways	20
Annex A (normative) Topology Scan result schema	26
A.1 General	26
A.2 Network	26
A.3 ProfibusNetworkT	26
A.4 ProfibusConnectionPointT	26
A.5 ProfibusIdentificationT	27
A.6 ProfibusAddressT	28
Annex B (normative) Transfer service parameters	29
B.1 General	29
B.2 sendData	29
B.3 xsreceiveData	29
B.4 xsTransferSendDataT	29
B.5 TransferResultDataT	30
B.6 OperationT	30

Bibliography.....	31
Figure 1 – Version mapping problem.....	11
Table 1 – ProtocolSupportFile for FDI Device Packages	8
Table 2 – ProtocolSupportFile for FDI Communication Packages	8
Table 3 – PROFIBUS CommunicationProfile definition schema	9
Table 4 – Catalog values for profile devices.....	9
Table 5 – Version mapping examples.....	9
Table 6 – Device identification information mapping.....	11
Table 7 – Protocol type Profibus_DP	12
Table 8 – Protocol type Profibus_PA.....	12
Table 9 – DeviceType property mapping	13
Table 10 – PROFIBUS Device Types identification attributes	13
Table 11 – ConnectionPoint type for Profibus_DP.....	14
Table 12 – ConnectionPoint type for Profibus_PA.....	15
Table 13 – Method Connect arguments.....	18
Table 14 – Method Disconnect arguments.....	18
Table 15 – Method Transfer arguments.....	19
Table 16 – Method SetAddress arguments.....	20
Table 17 – Connect service arguments	21
Table 18 – Method Transfer arguments.....	22
Table 19 – Method SetAddress arguments.....	24
Table A.1 – Elements of ProfibusNetworkT	26
Table A.2 – Attributes of ProfibusConnectionPointT	27
Table A.3 – Elements of ProfibusConnectionPointT	27
Table A.4 – Attributes of ProfibusIdentificationT.....	28
Table B.1 – Attributes of TransferSendDataT.....	30
Table B.2 – Attributes of TransferResultDataT	30

INTERNATIONAL ELECTROTECHNICAL COMMISSION

FIELD DEVICE INTEGRATION (FDI) –**Part 103-1: Profiles – PROFIBUS**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62769-103-1 has been prepared by subcommittee 65E: Devices and integration in enterprise systems, of IEC technical committee 65: Industrial-process measurement, control and automation.

This second edition cancels and replaces the first edition published in 2015. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) support for generic protocol extension for faster adoption of other technologies;
- b) support for Package Developers to build EDDs targeted for today's EDD bases system under a single development tool.

The text of this International Standard is based on the following documents:

CDV	Report on voting
65E/622/CDV	65E/685A/RVC 65E/685/RVC

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 62769 series, published under the general title *Field Device Integration (FDI)*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

<http://webstore.iec.ch/standards/catalogue/iec/62769-103-1-2020>
347bc0537c62/iec-62769-103-1-2020

FIELD DEVICE INTEGRATION (FDI) –

Part 103-1: Profiles – PROFIBUS

1 Scope

This part of IEC 62769 specifies an FDI profile of IEC 62769 for IEC 61784-1_CP 3/1 (PROFIBUS DP)¹ and IEC 61784-1_CP3/2 (PROFIBUS PA)¹.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61804 (all parts), *Function blocks (FB) for process control and Electronic Device Description Language (EDDL)*

IEC 62541-100:2015, *OPC Unified Architecture - Part 100: Device Interface*

IEC 62769-22, *Field Device Integration (FDI) - Part 2: FDI Client*

IEC 62769-4³, *Field Device Integration (FDI) – Part 4: FDI Packages*
<https://standards.iteh.ai/catalog/standards/sist/1c00d0bc-10c8-4412-9434-347bc0537e62/iec-62769-103-1-2020>

IEC 62769-54, *Field Device Integration (FDI) – Part 5: FDI Information Model*

IEC 62769-7⁵, *Field Device Integration (FDI) – Part 7: FDI Communication Devices*

PI Order No.: 2.122:2008, *Specification for PROFIBUS – Device Description and Device Integration – Volume 1: GSD, V5.1, July 2008: GSD*; available at <www.profibus.com> [viewed 2018-11-23]

3 Terms, definitions, abbreviated terms and conventions

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 61784-1, IEC 61804 (all parts), IEC 62541-100, IEC 62769-4, IEC 62769-5, IEC 62769-7 and PI Order No.: 2.122:2008 apply.

¹ PROFIBUS is the trade name of the non-profit consortium PROFIBUS & PROFINET International. This information is given for the convenience of users of this document and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance does not require use of the trade name. Use of the trade name requires permission of the trade name holder.

² Under preparation. Stage at the time of publication: IEC/RFDIS 62769-2:2020.

³ Under preparation. Stage at the time of publication: IEC/RFDIS 62769-4:2020.

⁴ Under preparation. Stage at the time of publication: IEC/RFDIS 62769-5:2020.

⁵ Under preparation. Stage at the time of publication: IEC/RFDIS 62769-7:2020.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.2 Abbreviated terms and acronyms

For the purposes of this document, the following abbreviations apply:

EDD	Electronic Device Description
EDDL	Electronic Device Description Language (see IEC 61804)
GSD	General station description (see PI Order No.: 2.122:2008)
I&M	Identification and maintenance function
UUID	Universally unique identifier (see ISO/IEC 11578)
XML	Extensible markup language (see REC-xml-20081126)

3.3 Conventions

3.3.1 EDDL syntax

This document specifies content for the EDD component that is part of FDI Communication Packages. The specification content using EDDL syntax uses the font `Courier New`. The EDDL syntax is used for method signature, variable, data structure and component declarations.

3.3.2 XML syntax

XML syntax examples use font `Courier New`. The XML syntax is used to describe XML document schema.

Example: `<xs:simpleType name="ExampleType">`

3.3.3 Capitalizations

IEC 62769 (all parts) use capitalized terms to emphasize that these terms have a FDI specific meaning.

Some of these terms using an acronym as a prefix, for example:

- FDI Client, or
- FDI Server.

Some of these terms are compound terms such as:

- Communication Servers, or
- Profile Package.

Parameter names or attributes are concatenated to a single term, where the original terms start in this term with a capital letter such as:

- ProtocolSupportFile, or
- ProtocolType.

Parameter names or attributes can also be constructed by using an underscore character to concatenate two or more terms such as:

- PROFILE_ID, or

- Profibus_PA_Network.

4 Profile for PROFIBUS

4.1 General

This profile document to the FDI specification in IEC 62769 specifies the protocol specifics needed for FDI Packages describing Communication Servers, Gateways and Devices.

For Communication Servers, this document defines also protocol specifics as these need to be considered in the Communication Servers hosted Information Model.

4.2 Catalog profile

4.2.1 Protocol support file

4.2.1.1 FDI Device Package

Protocol specific attachments are mentioned in the Package Catalog as defined in IEC 62769-5. A communication feature list (GSD) file according to PI Order No.: 2.122:2008 is a mandatory attachment for FDI Device Packages representing PROFIBUS DP and PROFIBUS PA devices. Table 1 specifies the parameters of the ProtocolSupportFile in the FDI Device Package.

Table 1 – ProtocolSupportFile for FDI Device Packages

Parameter	Description
Content Type	text/plain
Root Namespace	empty
Source Relationship	http://fdi-cooperation.com/2010/relationship/attachment-protocol
Filename	According to PI Order No.: 2.122:2008

4.2.1.2 FDI Communication Packages

A GSD file as specified in PI Order No.: 2.122:2008 is an optional attachment for FDI Communication Packages representing PROFIBUS DP and PROFIBUS PA devices. Table 2 specifies the parameters of ProtocolSupportFile for FDI Communication Packages.

Table 2 – ProtocolSupportFile for FDI Communication Packages

Parameter	Description
Content Type:	text/plain
Root Namespace:	empty
Source Relationship:	http://fdi-cooperation.com/2010/relationship/attachment-protocol
Filename:	According to PI Order No.: 2.122:2008

4.2.2 CommunicationProfile definition

IEC 62769-4 defines a CommunicationProfileT string for the Catalog XML schema. Table 3 defines the PROFIBUS specific values for this string.

Table 3 – PROFIBUS CommunicationProfile definition schema

Profile Identifier	Protocol
"profibus_dp"	PROFIBUS DP/V0; PROFIBUS DP/V1; PROFIBUS DP/V2
"profibus_pa"	PROFIBUS PA

4.2.3 Profile device

A Profile Package shall provide the catalog values for profile devices, enabling the FDI Server to leverage a generic device description, if a specific one is not available. The definitions in Table 4 focus on catalog content that is vendor independent.

Table 4 – Catalog values for profile devices

Element	Attribute	Content
PackageType	—	Profile
Manufacturer	—	Empty
DeviceModel	—	<p>The allowed profile identifier values (PROFILE_ID) are provided by PROFIBUS & PROFINET International (PI). PI provides and maintains an XML file (Profile_ID_Table) containing the assignment of PROFILE_ID to profiles.</p> <p>It is available at <http://www.profibus.com/IM/Profile_ID_Table.xml> The file can be downloaded by any engineering or service tool whenever it is connected to the Internet.</p> <p>NOTE More information is provided in PI Order No.: 3.502 (I&M Profile) and related profile definitions are referred therein.</p> <p>The string format shall be hexadecimal starting with 0x, e.g. '0x3D00'.</p>

<https://standards.iteh.org/catalog/standards/sist/1c00d0bc-10c8-4412-9434-347bc0537c62/iec-62769-103-1-2020>

4.2.4 Protocol version information

IEC 62769-4 defines an element type named InterfaceT for the Catalog XML schema. The element type InterfaceT contains an element named Version which is supposed to provide version information about the applied communication protocol profile. The value has to follow the IEC 62769-4 defined version information schema defined in the element type VersionT. Table 5 describes how to apply the currently known protocol versions defined by the non-profit consortium PROFIBUS & PROFINET International. The general rule is to apply the value "0" for parts of the version information according to IEC 62769-4 that are not used in currently known protocol versions.

Table 5 – Version mapping examples⁶

Protocol / Version	InterfaceT Version value
PROFIBUS DP/V0	0.0.0 ^a
PROFIBUS DP/V1	1.0.0 ^a
PROFIBUS DP/V2	2.0.0 ^a
PROFIBUS PA 3.02	3.2.0 ^b
<p>^a The protocols PROFIBUS DP/V0, PROFIBUS DP/V1 and PROFIBUS DP/V2 contain a single number. This number is considered to be the major version. The minor and built numbers are set to "0".</p> <p>^b The currently known PROFIBUS PA profile number is considered to provide major and minor version information. Leading zeros are not considered in version value evaluation since only the actual decimal values are relevant.</p>	

⁶ The given table can be considered to be an example only since this document cannot foresee how future protocol versions will be defined.

4.3 Associating a Package with a device

4.3.1 Device type identification mapping

The purpose of device type identification mapping is to enable FDI host systems to compare the scan result against the topology representation in the Information Model. FDI host systems shall also be enabled to determine the FDI Device Package that fits for a device entry contained in the scan result. This will enable the user of an FDI host system to synchronize the Information Model with the actual installation.

The Communication Server implemented scan service (defined in 4.6.1.7) provides the scan result through an XML document (the schema is defined in Clause A.5).

The Gateway implemented scan service (defined in 4.6.2.7) provides the scan result by means of the Information Model that contains data structures created from EDD content as specified in 4.6.2.7.

Common for both ways of presenting the scan result is that scan results contain device type identification and device instance identification.

FDI host systems comparing the actual network topology configuration against the topology representation in the Information Model shall be enabled to handle the following situations:

- c) The physical Device instance identified at a specific device address is not logically present in the Information Model (as Instance): Enable the FDI Host system to find the appropriate FDI Device package according to the device catalog information.
- d) The physical Device instance identified by the device address is logically present in the Information Model (as Instance): Enable the FDI Host system to compare device type information presented in scan result (see the identification in Clause A.5) and the device type specific information of the Instance present in the Information Model.

The FDI Device package contains device type identification information that can be compared to scan result based on the Catalog Schema in IEC 62769-4 defining the XML (simple) element types “DeviceModel” and “Manufacturer”. Both types are used in the (complex) element types “Protocol” and “RegDeviceType”.

As a result of the FDI Package deployment the FDI Package information is then present in the Information Model as the specified FunctionalGroup Identification containing Ident_Number and Manufacturer_ID (see 4.4.3). The Ident_Number matches with the GSD specified Ident_Number. Manufacturer_ID is specified through the I&M profile defined VendorID and DeviceID (see 4.4.3).

The mapping between different device identification data sources is described in Table 6. Since scan results provided by the Communication Server or Gateway can convey data that is produced by the device (firmware) the device type identification mapping shall be supported by providing corresponding data in the FDI Device Package contained Catalog and Information Model.

Table 6 – Device identification information mapping

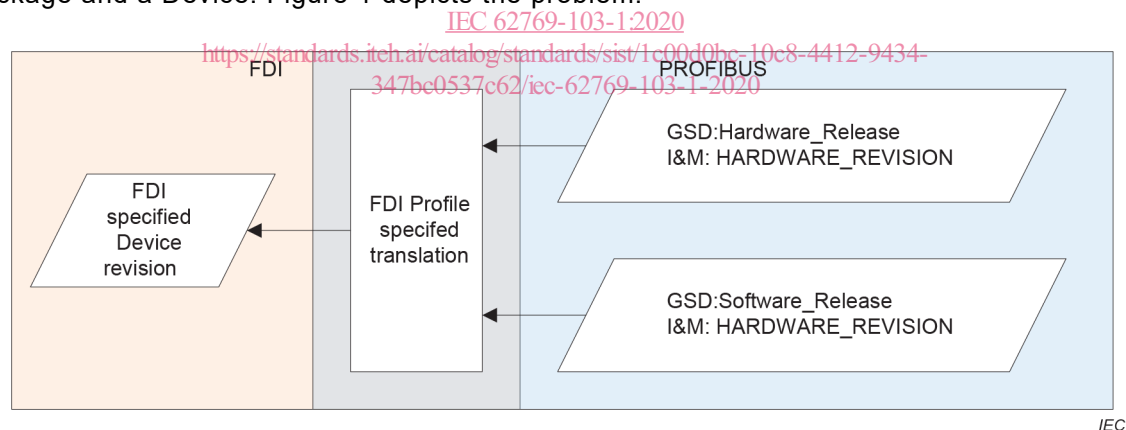
FDI Device Package	Information Model	Communication Server provided scan result	Gateway provided scan result
Catalog specified type Manufacturer	FunctionalGroup: Identification Browse Name: Manufacturer_ID	Element (path): ConnectionPoint/Identification Attribute: Manufacturer_ID	COLLECTION ConnectionPoint. Identification. Manufacturer_ID
Catalog specified type DeviceModel	FunctionalGroup: Identification Browse Name: Ident_Number	Element (path): ConnectionPoint/Identification Attribute: Ident_Number	COLLECTION ConnectionPoint. Identification. Ident_Number

4.3.2 Device type revision mapping

IEC 62769-4 envisions a concept that allows to determine the compatibility between an FDI Device Package and a Device. IEC 62769-4 specifies a life cycle management process bearing on a single version information provided for the entire device.

NOTE PROFIBUS related specifications, for example PI Order No.: 2.122:2008 (GSD) and PI Order No.: 3.502:2009 (I&M) splits the device type revision into software and hardware related information. The GSD specifies the attributes Hardware_Release and Software_Release. The I&M specifies HARDWARE_REVISION and SOFTWARE_REVISION. Hardware_Release and HARDWARE_REVISION will always match. Software_Release and SOFTWARE_REVISION will always match.

The goal of 4.3.2 is to describe the translation between PROFIBUS related specifications, describing their way of providing the version information, and the IEC 62769-4 specified way of containing the version information that can be compared against the version read from the device. The purpose is to determine the compatibility between an FDI Device Package and a Device. Figure 1 depicts the problem.

**Figure 1 – Version mapping problem**

The firmware of a device implements the data exchange interface which shall be described by means of the FDI Device Package content (EDD). A device firmware that implements the PROFIBUS PA profile enables the reading of the values SOFTWARE_REVISION and HARDWARE_REVISION. The access to these values shall be described in the EDD contained in the FDI Device Package.

Firmware modifications that affect the firmware implemented data exchange interface shall be reflected in the FDI Device Package. Such firmware and device description modification shall be visible in the SOFTWARE_REVISION and Software_Release.

Hardware related modifications shall be captured in the HARDWARE_REVISION and Hardware_Release. Hardware related modifications do not necessarily always require a firmware update. Thus HARDWARE_REVISION and Hardware_Release cannot be used to determine compatibility between a device and the FDI Device Package. But if a hardware

modification requires firmware modifications both `HARDWARE_REVISION` and `SOFTWARE_REVISION` shall be changed. `Hardware_Release` and `Software_Release` shall be changed accordingly.

The IEC 62769-4 specifies the Catalog schema and an element `DeviceVersion` which is used in the element type declaration `ListOfSupportedDeviceVersions`. The value of the `DeviceVersion` shall be compared to the device provided `SOFTWARE_REVISION` or the GSD provided `Software_Release` in order to determine the compatibility between an FDI Device Package and a device.

The data format for the `SOFTWARE_REVISION` is a string while the `DeviceVersion` expects three numbers for major, minor, and revision. Therefore the following rules apply: If the string has the format `<integer>.<integer>.<integer>` this is transferred to major, minor, and revision (in the same order). `<integer>` references to simple integer number in the string such as '1' or '12', not to other representations such as hexadecimal format (e.g. `0x001A`). If `<integer>.<integer>` is provided, this is transferred to major and minor and '0' is used for revision. If only an `<integer>` is provided, this is transferred to major and '0' is used for minor and revision. A leading character or a leading character and whitespace shall be ignored. For a string in any other format, the revision number shall not be considered to select the correct FDI package.

4.4 Information Model mapping

4.4.1 ProtocolType definition

The concept to derive PROFIBUS DP and PROFIBUS PA specific Network Types applies to the protocol type definition.

The protocol type `Profibus_DP` shall be used to identify the PROFIBUS DP communication. The type `Profibus_DP` is a sub type of the abstract type `ProtocolType` in IEC 62541-100. Table 7 specifies the allowed values of the `ProtocolType` attributes for the protocol type `Profibus_DP`.

Table 7 – Protocol type Profibus_DP

Attribute	Value				
BrowseName	Profibus_DP				
IsAbstract	False				
References	NodeClass	BrowseName	Data Type	TypeDefinition	ModellingRule
Subtype of the ProtocolType defined in IEC 62541-100.					

The network type `Profibus_PA_Network` shall be used to build PROFIBUS PA network topologies. The type `Profibus_DP_Network` is a sub type of the abstract type `NetworkType` in IEC 62541-100. Table 8 specifies the allowed values of the `ProtocolType` attributes for the protocol type `Profibus_PA`.

Table 8 – Protocol type Profibus_PA

Attribute	Value				
BrowseName	Profibus_PA				
IsAbstract	False				
References	NodeClass	BrowseName	Data Type	TypeDefinition	ModellingRule
Subtype of the ProtocolType defined in IEC 62541-100.					

4.4.2 DeviceType mapping

The DeviceType property mapping of the DeviceType node is defined in Table 9.

Table 9 – DeviceType property mapping

Property	PROFIBUS Mapping
SerialNumber	SERIAL_NUMBER (see Table 10)
RevisionCounter	REV_COUNTER (see Table 10)
Manufacturer	String taken from FDI package catalog (ManufacturerName from PackageT)
Model	String taken from FDI package catalog (Name of DeviceTypeT, which is a localized name)
DeviceRevision	Not supported
DeviceManual	Not supported
SoftwareRevision	SOFTWARE_REVISION (see Table 10)
HardwareRevision	HARDWARE_REVISION (see Table 10)

4.4.3 FunctionalGroup identification definition

As defined in IEC 62541-100:2015, 5.3, each device representation in the FDI Server hosted Information Model shall contain a protocol specific FunctionalGroup named Identification. The Parameters of this FunctionalGroup are defined for PROFIBUS devices types as follows:

Table 10 – PROFIBUS Device Types identification attributes

BrowseName	DataType	Mandatory/Optional
Ident_Number	UInt16	Mandatory
MANUFACTURER_ID	UInt16	Mandatory
ORDER_ID	String	Optional
SERIAL_NUMBER	String	Optional
HARDWARE_REVISION	UInt16	Optional
SOFTWARE_REVISION	String	Optional
REV_COUNTER	UInt16	Optional
PROFILE_ID	UInt16	Optional
PROFILE_SPECIFIC_TYPE	UInt16	Optional
IM_VERSION	ByteString	Optional
IM_SUPPORTED	UInt16	Optional

The BaseDataVariable instances, except Ident_Number, shall be created from VARIABLE declarations with identifiers that correspond to the browse names listed in Table 10. The BaseDataVariable instances Ident_Number shall be created from the GSD file attribute Ident_Number.

4.5 Topology elements

4.5.1 ConnectionPoint definition

In order to support different network topology engineering needs related to different physical layers used by PROFIBUS DP and PROFIBUS PA, two different ConnectionPoint types shall be defined.