

TECHNICAL REPORT

IEC TR 61000-1-4

First edition
2005-05

Electromagnetic compatibility (EMC) –

Part 1-4:

General – Historical rationale for the limitation of power-frequency conducted harmonic current emissions from equipment, in the frequency range up to 2 kHz

(<https://standards.iteh.ai>)
Document Preview

IEC TR 61000-1-4:2005

<https://standards.iteh.ai/catalog/standards/iec/c2b57e48-77be-4342-89a5-7909555bc2a5/iec-tr-61000-1-4-2005>



Reference number
IEC/TR 61000-1-4:2005(E)

Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** (www.iec.ch)

- **Catalogue of IEC publications**

The on-line catalogue on the IEC web site (www.iec.ch/searchpub) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.

- **IEC Just Published**

This summary of recently issued publications (www.iec.ch/online_news/justpub) is also available by email. Please contact the Customer Service Centre (see below) for further information.

- **Customer Service Centre**

If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: custserv@iec.ch
Tel: +41 22 919 02 11
Fax: +41 22 919 03 00

TECHNICAL REPORT

IEC TR 61000-1-4

First edition
2005-05

Electromagnetic compatibility (EMC) –

Part 1-4:

General – Historical rationale for the limitation of power-frequency conducted harmonic current emissions from equipment, in the frequency range up to 2 kHz

(<https://standards.iteh.ai>)
Document Preview

IEC TR 61000-1-4:2005

<https://standards.iteh.ai/catalog/standards/iec/c2b57e48-77be-4342-89a5-7909555bc2a5/iec-tr-61000-1-4-2005>

© IEC 2005 — Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembé, PO Box 131, CH-1211 Geneva 20, Switzerland
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: inmail@iec.ch Web: www.iec.ch



Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

PRICE CODE

X

For price, see current catalogue

CONTENTS

FOREWORD.....	4
INTRODUCTION.....	6
1 Scope.....	7
2 Normative references	7
3 Definitions	8
4 General appraisal.....	8
5 Acceptable provisions in standards related to regulatory legislation.....	9
6 History of IEC 61000-3-2 and its predecessors	10
6.1 Before 1960	10
6.2 1960 to 1975	10
6.3 1975 to 1982	11
6.4 1982 to 1995	11
6.5 1995 to 2000	13
6.6 The 'Millennium Amendment'.....	14
6.7 Future development of IEC 61000-3-2	14
7 History of IEC 61000-3-12 and its predecessor	14
7.1 1989 to 1998	14
7.2 After 1998	15
8 Economic considerations taken into account in setting limits in IEC 61000-3-2 before publication in 1995, and before the finalization of the text of the Millennium Amendment.....	15
Annex A (informative) Compatibility level and compensation factor.....	16
Annex B (informative) Comparison of Class A limits and the harmonic spectra of phase-controlled dimmers of incandescent lamps at 90° firing angle.....	20
Annex C (informative) Comparison of Class C (Table 2 of IEC 61000-3-2) limits and the harmonic spectrum of a discharge lamp with inductive ballast.....	21
Annex D (informative) Comparison of Class D limits and the harmonic spectra of capacitor-filtered single-phase rectifiers with 35° and 65° conduction angles	22
Annex E (informative) Economic considerations taken into account in setting limits, before finalization of the text of the Millennium Amendment to IEC 61000-3-2	23
Annex F (Informative) Concept plan for the full revision of IEC 61000-3-2.....	25
Annex G (informative) Derivation of the limits in IEC 61000-3-12	27
Annex H (informative) Explanation of the reasons for using the concepts of total harmonic distortion (THD) and partial weighted harmonic distortion (PWHD)	39
Bibliography.....	41
Figure 1 – Diagram showing compatibility level in relation to disturbance and immunity levels	9
Figure A.1 – Allocation of harmonic voltage drops over the transformer impedances in a typical system.....	17
Figure B.1 – Comparison of Class A limits and spectra of dimmers	20
Figure C.1 – Comparison of Class C limits and the harmonic spectrum of a discharge lamp	21

Figure D.1 – Comparison of Class D limits and harmonic spectra of single-phase 230 W rectifiers with capacitor filters	22
Figure E.1 – Illustration of the concept of total aggregate cost trade-offs for meeting compatibility levels.....	24
Figure H.1a – Diagram of a LV system consisting of a transformer, a busbar and n equal feeders.....	40
Figure H.1b – Equivalent circuit for the LV system with "fictitious" feeders.....	40
Figure H.2 – Relative total distortion weight "tdw" as a function of the short-circuit ratio R_{sce}	40
Table A.1 – Compensation factors $k_{p,h}$	18
Table A.2 – Sub-factors of $k_{p,h}$	19
Table G.1 – Relative total distortion weight depending on the point x where the distorting load is connected	31
Table G.2 – Comparison of limit values of IEC 61000-3-12 (columns 2 and 4) with the approximation by equation (8) (columns 3 and 5).....	32
Table G.3 – Compatibility levels.....	35
Table G.4 – Maximum harmonic currents and voltages for one piece of single phase equipment (from Table 2 of IEC 61000-3-12)	35
Table G.5 – Maximum harmonic currents and voltages for one piece of balanced three phase equipment (from Table 3 of IEC 61000-3-12).....	36
Table G.6 – Maximum harmonic currents and voltages for one piece of balanced three phase equipment (from Table 4 of IEC 61000-3-12).....	36
Table G.7 – Maximum harmonic currents and voltages for n pieces of single phase equipment (from Table 2 of IEC 61000-3-12).....	36
Table G.8- Maximum harmonic currents and voltages for n pieces of balanced three phase equipment (from Table 3 of IEC 61000-3-12):.....	37
Table G.9 – Maximum harmonic currents and voltages for n pieces of balanced three phase equipment (from Table 4 of IEC 61000-3-12):.....	37
Table G.10 – Maximum harmonic currents and voltages for n pieces of single phase equipment (from Table 2 of IEC 61000-3-12):	37
Table G.11- Maximum harmonic currents and voltages for n pieces of balanced three phase equipment (from Table 3 of IEC 61000-3-12):.....	38
Table G.12 – Maximum harmonic currents and voltages for n pieces of balanced three phase equipment (from Table 4 of IEC 61000-3-12):.....	38

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ELECTROMAGNETIC COMPATIBILITY (EMC) –**Part 1-4: General – Historical rationale for the limitation
of power-frequency conducted harmonic current emissions
from equipment, in the frequency range up to 2 kHz**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a technical report when it has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

IEC 61000-1-4, which is a technical report, has been prepared by subcommittee 77A: Low frequency phenomena, of IEC technical committee 77: Electromagnetic compatibility.

The text of this technical report is based on the following documents:

DTR	Report on voting
77A/477/DTR	77A/481/RVC

Full information on the voting for the approval of this technical report can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

Withdrawing

iTech Standards
(<https://standards.itih.ai>)
Document Preview

IEC TR 61000-1-4:2005
<https://standards.itih.ai/catalog/standards/iec/c2b57e48-77be-4342-89a5-7909555bc2a5/iec-tr-61000-1-4-2005>

INTRODUCTION

IEC 61000 is published in separate parts according to the following structure:

Part 1: General

General considerations (introduction, fundamental principles)
Definitions, terminology

Part 2: Environment

Description of the environment
Classification of the environment
Compatibility levels

Part 3: Limits

Emission limits
Immunity limits
(in so far as they do not fall under the responsibility of product committees)

Part 4: Testing and measurement techniques

Measurement techniques
Testing techniques

Part 5: Installation and mitigation guidelines

Installation guidelines
Mitigation methods and devices

Part 6: Generic standards

Part 9: Miscellaneous

Each part is further subdivided into several parts published either as International Standards or as technical specifications or technical reports, some of which have already been published as sections. Others will be published with the part number followed by a dash and a second number identifying the subdivision (example: IEC 61000-6-1).

ELECTROMAGNETIC COMPATIBILITY (EMC) –

Part 1-4: General – Historical rationale for the limitation of power-frequency conducted harmonic current emissions from equipment, in the frequency range up to 2 kHz

1 Scope

This part of IEC 61000, which is an IEC technical report, reviews the sources and effects of power frequency conducted harmonic current emissions in the frequency range up to 2 kHz on the public electricity supply, and gives an account of the reasoning and calculations leading to the *existing* emission limits for equipment in the editions of IEC 61000-3-2, up to and including the second edition (2000) and its first amendment (2001), and in the first edition of IEC 61000-3-12 (2004).

The concepts in this technical report apply to all low voltage AC systems, but the numerical values apply specifically to the European 230 V/400 V 50 Hz system.

NOTE A rationale for the limits in future complete revisions of IEC 61000-3-2 or IEC 61000-3-12 or both will be included in a new technical report.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61000-2-2:2002¹⁾, *Electromagnetic compatibility (EMC) – Part 2-2: Environment – Compatibility levels for low-frequency conducted disturbances and signalling in public low-voltage power supply systems*

IEC 61000-3-2:2000²⁾, *Electromagnetic compatibility (EMC) – Part 3-2: Limits – Limits for harmonic current emissions (equipment input current ≤ 16 A per phase)³⁾*
Amendment 1 (2001)

IEC 61000-3-3:1994, *Electromagnetic compatibility (EMC) – Part 3-3: Limits – Limitation of voltage fluctuations and flicker in public low-voltage supply systems for equipment with rated current ≤ 16 A⁴⁾*
Amendment 1 (2001)

1) This technical report also refers to the first edition of IEC 61000-2-2 (1990), *Electromagnetic compatibility (EMC) – Part 2: Environment – Section 2: Compatibility levels for low-frequency conducted disturbances and signalling in public low-voltage power supply systems*, since superseded by the second edition of that publication.

2) This technical report also refers to the first edition of IEC 61000-3-2 (1995), *Electromagnetic compatibility (EMC) – Part 3: Limits – Section 2: Limits for harmonic current emissions (equipment input current ≤ 16 A per phase)*, and its Amendment 1 (1995), since superseded by the second edition and its amendments of that publication.

3) A consolidated edition 2.2 exists, which includes IEC 61000-3-2:2000 and its Amendments 1 (2001) and 2 (2004).

4) A consolidated edition 1.1 exists, which includes IEC 61000-3-3:1994 and its Amendment 1 (2001), *Electromagnetic compatibility (EMC) – Part 3-3: Limits – Limitation of voltage changes, voltage fluctuations and flicker in public low-voltage supply systems, for equipment with rated current ≤ 16 A per phase and not subject to conditional connection*

IEC 61000-3-4, *Electromagnetic compatibility (EMC) – Part 3-4: Limits – Limitation of emission of harmonic currents in low-voltage power supply systems for equipment with rated current greater than 16 A*

IEC 61000-3-6, *Electromagnetic compatibility (EMC) – Part 3: Limits – Section 6: Assessment of emission limits for distorting loads in MV and HV power systems*

IEC 61000-3-11, *Electromagnetic compatibility (EMC) – Part 3-11: Limits – Limitation of voltage changes, voltage fluctuations and flicker in public low-voltage supply systems – Equipment with rated current ≤ 75 A and subject to conditional connection*

IEC 61000-3-12, *Electromagnetic compatibility (EMC) – Part 3-12: Limits for harmonic currents produced by equipment connected to public low-voltage systems with input current > 16 A and ≤ 75 A per phase*

IEC 61000-4-13, *Electromagnetic compatibility (EMC) – Part 4-13: Testing and measurement techniques – Harmonics and interharmonics including mains signalling at a.c. power port, low frequency immunity tests*

3 Definitions

Definitions of terms used in this technical report can be found in other publications in the IEC 61000 series.

4 General appraisal

The electricity supply industry intends to supply electric power with a sinusoidal voltage waveform, and customers' equipment is designed to operate correctly on such a supply. However, because the internal impedance of the supply system is not zero, a non-linear load connected by one customer produces distortion of the voltage waveform that may adversely affect another customer's equipment, as well as equipment in the supply system itself. There is no type of load or supply system equipment that is totally immune to distortion of the voltage waveform, although 'natural' immunity levels (those achieved by customary designs without special attention to improving immunity) vary greatly. Based largely on experience of the amounts of voltage distortion that give rise to evidence of malfunction of, or damage to, equipment, compatibility levels of voltage distortion for the low-voltage (LV) public supply system have been determined and are given in IEC 61000-2-2. The correspondences between these levels and other values are shown schematically in Figure 1. See Annex A of IEC 61000-2-2 from which that figure is taken. Compatibility levels are set as an acceptable compromise between immunity to harmonics and reduction of emissions. Methods to check that the immunity of equipment to voltage distortion is adequate are given in IEC 61000-4-13.

NOTE For the purposes of this technical report, the compatibility levels in the first edition of IEC 61000-2-2 apply.

The intention of applying limits on the harmonic current emissions of equipment connected to the public low-voltage (LV) system is to keep the actual levels of voltage distortion on the system below the compatibility levels for a very large proportion of the time, and below lower levels, known as planning levels, for a lesser but still large proportion of the time. (See Figure 1.)

NOTE 1 Emissions into the medium-voltage (MV) and high voltage (HV) systems can be controlled by other methods and procedures. See IEC 61000-3-6.

NOTE 2 In some countries, the electricity supply industry places reliance on IEC 61000-3-2 to control emissions from portable equipment, whether the point of common coupling is at LV, MV or HV.

Emissions from equipment are expressed as currents, because these are largely, but not completely, independent of the source impedance of the supply system, whereas the voltage distortion produced by the equipment is almost proportional to the supply-system impedance and therefore has no definite value. A product that draws a non-linear current from the supply system may alternatively be regarded as drawing a sinusoidal current, while emitting into the supply system harmonic currents of the opposite polarity to those that it actually draws.

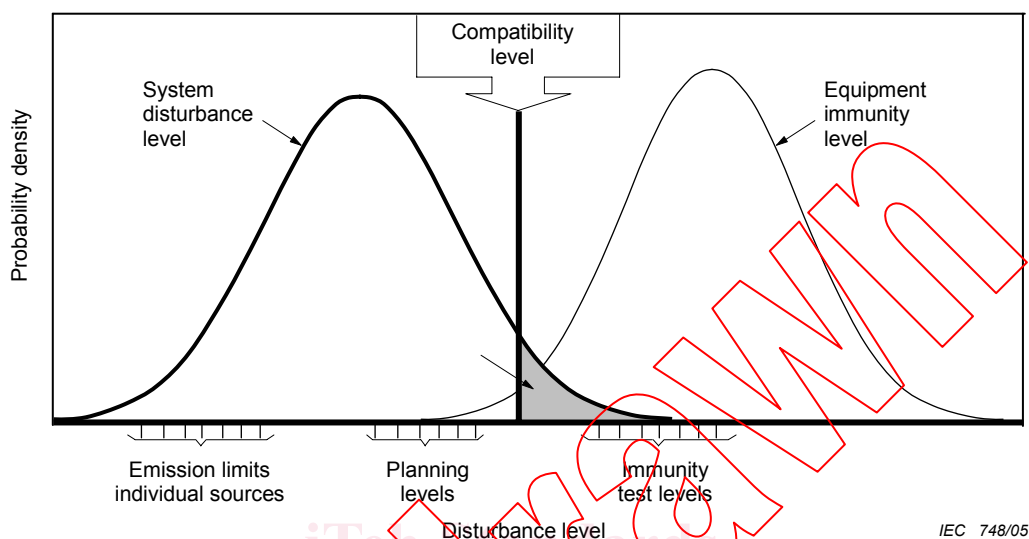


Figure 1 – Diagram showing compatibility level in relation to disturbance and immunity levels

5 Acceptable provisions in standards related to regulatory legislation

The equipment manufacturing industry can accept requirements in a voluntary standard, whose application may be determined by custom or moderated during individual contract negotiations, that would be unacceptable in a standard backed by regulatory enforcement. For example, a standard may contain provisions that, if fully applied, would result in very long test times. Parties to a contract might waive these provisions, wholly or partly (calculation or simulation might be employed, for example) whereas in an enforcement situation, no deviation from the provisions might be allowed.

Both 7.1 of EN 50006 and 5.3.1 of IEC (60)555-2⁵⁾ required the test operator to search for worst-case conditions using the controls of the equipment under test, and in IEC (60)555-2, this was required for each harmonic in turn. Such a test might well take many days, with no assurance that another test operator might not find a different worst-case condition for just one harmonic. Such a provision was also contained in clause C.1 of IEC 61000-3-2:1995 and was not removed until the publication of Amendment 1 to IEC 61000-3-2:2000.

A standard must not include regulatory requirements: it is concerned only with the procedures necessary to determine whether a product within its scope meets its requirements.

5) IEC (60)555-2 was withdrawn in 1995 and replaced by IEC 61000-3-2.

6 History of IEC 61000-3-2 and its predecessors

6.1 Before 1960

The most numerous non-linear loads were television receivers with half-wave rectifiers. Because most of these had mains connectors of reversible polarity, the d.c. components approximately cancelled. The number of receivers installed was insufficient to create any significant system problems due to harmonic current emissions, but there is evidence that there was enough random unbalance of polarity of connection in some countries for the resultant d.c. component to cause corrosion problems in underground cables.

6.2 1960 to 1975

Phase-controlled dimmers for household lighting began to be marketed. These created high-frequency conducted emissions, thus initially drawing the attention of radio-spectrum protection authorities. Measures to limit these emissions could be made mandatory, but it was also noted that the dimmers produced harmonic currents and there was no practicable way of reducing the ratios of harmonic to fundamental current.

A system survey in Europe determined the 90th percentile value for supply impedance for residential customers (who were mostly fed by overhead LV distribution) as $(0,4 + jh0,25)$ ohms, where h is the harmonic order, and this value was included in IEC 60725. In addition it was determined that without some control of emissions from dimmers, the voltage distortion might grow to exceed acceptable levels (later to be called 'compatibility levels').

NOTE There is no direct relationship between compatibility levels and emission limits generally. Further information on this subject can be found in Annex A.

The first standard on this subject (according to its own text it is not based on any previous standard) was the European standard EN 50006 of 1975, implemented as various national standards including BS 5406:1976. This standard took burst-firing techniques into account and also covered voltage fluctuations, now the subject of IEC 61000-3-3 and IEC 61000-3-11. Limitation of harmonic current emissions was achieved by:

- prohibiting the use of phase control for heating loads over 200 W;
- applying limits for odd-harmonic emissions;
- applying limits for even-harmonic emissions to both symmetrical and asymmetrical control techniques.

The limits were expressed as voltage-harmonic percentages, produced with a supply system whose impedance (for single-phase loads) was $(0,4 + jh0,25)$ ohms. However, the test procedure actually required measurement of the harmonic currents, from which the voltage distortions were calculated. The standard does not include any explanation of the derivation of the limits, which are preserved as the Class A limits in IEC 61000-3-2, up to the 2000 edition. In fact, the numerical values were undoubtedly established piecemeal by negotiation between supply industry and equipment manufacturer experts. The retention of a strict mathematical rule for determining the values would not have been a priority for either group.

There was, however, a study that led to an approximate algorithm for determining the cumulative contribution of many dimmers set at different firing angles to a net voltage distortion level at the terminals of the LV transformer feeding the final distribution. (See also Annex A.)