

TECHNICAL SPECIFICATION



**Distributed energy resources connection with the grid –
Part 1: General requirements**

(<https://standards.iteh.ai>)

Document Preview

[IEC TS 62786-1:2023](https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023)

<https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023>



THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2023 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.



IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

International
Standards
Document Preview
standards.iteh.ai

www.iec.ch
standards.iteh.ai
<https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023>

<https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023>

TECHNICAL SPECIFICATION



**Distributed energy resources connection with the grid –
Part 1: General requirements**

iteh Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC TS 62786-1:2023](https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023)

<https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.240.01

ISBN 978-2-8322-7927-4

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	5
1 Scope and object.....	7
2 Normative references	7
3 Terms, definitions and abbreviated terms	8
3.1 Terms and definitions.....	8
4 Requirements for generating plants	14
4.1 General.....	14
4.2 Connection scheme	14
4.3 Choice of switchgear.....	14
4.3.1 General	14
4.3.2 Interface switch	15
4.4 Normal operating range	15
4.4.1 General	15
4.4.2 Operating frequency range	15
4.4.3 Operating voltage range	15
4.5 Immunity to disturbances	16
4.5.1 General	16
4.5.2 Rate of change of frequency (ROCOF) immunity	16
4.5.3 Undervoltage ride through (UVRT) requirements	18
4.5.4 Overvoltage ride through (OVRT) requirements	19
4.5.5 Rapid phase angle change immunity.....	20
4.6 Active power response to frequency deviation.....	21
4.7 Power response to voltage changes.....	21
4.7.1 General	21
4.7.2 Voltage support by reactive power	21
4.7.3 Reactive power control modes	22
4.7.4 Voltage related active power control	22
4.7.5 Voltage related reactive power response	23
4.7.6 Additional reactive current requirements on generating plants	24
4.8 EMC and power quality	29
4.8.1 General	29
4.8.2 Direct current (DC) injection	29
4.9 Interface protection.....	29
4.9.1 General	29
4.9.2 Requirements on voltage and frequency protection.....	31
4.9.3 Means to detect islanding situation	32
4.9.4 Digital input to the interface protection.....	33
4.10 Connection and starting to generate electrical power	33
4.10.1 General	33
4.10.2 Connection of synchronous-type generators	33
4.10.3 Autoreclose of distribution lines	33
4.11 Ceasing and reduction of active power on set point.....	33
4.12 Remote information exchange.....	34
4.12.1 General	34
4.12.2 Monitoring and control	34
4.12.3 Communication.....	34

4.13	Requirements regarding single fault tolerance of interface protection system and interface switch	35
5	Conformance tests	35
Annex A (normative)	Operating frequency range	36
Annex B (normative)	Operating voltage range	37
Annex C (normative)	Undervoltage ride through capability of DER	38
Annex D (normative)	Overvoltage ride through parameters	39
Annex E (informative)	Reactive power control behaviour of DC to AC power conversion equipment used in DER in conjunction with synchronous generators	40
E.1	Background	40
E.2	Power system with DER configuration	40
E.3	Reactive power directions with leading/lagging of current phase angle to voltage phase	40
E.4	Reactive power control of synchronous generators	41
E.5	Reactive power control of power conversion equipment	42
E.6	Reactive power effect as reactive and capacitive load	42
E.7	Conclusion	43
Annex F (normative)	Summary of power thresholds to be defined by individual countries	44
Bibliography	45
Figure 1	– Example of electricity generating plant connected to a network (schematic view of switches)	12
Figure 2	– Under frequency ride through capability requirements of DER	17
Figure 3	– Over frequency ride through capability requirements of DER	17
Figure 4	– Instantaneous frequency change ride through requirement of DER	18
Figure 5	– Under voltage ride through capability requirements of DER	18
Figure 6	– Power recovering requirements for UVRT operation of DER (example)	19
Figure 7	– Over voltage ride through capability	20
Figure 8	– Example of instantaneous voltage phase angle change during UVRT	20
Figure 9	– Typical power-frequency response curve	21
Figure 10	– Typical volt-watt response curve	23
Figure 11	– Typical volt-var response curve	24
Figure 12	– Principle of voltage support during faults and voltage steps (DBL: lower deadband limit; DBH: higher deadband limit)	27
Figure 13	– Accuracy requirement for additional reactive current in positive and negative sequence (LTR: limit of tolerance range)	28
Figure 14	– Operation of protection functions	32
Figure E.1	– Configuration schematic of a power system	40
Figure E.2	– Reactive and active power control image of synchronous generators and DER	42
Table 1	– Operating frequency requirements of DER	15
Table 2	– Operating voltage requirements of DER	16
Table 3	– Volt watt mode parameters (example)	22
Table 4	– volt-var response set-point values for reference voltages (example)	23
Table 5	– Interface protection functions	30

Table A.1 – Continuous operating frequency range 36

Table A.2 – Limited operating frequency range 36

Table B.1 – Continuous operating POC voltage range..... 37

Table B.2 – Limited operating voltage range 37

Table C.1 – UVRT capability of DER with an interface to the grid based on a synchronous generator 38

Table C.2 – UVRT capability of DER with an interface to the grid based on non-synchronous generators (eg. converters, DFIG, etc.) 38

Table D.1 – OVRT capability of DER..... 39

Table E.1 – Operation and behaviours of synchronous generators, dispersed loads and DER43

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC TS 62786-1:2023](https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023)

<https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023>

INTERNATIONAL ELECTROTECHNICAL COMMISSION

DISTRIBUTED ENERGY RESOURCES CONNECTION WITH THE GRID –**Part 1: General requirements**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at <https://patents.iec.ch>. IEC shall not be held responsible for identifying any or all such patent rights.

IEC TS 62786-1 has been prepared by IEC Technical Committee 8: System aspects of electrical energy supply. It is a Technical Specification.

The text of this Technical Specification is based on the following documents:

Draft	Report on voting
8/1656/DTS	8/1677/RVDTS

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this Technical Specification is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.

A list of all parts in the IEC 62786 series, published under the general title *Distributed energy resources connection with the grid*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The "colour inside" logo on the cover page of this document indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

ITeH Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC TS 62786-1:2023](https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023)

<https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023>

DISTRIBUTED ENERGY RESOURCES CONNECTION WITH THE GRID –

Part 1: General requirements

1 Scope and object

This part of IEC 62786, which is a Technical Specification, provides principles and general technical requirements for distributed energy resources (DER) connected to an electric power network (in the following: the "network"). It applies to the planning, design, operation and connection of DER to networks. It includes general requirements, connection scheme, choice of switchgear, normal operating range, immunity to disturbances, active power response to frequency deviations, reactive power response to voltage changes, EMC and power quality, interface protection, connection and start to generate electrical power, active power management, monitoring, control and communication, and conformance tests.

It is supplemented by additional parts of IEC 62786 series, covering specific aspects.

This document specifies interface and interoperability requirements for connection of DER to a network operating at a nominal frequency of 50 Hz or 60 Hz. These requirements are intended for application at the point of connection (POC) of the DER to the grid. In some situations, the requirements can be applied at the AC terminals of the generator. Additional parts of IEC 62786 provide more specific requirements.

DER include distributed generation and electrical energy storage in the form of synchronous generators, asynchronous generators, power converters, etc., connected to the medium voltage (MV) or low voltage (LV) network.

2 Normative references

[IEC TS 62786-1:2023](https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023)

<https://standards.iteh.ai/catalog/standards/sist/3ccfecb3-e776-47c7-969d-e40fa529f353/iec-ts-62786-1-2023>

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60255-12, *Electrical relays – Part 12: Directional relays and power relays with two input energizing quantities*

IEC 60255-127, *Measuring relays and protection equipment – Part 127: Functional requirements for over/under voltage protection*

IEC 60255-151, *Measuring relays and protection equipment – Part 151: Functional requirements for over/under current protection*

IEC 60255-181, *Measuring relays and protection equipment – Part 181: Functional requirements for frequency protection*

IEC 61000 (all parts), *Electromagnetic compatibility (EMC)*

IEC 61850 (all parts), *Communication networks and systems for power utility automation*

IEC 62116, *Utility-interconnected photovoltaic inverters – Test procedure of islanding prevention measures*

IEC TS 62749, *Assessment of power quality – Characteristics of electricity supplied by public networks*

3 Terms, definitions and abbreviated terms

3.1 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1.1

black start

startup of an electric power system from a blackout through internal energy resources

3.1.2

converter-type generator

generator that produces electrical power and is connected to the network via a converter, including doubly fed induction machines

3.1.3

declared supply voltage

U_C

supply voltage agreed by the power system operator and the network user

Note 1 to entry: Generally declared supply voltage U_C is the nominal voltage U_n but it may be different according to the agreement between the DSO and the network user.

3.1.4

distributed energy resource

DER

generators (with their unit auxiliaries, protection and connection equipment), including loads having a generating mode (such as electrical energy storage systems), connected to a low voltage or a medium-voltage network

[SOURCE: IEC 60050-617:2017, 617-04-20, modified – unit has been added.]

3.1.5

distribution network

electric power network for the distribution of electric power from and to network users for which a distribution system operator (DSO) is responsible

3.1.6

distribution system operator

DSO

party operating a distribution network

Note 1 to entry: In some countries, a DSO is also referred to as DNO (distribution network operator).

[SOURCE: IEC 60050-617:2009, 617-02-10, modified – Note 1 to entry has been added.]

3.1.7**electrical proximity**

state of two or more pieces of equipment linked to one another by connections the impedances of which are negligible as compared to other impedances involved

3.1.8**flicker**

impression of unsteadiness of visual sensation induced by a light stimulus whose luminance or spectral distribution fluctuates with time

Note 1 to entry: Flicker can be calculated by short-term flicker indicator P_{st} and long-term flicker indicator P_{lt} .

[SOURCE: IEC 60050-161:1990, 161-08-13, modified – Note 1 to entry has been added.]

3.1.9**fundamental frequency**

frequency of the fundamental component of a periodic quantity

Note 1 to entry: For the purpose of this document, the fundamental frequency is the same as the power supply frequency, e.g. 50 Hz or 60 Hz.

[SOURCE: IEC 60050-103:2009, 103-07-21, modified – Note 1 to entry has been added.]

3.1.10**fundamental component**

sinusoidal component of the Fourier series of a periodic quantity having the frequency of the quantity itself

[SOURCE: IEC 60050-103:2009, 103-07-19]

3.1.11**generating unit**

set of equipment connected together whose primary purpose is to generate electrical power.

3.1.12**generating plant**

group of generating units including auxiliaries connected to one POC

3.1.13**harmonic component**

sinusoidal component of the Fourier series of a periodic quantity, the harmonic order of which is an integer number greater than one

Note 1 to entry: A component of harmonic n (with $n > 1$) is generally designated n^{th} harmonic. the designation of the fundamental component as the "1st harmonic" is not recommended.

[SOURCE: IEC 60050-103:2009, 103-07-25]

3.1.14**interface protection**

combination of protection relay functions which open the interface switch of a generating unit and prevents its closure, whichever is appropriate, in the case of:

- a fault in the electric power network;
- an unintentional islanding situation;
- voltage and/or frequency being outside the tolerance of their operating ranges for continuous operation

3.1.15**interharmonic frequency**

frequency which is a non-integer multiple of the reference fundamental frequency

Note 1 to entry: By extension from harmonic order, the interharmonic order is the ratio of an interharmonic frequency to the fundamental frequency. This ratio is not an integer (Recommended notation: "m").

Note 2 to entry: In the case where $m < 1$ the term subharmonic frequency can be used.

[SOURCE: IEC 60050-551:2001, 551-20-06, modified – Note 1 to entry and Note 2 to entry have been added.]

3.1.16**interharmonic component**

sinusoidal component of a periodic quantity having an interharmonic frequency

Note 1 to entry: Its value is normally expressed as an RMS value.

[SOURCE: IEC 60050-551:2001, 551-20-08, modified – The existing note has been deleted and a new Note 1 to entry has been added.]

3.1.17**interoperability**

property permitting diverse systems or components to work together for a specified purpose

[SOURCE: IEC 60050-871:2018, 871-05-06]

3.1.18**long-term flicker indicator**

measure of flicker evaluated over a specified time interval of a relatively long duration, using successive values of the short-term flicker indicator

Note 1 to entry: The duration is typically 2 hours, using 12 successive values of P_{st} , in accordance with IEC 61000-4-15.

[SOURCE: IEC 60050-161:1990, 161-08-19]

3.1.19**low voltage****LV**

set of voltage levels used for the distribution of electricity and whose upper limit is generally accepted to be 1 000 V for alternating current

[SOURCE: IEC 60050-601:1985, 601-01-26]

3.1.20**medium voltage****MV**

any set of voltage levels lying between low and high voltage

Note 1 to entry: The boundaries between medium and high voltage levels that overlap and depend on local circumstances as well as history or common usage. Nevertheless, the band 1 kV to 35 kV is considered as the accepted medium voltage boundary.

Note 2 to entry: Because of existing network structures, boundary between MV and HV can be different from country to country.

[SOURCE: IEC 60050-601:1985, 601-01-28, modified – The existing note has been modified and Note 2 to entry has been added]

3.1.21
point of connection
POC

reference point on the electric power system where the user's electrical facility is connected

Note 1 to entry: See Figure 1.

[SOURCE: IEC 60050-617:2009, 617-04-01]

3.1.22
power converter

electronic equipment that converts

- AC to DC (rectifier)
- DC to AC (inverter)
- DC to DC (DC-to-DC converter)
- AC to AC (AC-to-AC converter)

[SOURCE: IEC TR 61850-90-7:2013, 3.1.16]

3.1.23
port

location giving access to a device or network where electromagnetic energy or signals may be supplied or received or where the device or network variables may be observed or measured

[SOURCE: IEC TR 62109.1:2010, 3.64]

3.1.24
power factor

under periodic conditions, ratio of the absolute value of the active power P to the apparent power S :

$$\lambda = \frac{|P|}{S}$$

Note 1 to entry: Under sinusoidal conditions, the power factor is the absolute value of the active factor.

[SOURCE: IEC 60050-131:2002, 131-11-46]

3.1.25
rate of change of frequency
ROCOF

amount of frequency change per unit of time

3.1.26
short-term flicker indicator

a measure of flicker evaluated over a specified time interval of a relatively short duration

Note 1 to entry: The duration is typically 10 minutes, in accordance with IEC 61000-4-15.

[SOURCE: IEC 60050-161:1990, 161-08-18]

3.1.27
short-time withstand current

the current that a circuit or a switching device in the closed position can carry during a specified short time under prescribed conditions of use and behaviour

[SOURCE: IEC 60050-441:1984, 441-17-17]

**3.1.28
single fault tolerance**

built-in capability of a system to provide continued correct execution of its function in the presence of a single fault

**3.1.29
system operator**

party responsible for safe and reliable operation of a part of the electric power system in a certain area and for connection to other parts of the electric power system

[SOURCE: IEC 60050-617:2009, 617-02-09]

**3.1.30
switch**

device for changing the electric connections among its terminals

Note 1 to entry: See Figure 1.

[SOURCE: IEC 60050-151:2001, 151-12-22]

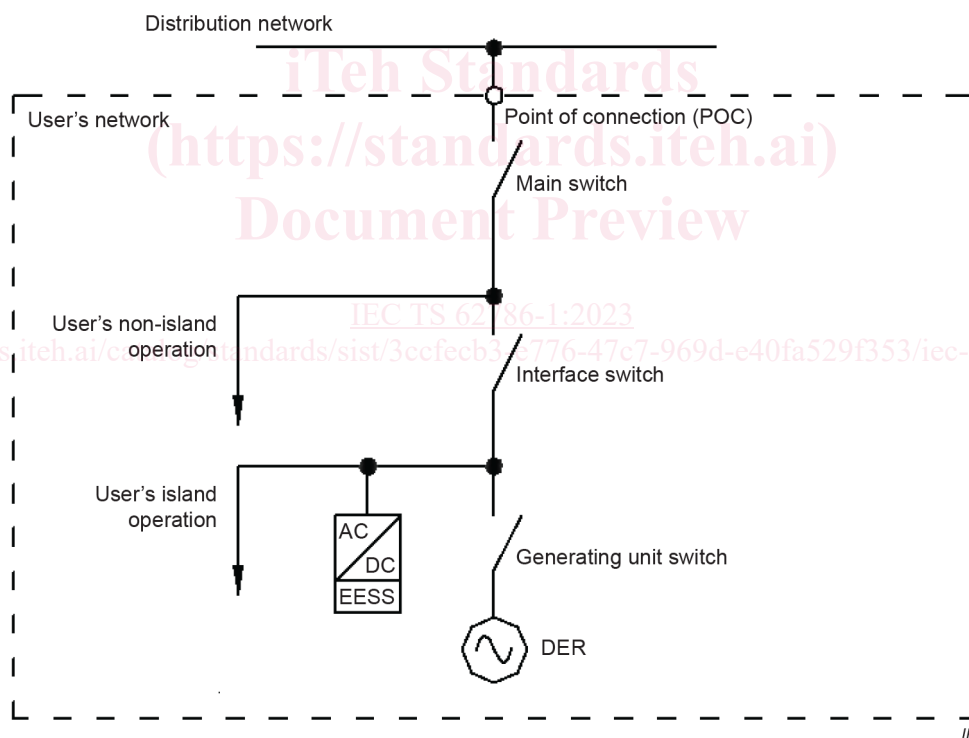


Figure 1 – Example of electricity generating plant connected to a network (schematic view of switches)

**3.1.31
main switch**

switch installed as close as possible to the point of connection, for protection against internal faults and disconnection of the whole plant from the network

Note 1 to entry: See also Figure 1.