

# TECHNICAL REPORT

# RAPPORT TECHNIQUE



**A method of temperature-rise verification of low-voltage switchgear and controlgear assemblies by calculation**

**Méthode de vérification par calcul des échauffements pour les ensembles d'appareillages à basse tension**

[IEC TR 60890:2022](#)

<https://standards.iteh.ai/catalog/standards/sist/7a954d7c-2b57-4c93-8b3b-f930bc8b227c/iec-tr-60890-2022>





**THIS PUBLICATION IS COPYRIGHT PROTECTED**  
**Copyright © 2022 IEC, Geneva, Switzerland**

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Secretariat  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

#### **About the IEC**

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

#### **About IEC publications**

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

#### **IEC publications search - [webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)**

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

#### **IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)**

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

#### **IEC Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)**

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [sales@iec.ch](mailto:sales@iec.ch).

#### **IEC Products & Services Portal - [products.iec.ch](http://products.iec.ch)**

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

#### **Electropedia - [www.electropedia.org](http://www.electropedia.org)**

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

#### **A propos de l'IEC**

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

#### **A propos des publications IEC**

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

#### **Recherche de publications IEC -**

#### **[webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)**

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études, ...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

#### **IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)**

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

#### **Service Clients - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)**

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: [sales@iec.ch](mailto:sales@iec.ch).

#### **IEC Products & Services Portal - [products.iec.ch](http://products.iec.ch)**

Découvrez notre puissant moteur de recherche et consultez gratuitement tous les aperçus des publications. Avec un abonnement, vous aurez toujours accès à un contenu à jour adapté à vos besoins.

#### **Electropedia - [www.electropedia.org](http://www.electropedia.org)**

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 300 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 19 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

# TECHNICAL REPORT

# RAPPORT TECHNIQUE



**A method of temperature-rise verification of low-voltage switchgear and controlgear assemblies by calculation**

**Méthode de vérification par calcul des échauffements pour les ensembles d'appareillages à basse tension**

<https://standards.iteh.ai/catalog/standards/sist/7a954d7c-2b57-4c93-8b3b-f930bc8b227c/iec-tr-60890-2022>

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

COMMISSION  
ELECTROTECHNIQUE  
INTERNATIONALE

ICS 29.130.20

ISBN 978-2-8322-6368-6

**Warning! Make sure that you obtained this publication from an authorized distributor.  
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

## CONTENTS

FOREWORD .....	5
INTRODUCTION .....	7
1 Scope .....	8
2 Normative references .....	8
3 Terms and definitions .....	8
4 Verification conditions .....	9
5 Calculation method .....	9
5.1 Assumptions made in this calculation .....	9
5.2 Necessary information .....	10
5.3 Calculation procedure .....	10
5.3.1 General .....	10
5.3.2 Determination of the effective cooling surface $A_e$ of the enclosure .....	10
5.3.3 Determination of the internal temperature-rise $\Delta t_{0,5}$ of the air at mid-height of the enclosure .....	10
5.3.4 Determination of the internal temperature-rise $\Delta t_{1,0}$ of air at the top of the enclosure .....	11
5.3.5 Characteristic curve for temperature-rise of air inside enclosure .....	11
5.4 Maximum internal air temperature limits .....	13
6 Further considerations .....	13
6.1 General .....	13
6.2 Guidance on the effects of an uneven power distribution .....	13
6.3 Guidance on the additional temperature-rise effect due to solar radiation .....	14
7 Evaluation of the design .....	15
Annex A (informative) Examples for the calculation of the temperature-rise of air inside enclosures .....	26
A.1 Example 1 .....	26
A.2 Example 2 .....	29
Annex B (informative) Guidance on the effects of an uneven power distribution .....	33
B.1 Horizontal partition .....	33
B.2 Calculation of internal air temperature-rise for assemblies with ventilation openings with even power distribution and less than 50 % perforation in horizontal partitions .....	33
B.3 Calculation of internal air temperature-rise with an uneven power distribution .....	34
Annex C (informative) Guidance on the additional temperature-rise effect due to solar radiation .....	35
C.1 General .....	35
C.2 Solar radiation phenomena .....	35
C.3 Solar radiation – consequences for thermal calculation .....	36
C.4 Solar radiation of enclosures with air ventilation openings .....	37
Annex D (informative) Guidance on the effect of different enclosure materials, construction and finishes .....	38
D.1 General .....	38
D.2 Validity criteria .....	38
D.3 Material of enclosure .....	38
D.4 Results .....	38

Annex E (informative) Guidance on the effects of different natural ventilation arrangements.....	40
Annex F (informative) Guidance on forced ventilation management .....	42
F.1 General.....	42
F.2 Forced ventilation installation system.....	42
F.3 Installation considerations.....	42
Annex G (informative) Power loss values calculation .....	44
G.1 General.....	44
G.2 Power losses of low-voltage switchgear and controlgear .....	44
G.3 Power losses of conductors connecting low-voltage switchgear and controlgear .....	44
G.4 Power losses of busbars .....	45
G.5 Power losses of electronic devices.....	45
Annex H (informative) Guidance on the impact of an adjacent wall on the assembly cooling surfaces.....	46
Annex I (informative) Operating current and power loss of copper conductors.....	48
Annex J (informative) Guidance to magnetic and eddy-current power losses.....	53
Annex K (informative) Forced ventilation airflow calculation .....	54
K.1 General.....	54
K.2 Ventilation airflow calculation .....	55
Bibliography.....	57
Figure 1 – Temperature-rise characteristic curve for enclosures with $A_e$ exceeding $1,25 \text{ m}^2$ .....	12
Figure 2 – Temperature-rise characteristic curve for enclosures with $A_e$ not exceeding $1,25 \text{ m}^2$ .....	13
Figure 3 – Enclosure constant $k$ for enclosures without ventilation openings, with an effective cooling surface $A_e > 1,25 \text{ m}^2$ .....	18
Figure 4 – Temperature distribution factor $c$ for enclosures without ventilation openings and with an effective cooling surface $A_e > 1,25 \text{ m}^2$ .....	19
Figure 5 – Enclosure constant $k$ for enclosures with ventilation openings and an effective cooling surface $A_e > 1,25 \text{ m}^2$ .....	20
Figure 6 – Temperature distribution factor $c$ for enclosures with ventilation openings and an effective cooling surface $A_e > 1,25 \text{ m}^2$ .....	21
Figure 7 – Enclosure constant $k$ for enclosures without ventilation openings and with an effective cooling surface $A_e \leq 1,25 \text{ m}^2$ .....	22
Figure 8 – Temperature distribution factor $c$ for enclosures without ventilation openings and with an effective cooling surface $A_e \leq 1,25 \text{ m}^2$ .....	23
Figure 9 – Calculation of temperature-rise of air inside enclosures .....	25
Figure A.1 – Example 1, calculation for an enclosure with exposed side faces without ventilation openings and without internal horizontal partitions .....	26
Figure A.2 – Example 1, calculation for a single enclosure.....	28
Figure A.3 – Example 2, calculation for an enclosure for wall-mounting with ventilation openings.....	29
Figure A.4 – Example 2, calculation for one enclosure half .....	30

Figure A.5 – Example 2, calculation for an enclosure for wall-mounting with ventilation openings.....	32
Figure B.1 – Examples of assemblies with horizontal partitions.....	33
Figure B.2 – Temperature-rise verification of a higher-power circuit.....	34
Figure C.1 – Solar radiation phenomena.....	35
Figure C.2 – Interpolation curve.....	36
Figure D.1 – Results of comparison tests.....	39
Figure E.1 – Examples of crossing diagonal installation.....	40
Figure E.2 – Effect of additional filters.....	41
Figure F.1 – Examples of forced ventilation arrangements.....	43
Figure H.1 – Wall-mounted assembly.....	46
Figure H.2 – Floor-standing assembly.....	47
Figure J.1 – Power losses distribution for different gland plates with the same rating.....	53
Table 1 – Method of calculation, application, formulas and characteristics.....	15
Table 2 – Symbols, units and designations.....	16
Table 3 – Surface factor $b$ according to the type of installation.....	17
Table 4 – Factor $d$ for enclosures without ventilation openings and with an effective cooling surface $A_e > 1,25 \text{ m}^2$ .....	17
Table 5 – Factor $d$ for enclosures with ventilation openings and an effective cooling surface $A_e > 1,25 \text{ m}^2$ .....	17
Table 6 – Equation for Figure 3.....	18
Table 7 – Equations for Figure 4.....	19
Table 8 – Equations for Figure 5.....	20
Table 9 – Equations for Figure 6.....	22
Table 10 – Equation for Figure 7.....	23
Table 11 – Equation for Figure 8.....	24
Table C.1 – Approximate solar absorption radiation coefficients (according to colour).....	36
Table I.1 – Operating current and power loss of single-core copper cables with a permissible conductor temperature of 70 °C (ambient temperature inside the enclosure: 55 °C).....	49
Table I.2 – Reduction factor $k_1$ for cables with a permissible conductor temperature of 70 °C (extract from IEC 60364-5-52:2009, Table B.52.14).....	50
Table I.3 – Operating current and power loss of bare copper bars with rectangular cross-section, run horizontally and arranged with their largest face vertical, for DC and AC frequencies 16 2/3 Hz, 50 Hz to 60 Hz (ambient temperature inside the enclosure: 55 °C, temperature of the conductor 70 °C).....	51
Table I.4 – Factor $k_4$ for different temperatures of the air inside the enclosure and/or for the conductors.....	52
Table K.1 – Factor $k$ for altitudes above sea level.....	55

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**A METHOD OF TEMPERATURE-RISE VERIFICATION OF LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR ASSEMBLIES BY CALCULATION**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

IEC TR 60890 has been prepared by subcommittee 121B: Low-voltage switchgear and controlgear assemblies, of IEC technical committee 121: Switchgear and controlgear and their assemblies for low-voltage. It is a Technical Report.

This third edition cancels and replaces the second edition published in 2014. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- alignment with IEC 61439-1:2020;
- addition of individual annexes for guidance of technical explanations related to:
  - effect of an uneven power distribution;
  - additional temperature-rise due to solar radiation;
  - effect of different enclosure materials;
  - effect of different natural ventilation management;
  - forced ventilation management;

- power losses calculation;
- impact of an adjacent wall can have on the assembly cooling surface(s);
- maximum internal ambient temperature limit into an assembly;
- validity area of the calculation extended from 3 150 A to 3 200 A;
- addition of an algebraic equation to the different curves included in the document.

The text of this Technical Report is based on the following documents:

Draft	Report on voting
121B/136/DTR	121B/147/RVDTR

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this Technical Report is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at [www.iec.ch/members\\_experts/refdocs](http://www.iec.ch/members_experts/refdocs). The main document types developed by IEC are described in greater detail at [www.iec.ch/publications](http://www.iec.ch/publications).

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under [webstore.iec.ch](http://webstore.iec.ch) in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The “colour inside” logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this publication using a colour printer.**



## INTRODUCTION

In the series of design verifications of IEC 61439-1 a temperature-rise verification of low-voltage power switchgear and controlgear assemblies is specified. This can be by test, however, alternatives are acceptable under defined circumstances. Selection of the method used for temperature-rise verification is the responsibility of the original manufacturer. Where applicable this document can also be used for temperature-rise verification of similar products in accordance with other standards (e.g. IEC 60204-1). The method of calculation can also be used to determine the thermal power dissipation capability of an enclosure in accordance with IEC 62208 for a given internal air temperature-rise. The factors and coefficients, set out in this document have been derived from measurements on numerous assemblies and the method has been verified by comparison with test results.

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[IEC TR 60890:2022](https://standards.iteh.ai/catalog/standards/sist/7a954d7c-2b57-4c93-8b3b-f930bc8b227c/iec-tr-60890-2022)

<https://standards.iteh.ai/catalog/standards/sist/7a954d7c-2b57-4c93-8b3b-f930bc8b227c/iec-tr-60890-2022>

# A METHOD OF TEMPERATURE-RISE VERIFICATION OF LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR ASSEMBLIES BY CALCULATION

## 1 Scope

This document specifies a method of air temperature-rise calculation inside enclosures for low-voltage switchgear and controlgear assemblies or similar products in accordance with their respective standard.

The method is primarily applicable to enclosed assemblies or partitioned sections of assemblies without forced ventilation. However, some technical guidance to adapt it for the use of forced ventilation is given in this document. The results obtained by using this method are directly influenced by the accuracy of the evaluation of power losses used as inputs to perform the thermal calculations.

NOTE The air temperature within the enclosure is equal to the ambient air temperature outside the enclosure plus the temperature-rise of the air inside the enclosure caused by the power losses of the installed equipment.

For the method to be applied, the maximum daily average ambient air temperature outside the assembly at the place of installation is specified between 10 °C and 50 °C. The maximum daily temperature does not exceed the maximum daily average temperature by more than 5 K.

Several annexes in this document provide guidance on how temperature-rise within assemblies can be affected by influences which are not considered in the calculation method included in this document, for example, when the assembly is subject to solar radiation. In such cases, different means of verification to that given in this document can be applied to ensure a definitive result and verification of the design.

<https://standards.iteh.ai/catalog/standards/sist/7a954d7c-2b57-4c93-8b3b-f930bc8b227c/iec-tr-60890-2022>

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61439 (all parts), *Low-voltage switchgear and controlgear assemblies*

IEEE C37.24-2017, *IEEE Guide for Evaluating the Effect of Solar Radiation on Outdoor Metal-Enclosed Switchgear*

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 61439 (all parts) apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

## 4 Verification conditions

When this method of calculation is applied to low-voltage switchgear and controlgear assemblies the following conditions shall be fulfilled:

- the assembly is designed for AC currents and frequencies up to and including 1 600 A, 60 Hz. For higher current ratings or frequencies, the method could be used with additional verifications taking into account the effect of eddy-currents on the temperature distribution inside the assembly as required by the relevant product standards.

NOTE 1 In IEC 61439-2, additional requirements for currents in excess of 1 600 A are specified to take into account the considerably increased power losses due to magnetic effects (eddy currents, proximity effect, skin effect)

- the assembly is designed for DC currents up to and including 3 200 A. For higher current ratings the method could be used with additional verifications as required by the relevant product standards;
- conductors carrying currents in excess of 200 A AC, and the adjacent structural parts are so arranged that eddy-current and hysteresis losses are negligible;
- there is an approximately even distribution of power losses inside the enclosure;
- the power losses data for all built-in components are available or can be calculated (see Clause 5);
- the installed equipment is so arranged that air circulation is not significantly impeded.

NOTE 2 When this method is used to determine the thermal power dissipation capability of an empty enclosure in accordance with IEC 62208, the above conditions do not apply.

## 5 Calculation method

### 5.1 Assumptions made in this calculation

To use the calculation method of this document, the following assumptions are deemed valid:

- the enclosure is made of metal (steel, aluminium, stainless steel) coated (both sides, inside and outside), insulating material like thermoplastic or thermoset or similar (see Annex D);
- the enclosure is made of a single layer material or multiple layers without air-gap;
- for enclosures with or without natural ventilation, there are no more than five horizontal partitions in the assembly or in a section of it;
- the enclosure is designed without ventilation openings or;
- the enclosure is designed with free air inlet and outlet ventilation openings, without the inclusion of any additional filter (see Annex E);
  - the cross-section of the air outlet openings is at least 10 % bigger than that of the inlet openings to permit the chimney effect;
  - the minimum cross section of air inlet openings is 10 cm<sup>2</sup>;

NOTE 1 Figure 3 and the formula given in Table 7 are not usable for lower cross sections. Assemblies with a sum of the air inlet openings less than 10 cm<sup>2</sup> are considered as assemblies without an air inlet.

- if the enclosure has air inlet and outlet openings with filters for an IP5X rating or higher then these openings are not considered for the calculation;
- for IP ratings lower than IP5X the effective free air cross section of the openings shall be used for calculation (see Annex E);
- where enclosures with natural ventilation openings have compartments, the surface of each horizontal partition shall be provided with free air ventilation openings of at least 50 % of the horizontal cross-section of the partition (see Clause B.1);
- power losses are considered as a sum of the followings:
  - power losses of low-voltage switchgear and controlgear (see Clause G.2);

- power losses of conductors connecting low-voltage switchgear and controlgear (see Clause G.3);
  - power losses of busbars (see Clause G.4);
  - power losses of electronic devices (see Clause G.5);
- the enclosure is not subject to solar radiation.

## 5.2 Necessary information

The following data shall be used to calculate the temperature-rise of the air inside an enclosure:

- dimensions of the enclosure: height/width/depth;
- type of installation of the enclosure according to Figure 4;
- design of enclosure, i.e. with or without ventilation openings;
- number of internal horizontal partitions;
- effective power loss of equipment installed in the enclosure, see Annex G;
- effective power loss ( $P_v$ ) of conductors according to Annex I.

## 5.3 Calculation procedure

### 5.3.1 General

For the enclosures specified in columns 4 and 5 of Table 1, the calculation of the temperature-rise of the air inside the enclosure is carried out using the formulae laid down in columns 1 to 3 of Table 1.

The pertinent factors and exponents (characteristics) are obtained from columns 6 to 10 of Table 1.

The symbols, units and designations are stated in Table 2.

For enclosures having more than one section with vertical partitions, the temperature-rise of the air inside the enclosure shall be determined separately for each section.

Where enclosures without vertical partitions or individual sections have an effective cooling surface greater than 11,5 m<sup>2</sup> or a width greater than about 1,5 m, they should be divided for the calculation into fictitious sections, whose dimensions approximate to the foregoing values.

NOTE The template (see Figure 9) can be used as a calculation aid.

### 5.3.2 Determination of the effective cooling surface $A_e$ of the enclosure

The calculation is carried out according to Formula (1) in column 1 of Table 1.

The effective cooling surface  $A_e$  of an enclosure is the sum of the individual surfaces  $A_o$  multiplied by the surface factor  $b$ . This factor takes into account the heat dissipation of the individual surfaces according to the type of installation of the enclosure (see Annex H for additional explanations).

### 5.3.3 Determination of the internal temperature-rise $\Delta t_{0,5}$ of the air at mid-height of the enclosure

The calculation is carried out according to Formula (2) in column 2 of Table 1.

In Formula (2) the enclosure constant  $k$  allows for the size of the effective cooling surface for enclosures without ventilation openings and, in addition, for the cross-section of the air inlet openings for enclosures with ventilation openings.

The dependence of the temperature-rise occurring in the enclosure on the effective power loss  $P$  is expressed by the exponent  $x$ .

The factor  $d$  allows for the dependence of the temperature-rise on the number of internal horizontal partitions.

### 5.3.4 Determination of the internal temperature-rise $\Delta t_{1,0}$ of air at the top of the enclosure

The calculation is made according to Formula (3) in column 3 of Table 1.

Factor  $c$  allows for the temperature distribution inside an enclosure. Its determination varies with the design and installation of the assembly as follows:

- a) For enclosures without ventilation openings and with an effective cooling surface: The factor  $c$  from Figure 4, depends on the type of installation and the height/base factor  $f$ , where:

$$A_e > 1,25 \text{ m}^2 \quad f = \frac{h^{1,35}}{A_b}$$

- b) For enclosures with ventilation openings and with an effective cooling surface: The factor  $c$  from Figure 6, depends on the cross-section of air inlet openings and the height/base factor  $f$ , where:

$$A_e > 1,25 \text{ m}^2 \quad f = \frac{h^{1,35}}{A_b}$$

- c) For enclosures without ventilation openings and with an effective cooling surface: The factor  $c$  from Figure 8, depends on the height/width factor  $g$ , where:

$$A_e \leq 1,25 \text{ m}^2 \quad g = \frac{h}{w}$$

where

$h$  is the enclosure height, in m;

$A_b$  is the surface area of the enclosure base, in m<sup>2</sup>;

$w$  is the enclosure width, in m.

### 5.3.5 Characteristic curve for temperature-rise of air inside enclosure


#### 5.3.5.1 General

To evaluate the design according to Clause 7, the calculated results of 5.3.3 and 5.3.4 shall be applied with the proper characteristic curve for temperature-rise of air inside the enclosure as a function of the enclosure height. The air temperatures within horizontal levels are practically constant.

#### 5.3.5.2 Temperature-rise characteristic curve for enclosures with an effective cooling surface $A_e$ exceeding 1,25 m<sup>2</sup>

As a general rule, the characteristic curve of temperature-rise is adequately well defined by a straight line which runs through the points  $\Delta t_{1,0}$  and  $\Delta t_{0,5}$  (see Figure 1).

The internal air temperature-rise at the bottom of the enclosure is close to zero, i.e. the characteristic curve flattens out towards zero. In practice, the dotted part of the characteristic curve is of secondary importance.

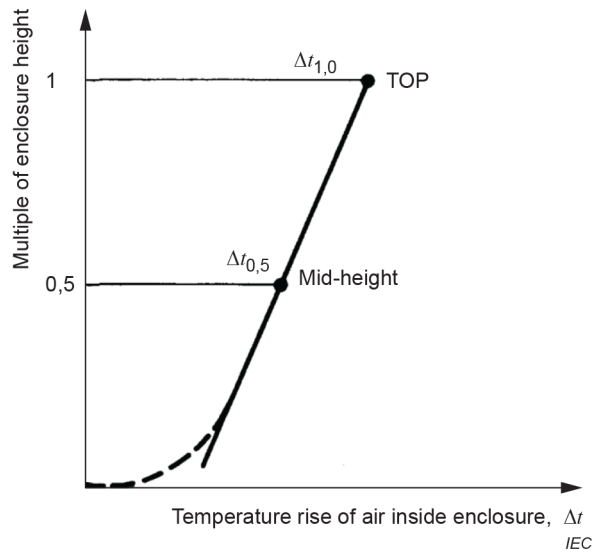


**Figure 1 – Temperature-rise characteristic curve for enclosures with  $A_e$  exceeding 1,25 m<sup>2</sup>**

**5.3.5.3 Temperature-rise characteristic curve for enclosures with an effective cooling surface  $A_e$  not exceeding 1,25 m<sup>2</sup>**

For this type of enclosure, the maximum temperature-rise in the upper quarter is constant and the values for  $\Delta t_{1,0}$  and  $\Delta t_{0,75}$  are identical (see Figure 2).

The characteristic curve is obtained by connecting the temperature-rise values at an enclosure level of 0,75 and 0,5 (see Figure 2).

The internal air temperature-rise at the bottom of the enclosure is close to zero, i.e. the characteristic curve flattens out towards zero. In practice, the dotted part of the characteristic curve is of secondary importance.

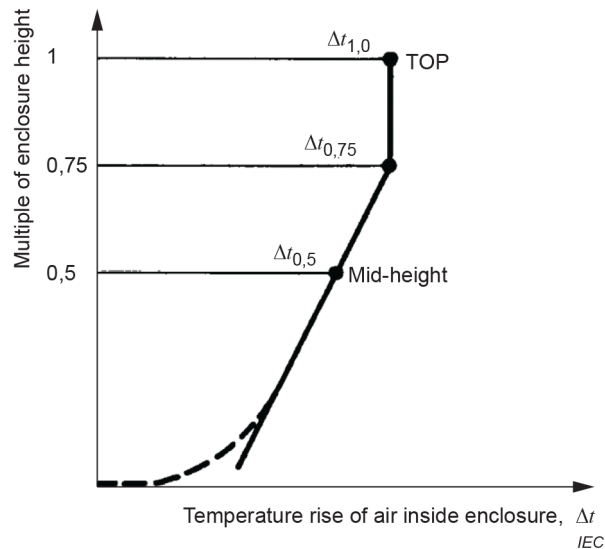

**Figure 2 – Temperature-rise characteristic curve for enclosures with  $A_e$  not exceeding 1,25 m<sup>2</sup>**

#### 5.4 Maximum internal air temperature limits

This document contains a method to calculate the internal air temperature within an enclosure. The resulting temperature shall not exceed the maximum absolute temperature allowed by different types of devices and products installed inside.

The user of this document should refer to the manufacturer's instructions regarding the maximum operational temperature allowed for the devices used inside the assembly.

NOTE The value of internal air temperature has a direct influence on the ageing and operation of built-in components.

## 6 Further considerations

### 6.1 General

The means of temperature-rise calculation in this document relate to specific arrangements of assembly in the conditions as defined. These arrangements and conditions do not cover all designs of assembly or the conditions in which some are installed. Where good practises are applied the calculation methods in this document can lead to conservative results.

Annex B, Annex C, Annex D, Annex E, Annex F, Annex H, Annex J and Annex K detail good practice that can lead to an improvement in thermal performance or some aspects not considered in the calculation method in this document. However, when using these additional considerations, to ensure a defined performance of an assembly, further verification, e.g. test, shall be performed.

### 6.2 Guidance on the effects of an uneven power distribution

The aim of Annex B is to determine the temperature-rise where there is not an even power distribution within an assembly using as a starting point the temperature-rise of a reference design or calculation in accordance with Clause 5.