



# Standard Specification for Cured-in-Place Pipe Lining System for Rehabilitation of Metallic Gas Pipe<sup>1</sup>

This standard is issued under the fixed designation F2207; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This specification covers requirements and method of testing for materials, dimensions, hydrostatic burst strength, chemical resistance, adhesion strength and tensile strength properties for cured-in-place (CIP) pipe liners installed into existing metallic gas pipes,  $\frac{3}{4}$  to 48 in. nominal pipe size, for renewal purposes. The maximum allowable operating pressure (MAOP) of such renewed gas pipe shall not exceed a pressure of 300 psig (2060 kPa). The cured-in-place pipe liners covered by this specification are intended for use in pipelines transporting natural gas, petroleum fuels (propane-air and propane-butane vapor mixtures), and manufactured and mixed gases, where resistance to gas permeation, ground movement, internal corrosion, leaking joints, pinholes, and chemical attack are required.

1.2 The medium pressure (up to 100 psig) cured-in-place pipe liners (Section A) covered by this specification are intended for use in existing structurally sound or partially deteriorated metallic gas pipe as defined in 3.2.10. The high pressure (over 100 psig up to 300 psig) cured-in-place pipe liners (Section B) covered by this specification are intended for use only in existing structurally sound steel gas pipe as defined in 3.2.10. CIP liners are installed with limited excavation using an inversion method (air or water) and are considered to be a trenchless pipeline rehabilitation technology. The inverted liner is bonded to the inside wall of the host pipe using a compatible adhesive (usually an adhesive or polyurethane) in order to prevent gas migration between the host pipe wall and the CIP liner and, also, to keep the liner from collapsing under its own weight.

1.2.1 Continued growth of external corrosion, if undetected and unmitigated, could result in loss of the host pipe structural integrity to such an extent that the liner becomes the sole pressure bearing element in the rehabilitated pipeline structure. The CIP liner is not intended to be a stand-alone pipe and relies on the structural strength of the host pipe. The operator must

maintain the structural integrity of the host pipe so that the liner does not become free standing.

1.3 MPL CIP liners (Section A) can be installed in partially deteriorated pipe as defined in 3.2.10. Even for low pressure gas distribution systems, which typically operate at less than 1 psig, MPL CIP liners are not intended for use as a stand-alone gas carrier pipe but rely on the structural integrity of the host pipe. Therefore, the safe use of cured-in-place pipe lining technology for the rehabilitation of existing cast iron, steel, or other metallic gas piping systems, operating at pressures up to 100 psig, is contingent on a technical assessment of the projected operating condition of the pipe for the expected 30 to 50 year life of the CIP liner. Cured-in-place pipe liners are intended to repair/rehabilitate structurally sound pipelines having relatively small, localized defects such as localized corrosion, welds that are weaker than required for service, or loose joints (cast iron pipe), where leaks might occur.

1.3.1 HPL CIP liners (Section B) are intended for use only in existing structurally sound steel gas pipe as defined in 3.2.10. HPL CIP liners are not intended for use as a stand-alone gas carrier pipe but rely on the structural integrity of the host pipe. Therefore, the safe use of cured-in-place pipe lining technology for the rehabilitation of existing steel gas piping systems, operating at pressures up to 300 psig, is contingent on a technical assessment of the projected operating condition of the pipe for the expected 30 to 50 year life of the CIP liner.

1.4 The values stated in inch-pound units are to be regarded as standard. No other units of measurement are included in this standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.6 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

<sup>1</sup> This specification is under the jurisdiction of ASTM Committee F17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.60 on Gas.

Current edition approved Aug. 1, 2019. Published August 2019. Originally approved in 2002. Last previous edition approved in 2013 as F2207 – 06 (2013). DOI: 10.1520/F2207-06R19.

## 2. Referenced Documents

### 2.1 *ASTM Standards*:<sup>2</sup>

- D123 Terminology Relating to Textiles
- D543 Practices for Evaluating the Resistance of Plastics to Chemical Reagents
- D763 Specification for Raw and Burnt Umber Pigments
- D883 Terminology Relating to Plastics
- D1598 Test Method for Time-to-Failure of Plastic Pipe Under Constant Internal Pressure
- D1600 Terminology for Abbreviated Terms Relating to Plastics
- D1763 Specification for Epoxy Resins
- D2240 Test Method for Rubber Property—Durometer Hardness
- D2837 Test Method for Obtaining Hydrostatic Design Basis for Thermoplastic Pipe Materials or Pressure Design Basis for Thermoplastic Pipe Products
- D3167 Test Method for Floating Roller Peel Resistance of Adhesives
- D3892 Practice for Packaging/Packing of Plastics
- D4814 Specification for Automotive Spark-Ignition Engine Fuel
- D4848 Terminology Related to Force, Deformation and Related Properties of Textiles
- D4850 Terminology Relating to Fabrics and Fabric Test Methods
- F412 Terminology Relating to Plastic Piping Systems

### 2.2 *Other Standards*:

- CFR 49 Part 192<sup>3</sup>

## 3. Terminology

3.1 *General*—Definitions are in accordance with those set forth in Terminologies D123, D883, D4848, D4850, and F412. Abbreviations are in accordance with Terminology D1600, unless otherwise indicated.

### 3.2 *Definitions of Terms Specific to This Standard*:

3.2.1 *adhesive system*—the adhesive system is typically a two-part adhesive or polyurethane consisting of a resin and a hardener. The flexible tubing, after wet-out, is inserted into the pipeline to be rehabilitated using an inversion method. After the inversion is complete, the adhesive is cured using either ambient or thermal processes.

3.2.2 *cleaned pipe*—pipe whose inside wall, that which is bonded to the CIP pipe liner, has been cleaned down to bare metal and is free of tars, pipeline liquids, oils, corrosion by-products, and other materials that could impair the bonding of the liner to the pipe wall.

3.2.3 *composite*—the composite is the combination of the cured adhesive system, the elastomer skin, and the jacket.

3.2.4 *elastomer skin*—the elastomer skin is a membrane, typically made of polyurethane or polyester, allowing for both inversion of the liner during the installation process and pressure tight in-service operation. When the flexible tubing is inverted into the pipeline to be rehabilitated, the elastomer skin becomes the inside surface of the newly rehabilitated pipeline, directly exposed to the gas being transported.

3.2.5 *expansion ratio table*—a table of measured diameters of the flexible tubing at increments of pressure, supplied by the manufacturer. The expansion ratio is used to calculate the pressure required to fit the flexible tubing against the pipe wall and to determine the applicable range of pipe I.D. for a given diameter flexible tubing.

3.2.6 *flexible tubing*—the flexible tube is the tubing material inverted into the host pipe and is used to carry and distribute the adhesive. For a two-component system, the flexible tubing consists of a cylindrical jacket coated with an elastomer skin. For a three-component system, it is the same as the elastomer skin.

3.2.7 *high-pressure liner (HPL)*—a CIP liner only intended for structurally sound steel pipe in sizes 4 in. and larger with an MAOP greater than 100 psig up to 300 psig. High pressure liners (HPL) are only intended for steel pipe that has a maintained cathodic protection system with annual reads per local codes, such as CFR 49 Part 192, and other mandated maintenance, such as leak surveys. The PDB testing conducted on high pressure liners is intended for the extreme case if holes occur in the steel pipe that are not detected by the cathodic protection maintenance system. Corrosion monitoring per CFR 49 Part 192 shall be conducted annually to track changes in required readings and confirm there is no active corrosion

3.2.8 *jacket*—the jacket is a textile product that is manufactured into a cylindrical form. It is made of synthetic materials, typically polyester, and provides the tensile strength and flexibility necessary to resist the specified sustained pressure when installed in partially deteriorated pipe as defined in 3.2.10.

3.2.9 *medium-pressure liner (MPL)*—a CIP liner intended for all types of structurally sound or partly deteriorated metal pipes and for all applicable sizes of pipe with an MAOP of 100 psig or less. MPL liners are relatively flexible.

3.2.10 *partially deteriorated metallic pipe*—pipe that has either been weakened or is leaking because of localized corrosion, welds that are weaker than required for service, deteriorated joints (cast iron), etc. Partially deteriorated pipe can support the soil and internal pressure throughout the design life of the composite except at the relatively small local points identified above.

3.2.11 *three-component system*—a CIP pipe lining system comprised of three separate components, which are the elastomer skin, the jacket, and the adhesive.

3.2.12 *two-component system*—a CIP pipe lining system comprised of two separate components, which are the flexible tube and the adhesive.

3.2.13 *wet-out*—the process of placing the adhesive system into the flexible tubing and uniformly distributing it prior to the inversion process.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

<sup>3</sup> Available from U.S. Government Printing Office, Superintendent of Documents, 732 N. Capitol St., NW, Washington, DC 20401-0001, <http://www.access.gpo.gov>.

## 4. Materials

4.1 The materials shall consist of the flexible tubing, jacket, and the adhesive system. The combination of materials used in both the flexible tubing and the adhesive system shall depend on the desired design characteristics of the composite. All materials shall be compatible for natural gas service. Because CIP pipe liners are both multi-component and multi-material systems, it becomes necessary to specify minimum material performance requirements for the liner composite rather than specific material testing requirements for the individual components. These requirements are outlined in Section 5.

4.1.1 *Flexible Tubing*—For a two-component system, the flexible tubing consists of a jacket with an elastomer skin that functions as a gas barrier. For a three-component system, the elastomer skin is the flexible tubing. The elastomer skin in both systems is typically made of polyurethane or polyester. The flexible tubing is fit tightly against the inner surface of the existing pipe by diametrical expansion using air or water pressure and bonded to the inner pipe wall with an adhesive.

4.1.2 *Jacket*—The jacket is made of polyester or other synthetic materials compatible with the application. The jacket provides the necessary strength to the composite to meet the required design characteristics, for example, resistance to internal and external pressure, resistance to earth movement, and diametrical expandability.

4.1.3 *Elastomer Skin*—The elastomer skin holds the adhesive system inside the flexible tubing during the wet-out, inversion, and curing. During the inversion and curing, the elastomer skin holds the air, water, or steam pressure inside the flexible tubing. When the flexible tubing is inverted into the existing pipe, the elastomer skin becomes the inside surface of the lined pipe. Upon completion of the installation, the elastomer skin is directly exposed to the gas being transported and forms a gas barrier. The elastomer skin shall have a high chemical resistance to the materials it is in contact with as defined in 5.1.3. For two-component systems, the elastomer skin is extruded or otherwise placed on the outside of the jacket during the manufacture of the flexible tubing.

4.1.4 *Adhesive System*—The adhesive is a two-part system composed of a resin and a hardener. The adhesive formulation can be modified as necessary to meet the curing time, strength, and application requirements specified for the lining installation. The cured adhesive system, in combination with the

flexible tubing, forms the composite. Either ambient or thermal curing of the adhesive system may be used.

## 5. Requirements

### 5.1 *Jacket and Elastomer Skin (Pre-Installation):*

5.1.1 *Workmanship*—Both the jacket and the elastomer skin shall be free from defects such as tears, bubbles, cracks, and scratches that could cause the liner to not be able to hold inversion and expansion pressures and, therefore, fail during installation. For two-component systems, the flexible tubing shall be rolled onto a reel designed to provide protection during shipping and handling. For three-component systems, the elastomer skin shall be rolled onto reels designed to provide protection during shipping and handling. The jacket may either be rolled onto reels or folded into boxes.

5.1.2 *Dimensions*—An expansion ratio table, as defined in 3.2.5, including nominal size and length, shall be attached to each roll of flexible tubing or jacket and elastomer skin prior to shipment from the manufacturer. All material dimensions and physical properties must at least meet the minimum specifications, requirements, or tolerances assumed in establishing the strength tests under Section 6.

5.1.3 *Chemical Resistance*—The jacket and the elastomer skin materials shall be compatible with the liquids listed in Table 1 and tested in accordance with Practice D543, Practice A, Procedure I. Neither tensile strength nor elongation of any of the components shall change more than 20 %. Weight of the test specimen after testing shall not have increased by more than 14 % or decreased by more than 3 %. This test shall be a qualification test to be performed once for each class or pressure rating of installed pipe liner.

NOTE 1—These tests are only an indication of what will happen as a result of short-term exposure to these chemicals. For long-term results, additional testing is required.

5.1.4 *Elastomeric Peeling Strength*—The peeling strength between the jacket and the elastomer skin shall meet or exceed 7.0 lb/in. (1.2 kg/cm) when measured in accordance with Test Method D3167.

5.1.5 *Physical Properties*—For two-component systems, the design pressure of the flexible tubing shall be sufficient to withstand the required installation, testing, and operating pressures and to form the required composite. For three-component systems, the design pressure of the elastomer skin

**TABLE 1 Chemical Resistivity List of Reagents**

Liquids	Test Composition
Water (External and Internal)	Freshly prepared distilled water (in accordance with Practice D543)
Gasoline (External)	Gasoline-Automotive Spark-Ignition Engine Fuel per Specification D4814
Gas Condensate (Internal)	70 % volume isooctane + 30 % volume toluene
Methanol	20 % volume methanol + 80 % volume distilled water
Triethylene Glycol	10 % volume triethylene glycol + 90 % volume distilled water
Brine Solution	10 % mass NaCl solution made up with a balance of distilled water
Mineral Oil	100 % White Mineral Oil USP, specific gravity 0.830 to 0.860, Saybolt at 100°F: 125 to 135 s, in accordance with Practice D543
Isopropanol	10 % volume isopropanol + 90 % volume distilled water
Sulfuric Acid	5 % weight (of total solution) H <sub>2</sub> SO <sub>4</sub> in distilled water
Surfactants	5 % mass (of solution weight) dehydrated pure white soap flakes (dried 1 h at 105°C) dissolved in distilled water, in accordance with Practice D543
Mercaptans	2 % volume tertiary butyl mercaptan + 98 % volume mineral oil, white, USP

or flexible tube shall be sufficient to withstand the installation inversion pressure and the design pressure of the combined jacket and elastomer skin shall be high enough to withstand the testing and operating pressures and to form the composite. For both systems the flexible tubing shall be flexible enough to allow installation using the inversion method.

### 5.2 Adhesive System (Post-Installation and Cure):

5.2.1 *General*—The adhesive system shall provide uniform bonding of the jacket to the I.D. of the host pipe. The adhesive shall provide protection against gas tracking between the composite and the host pipe when the installed cured liner (composite) is penetrated for any reason. For three-component systems the adhesive system shall also provide uniform bonding of the elastomer skin to the jacket.

#### 5.2.2 Composite Liner Peeling Strength

5.2.2.1 *Section A-For MPL liners*, the peeling strength of the composite liner from the wall of the cleaned pipe shall be tested in accordance with Test Method **D3167** and shall not be less than 6.0 lb/in. (1.0 kg/cm).

5.2.2.2 *Section B-For HPL liners*, the peeling strength shall not be less than 10.0 lb/in. (1.7 kg/cm).

5.2.3 *Chemical Resistance*—The cured adhesive system shall have resistance to the chemicals listed in **5.1.3**. The weight of the test specimen shall not increase by more than 14 % nor decrease by more than 3 % and it shall retain at least 80 % of both its hardness, when measured in accordance with Test Method **D2240**, and its peeling strength, when measured in accordance with Test Method **D3167**. This test shall be a qualification test to be performed once for each class of adhesives developed by each manufacturer.

### 5.3 Composite (Post-Installation and Cure):

#### 5.3.1 Mechanical Properties:

5.3.1.1 *Peeling Strength*—The peeling strength of the composite shall be determined by the peeling strength of the adhesive system as required in **5.2.2**.

5.3.1.2 *Strength Test*—The manufacturer shall conduct pressure tests to demonstrate the strength of the composite. The tests shall be conducted on properly lined partially deteriorated pipe as defined in **3.2.10**. For a given pipeline operating pressure rating, the lined partially deteriorated pipe shall be tested at a minimum pressure of two times the certified MAOP of the pipeline for a minimum of one hour without leakage. The MAOP shall be determined as defined in **5.4**. Nitrogen gas, air, or water may be used to conduct the strength tests.

5.3.1.3 *Flexibility Tests*—For flexible MPL liners, the manufacturer shall demonstrate the flexibility of each liner composite product as installed in partially deteriorated pipe by performing either a tensile test, see **6.1.4**, or a bend test, see **6.1.5**, while pressurized to the certified MAOP of the lined pipeline. For both of these tests, the liner composite shall not leak for a minimum period of 24 h. These tests are not considered as quality control tests and are not needed for acceptance of individual lots or runs.

5.3.2 *Chemical Resistance*—The composite shall be compatible with the liquids listed in **5.1.3**, **Table 1**, and tested in accordance with Practice **D543**, Practice B. The level of applied stress in Practice B shall be determined by the manufacturer and reported along with the results of this test.

Neither tensile strength nor elongation shall change more than 20 %. Weight of the test specimen after testing shall not have increased by more than 14 % or decreased by more than 3 %. This test shall be a qualification test to be performed once for each class or pressure rating of installed pipe liner.

NOTE 2—These tests are only an indication of what will happen as a result of short-term exposure to these chemicals. For long-term results, additional testing is required.

### 5.4 MAOP (Post-Installation and Cure):

5.4.1 The lined partially deteriorated pipe, as defined in **3.2.10**, shall have an MAOP. The determination of the MAOP shall be based on the Pressure Design Basis (PDB) obtained in accordance with **6.1** and shall be the responsibility of the CIP pipe liner manufacturer.

$$\text{MAOP} = \text{PDB} \times 0.50$$

## 6. Test Methods

### 6.1 Sustained Pressure Test:

6.1.1 Lined partially deteriorated metallic pipe, as defined in **3.2.10**, shall be used for all sustained pressure testing. For testing purposes and establishing pipeline MAOP, partially deteriorated pipe shall be simulated by a minimum full circumference gap between two pipe segments and a hole size as defined in the table below.

Nominal Pipe Diameter	Linear Pipe	Circumferential Gap Size	Minimum Diameter Hole Size
Section A			
¾ in.-3 in.	MPL	1 in.	½ nominal pipe diameter in pipe body
4 in.-10 in.	MPL	1.5 in.	2 in.
12 in. and larger	MPL	2 in.	4 in.
Section B			
4 in. and larger	HPL	1 in.	2 in.

Note- The sustained pressure test is only used to establish the PDB rating, and does not imply the CIP liners can perform structurally as a stand-alone pipe.

6.1.2 Lined pipe samples are capped and tested to failure using either an extension of Test Method **D1598**, with suitable modifications in analysis and data validation or, the methodology developed and validated by Battelle for GTI, as outlined in **Annex A1** of this specification, to develop a stress regression curve at 73°F.

6.1.3 *Pressure Design Basis*—Either an extension of Test Method **D2837** which has been validated for CIP liners or, the methodology developed by Battelle for GTI, as outlined in **Annex A1** of this specification, shall be used to determine the pressure design basis for CIP lined partially deteriorated pipe.

6.1.4 *Tensile Test*—Two contiguous pipe segments made of similar material to the pipe to be lined (steel, cast iron, copper, etc.), each 10 ft in length, shall be lined and, while at the certified pipeline MAOP, then pulled apart in tension until there is a minimum separation of 2 in. between the pipe segments.

6.1.5 *Bend Test*—Two contiguous pipe segments made of similar material to the pipe to be lined (steel, cast iron, copper, etc.), each 10 ft in length, shall be lined and, while at the

certified pipeline MAOP, then bent at the pipe joint to form a minimum separation of 2 in. between the pipe segments.

## 7. Manufacturing Quality Control

7.1 *Jacket and Elastomer Skin or Flexible Tubing*—For quality control and assurance purposes, tests of each diameter and size of the jacket and elastomer skin for three-component systems and of the flexible tubing for two-component systems shall be conducted at the beginning and end of each production run, and for each 10 000 ft of production or extrusion when a production run exceeds 10 000 ft.

7.2 *Adhesive System and Its Components*—Sampling shall be done for each production lot. The curing time and the adhesive strength, as specified in 5.2.2, shall be documented by the manufacturer. Measured values must be within prescribed tolerances given by the manufacturer.

7.3 *The Composite*—The sampling and tests shall be as specified by the purchaser.

## 8. Product Marking

8.1 The flexible hose shall be clearly marked throughout its length, at intervals not exceeding 5 ft (1.5 m), with the product designation, size, design ASTM Standard, and date of manufacture.

## 9. Packaging and Package Marking

### 9.1 *Jacket and Elastomer Skin*:

9.1.1 The elastomer skin shall be rolled onto a reel. The reel shall be strong enough to protect the materials from damage and all surfaces that contact the materials shall be appropriately coated to prevent damage to the elastomer skin. The loaded reels shall be sealed in plastic for protection during shipping. For three component systems, the jacket can be packaged as recommended by the manufacturer.

9.1.2 Shipping reels and boxes shall be marked with the name of the product, its type and size, lot or control number, and quantity contained as defined by the contract or purchase order under which the shipment is made.

9.2 *Adhesive System*—All packaging and package marking shall be in accordance with Specification D763, Section 10. All packing, packaging, and marking provisions of Practice D3892 shall apply to this specification. Material Safety Data Sheets (MSDS) shall be supplied and packaged with each shipment.

## 10. Keywords

10.1 composite; cured-in-place; flexible tubing; gas pipe renewal; inversion; rehabilitation

iTeh Standards  
(<https://standards.iteh.ai>)  
ANNEX  
(Mandatory Information)  
Document Preview

## A1. DETERMINATION OF THE DESIGN PRESSURE FOR CURED-IN-PLACE LINERS IN PARTIALLY DETERIORATED PIPE

### A1.1 Introduction

A1.1.1 The life of deteriorating buried gas distribution piping can be extended by lining the pipe. Rehabilitation technologies utilize the existing cavity and the structural support of the old pipe by inserting a liner into the old pipe. Cured-in-place (CIP) liners typically have an elastomeric layer in contact with the gas to inhibit permeation, and a fabric backing to contain the pressure. The liner is attached to the host pipe by an adhesive that cures and stiffens. Liners of this type can be characterized as having an elastomer-fabric-adhesive structure.

A1.1.2 When determining the “life” of a liner, it is necessary to specify the cause of failure, because different driving forces generally result in different estimates of “life.” In the methodology described in this Annex, the stress field that causes failure is assumed to be the internal operating pressure. The “life” calculated on this basis is referred to as “stress rupture life.”

A1.1.3 A traditional and well-established method of determining the long-term strength of unlined pipe is to pressurize the pipe (possibly at higher temperatures to accelerate the process) and note the time-to-failure. Repetition of this experiment using different pressures gives a graph of pressure versus

time-to-failure. Judicious extrapolation of this data to longer times gives the desired result. If the desired service life (“design life”) is specified, the data can be used to determine the expected internal pressure that can be safely sustained at that time. This is termed the “design pressure.” Conversely, if the operating pressure is specified, the data can be used to determine the service life for which the lined pipe will sustain this internal pressure safely. The qualifier with respect to “safety” implies the use of a suitable safety factor. An alternative approach developed by Battelle for the Gas Technology Institute is presented here. Battelle’s approach allows the number of test data to be reduced, and some tests to be performed on coupon specimen rather than full-scale host pipe.

A1.1.4 Pipe is lined because the integrity of the original host pipe is questionable. This means that the pipe has leaks (holes) or is expected to leak in the near future. Therefore, the long-term evaluation of lined pipe that fails because of internal pressure needs to consider the effect of:

- Internal pressure,
- Hole size,
- Hole shape,
- Host pipe diameter, and
- Operating temperature.

A1.1.5 To extend traditional testing methods to lined pipe of different diameters and different holes, a large test matrix becomes necessary. This is likely to be time-consuming and expensive. By combining full-scale (or traditional) tests with coupon testing and a mathematical model, the procedure is able to reduce the amount of testing and extrapolate data on a more rational basis. This approach is described in the sections titled, “Material Characterization,” and “Mathematical Modeling.” It has been validated for two commercial liners, both of which had the elastomer-fabric-adhesive structure described earlier.

A1.1.6 The methodology described in this Annex documents the specifics of the mathematical model that was originally described in a Gas Research Institute (GRI) report.<sup>4</sup> The equations differ somewhat from those presented in the original report because of slight changes in nomenclature and rectification of minor errors. A stepwise procedure applicable to liners other than those tested and documented in the Gas Research Institute (GRI) report is also given herein.

A1.1.7 This Annex is formatted such that the methodology is described, and the roles of the materials characterization and mathematical modeling are clarified. Sections in this Annex (along with a brief description of the contents) are:

A1.1.7.1 *Stress Rupture Life Determination*—Defines empirical relationships between operating pressure, burst pressure, time-to-failure, and operating temperature, for a given hole shape and size, and pipe diameter based on measured data. If the model is applicable to the liner behavior, the burst pressure can be calculated from material properties as a function of hole shape and size, and pipe diameter. The model has been validated for two liners with the elastomer-fabric-adhesive structure.

A1.1.7.2 *Material Characterization*—Defines the material properties that are necessary, and indicates the manner of data acquisition and data processing.

A1.1.7.3 *Mathematical Modeling*—Lists the equations that comprise the model, and the physical origin of the equations.

A1.1.7.4 *Selection of the Failure Criterion and Computation of Burst Pressure*—Gives an overview of how the equations are to be processed, and specifies the input variables and the output variables.

A1.1.7.5 *Procedure to Estimate Design Pressure*—Gives a stepwise process to determine design pressure of a CIP liner.

## A1.2 Stress Rupture Life Determination

A1.2.1 In full-scale stress-rupture tests, lined pipe of a specific diameter, with the host pipe having a hole of specific dimensions and a specific shape, is held under sustained internal pressure until the liner ruptures. When the rupture is immediate (under conditions of rapidly increasing internal pressure), the pressure at rupture is termed the “burst pressure” or the “ultimate strength.” At pressures less than the burst pressure, failure is not immediate but occurs after a time period termed “time-to-failure.” By repeating the test using different internal pressures, but keeping all other variables constant, an

empirical relationship between the internal pressure and the time-to-failure is obtained (for a specific pipe diameter, hole shape, hole size, and operating temperature). By geometrically extrapolating the short-term data, one can obtain a design pressure corresponding to a desired design life. It is assumed that there is only one mode of failure in the short-term data set, and that the same mode of failure will be exhibited over the period of extrapolation. The entire procedure may have to be repeated to account for parameters such as hole size, hole shape, host pipe diameter and operating temperature.

A1.2.2 On the other hand, if the empirical data are used in conjunction with an applicable theoretical model, fewer tests are required, coupon testing can be substituted for some of the full-scale testing, and a more rational extrapolation basis can be used. The applicability of the model is determined by whether an equivalence can be demonstrated between tensile tests on coupons and stress-rupture tests on lined pipe with machined defects. This equivalence implies a unique relationship between load per width (LPW) and internal pressure for a specified hole size. The mathematical model described here demonstrates and quantifies such an equivalence for a particular class of liners.

A1.2.3 Whether the testing uses coupons or full-scale lined pipe, the number of specimens must be large enough so that the data are statistically valid. At least three to five LPW (or pressure) levels should be tested, with at least three replicates at each level. The temperature range should cover the expected temperature range of the liner in operation. The LPW (or pressure) levels need to be selected so that the specimen failure times are relatively evenly distributed over the full range of test times. This may require substantial trial-and-error because fiber composites tend to have a narrow range of LPW (or pressure) levels over which failure occurs. If the load is too high the failure is immediate; if the load is too low, failure times are very long. This emphasizes the importance of multiple test fixtures. The maximum duration of the testing is guided by the expected design life for the liner. In general, good practice suggests that data should not be extrapolated by more than two orders of magnitude when estimating the design life. This translates to tests with a maximum duration of 2500 h for a 30-year design life. The mode of failure must be the same for all specimens. If the mode of failure changes because of stress level or temperature, only data that have the same mode of failure can be analyzed together.

A1.2.4 For convenience, a dimensionless quantity,  $P$ , is defined as the ratio of the LPW to the ultimate LPW for tensile coupons, or the ratio of pressure to the burst pressure for a given size defect for full scale specimens. A power law curve is fit to isothermal data where  $t_f$  is the time to failure, and the constants  $a$  and  $b$  determined by regression analysis.

$$P = a \cdot t_f^b \quad (\text{A1.1})$$

A1.2.5 If data at different temperatures are available, the form of the equation changes to:

$$P = a \cdot t_f^b \cdot e^{k' \left( \frac{1}{T} - \frac{1}{529.7} \right)} \quad (\text{A1.2})$$

where  $T$  is the temperature in degrees Rankine, the constants  $a$ ,  $b$  and  $k'$  are determined from the regression analysis, and  $e$

<sup>4</sup> Francini, R. M., Pimputkar, S. M., Wall, G., and Battelle, M. O., *The Long-Term Performance of the Starline® 200 Liner for Gas Distribution Systems*, GRI-00/0237.

is the natural logarithm and has the value of 2.71828. The statistical level of confidence for the constants should be specified.

A1.2.6 Once the constants have been determined, Eq A1.1 or Eq A1.2 can be used with the specified design life to obtain the design pressure. This will give the maximum allowable LPW or pressure for a given pipe diameter and defect size at the design life. The next step is to extend this data set to any defect size and pipe diameter. This is done by relating coupon test data and hole dimensions to lined pipe burst pressure through material characterization and mathematical modeling.

**A1.3 Material Characterization**

A1.3.1 *Coupon Preparation*—The flexible tubing is shipped “flattened out,” and has folds or creases. (See Fig. A1.1.) The installed liner is to be slit open in such a way as to produce coupon samples that include the creases in some cases and coupons without the creases in other cases. The coupons are cut in several orientations: axially and in the hoop direction. If necessary some coupons can be cut oriented in the 45° direction. (See Fig. A1.2.)

A1.3.2 To represent normal installation conditions, the liner should be tested with the same thickness of adhesive that is present in a normal installation. One way to make test specimens that are representative of field conditions is to flatten the liner between two sheets of metal with the adhesive applied to the same side of the liner (the fabric side) as in practice, as shown in Fig. A1.3. If necessary, a release agent can be applied to the metal to facilitate removal of the specimens. A coupon cross section is shown in Fig. A1.4. Woven liners often have a crease where they have been flattened for spooling. Whether the crease affects liner properties significantly has to be determined by comparing tensile test data for samples with and without the crease. If the presence of a crease is significant, this has to be considered in formulating the test matrix.

A1.3.3 The approach described here applies directly to liners in which the hoop and axial fibers are orthogonal to each other. Tensile properties need to be determined in the hoop and axial orientations for the fabric as shown in Fig. A1.5. Fig. A1.6 shows a coupon being subjected to tensile stress. The specimen needs to be wide enough (0.75 to 1.00 in.) so that a representative number of fibers is included. (See Fig. A1.7) Based on measurements of the dimensions of the coupon, the load, and the strain in the direction of the load and transverse

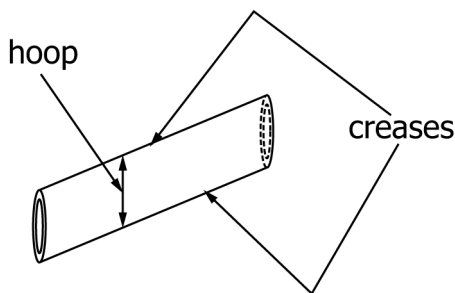


FIG. A1.1 Liner Before It is Slit Open

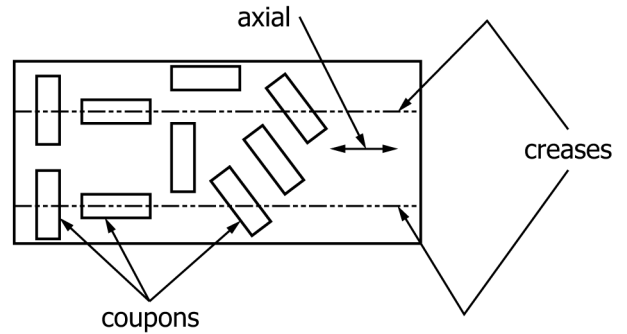


FIG. A1.2 Liner After It is Slit Open (Note the Orientation of the Coupons)

to the load, the LPW and the axial and transverse strains can be calculated and graphed.

A1.3.4 Fig. A1.8 shows a typical load/width-axial strain curve. Close to the origin, the curve is dominated by the strength of the adhesive, and away from the origin, the curve is dominated by the strength of the fiber-elastomer liner. The LPW-strain curve can be approximated by two straight lines (a bilinear curve) as shown in Fig. A1.9. The point of intersection of the two lines represents the yield point and the values at this point are the yield strain and the yield LPW. The slope represents the modulus of elasticity. Least-squares linear regression gives the equations for the bilinear approximation as:

$$y = m_{a1}x + c_{a1} \tag{A1.3}$$

for the left-hand portion, and

$$y = m_{a2}x + c_{a2} \tag{A1.4}$$

for the right-hand portion.

The constants  $m_L$  and  $m_R$  represent the slopes of the lines, and the constants  $c_L$  and  $c_R$  represent intercepts on the y-axis.

A1.3.5 The next step is to plot the load versus the transverse strain. This will result in a plot that has a similar shape to that in Figs. A1.8 and A1.9, but the strain will be negative in most cases. The same procedure described above is used to fit the two parts of the curve to straight lines. The resulting regression of the two straight-line portions of these curves will give the following equations for the initial portion of the curve and secondary straight-line portions of the curve:

$$y = m_{t1}x + c_{t1} \tag{A1.5}$$

$$y = m_{t2}x + c_{t2} \tag{A1.6}$$

The constants  $m_{t1}$  and  $m_{t2}$  represent the slopes of the lines, and the constants  $c_{t1}$  and  $c_{t2}$  represent the intercepts on the y-axis.

A1.3.6 The procedure to determine material properties based on the bilinear approximation is as follows:

A1.3.6.1 The primary modulus is given by:

$$E_1 = m_{a1} \tag{A1.7}$$

A1.3.6.2 The secondary modulus is given by:

$$E_2 = m_{a2} \tag{A1.8}$$

A1.3.6.3 The primary Poisson ratio is given by:

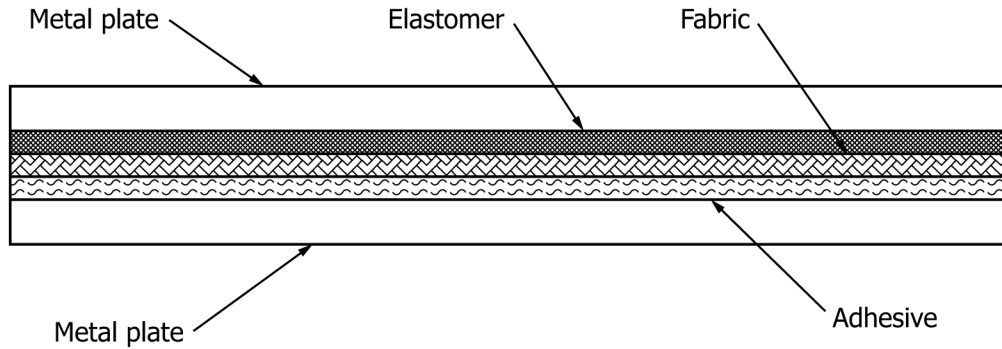


FIG. A1.3 Preparation of Tensile Specimen from Flattened Liner Material (Not to Scale)

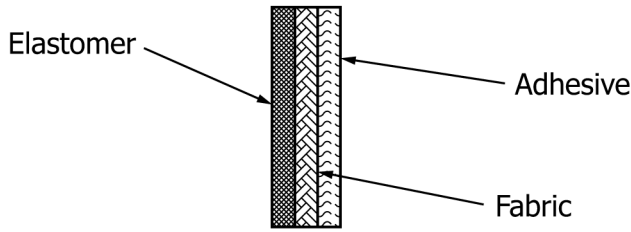


FIG. A1.4 Cross Section of Coupon (Not to Scale)

$$v_{ah-1} = \frac{-m_{r1}}{m_{a1}} \quad (A1.9)$$

A1.3.6.4 The secondary Poisson ratio is given by:

$$v_{ah-2} = \frac{-m_{r2}}{m_{a2}} \quad (A1.10)$$

A1.3.6.5 The intersection of the lines, that is, the solution of Eq A1.3 and A1.4 gives the load/width at yield (on the y-axis) and the strain at yield (on the x-axis).

A1.3.6.6 The maximum value for the load/width is the ultimate load/width.

A1.3.7 The following properties need to be determined for the hoop and axial orientations:

- Yield strain ( $\epsilon_y$ ),
- Load/width at yield ( $N_y$ ),
- Primary modulus ( $E_1$ ),
- Secondary modulus ( $E_2$ ),
- Primary Poisson ratio ( $v_{12-1}$ ),
- Secondary Poisson ratio ( $v_{12-2}$ ) and
- Ultimate load/width ( $N_{uts}$ )

A1.3.8 The orientations in the axial and hoop orientations will be indicated by subscripts “a” and “h” on the parentheses respectively. For example, the yield strain the hoop direction will be represented by  $(\epsilon_y)_h$ , and the secondary modulus in the hoop orientation will be denoted by  $(E_2)_h$ .

A1.3.9 At least five tests need to be performed in each orientation. The averaged values for each property and orientation are used in subsequent calculations. For convenience, material properties termed compliance coefficients can be defined as follows:

A1.3.9.1 The primary interaction compliance ( $S_{12-1}$ ) is determined using the following equation:

$$S_{12-1} = \frac{-v_{12-1}}{E_1} \quad (A1.11)$$

A1.3.9.2 The secondary interaction compliance ( $S_{12-2}$ ) is determined using the following equation:

$$S_{12-2} = \frac{-v_{12-2}}{E_2} \quad (A1.12)$$

#### A1.4 Mathematical Modeling

A1.4.1 This model applies to an elastomer-fabric liner whose shear stiffness is small compared with its stiffness in the axial and hoop directions. The purpose of this model is to use coupon test data, hole size data, and material property data to calculate the ultimate strength of the liner. This enables the calculation of service life or design pressure using Eq A1.1 or Eq A1.2 with greatly reduced full-scale testing of lined pipe. Some burst test data are necessary to select the appropriate failure criterion, and additional burst test data are necessary to validate the model.

A1.4.2 The model solves equilibrium equations, strain displacement equations, constitutive equations, and compatibility equations in conjunction with a failure model. Each is described below:

A1.4.2.1 *Equilibrium*—Static equilibrium of the exposed liner is expressed by the following equation:

$$\frac{N_h}{r_h} + \frac{N_a}{r_a} = p \quad (A1.13)$$

where:

- $N_h$  = hoop load/width,
- $N_a$  = axial load/width,
- $r_h$  = radius of curvature of liner in hoop direction,
- $r_a$  = radius of curvature of liner in axial direction, and
- $p$  = applied pressure.

A1.4.2.2 *Strain Displacement*—The defect is assumed to be uniquely characterized by two dimensions,  $w$  in the hoop direction, and  $L$  in the axial direction. For circular defects,  $L = w$ . It is assumed that the liner deforms into a circular arc at the hole in each of these directions, as shown in Fig. A1.10. The strains are then given by:

$$\epsilon_h = \frac{2 \cdot r_h \cdot \sin^{-1} \left( \frac{w}{2 \cdot r_h} \right)}{D \cdot \sin^{-1} \left( \frac{w}{D} \right)} - 1 \quad (A1.14)$$



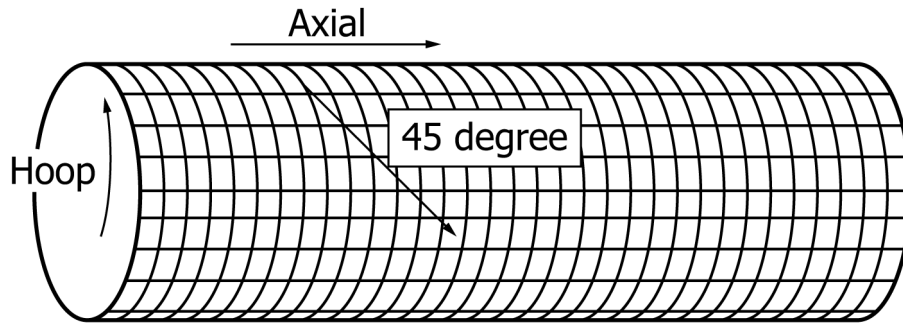


FIG. A1.5 Definition of Fiber Orientation for Tensile Testing

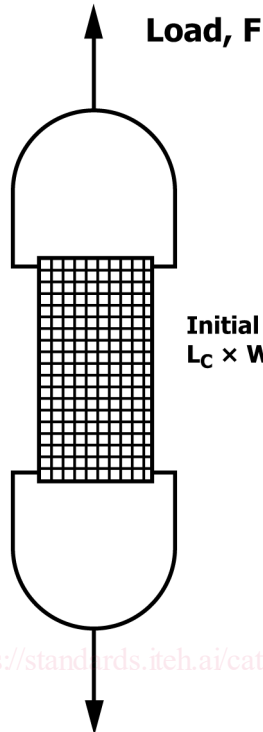


FIG. A1.6 Schematic of Tensile Test

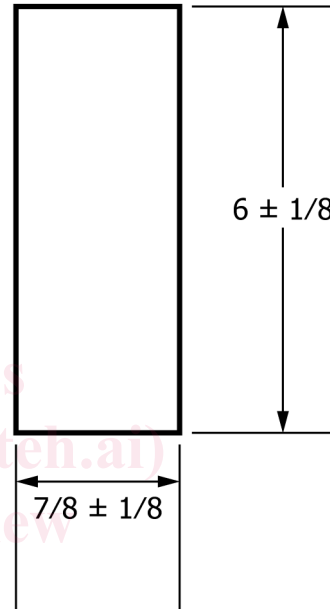


FIG. A1.7 Coupon Size

$$\epsilon_a = \frac{2 \cdot r_a \cdot \sin^{-1} \left( \frac{L}{2 \cdot r_a} \right) - L}{L} \quad (\text{A1.15})$$

where:

$D$  = diameter of the host pipe.

A1.4.2.3 *Constitutive Equations*—The liner is assumed to be an orthotropic membrane without any shear stiffness. The relationship between stress and strain is then given by the following equations:

$$\epsilon_h = \frac{1}{E_h} \cdot N_h + S_{12} \cdot N_a \quad (\text{A1.16})$$

$$\epsilon_a = S_{12} \cdot N_h + \frac{1}{E_a} \cdot N_a \quad (\text{A1.17})$$

When using Eq A1.16 and A1.17, it is noted that the coefficients are different above and below the yield strain because of the bilinear approximation. The appropriate primary and secondary properties should be used.

NOTE A1.1—Strictly speaking,  $S_{12}$  in Eq A1.17 is  $S_{21}$ . Normally these are equal, but with a fabric they may not be. This will be determined during the material property testing described above. In the case that they are not, it must be taken into account when solving the series of equations.

A1.4.2.4 *Compatibility Equations*—As the liner bulges out of the defect, it is constrained to pass through the end-points of the defect. This requirement, in conjunction with the assumption that the shape of the liner in the axial and hoop directions is a circular arc, gives the following relationships for the radius of curvature of the bulge in each direction:

$$r_a = \frac{L^2}{8 \cdot h} + \frac{h}{2} \quad (\text{A1.18})$$

$$r_h = \frac{w^2}{8 \cdot h} + \frac{h}{2} \quad (\text{A1.19})$$

where:

$h$  = height of the liner bulge beyond the pipe wall.

A1.4.2.5 *Failure Criteria*—Two failure criteria have been used successfully with liners. They are the maximum stress criterion and the interactive stress criterion. In the maximum stress criterion, failure occurs when either the hoop load/width

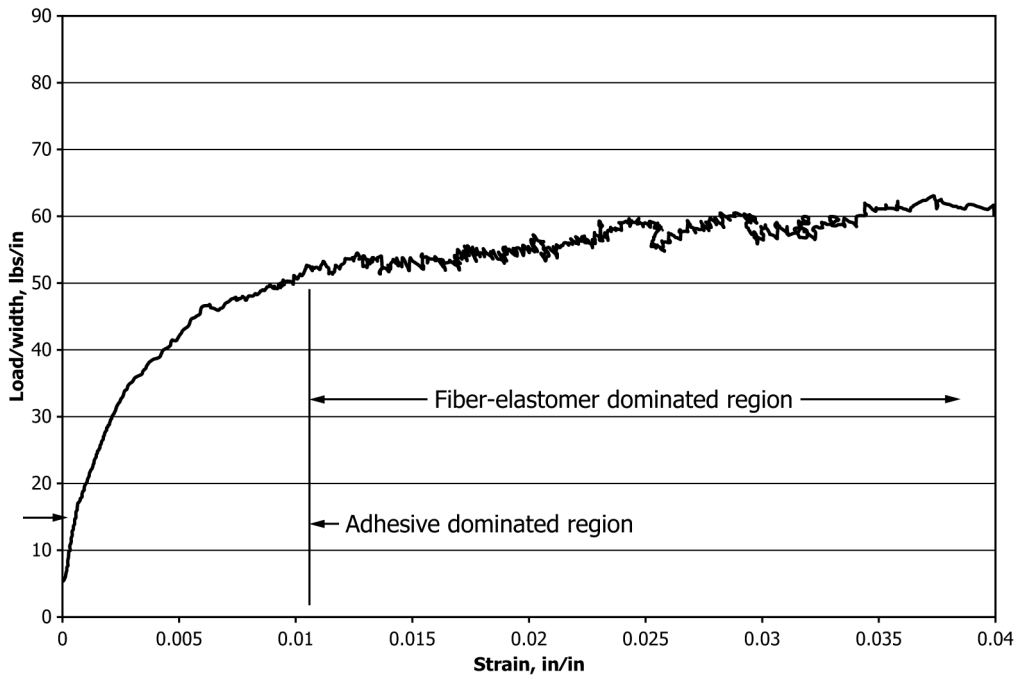


FIG. A1.8 Load/Width (N) versus Strain Showing Adhesive Dominance and Fiber-Elastomer Dominance

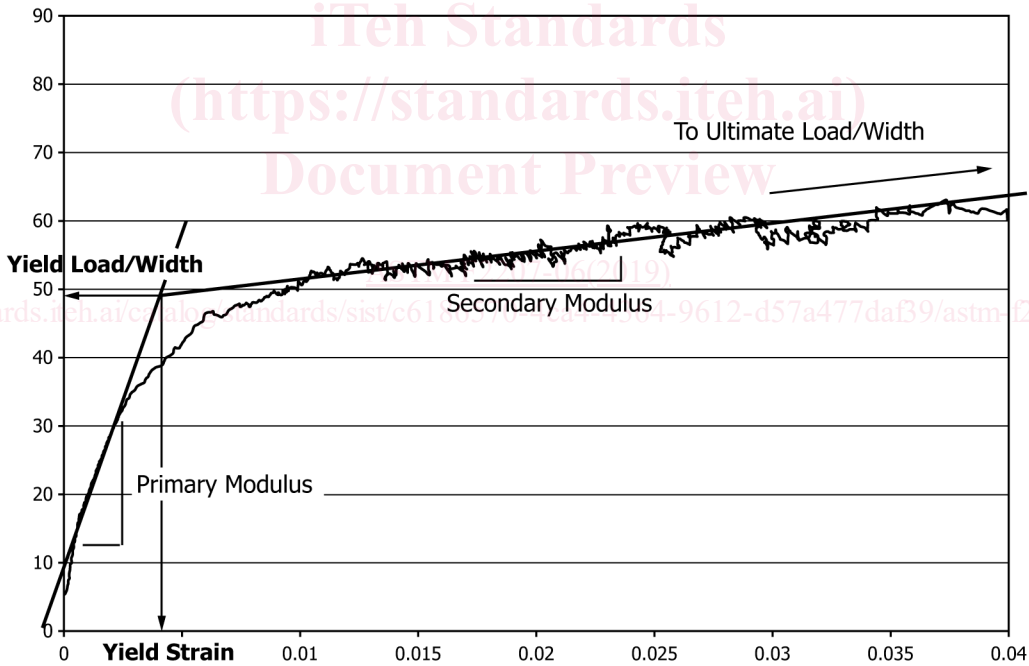


FIG. A1.9 Properties Defined on the Basis of the Bilinear Approximation

reaches the ultimate hoop load/width or the axial load/width reaches the ultimate axial load/width. This means that failure occurs when:

$$\frac{N_h}{(N_{uts})_h} = 1 \quad (A1.20)$$

$$\frac{N_a}{(N_{uts})_a} = 1 \quad (A1.21)$$

In the interactive stress criterion, failure occurs when the following condition is reached:

$$\left(\frac{N_h}{(N_{uts})_h}\right)^2 - \frac{N_h N_a}{(N_{uts})_h^2} + \left(\frac{N_a}{(N_{uts})_a}\right)^2 = 1 \quad (A1.22)$$

Which failure criterion is more appropriate for a given liner is determined by comparing calculated burst pressure with measured values of burst pressure as described next.