

INTERNATIONAL STANDARD



High-voltage switchgear and controlgear –
Part 112: Alternating current high-speed earthing switches for secondary arc
extinction on transmission lines

Document Preview

[IEC 62271-112:2021](#)

<https://standards.iteh.ai/catalog/standards/iec/8df007e6-3920-4d37-aa1f-efd5f6009f1c/iec-62271-112-2021>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2021 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC online collection - oc.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 18 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

International Standards
standards.iteh.ai
Document Preview

[IEC 62271-112:2021](https://standards.iteh.ai/catalog/standards/iec/8df007e6-3920-4d37-aa1f-efd5f6009f1c/iec-62271-112-2021)

<https://standards.iteh.ai/catalog/standards/iec/8df007e6-3920-4d37-aa1f-efd5f6009f1c/iec-62271-112-2021>



IEC 62271-112

Edition 2.0 2021-07
REDLINE VERSION

INTERNATIONAL STANDARD



High-voltage switchgear and controlgear –
Part 112: Alternating current high-speed earthing switches for secondary arc
extinction on transmission lines

Document Preview

[IEC 62271-112:2021](#)

<https://standards.iteh.ai/catalog/standards/iec/8df007e6-3920-4d37-aa1f-efd5f6009f1c/iec-62271-112-2021>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.130.10; 29.130.99

ISBN 978-2-8322-5282-6

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD	3
1 Scope	5
2 Normative references	5
3 Terms and definitions	5
4 Normal and special service conditions	8
5 Ratings	8
6 Design and construction	11
7 Type tests	13
8 Routine tests	17
9 Guide to the selection of HSESs (informative)	17
10 Information to be given with enquiries, tenders and orders (informative)	17
10 Rules for transport, storage, installation, operation and maintenance	17
11 Transport, storage, installation, operating instructions and maintenance	17
12 Safety	18
Annex A (informative) Background information on the use of HSESs	19
Annex B (informative) Induced current and voltage conditions for other cases	25
Bibliography	30
Figure 1 – Explanation of a multi-phase auto-reclosing scheme	7
Figure 2 – Timing chart of HSES and circuit-breakers	10
Figure A.1 – Single-line diagram of a power system	20
Figure A.2 – Timing chart of the HSESs in relation to the transmission line circuit-breakers	20
Figure A.3 – Typical timing chart showing the time between fault initiation and a successful re-close of the transmission line circuit-breakers	22
Figure B.1 – System condition to explain successive fault	26
Figure B.2 – Example of waveforms of delayed current zero phenomena	26
Figure B.3 – Typical test circuit for electromagnetic coupling test-duty of a HSES with delayed current zero crossings	28
Figure B.4 – Typical test circuit for electrostatic coupling test-duty of HSES with delayed current zero crossings	28
Table 1 – Standardized values of rated induced currents and voltages	12
Table 2 – Items to be listed on nameplate of a HSES	15
Table 1 – Nameplate information	12
Table 2 – Standard values of rated induced currents and voltages	15
Table A.1 – Comparison of earthing switches	23
Table A.2 – Comparison of a four-legged reactor and HSES	24
Table B.1 – Preferred values for single-phase earth fault with delayed current zero phenomena in the presence of a successive fault	27
Table B.2 – Preferred values for multi-phase earth faults in a double-circuit system	29
Table B.3 – Preferred values for covering the cases of categories 0 and 1	29

INTERNATIONAL ELECTROTECHNICAL COMMISSION

HIGH-VOLTAGE SWITCHGEAR AND CONTROLGEAR –

**Part 112: Alternating current high-speed earthing switches
for secondary arc extinction on transmission lines**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition IEC 62271-112:2013. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.

IEC 62271-112 has been prepared by subcommittee 17A: Switching devices, of IEC technical committee 17: High-voltage switchgear and controlgear. It is an International Standard.

This second edition cancels and replaces the first edition published in 2013. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

The document has been updated to the second edition of IEC 62271-1:2017.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
17A/1311/FDIS	17A/1314/RVD

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/standardsdev/publications.

This International Standard should be read in conjunction with IEC 62271-1:2017, to which it refers and which is applicable, unless otherwise specified. In order to simplify the indication of corresponding requirements, the same numbering of clauses and subclauses is used as in IEC 62271-1:2017. Amendments to these clauses and subclauses are given under the same numbering, whilst additional subclauses, are numbered from 101.

A list of all parts in the IEC 62271 series, published under the general title *High-voltage switchgear and controlgear*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

HIGH-VOLTAGE SWITCHGEAR AND CONTROLGEAR –

Part 112: Alternating current high-speed earthing switches for secondary arc extinction on transmission lines

~~1~~ General

1 Scope

This part of IEC 62271 applies to AC high-speed earthing switches (hereinafter termed HSES) designed for indoor and outdoor installation and for operation at service frequencies of 50 Hz and 60 Hz on systems having rated voltages of 550 kV and above.

HSESs described in this document are intended to extinguish the secondary arc remaining after clearing faults on transmission lines by the circuit-breakers.

For more detailed information on HSESs, refer to Annex A.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-441:1984, *International Electrotechnical Vocabulary (IEV) – Part 441: Switchgear, controlgear and fuses*

IEC 60050-441:1984/AMD1:2000

IEC 62271-1:~~2007~~2017, *High-voltage switchgear and controlgear – Part 1: Common specifications for alternating current switchgear and controlgear*

IEC 62271-100:~~2008~~2021, *High-voltage switchgear and controlgear – Part 100: Alternating current circuit-breakers*

IEC 62271-102:~~2004~~2018, *High-voltage switchgear and controlgear – Part 102: Alternating current disconnectors and earthing switches*

IEC 62271-200:2011, *High-voltage switchgear and controlgear – Part 200: AC metal-enclosed switchgear and controlgear for rated voltages above 1 kV and up to and including 52 kV*

~~IEC 62271-203:2011, High-voltage switchgear and controlgear – Part 203: Gas-insulated metal-enclosed switchgear for rated voltages above 52 kV~~

3 Terms and definitions

For the purposes of this document, the terms and definitions given in Clause 3 of IEC 62271-1:~~2011~~2017, as well as the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

Additional terms and definitions are classified so as to be aligned with the classification used in IEC 60050-441.

3.1 General terms and definitions

3.1.101

secondary arc

arc that remains at the faulted point after interruption of the short-circuit current fed by the network

Note 1 to entry: This secondary arc is supplied by electrostatic or electromagnetic induction from the adjacent **healthy** live phases.

3.1.102

single-phase auto-reclosing scheme

auto-reclosing scheme in which a faulted phase circuit is opened and automatically re-closed independently from the other phases

3.1.103

multi-phase auto-reclosing scheme


auto-reclosing scheme applied to double circuit overhead lines in which all faulted phase circuits are opened and re-closed independently provided that at least two different phases remain unfaulted

Note 1 to entry: An example of multi-phase auto-reclosing scheme is indicated in Figure 1.

ITEH Standards
(<https://standards.iteh.ai/>)
Document Preview

[IEC 62271-112:2021](https://standards.iteh.ai/catalog/standards/iec/8df007e6-3920-4d37-aa1f-efd5f6009f1c/iec-62271-112-2021)

<https://standards.iteh.ai/catalog/standards/iec/8df007e6-3920-4d37-aa1f-efd5f6009f1c/iec-62271-112-2021>

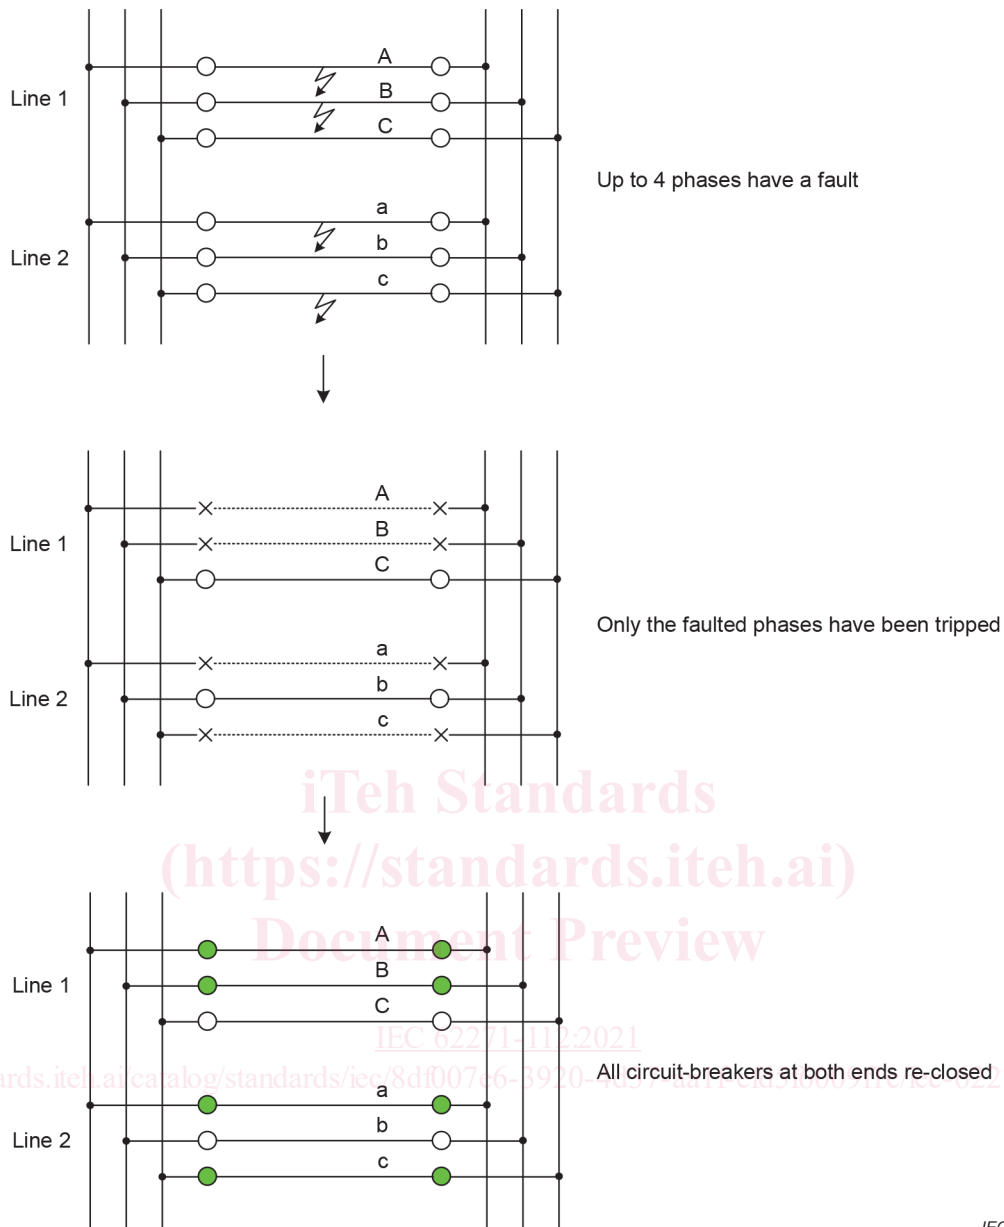

IEC

Key

- | | |
|--|-----------------------------|
| 1) Up to 4 phases have a fault | ○ Closed circuit-breaker |
| 2) Only the faulted phases have been tripped | × Open circuit-breaker |
| 3) All circuit-breakers at both ends re-closed | ● Re-closed circuit-breaker |

Figure 1 – Explanation of a multi-phase auto-reclosing scheme

Note 2 to entry: Other than the scheme described in 3.1.102 and 3.1.103, a three-phase auto-reclosing scheme is commonly applied. In this scheme, all three phases of one circuit are tripped and re-closed at both ends even if a fault occurred in one phase. So far high-speed earthing switches are rarely applied with this scheme.

3.1.104 successive fault

additional earth fault that occurs in the adjacent phase circuit(s) during the time interval between a single-phase earth fault and the opening of the high-speed earthing switch(es)

3.2 Assemblies of switchgear and controlgear

No particular definitions.

3.3 Parts of assemblies

No particular definitions.

3.4 Switching devices

3.4.101

high-speed earthing switch HSES

earthing switch that has the capability to:

- make, carry and interrupt the induced current;
- withstand the recovery voltage caused by electromagnetic and/or by electrostatic couplings prior to circuit re-closure;
- make and carry the rated short-circuit current

Note 1 to entry: The high-speed operation applies normally to both closing and opening.

Note 2 to entry: A high-speed earthing switch is not intended to be used as a maintenance earthing switch.

3.4.102

high-speed earthing switch class M0

high-speed earthing switch having a normal mechanical endurance of 1 000 operation cycles

3.4.103

high-speed earthing switch class M1

high-speed earthing switch having an extended mechanical endurance of 2 000 operation cycles for special requirements

3.5 Parts of switchgear and controlgear

No particular definitions.

3.6 Operational characteristics of switchgear and controlgear

No particular definitions.

3.7 Characteristics quantities

No particular definitions.

24 Normal and special service conditions

~~Clause 2 of IEC 62271-1:2007 is applicable.~~

Clause 4 of IEC 62271-1:2017 is applicable.

45 Ratings

5.1 General

~~Clause 4 of IEC 62271-1:2007 is applicable with the following additions.~~

Clause 5 of IEC 62271-1:2017 is applicable with the following additions.

NOTE Categories corresponding to the fault modes are explained in Annex B.

~~4.4 — Rated normal current and temperature rise~~

~~Subclause 4.4 of IEC 62271-1:2007 is not applicable.~~

5.5 Rated continuous current (I_r)

Subclause 5.5 of IEC 62271-1:2017 is not applicable.

45.101 Rated short-circuit making current (I_{ma})

~~Subclause 4.101 of IEC 62271-102:2001 is applicable.~~

Subclause 5.101 of IEC 62271-102:2018 is applicable.

45.102 Rated operating sequence

The rated characteristics of the HSES are referred to the rated operating sequence.

a) C – t_{i1} – O,

or

b) C – t_{i1} – O – t_{i2} – C – t_{i1} – O


Where

- t_{i1} is a time that is longer than the time required for secondary arc extinction and for dielectric recovery of air insulation at the faulted point. t_{i1} is determined by users considering system stability. The preferred value of t_{i1} is 0,15 s;
- t_{i2} is the intermediate time that is given by the system protection. t_{i2} includes the closing time of the circuit-breakers after the HSESs open, the duration of a new line fault and the break-time of the circuit-breakers. Following this time t_{i2} , the HSES can be reclosed. The preferred value of t_{i2} is 0,5 s.

In this case the HSES shall be able to operate without intentional time delay.

NOTE t_{i1} and t_{i2} are set by system control scheme and a HSES itself is to be operated according to its own operating time.

Figure 2 shows the time chart for the rated operating sequence of C – t_{i1} – O – t_{i2} – C – t_{i1} – O.

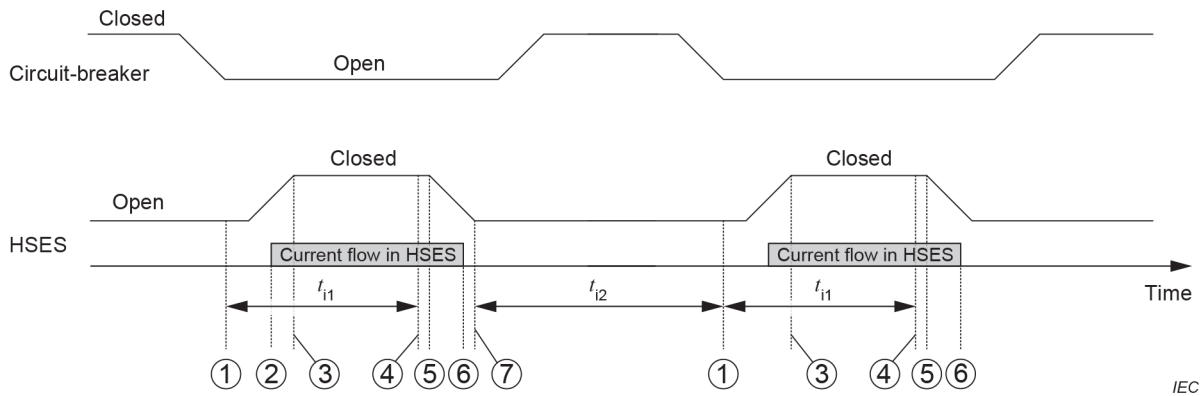

Key

Circuit-breaker	Transmission line circuit-breakers that interrupt the fault	3	Contact touch of HSESs
HSES	High-speed earthing switches	4	Energizing of the opening release of the HSESs
1	Energizing of the closing circuit of the HSESs	5	Contact separation of HSESs
2	Current start in HSESs	6	Arc extinction in HSESs
t_{i1}, t_{i2}	Times defined in 45.102	7	Fully open position of HSESs

NOTE 1 A common value for the re-closing time of the circuit-breaker is 1 s to guarantee system stability.

NOTE 2 t_{i1} is normally within the range of 0,15 s to 0,5 s.

NOTE 3 t_{i2} is normally within the range of 0,5 s to 1 s.

NOTE 4 The operating sequence b) is for system stability requirements to cover cases where another fault occurs on the same phase.

NOTE 5 The HSES closing time is normally less than 0,2 s.

Figure 2 – Timing chart of HSES and circuit-breakers

4.103 Standard values for interruption

Standard values for HSES are given in Table 1.

Table 1 – Standardized values of rated induced currents and voltages

Rated voltage U_r	Electromagnetic coupling				Electrostatic coupling	
	Rated induced current (+10 % / -0 %)	Rated power frequency recovery voltage (+10 % / -0 %)	First TRV peak (+10 % / -0 %)	Time to first peak (+10 % / -0 %)	Rated induced current (+10 % / -0 %)	Rated induced voltage (+10 % / -0 %)
kV	A (rms)	kV (rms)	kV	ms	A (rms)	kV (rms)
550	6-800	240	580	0,6	120	115
800	6-800	240	580	0,6	170	170
1-100 to 1-200	6-800	240	580	0,6	230	235

NOTE 1 For Table 1 the rated induced voltages by electrostatic recovery voltage have a 1-cos wave shape.

NOTE 2 For networks with up to two faults (category 0 and 1 as described in B.2) the corresponding values are presented in Table B.3.

~~For networks with delayed current zero crossing occurrence (category 3 as described in B.2), the corresponding values are presented in Table B.1.~~

~~For networks with multi-phase faults (category 4 as described in B.2) the corresponding values are presented in Table B.2.~~

56 Design and construction

~~Clause 5 of IEC 62271-1:2007 is applicable with the following modifications.~~

Clause 6 of IEC 62271-1:2017 is applicable with the following modifications.

56.5 Dependent power operation

~~Subclause 5.5 of IEC 62271-1:2007 is not applicable.~~

Subclause 6.5 of IEC 62271-1:2017 is not applicable.

~~**5.7 Independent manual operation power operation (independent unlatched operation)**~~

~~Subclause 5.7 of IEC 62271-1:2007 is not applicable.~~

6.7 Independent unlatched operation (independent manual or power operation)

Subclause 6.7 of IEC 62271-1:2017 is not applicable.

~~**5.10**~~**6.11 Nameplates**

The designation of the equipment is specified as HSES.

Items to be indicated on the nameplate are listed in ~~Table 2~~ Table 1.

<https://standards.iteh.ai/catalog/standards/iec/8df007e6-3920-4d37-aa1f-efd5f6009f1c/iec-62271-112-2021>

~~**Table 2 – Items to be listed on nameplate of a HSES**~~

Item
Manufacturer
Designation of type
Serial number
Year of manufacture
Rated voltage
Rated lightning impulse withstand voltage
Rated switching impulse withstand voltage
Rated power-frequency withstand voltage
Rated short-time withstand and peak withstand current
Rated duration of short-circuit
Rated filling pressure for insulation and /or operation
Rated supply voltage of auxiliary circuit
Rated frequency
Mechanical endurance class
Mass (including fluid)
Operating sequence

Table 1 – Nameplate information

Item	Abbreviation	Unit
Name of manufacturer		
Type designation		
Serial number		
Year of manufacture		
Rated voltage	U_r	kV
Rated lightning impulse withstand voltage	U_p	kV
Rated switching impulse withstand voltage	U_s	kV
Rated power-frequency withstand voltage	U_d	kV
Rated short-time withstand current	I_k	kA
Rate peak withstand current	I_p	kA
Rated duration of short-circuit	t_k	s
Rated short-circuit making current	I_{ma}	kA
Filling pressure for insulation	P_{re}	MPa
Filling pressure for operation	P_{rm}	MPa
Rated supply voltage(s) of auxiliary and control circuits Specify DC/AC (with rated frequency)	U_a	V
Rated frequency	f_r	Hz
Mechanical endurance class	M_1/M_2	
Electrical endurance class	E_1/E_2	
Type and mass fluid (liquid or gas) for insulation	M_f	kg
Mass (including fluid)	M	kg
Operating sequence	C- t_{r1} -O or C- t_{r1} -O- t_{r2} -C- t_{r1} -O (t_{r1}, t_{r2})	
Minimum and maximum ambient temperature		°C
Category (option) ^a		
^a Category is to refer to Clause B.2		

~~5.11 Interlocking devices~~

~~Subclause 5.11 of IEC 62271-1:2007 is not applicable.~~

6.12 Locking devices

Subclause 6.12 of IEC 62271-1:2017 is not applicable.

56.101 Anti-pumping device

Anti-pumping device shall be provided for pneumatic and hydraulic operating mechanism.