



Designation: ~~D3806 – 98 (Reapproved 2016)~~ **D3806 – 19**

Standard Test Method of Small-Scale Evaluation of Fire-Retardant Paints (2-Foot Tunnel Method)¹

This standard is issued under the fixed designation D3806; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This test method determines the protection a coating affords its substrate, and the comparative burning characteristics of coatings by evaluating the flame spread over the surface when ignited under controlled conditions in a small tunnel. This establishes a basis for comparing surface-burning characteristics of different coatings without specific consideration of all the end-use parameters that might affect surface-burning characteristics under actual fire conditions.

1.2 In addition to the experimental flame spread rate, the weight of panel consumed, time of afterflaming and afterglow, char dimensions and index, and height of intumescence ~~may~~can be measured in this test. However, a relationship should not be presumed among these measurements.

~~1.3 This standard should be used to measure and describe the properties of materials, products, or assemblies in response to heat and flame under controlled laboratory conditions, and should not be used to describe or appraise the fire hazard or fire risk of materials, products, or assemblies under actual fire conditions. However, results of this test may be used as elements of a fire risk assessment which takes into account all of the factors which are pertinent to an assessment of the fire hazard of a particular end use.~~

1.3 The values stated in SI units are to be regarded as the standard. The values given in parentheses are for information only.

1.4 This standard is used to measure and describe the response of materials, products, or assemblies to heat and flame under controlled conditions, but does not by itself incorporate all factors required for fire hazard or fire risk assessment of the materials, products, or assemblies under actual fire conditions.

1.5 Fire testing is inherently hazardous. Adequate safeguards for personnel and property shall be employed in conducting these tests.

1.6 This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate ~~safety~~safety, health, and health~~environmental~~ practices and determine the applicability of regulatory limitations prior to use.

1.7 This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 *ASTM Standards:*²

~~E220 Specification for Flat Asbestos-Cement Sheets~~

~~D344 Test Method for Relative Hiding Power of Paints by the Visual Evaluation of Brushouts~~ (Withdrawn 2018)³

~~D1475 Test Method for Density of Liquid Coatings, Inks, and Related Products~~

~~D2196 Test Methods for Rheological Properties of Non-Newtonian Materials by Rotational Viscometer~~

~~E84 Test Method for Surface Burning Characteristics of Building Materials~~

¹ This test method is under the jurisdiction of ASTM Committee D01 on Paint and Related Coatings, Materials, and Applications and is the direct responsibility of Subcommittee D01.21 on Chemical Analysis of Paints and Paint Materials.

Current edition approved Dec. 1, 2016/Oct. 1, 2019. Published December 2016/October 2019. Originally approved in 1979. Last previous edition approved in 2011/2016 as D3806 – 98 (2011);(2016). DOI: 10.1520/D3806-98R16;10.1520/D3806-19.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ The last approved version of this historical standard is referenced on www.astm.org.

2.2 Federal Standard:
 Fed. Spec. TT-V-119 Varnish, Spar, Phenolic Resin⁴

3. Significance and Use

3.1 A number of laboratory procedures are used to evaluate the effectiveness of fire-retardant and fire-resistant treatments and coatings. In general, these methods measure the three stages of fire development: (1) ignition; (2) flame spread (rate of growth of the fire); and (3) conflagration extent. While all three are of extreme importance, flame spread has been recognized as the main factor associated with testing fire-retardant coatings.

3.2 Flame spread ratings based upon Test Method E84 have acquired common acceptance by regulatory agencies, but such large-scale tests are seldom practical during the development or modification of a fire-retardant coating.

3.3 This test method provides the relative flame spread of experimental coatings using small test specimens. By specimens under the conditions established in the 2-foot tunnel. By experimentally calibrating the 2-foot tunnel with similar Test Method E84-rated fire-retardant paint, results obtained by this test method should be indicative of those obtained with a large specimen can be used to screen coatings for suitability for testing in the Test Method E84 tunnel.

3.3.1 This test method is intended as an experimental tool in evaluating experimental coatings for further development. No direct correlation of results from this test method and the Test Method E84 tunnel have been made or are implied.

3.3.2 The results obtained by this test method do not in themselves act as an accurate predictor of performance in Test Method E84.

4. Apparatus

4.1 *Flame Tunnel* (see Fig. 1A)—610-mm (two-foot) flame tunnel consisting of ~~asbestos-cement~~ asbestos-free cement board mounted on ~~an iron~~ a steel or stainless steel framework and supplied with ~~natural gas~~ methane fuel of uniform quality.

4.1.1 The framework is constructed of 3 by 25 by 25-mm (1/8 by 1 by 1-in.) ~~angle iron~~ steel or stainless steel, the top of which provides a 610 by 100-mm (24 by 4-in.) specimen holder inclined at 28° to the horizontal. The framework is mounted on a 250 by 610 by 13-mm (10 by 24 by 1/2-in.) steel or stainless steel base. The specimen holder is elevated 185 mm (7 3/8 in.) above the base at the lower (fire) end and 480 mm (18 7/8 in.) at the upper (flue) end.

(<https://standards.iteh.ai>)
 Document Preview

Materials of Construction and Equipment List

Item No	Item	Item No	Item
A	Base Plate	F	Glare Shield
B	Framework	G	Ceramic Insulator
C	Side and Front Panels	H	Spark Wire
D	Side Glass	I	Thermocouple
E	Burner		
	Gas Control Valve and Gage not shown		

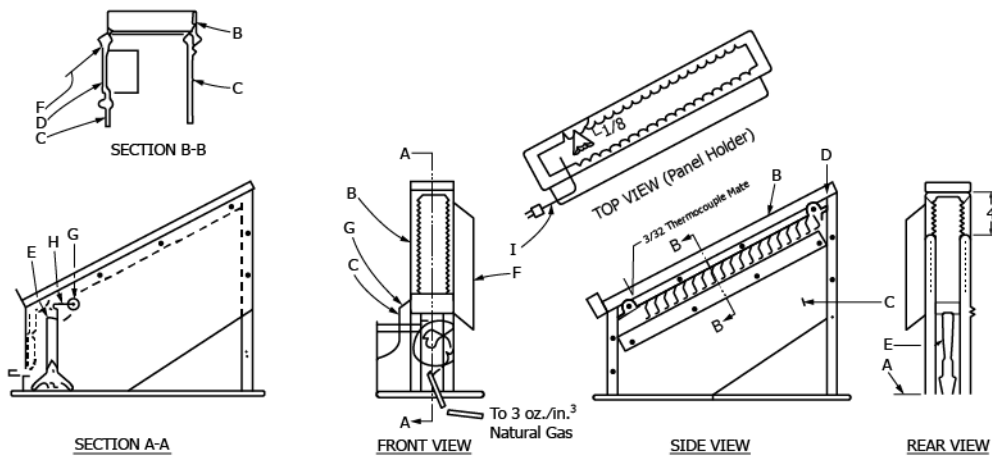


FIG. 1 Flame Tunnel

⁴ Available from DLA Document Services, Building 4/D, 700 Robbins Ave., Philadelphia, PA 19111-5094, <http://quicksearch.dla.mil>.

TABLE 1 Densities and Panel Weights of Various Woods (Conditioned at Relative Humidity 50 ± 5 % and 23 ± 2°C (73.5 ± 3.5°F) for 14 days)

Type of Wood	Density (9 to 10 % Moisture), kg/m ³ (lb/ft ³)	Weight of 3/8 by 23/8 by 1/4 in. Panel, g
Red cedar	345 to 360 (21.4 to 22.4)	130 to 140
Douglas fir	465 to 560 (29 to 35)	180 to 215
White pine-Ponderosa pine	360 to 420 (22.4 to 26.4)	140 to 160
Southern yellow pine	495 to 590 (31 to 37)	190 to 225
Redwood	435 to 450 (27.2 to 28.2)	165 to 175

4.1.2 The fire end and sides of the tunnel are covered to the extent shown in Fig. 1, with 6-mm (1/4-in.) asbestos-cement asbestos-free cement board or 6-mm (1/4-in.) inorganic asbestos-free reinforced-cement board attached to the inside of the angle iron-framework. The open flue end and the cut-out sides allow a natural draft through the tunnel. Additional air access is provided by a 25-mm (1-in.) hole drilled in the cover at the fire end, centered and 115 mm (4 1/2 in.) above the base.

4.1.3 An observation window made of a 50-mm (2-in.) wide strip of 3-mm (1/8-in.) polished heat-resistant sheet glass⁵ is located just below the specimen holder, extending the full length of the tunnel, 610 mm (24 in.). This glass is marked by any appropriate method at 1-in. intervals from 4 to 22 in. A 560 by 55 by 2-mm (22 by 2 1/4 by 1/16-in.) sheet metal shield is attached above the window, slanting downwards at an angle of 60° to shield the observation window. The angle iron-steel or stainless steel panel holder is notched along the bottom or supporting lip of the angle at 25-mm (1-in.) intervals to assist in the measurements of the flame advance.

NOTE 1—A rule may also be mounted outside the observation window to help measure the flame advancement.

4.1.4 A ~~2.5-mm (3/32-in.)~~ hole is drilled in the side of the specimen holder immediately above the center of the burner to allow insertion of a thermocouple.

4.1.5 The tunnel ~~should~~ shall be placed in an area as free from drafts as possible with facilities for removal or escape of combustion products. (Standard laboratory hood with forced draft off during test.)

4.2 ~~Burner,~~⁶ 215 mm (8.5 in.) high with 40-mm diameter, 10-mm thick grid for use with ~~natural~~ methane gas. The burner is placed 57 mm (2 1/4 in.) in from the fire end of the tunnel and 25 mm (1 in.) below the bottom side of the sample holder, that is, 30 mm (1 1/8 in.) from the bottom of the specimen. See Fig. 1.

NOTE 2—Artificial gas or liquid petroleum (LP) gas may be used, but burners designed for these types of gases must be used.

4.3 ~~Ignition Transformer,~~ or other suitable ignition source, to generate a spark through a 2-mm (1/16-in.) Nichrome wire to ignite the burner barrel. ~~The transformer is activated by a push-button type spark switch.~~

4.4 ~~Gas Supply,~~ of uniform quality controlled by a ~~positive-flow pressure regulatory valve (0 to 152 mm (0 to 6 in.) water) and a gas flowmeter (0.6 to 5.0 SCFH)~~ pressure regulator and flow meter appropriate to the gas being used to achieve the correct flame energy level.

4.5 ~~Insulating and Fire Resistant Backing for Test Panels,~~ consisting of 100 by 605-mm (3/8 by 23/8-in.) pieces of 13-mm (1/2-in.) asbestos-cement asbestos-free cement board or inorganic asbestos-free reinforced cement board and 1/2-in. steel or stainless steel plate applied one above the other with ~~asbestos~~ asbestos-free cement or the inorganic asbestos-free reinforced cement board placed directly on top of the test panel.

4.6 ~~Thermocouple~~ totally shielded type K (see Note 3), installed through the hole in the side of the specimen holder so that its tip rests on the back, cool side, of the test panel.

NOTE 3—Some commercial tunnels are supplied with more than one thermocouple.

4.7 ~~Recording Potentiometer,~~ 0 to 300°C ± 0.1 range.

4.8 ~~Audible Timer,~~ set to sound at 15-s intervals to indicate the time for flame-front measurements.

4.9 ~~Constant Temperature and Humidity Room or Cabinet,~~ maintained at 50 ± 5 % relative humidity and 23 ± 2°C (73.5 ± 3.5°F).

5. Test Panels

5.1 ~~Test Panels—~~See Table 1 for a list of various woods and their densities. Wood, 6 by 100 by 605-mm (1/4 by 3/8 by 23/8-in.) close grained, as nearly edge grain as possible and free from knots and imperfections. The panels ~~should~~ shall be solid wood with surfaces planed and sanded (see Note 4). Kiln-dry test panels to contain not more than 10 weight % of moisture on an oven dry basis.

⁵ Quartz or high-silica glass has been found satisfactory for this purpose.

⁶ The sole source of supply of a burner, Catalog No. 3-902 for artificial gas, or Catalog No. 3-900 and 3-902 for natural gas and LP gas, respectively, known to the committee at this time is Fisher Scientific Co. If you are aware of alternative suppliers, please provide this information to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee,¹ which you may attend.