

INTERNATIONAL STANDARD

IEC 60870-6-503

Second edition
2002-04

Telecontrol equipment and systems –

Part 6-503:

Telecontrol protocols compatible with ISO standards and ITU-T recommendations – TASE.2 Services and protocol

Matériels et systèmes de téléconduite –

Partie 6-503:

*Protocoles de téléconduite compatibles avec les
normes ISO et les recommandations de l'UIT-T –
Services et protocole TASE.2*



Reference number
IEC 60870-6-503:2002(E)

Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** (www.iec.ch)

- **Catalogue of IEC publications**

The on-line catalogue on the IEC web site (www.iec.ch/catlg-e.htm) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.

- **IEC Just Published**

This summary of recently issued publications (www.iec.ch/JP.htm) is also available by email. Please contact the Customer Service Centre (see below) for further information.

- **Customer Service Centre**

If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: custserv@iec.ch
Tel: +41 22 919 02 11
Fax: +41 22 919 03 00

INTERNATIONAL STANDARD

IEC 60870-6-503

Second edition
2002-04

Telecontrol equipment and systems –

Part 6-503: Telecontrol protocols compatible with ISO standards and ITU-T recommendations – TASE.2 Services and protocol

Matériels et systèmes de téléconduite –

*Partie 6-503:
Protocoles de téléconduite compatibles avec les
normes ISO et les recommandations de l'UIT-T –
Services et protocole TASE.2*

© IEC 2002 — Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembé, PO Box 131, CH-1211 Geneva 20, Switzerland
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: inmail@iec.ch Web: www.iec.ch



Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

PRICE CODE

XF

For price, see current catalogue

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
1.1 Control centre.....	8
1.2 Architecture.....	9
1.3 Network Model.....	10
1.4 Relation between TASE.2 and MMS.....	10
2 Normative references.....	11
3 Definitions.....	13
4 Abbreviations.....	15
5 TASE.2 Model.....	15
5.1 Informal TASE.2 Model Description.....	15
5.1.1 Associations.....	17
5.1.2 Bilateral Agreements, Bilateral Tables and Access Control.....	18
5.1.3 Data Value Objects and Services.....	20
5.1.4 Data Set Objects and Services.....	20
5.1.5 Account Objects and Services.....	20
5.1.6 Information Message Object and Services.....	20
5.1.7 Transfer Set Objects and Services.....	21
5.1.8 Common Data Transfer Mechanisms.....	23
5.1.9 Special Transfer Objects and Services.....	24
5.1.10 Device Objects and Services.....	24
5.1.11 Program Objects and Services.....	25
5.1.12 Event Enrollment Objects and Services.....	26
5.1.13 Event Condition Objects and Services.....	26
5.2 Formal TASE.2 Model Description.....	26
5.2.1 General Access Control Requirements.....	29
5.2.2 Association Management.....	29
5.2.3 Bilateral Tables.....	31
5.2.4 List of Access Control Specification.....	32
5.2.5 Data Values.....	33
5.2.6 Data Sets.....	34
5.2.7 Accounts.....	36
5.2.8 Information Messages.....	36
5.2.9 Transfer Sets.....	37
5.2.10 Special Transfer Objects.....	45
5.2.11 Devices.....	46
5.2.12 Programs.....	48
5.2.13 Event Enrollments.....	49
5.2.14 Event Conditions.....	49
6 Mapping of TASE.2 Object Models onto MMS Object Models.....	50
6.1 Object Modelling Notation (Informative).....	50
6.2 The Virtual Control Centre (VCC).....	51
6.2.1 TASE.2 Domain Mapping.....	51
6.2.2 TASE.2 Control Centre Mapping.....	52
6.2.3 OSI Application Processes, Application Entities and Presentation Addresses.....	52

6.3	Association Object Model Mapping.....	52
6.4	Bilateral Table Object Model Mapping	53
6.5	Data Value Object Model Mapping	55
6.6	Data Set Object Model Mapping	55
6.7	Account Object Model Mapping.....	56
6.8	Information Message Object Model Mapping	56
6.9	Transfer Set Object Model Mapping	57
6.9.1	Data Set Transfer Set Object Model Mapping	57
6.9.2	Time Series Transfer Set Object Model Mapping	59
6.9.3	Transfer Account Transfer Set Object Model Mapping	60
6.9.4	Information Message Transfer Set Object Model Mapping	61
6.10	Next Transfer Set Object Model Mapping	61
6.11	Transfer Set Name Object Model Mapping	62
6.12	Conditions Object Model Mapping	62
6.13	Event Code Object Model Mapping	62
6.14	Transfer Set Time Stamp Object Model Mapping.....	62
6.15	Device Object Model Mapping.....	63
6.16	Program Object Model Mapping	63
6.17	Event Enrollment Object Model Mapping	64
6.18	Event Condition Object Model Mapping.....	64
7	Mapping of TASE.2 Operations and Actions onto MMS Services.....	65
7.1	Use of MMS Services	66
7.1.1	Association Management Mapping to MMS	67
7.1.2	Data Value Operations Mapping to MMS	70
7.1.3	Data Set Operations Mapping to MMS	73
7.1.4	Transfer Set Operations and Actions Mapping to MMS	80
7.1.5	Account Operations and Actions Mapping	92
7.1.6	Device Operations and Actions Mapping to MMS.....	93
7.1.7	Program Operations Mapping to MMS	99
7.1.8	Event Enrollment Operations Mapping to MMS	104
7.1.9	Event Condition Actions Mapping onto MMS.....	106
7.1.10	Summary of TASE.2 Operations.....	107
8	Standardized Application-specific Objects	109
8.1	Named Type Objects	109
8.1.1	Visible-String-32 Type.....	109
8.1.2	MMS ObjectName	109
8.1.3	Time Stamp Types.....	110
8.1.4	TimeStampExtended Type	110
8.1.5	Time Interval Types	111
8.1.6	TransferSet Types	111
8.1.7	Conditions Types	113
8.1.8	SupportedFeatures Type.....	114
8.1.9	TASE.2Version Type.....	114
8.2	Named Variable Objects	115
8.2.1	"Supported_Features".....	115
8.2.2	"Bilateral_Table_ID"	115
8.2.3	"TASE.2_Version"	115
8.2.4	Data Value Objects	115
8.2.5	Transfer Set Objects.....	116

8.2.6	"Next_DSTransfer_Set".....	116
8.2.7	"Next_TSTransfer_Set".....	116
8.2.8	"Transfer_Set_Name".....	116
8.2.9	"TA_Transfer_Set".....	116
8.2.10	"IM_Transfer_Set".....	116
8.2.11	"DSConditions_Detected".....	117
8.2.12	"TSConditions_Detected".....	117
8.2.13	"TAConditions_Detected".....	117
8.2.14	"Event_Code_Detected".....	117
8.2.15	"Transfer_Set_Time_Stamp".....	117
8.2.16	"Transfer_Report_ACK".....	117
8.2.17	"Transfer_Report_NACK".....	118
8.3	Named Variable List Objects.....	118
8.4	Information Message Objects.....	118
8.5	Event Condition Objects.....	118
9	Conformance.....	119
9.1	Allowable Subsets.....	119
9.2	PICS.....	120
9.3	MMS Services Required.....	124
Annex A (normative) TASE.2 Operations and Actions Summary.....		125
Annex B (normative) Quality of Service (QoS), Routing and Priority.....		127
(https://standards.iteh.ai)		
Preview		
https://standards.iteh.ai/standards/iec/60870-6-503-2002		
a74d88c8a7a1cc-60870-6-503-2002		
Figure 1	– Protocol relationships.....	9
Figure 2	– Router-based WAN.....	10
Figure 3	– Mesh network.....	10
Figure 4	– Informal TASE.2 Model.....	17
Figure 5	– Transfer Reporting Mechanism.....	22
Figure 6	– Relationship between TASE.2 and Real Control Centres.....	27
Figure 7	– TASE.2 server components.....	66
Figure 8	– TASE.2 Server Association Control Components.....	67
Figure 9	– Data Value operations.....	70
Figure 10	– Sequence of Get Data Value.....	71
Figure 11	– Data Set operations.....	74
Figure 12	– Sequence of Create Data Set.....	76
Figure 13	– Sequence of Delete Data Set.....	77
Figure 14	– Transfer Set services.....	81
Figure 15	– Sequence of Transfer Set operations and actions.....	90
Figure 16	– Device operations.....	94
Figure 17	– Sequence of Device Control.....	95
Figure 18	– Server Program Components.....	100
Figure 19	– Sequence of Program Invocation operations.....	104
Table 1 – Scope of the object models in the VCC.....		28
Table 2 – Summary of TASE.2 Operations.....		107

INTERNATIONAL ELECTROTECHNICAL COMMISSION

TELECONTROL EQUIPMENT AND SYSTEMS –

**Part 6-503: Telecontrol protocols compatible with
ISO standards and ITU-T recommendations –
TASE.2 Services and protocol**

FOREWORD

- 1) The IEC (International Electrotechnical Commission) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of the IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, the IEC publishes International Standards. Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. The IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of the IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested National Committees.
- 3) The documents produced have the form of recommendations for international use and are published in the form of standards, technical specifications, technical reports or guides and they are accepted by the National Committees in that sense.
- 4) In order to promote international unification, IEC National Committees undertake to apply IEC International Standards transparently to the maximum extent possible in their national and regional standards. Any divergence between the IEC Standard and the corresponding national or regional standard shall be clearly indicated in the latter.
- 5) The IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with one of its standards.
- 6) Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. The IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60870-6-503 has been prepared by IEC technical committee 57: Power system control and associated communications.

This second edition cancels and replaces the first edition published in 1997 and constitutes a technical revision.

The text of this standard is based on the following documents:

FDIS	Report on voting
57/574/FDIS	57/582/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

Annexes A and B form an integral part of this standard.

The committee has decided that the contents of this publication will remain unchanged until 2004. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

Withdawn

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 60870-6-503:2002](https://standards.iteh.ai/cou/iec/standards/iec/fda11965-2457-43b9-a489-5a74d68e8a4a/iec-60870-6-503-2002)

<https://standards.iteh.ai/cou/iec/standards/iec/fda11965-2457-43b9-a489-5a74d68e8a4a/iec-60870-6-503-2002>

INTRODUCTION

The Telecontrol Application Service Element (TASE.2) protocol (also known as Inter-Control Centre Communications Protocol, ICCP) allows for data exchange over Wide Area Networks (WANs) between a utility control centre and other control centres, other utilities, power pools, regional control centres, and Non-Utility Generators. Data exchange information consists of real-time and historical power system monitoring and control data, including measured values, scheduling data, energy accounting data, and operator messages. This data exchange occurs between one control centre's Supervisory Control And Data Acquisition/Energy Management System/Distribution Management System (SCADA/EMS/DMS) host and another centre's host, often through one or more intervening communications processors.

This part of IEC 60870 defines a mechanism for exchanging time-critical data between control centres. In addition, it provides support for device control, general messaging and control of programs at a remote control centre. It defines a standardized method of using the ISO 9506 Manufacturing Message Specification (MMS) services to implement the exchange of data. The definition of TASE.2 consists of three documents. This part of IEC 60870 defines the TASE.2 application modelling and service definitions. IEC 60870-6-702 defines the application profile for use with TASE.2. IEC 60870-6-802 defines a set of standardized object definitions to be supported.

The TASE.2 describes real control centres with respect to their external visible data and behaviour using an object oriented approach. The objects are abstract in nature and may be used in a wide variety of applications. The use of TASE.2 goes far beyond the application in the control centre to control centre communications. This standard must be understood as a tool box for any application domain with comparable requirements. i.e. the TASE.2 may be applied in areas like substation automation, power plants, factory automation, chemical plants, or others which have comparable requirements. It provides a generic solution for advanced Information and Communication Technology.

The TASE.2 version number for this standard is 2001-08. See 8.2.3 for more details.

[IEC 60870-6-503:2002](https://standards.iteh.ai/catalog/standards/iec/fda11965-2457-43b9-a489-5a74d68e8a4a/iec-60870-6-503-2002)

<https://standards.iteh.ai/catalog/standards/iec/fda11965-2457-43b9-a489-5a74d68e8a4a/iec-60870-6-503-2002>

TELECONTROL EQUIPMENT AND SYSTEMS –

Part 6-503: Telecontrol protocols compatible with ISO standards and ITU-T recommendations – TASE.2 Services and protocol

1 Scope

This part of IEC 60870 specifies a method of exchanging time-critical control centre data through wide-area and local-area networks using a full ISO compliant protocol stack. It contains provisions for supporting both centralized and distributed architectures. This standard includes the exchange of real-time data indications, control operations, time-series data, scheduling and accounting information, remote program control and event notification.

Though the primary objective of TASE.2 is to provide control centre (telecontrol) data exchange, its use is not restricted to control centre data exchange. It may be applied in any other domain having comparable requirements. Examples of such domains are power plants, factory automation, process control automation, and others.

This standard does not specify individual implementations or products, nor does it constrain the implementation of entities and interfaces within a computer system. This standard specifies the externally visible functionality of implementations together with conformance requirements for such functionalities.

1.1 Control centre

The model of a control centre includes four primary classes of host processors: SCADA/EMS, Demand Side Management (DSM)/ Load Management, Distributed Applications, and Display Processors. The SCADA/EMS host is the primary processor, utilizing analogue and digital monitoring data collected at power plants, Non-Utility Generators, and transmission and distribution substations via Data Acquisition Units (DAUs) and Remote Terminal Units (RTUs). The control centre typically contains redundant SCADA/EMS/DMS hosts in a "hot standby" configuration. The DSM/Load Management host(s) are used by either an operator or EMS application to initiate load management activities. The Distributed Application host(s) perform miscellaneous analysis, scheduling, or forecasting functions. Display Processors allow for local operator and dispatcher display and control. Typically, the control centre will contain one or more Local Area Networks (LANs) to connect these various hosts. The control centre will also access several WANs, often through intermediate communications processors. These WAN connections may include the company-wide area network for communications with the corporate host and a distinct real-time SCADA network. Each control centre will also have one or more TASE.2 instances to handle data exchange with remote control centres.

Other classes of host processors like archive systems, engineering stations, or quality control systems (e.g. for data recording according to ISO 9000) may also be included. The application of the TASE.2 control centre model is in principle unlimited. This model provides a common and abstract definition applicable for any real systems which have comparable requirements.

1.2 Architecture

The TASE.2 protocol relies on the use of MMS services (and hence the underlying MMS protocol) to implement the control centre data exchange. Figure 1 shows the relationship of TASE.2, the MMS provider, and the rest of the protocol stack. In most cases, the values of objects being transferred are translated from/to the local machine representation automatically by the local MMS provider. Some TASE.2 objects require a common syntax (representation) and meaning (interpretation) by both communicating TASE.2 systems. This common representation and interpretation constitutes a form of protocol. The control centre applications are not part of this standard. It is assumed that these applications request TASE.2 operations and supply control centre data and functions to the TASE.2 implementation as needed. The specific interface between TASE.2 and the control centre applications is a local issue and not part of this standard.

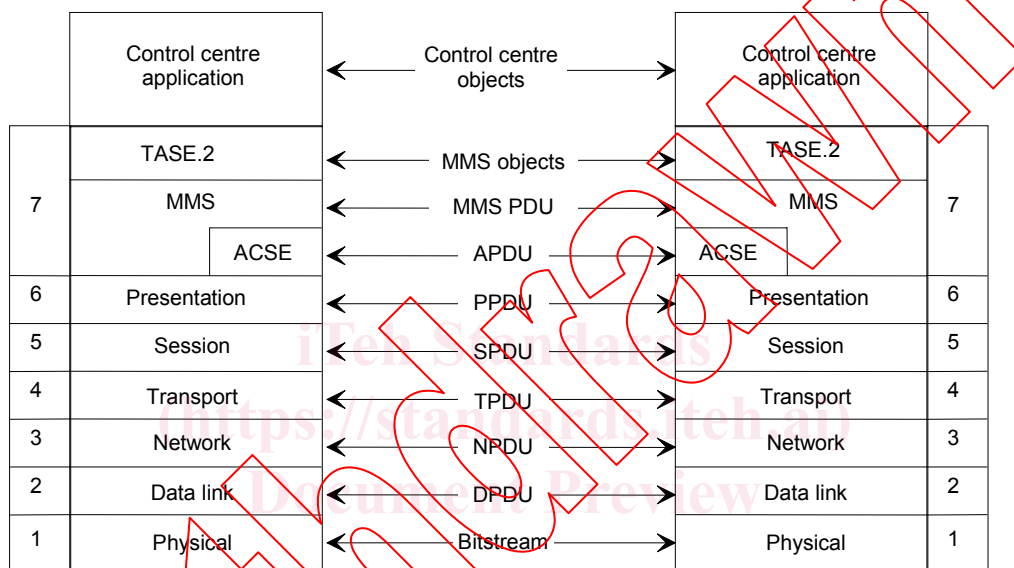


Figure 1 – Protocol relationships

The protocol architecture for TASE.2 requires the use of ISO protocols in layers 5-7 of the OSI reference model. The Transport Profiles (layers 1-4) may use virtually any standard or de-facto standard (including TCP/IP) connection-mode transport layer and connectionless-mode network layer services over any type of transmission media.

1.3 Network Model

The TASE.2 Data Exchange network may be either a private or public packet-switched or mesh network connecting communications processors which provide adequate routing functionality to allow for redundant paths and reliable service.

Figure 2 shows a typical network topology using a router-based Wide Area Network (WAN). The WAN provides routing and reliable service between control centres (which may include internal networks and routing capabilities).

The mesh network shown in figure 3 demonstrates the concept of redundant paths for a mesh network. Each control centre maintains its own series of direct circuits, and also provides a mechanism for routing between those direct circuits. Control Centre C provides an alternate routing path for network traffic going from Control Centre A to B. This network configuration requires key control centres to provide significant routing capabilities.

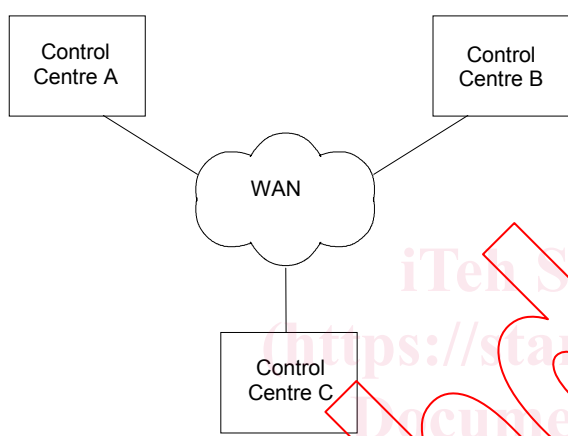


Figure 2 – Router-based WAN

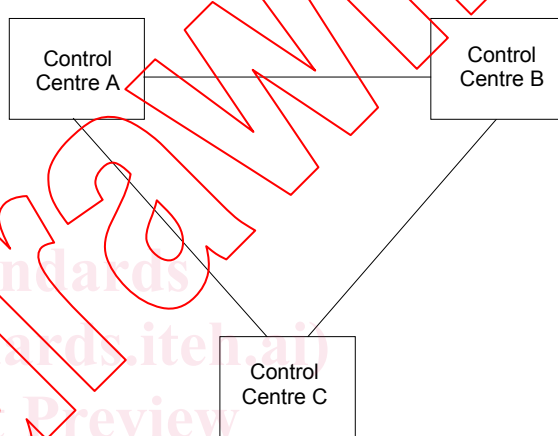


Figure 3 – Mesh network

1.4 Relation between TASE.2 and MMS

The TASE.2 resides on top of MMS. It describes a standardized application of MMS using the MMS services and protocol. TASE.2 enhances the functionality of MMS by specifying structured data mapped to MMS objects and assigning specific semantics to it. As an example of pure MMS services, MMS allows reading data from a remote system. The data will be responded without any specific condition. If these data are read depending on very specific conditions (e.g. on change only) then TASE.2 provides appropriate services which are not provided by MMS.

Though the specific requirements agreed upon within IEC TC 57 have led to the definition of TASE.2 there are several other application domains (outside the control centres) with less, very limited or mixed requirements which may use the TASE.2 services. These other areas are outside the scope of this standard but the use of TASE.2 goes far beyond the specific scope of this standard.

TASE.2 provides an independent and scalable set of services to allow efficient implementations optimized for the respective requirements of a control centre. It does this by defining several conformance building blocks. MMS offers also a scalability of its services specifying MMS Conformance Building Blocks (CBBs). A simple TASE.2 implementation requires only a simple MMS implementation.

TASE.2 and MMS provide their services to their respective users. MMS provides its services to TASE.2 and TASE.2 provides its services to the control centre application. MMS is an independent standard that can provide its services also to users other than TASE.2 – it may serve directly to specific control centre applications and to any other application. This means that the use of MMS is not restricted to TASE.2.

For requirements outside the scope of this standard or for future requirements, for example journaling of data, downloading and uploading of mass data like programs, additional MMS models and services, i.e. Journaling and Domain Loading respective can be applied by an real system in addition to TASE.2. This is possible because the additional application of MMS objects and services is independent of the use of TASE.2 and the use of MMS by TASE.2.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60870-6-702:1998, *Telecontrol equipment and systems – Part 6-702: Telecontrol protocols compatible with ISO standards and ITU-T recommendations – Functional profile for providing the TASE.2 application service in end systems*

IEC 60870-6-802:2002, *Telecontrol equipment and systems – Part 6-802: Telecontrol protocols compatible with ISO standards and ITU-T recommendations – TASE.2 Object models*

ISO/IEC 8073, *Information technology – Open Systems Interconnection – Protocol for providing the connection-mode transport service*

ISO/IEC 8208:2000, *Information technology – Data communications – X.25 Packet Layer Protocol for Data Terminal Equipment*

ISO/IEC 8473, *Information technology – Protocol for providing the connectionless-mode network service*

ISO/IEC 8802-3:2001, *Information technology – Telecommunications and information exchange between systems – Local and metropolitan area networks – Specific requirements – Part 3: Carrier sense multiple access with collision detection (CSMA/CD) access method and physical layer specifications*

ISO 9506-1:2000, *Industrial automation systems – Manufacturing Message Specification – Part 1: Service definition*

ISO 9506-2:2000, *Industrial automation systems – Manufacturing Message Specification – Part 2: Protocol specification*

ISO/IEC 9542, *Information processing systems – Telecommunications and information exchange between systems – End system to Intermediate system routing exchange protocol for use in conjunction with the Protocol for providing the connectionless-mode network service (ISO 8473)*

ISO/IEC 10589:1992, *Information technology – Telecommunications and information exchange between systems – Intermediate system to intermediate system intra-domain-routing exchange protocol for use in conjunction with the protocol for providing the connectionless-mode network Service (ISO 8473)*

ISO/IEC ISP 10608-1:1992, *Information technology – International Standardized Profile TAnnnn – Connection-mode Transport Service over Connectionless-mode Network Service – Part 1: General overview and subnetwork-independent requirements*

ISO/IEC ISP 10608-2:1992, *Information technology – International Standardized Profile TAnnnn – Connection-mode Transport Service over Connectionless-mode Network Service – Part 2: TA51 profile including subnetwork-dependent requirements for CSMA/CD Local Area Networks (LANs)*

ISO/IEC ISP 10608-5:1992, *Information technology – International Standardized Profile TAnnnn – Connection-mode Transport Service over Connectionless-mode Network Service – Part 5: TA1111/TA1121 profiles including subnetwork-dependent requirements for X.25 packet-switched data networks using virtual calls*

ISO/IEC ISP 10613-1:1994, *Information technology – International Standardized Profile RA – Relaying the Connectionless-mode Network Service – Part 1: Subnetwork-independent requirements*

ISO/IEC ISP 10613-2:1994, *Information technology – International Standardized Profile RA – Relaying the Connectionless-mode Network Service – Part 2: LAN Subnetwork-dependent, media-independent requirements*

ISO/IEC ISP 10613-3:1994, *Information technology – International Standardized Profile RA – Relaying the Connectionless-mode Network Service – Part 3: CSMA/CD LAN subnetwork-dependent, media-dependent requirements*

ISO/IEC ISP 10613-5:1994, *Information technology – International Standardized Profile RA – Relaying the Connectionless-mode Network Service – Part 5: Definition of profile RA51.51, relaying the Connectionless-mode Network Service between CSMA/CD LAN subnetworks*

ISO/IEC ISP 10613-7:1994, *Information technology – International Standardized Profile RA – Relaying the Connectionless-mode Network Service – Part 7: PSDN subnetwork-dependent, media-dependent requirements for virtual calls over a permanent access*

ISO/IEC ISP 10613-8:1994, *Information technology – International Standardized Profile RA – Relaying the Connectionless-mode Network Service – Part 8: Definition of profile RA51.1111, relaying the Connectionless-mode Network Service between CSMA/CD LAN subnetworks and PSDNs using virtual calls over a PSTN leased line permanent access*

ISO/IEC ISP 10613-9:1994, *Information technology – International Standardized Profile RA – Relaying the Connectionless-mode Network Service – Part 9: Definition of profile RA51.1121, relaying the Connectionless-mode Network Service between CSMA/CD LAN subnetworks and PSDNs using virtual calls over a digital data circuit/CSDN leased line permanent access*

ISO 8649, *Information processing systems – Open Systems Interconnection – Service definition for the Association Control Service Element*