

# INTERNATIONAL STANDARD



**Lightning protection system components (LPSC) –  
Part 4: Requirements for conductor fasteners**

(<https://standards.iteh.ai>)  
Document Preview

[IEC 62561-4:2023](#)

<https://standards.iteh.ai/catalog/standards/iec/2e45fc4f-06cf-4eff-b8d4-8390784b056a/iec-62561-4-2023>



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2023 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

#### IEC publications search - [webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

#### IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

#### IEC Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [sales@iec.ch](mailto:sales@iec.ch).

#### IEC Products & Services Portal - [products.iec.ch](http://products.iec.ch)

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

#### Electropedia - [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

International  
Standards.iteh.ai)  
Document Preview

[IEC 62561-4:2023](https://standards.iteh.ai/catalog/standards/iec/2e45fc9f-06cf-4eff-b8d4-8390784b056a/iec-62561-4-2023)

<https://standards.iteh.ai/catalog/standards/iec/2e45fc9f-06cf-4eff-b8d4-8390784b056a/iec-62561-4-2023>



IEC 62561-4

Edition 3.0 2023-10  
REDLINE VERSION

# INTERNATIONAL STANDARD



Lightning protection system components (LPSC) –  
Part 4: Requirements for conductor fasteners

iteh Standards  
(<https://standards.iteh.ai>)  
Document Preview

[IEC 62561-4:2023](https://standards.iteh.ai/catalog/standards/iec/2e45fc4f-06cf-4eff-b8d4-8390784b056a/iec-62561-4-2023)

<https://standards.iteh.ai/catalog/standards/iec/2e45fc4f-06cf-4eff-b8d4-8390784b056a/iec-62561-4-2023>

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

ICS 29.020, 91.120.40

ISBN 978-2-8322-7690-7

**Warning! Make sure that you obtained this publication from an authorized distributor.**

## CONTENTS

|  |    |
|--|----|
| FOREWORD.....  | 4  |
| INTRODUCTION.....  | 2  |
| 1 Scope.....   | 7  |
| 2 Normative references .....   | 7  |
| 3 Terms and definitions .....  | 8  |
| 4 Classification.....  | 8  |
| 4.1 According to the material of the conductor fastener.....                                 | 8  |
| 4.2 According to the fixing arrangement of the conductor within the conductor fastener ..... | 8  |
| 4.3 According to the conductor clamping arrangement .....                                    | 8  |
| 5 Requirements .....   | 9  |
| 5.1 General.....   | 9  |
| 5.2 Environmental requirements .....   | 9  |
| 5.2.1 Corrosion resistance.....  | 9  |
| 5.2.2 Ultraviolet (UV) light resistance .....  | 9  |
| 5.3 Mechanical strength.....   | 9  |
| 5.3.1 Perpendicular and axial loads.....   | 9  |
| 5.3.2 Impact tests.....  | 9  |
| 5.4 Installation instructions .....  | 9  |
| 5.5 Marking.....   | 10 |
| 5.5.1 Content of marking .....   | 10 |
| 5.5.2 Durability and legibility.....   | 10 |
| 6 Tests .....  | 10 |
| 6.1 General test conditions .....  | 10 |
| 6.2 Preparation of the specimen .....  | 11 |
| 6.3 Environmental influence test .....   | 11 |
| 6.3.1 General .....  | 11 |
| 6.3.2 Metallic.....  | 12 |
| 6.3.3 Non-metallic .....   | 12 |
| 6.3.4 Composite .....  | 13 |
| 6.4 Resistance to mechanical effects .....   | 13 |
| 6.4.1 Lateral load test.....   | 13 |
| 6.4.2 Axial load test.....   | 14 |
| 6.4.3 Impact test.....   | 15 |
| 6.5 Installation instructions .....  | 16 |
| 6.5.1 General conditions.....  | 17 |
| 6.5.2 Acceptance criteria .....  | 17 |
| 6.6 Marking test.....  | 17 |
| 6.6.1 General test conditions <del>for tests</del> .....                                     | 17 |
| 6.6.2 Acceptance criteria .....  | 17 |
| 6.7 Construction .....   | 17 |
| 7 Electromagnetic compatibility (EMC) .....  | 18 |
| 8 Structure and content of the test report.....  | 18 |
| 8.1 General.....   | 18 |
| 8.2 Report identification.....   | 18 |
| 8.3 Specimen description.....  | 19 |

|  |   |    |
|--|---|----|
| 8.4  | Conductor .....                                     | 19 |
| 8.5  | Standards and references .....                      | 19 |
| 8.6  | Test procedure.....                                 | 19 |
| 8.7  | Testing equipment, description .....                | 19 |
| 8.8  | Measuring instruments description.....              | 19 |
| 8.9  | Results and parameters recorded .....               | 19 |
| 8.10   | Statement of pass/ and fail.....                    | 20 |
| Annex A (normative) <del>Environmental test</del> Resistance to corrosion for metallic and composite conductor fasteners .....   |   | 21 |
| A.1  | General.....  | 21 |
| A.2  | Salt mist treatment.....                            | 21 |
| A.3  | Humid sulphurous atmosphere treatment .....         | 21 |
| A.4  | Ammonia atmosphere treatment.....                   | 21 |
| Annex B (normative) Environmental test for non-metallic and composite conductor fasteners – Resistance to ultraviolet light..... |   | 22 |
| B.1  | General.....  | 22 |
| B.2  | Test .....  | 22 |
| B.3  | First alternative test to Clause B.2 .....          | 22 |
| B.4  | Second alternative test to Clause B.2 .....         | 22 |
| Annex C (normative) Applicability of previous tests .....  |   | 23 |
| Annex D (normative) Flow chart of tests for conductor fastener .....   |   | 24 |
| Bibliography.....  |   | 27 |
| (https://standards.iteh.ai)  |   |    |
| Document Preview   |   |    |
| IEC 62561-4:2023   |   |    |
| http://standards.iteh.ai/catalog/standards/iec/2023/iec-62561-4-2023-6604-85907840056a/iec-62561-4-2023                          |   |    |
| Figure 1   | – Basic arrangement of specimens.....               | 12 |
| Figure 2   | – Basic arrangement of lateral load test .....      | 14 |
| Figure 3   | – Typical arrangement for axial movement test ..... | 15 |
| Figure 4   | – Impact test apparatus.....                        | 26 |
| Figure D.1   | – Flowchart of tests for conductor fastener .....   | 26 |
| Table C.1 – Differences in the requirements for conductor fasteners complying with IEC 62561-4:2010 or 62561-4:2017 .....        |   | 23 |

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

## LIGHTNING PROTECTION SYSTEM COMPONENTS (LPSC) –

## Part 4: Requirements for conductor fasteners

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at <https://patents.iec.ch>. IEC shall not be held responsible for identifying any or all such patent rights.

**This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition IEC 62561-4:2017. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.**

IEC 62561-4 has been prepared by IEC technical committee 81: Lightning protection. It is an International Standard.

This third edition cancels and replaces the second edition published in 2017. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) alignment with the latest edition of ISO IEC 60068-2-52:2017 relating to salt mist atmosphere treatment;
- b) alignment with the new edition of ISO 22479:2019 relating to humid sulphurous atmosphere treatment;
- c) new normative annex for the applicability of previous tests.

The text of this International Standard is based on the following documents:

| Draft       | Report on voting |
|-------------|------------------|
| 81/734/FDIS | 81/740/RVD       |

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at [www.iec.ch/members\\_experts/refdocs](http://www.iec.ch/members_experts/refdocs). The main document types developed by IEC are described in greater detail at [www.iec.ch/publications](http://www.iec.ch/publications).

A list of all the parts in the IEC 62561 series, published under the general title *Lightning protection system components (LPSC)*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under [webstore.iec.ch](http://webstore.iec.ch) in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn, or
- revised.

**IMPORTANT – The "colour inside" logo on the cover page of this document indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

## INTRODUCTION

This part of IEC 62561 deals with the requirements and tests for lightning protection system components (LPSC), specifically conductor fasteners used for the installation of a lightning protection system (LPS) designed and implemented in accordance with the IEC 62305 series.

**iTeh Standards**  
**(<https://standards.itih.ai>)**  
**Document Preview**

[IEC 62561-4:2023](#)

<https://standards.itih.ai/catalog/standards/iec/2e45fc4f-06cf-4eff-b8d4-8390784b056a/iec-62561-4-2023>



## LIGHTNING PROTECTION SYSTEM COMPONENTS (LPSC) –

### Part 4: Requirements for conductor fasteners

#### 1 Scope

This part of IEC 62561 deals with the requirements and tests for metallic and non-metallic conductor fasteners that are used to retain and support the air-termination, down-conductor and earth-termination systems.

This document does not cover the fixing of conductor fasteners to the fabric of structures due to the vast number and types used in modern day construction.

~~LPSC can also be suitable for use in hazardous atmospheres. There are therefore additional requirements when installing the components in such conditions.~~

Testing of components for an explosive atmosphere is not covered by this document. Extra requirements for the components can be necessary for LSCs intended for use in hazardous atmospheres.

NOTE In CENELEC member countries, testing requirements of components for explosive atmospheres are specified in CLC/TS 50703-2.

#### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60068-2-52:1996/2017, *Environmental testing – Part 2-52: Tests – Test Kb: Salt mist, cyclic (sodium chloride solution)*

IEC 60068-2-75:2014, *Environmental testing – Part 2: Tests – Test Eh: Hammer tests*

IEC 62305-3:2010, *Protection against lightning – Part 3: Physical damage to structures and life hazard*

IEC 62561-1:2017, *Lightning protection system components (LPSC) – Part 1: Requirements for connection components*

ISO 4892-2:2013, *Plastics – Methods of exposure to laboratory light sources – Part 2: Xenon – arc lamps*

ISO 4892-3:2016, *Plastics – Methods of exposure to laboratory light sources – Part 3: Fluorescent UV lamps*

ISO 4892-4, *Plastics – Methods of exposure to laboratory light sources – Part 4: Open-flame carbon-arc lamps*

~~ISO 6988:1985, *Metallic and other non-organic coatings – Sulphur dioxide test with general condensation of moisture*~~

ISO 6957:1988, *Copper alloys – Ammonia test for stress corrosion resistance*

ISO 22479:2019, *Corrosion of metals and alloys – Sulfur dioxide test in a humid atmosphere (fixed gas method)*

### 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

#### 3.1

##### **conductor fastener**

metallic, non-metallic or composite component designed to retain and support the air-termination, down-conductor and earth-termination systems, installed at intervals along the length of the conductors

#### 3.2

##### **composite fastener**

mixture of metallic and non-metallic materials, for example plastic

#### 3.3

##### **type test**

test made before supplying a type of material covered by IEC 62561-4 on a general commercial basis, in order to demonstrate satisfactory performance characteristics to meet the intended application

<https://standards.iteh.ai/>

### 4 Classification

#### 4.1 According to the material of the conductor fastener

- a) metallic (e.g. hot dip galvanized steel, copper, aluminium, stainless steel);
- b) non-metallic (e.g. PVC, plastics);
- c) composite (combination of metal and plastic non-metallic).

If a metallic conductor fastener is used for bonding of two metallic parts of the external LPS it becomes a connection component and shall comply with testing requirements in accordance with IEC 62561-1.

#### 4.2 According to the fixing arrangement of the conductor within the conductor fastener

- a) with screws;
- b) without screws (e.g. clips, springs).

#### 4.3 According to the conductor clamping arrangement

- a) conductor fasteners that are designed to clamp the conductor;
- b) conductor fasteners that are designed to clamp but allow axial movement of the conductor.

## 5 Requirements

### 5.1 General

The conductor fastener shall carry out its function of clamping the conductor in an acceptable and safe manner when subjected to mechanical influences, lightning discharge stress and environmental influences.

Conductor fasteners shall comply with the tests given in Clause 6. The material of the conductor fastener shall be compatible with the conductor it is fastening and the surface material onto which it is mounted.

NOTE 1 Certain extreme environmental conditions make the choice of non-metallic conductor fasteners unsuitable. Specific recommendations are provided by manufacturers as to their suitability in varying environments.

NOTE 2 Conductor fasteners are so designed and constructed that safe handling is ensured, that retention and support for the conductor is provided, and that in normal use their performance is reliable and without danger to persons and the surroundings.

### 5.2 Environmental requirements

#### 5.2.1 Corrosion resistance

Metallic or composite conductor fasteners shall withstand corrosion effects.

Compliance is checked for metallic fasteners by the test specified in 6.3.2 or for composite fasteners by the tests described in 6.3.4.

#### 5.2.2 Ultraviolet (UV) light resistance

Non-metallic and composite conductor fasteners shall withstand UV light effects.

Compliance is checked for non-metallic fasteners by the tests specified in 6.3.3 or for composite fasteners by the tests specified in 6.3.4.

### 5.3 Mechanical strength

#### 5.3.1 Perpendicular and axial loads

The design of the conductor fastener shall be such that it carries the perpendicular loads caused by the weight of the conductor, snow, ice and wind and axial loads caused by the thermal expansion–contraction of the conductor and its weight.

Compliance is checked following the manufacturer's declaration for the classification of the conductor fastener in accordance with Clause 4 and by the tests specified in 6.4.1 and 6.4.2.

#### 5.3.2 Impact tests

Conductor fasteners shall be so designed and constructed to withstand impact stresses caused accidentally.

Compliance is checked by the tests specified in 6.4.3.

### 5.4 Installation instructions

The manufacturer or supplier of the conductor fastener shall provide adequate information in its literature to ensure that the installer ~~can~~ shall select and install the component ~~in a suitable and safe manner, in accordance with IEC 62305-3~~ accordance with 62305-3:2010, 5.5.2 and manufacturer's instructions, containing at least the following information:

a) classifications according to Clause 4;

- b) maximum and minimum conductor diameter;
- c) materials of conductors to be used;
- d) type of mounting surface to be used;
- e) recommended method of assembly, installation and fixing to the mounting surface;
- f) lateral load;
- g) axial movement load.

Compliance is checked by inspection in accordance with 6.5.

## 5.5 Marking

### 5.5.1 Content of marking

Each conductor fastener shall be marked with:

- a) the manufacturer's or responsible vendor's name, logo or trademark,
- b) product identification or type.

Where it is not possible to make these marks directly onto the product, they shall be made on the smallest supplied packaging.

Compliance is checked in accordance with 6.6.

Where this proves to be impractical, the marking in accordance with a) and b) may be given on the smallest packing unit label or on the accompanying documentation.

NOTE 1 Marking can be applied for example by moulding, pressing, engraving, printing and environmental stress adhesive labels ~~or water slide transfers~~.

NOTE 2 Marking can be applied by water slide transfers for components installed indoors only.

### 5.5.2 Durability and legibility [IEC 62561-4:2023](https://standards.iteh.ai/catalog/standards/iec/2e45fcdf-06cf-4eff-b8d4-8390784b056a/iec-62561-4-2023)

The marking shall be durable and legible.

Compliance is checked in accordance with 6.6.

## 6 Tests

### 6.1 General test conditions

~~Tests specified in this document are type tests.~~ The tests in accordance with this document are type tests (see 3.3), performed in a sequence according to Annex D. These tests are of such a nature that, after they have been performed, ~~they need not be repeated~~ unless changes are made to the accessory materials, design or type of manufacturing process, which ~~might~~ can change the performance characteristics ~~of the product~~, repeated testing is not required.

The present document cannot cover all possible types of conductor fasteners and the way of fixing them on various surfaces of different materials. When required for these applications, agreement should be obtained between the test engineer and manufacturer on the specific testing regime.

Unless otherwise specified, tests are carried out with the specimens assembled and installed as in normal use as specified in the manufacturer's or supplier's instructions, with the recommended conductor materials, sizes and the tightening torque.

The tests shall be carried out in the sequence given after environmental tests of the specimen in accordance with 6.3.

Unless otherwise specified, 12 metallic or 18 composite/non-metallic specimens are subjected to the tests and the requirements are satisfied if all the tests criteria are met.

If only one of the specimens fails to satisfy a test due to a manufacturing fault, that test and any preceding one which ~~may~~ can have influenced the results of the test shall be repeated. The tests which follow shall be made in the same required sequence on another full set of samples, all of which shall comply with the requirements.

The applicant, when submitting the first set of samples, may also submit an additional set of samples that ~~may~~ can be necessary should one sample fail. The testing laboratory shall then, without further request, test the additional set of samples, and shall only reject if a further failure occurs. If the additional set of samples is not submitted at the same time, a failure of one sample shall entail rejection.

Tests for non-metallic conductor fasteners shall not commence earlier than 168 h from the time of their manufacturing.

A torque meter shall be used for all tightening operations. It shall have a resolution of at least 0,5 Nm with an accuracy of  $\pm 4$  % or less. The applicable tolerance for any applied mechanical load shall be within  $\pm 5$  %.

For products already successfully tested in accordance with IEC 62561-4:2010 or IEC 62561-4:2017 the applicability of previous tests according to Annex C, Table C.1, may be applied.

For new products, complete type tests and samples according to Clause 6 are required.

## 6.2 Preparation of the specimen [IEC 62561-4:2023](#)

If not otherwise specified by the manufacturer, the conductors and specimens shall be cleaned by using a suitable degreasing agent followed by cleaning in demineralized water and drying. They shall then be assembled in accordance with the manufacturer's installation instructions, for example with the recommended conductors and the tightening torques.

The tightening torque should be applied in a steady and uniform manner.

Any conductor fastener accommodating conductors with differences in size (diameter, thickness and width) equal to or less than 2 mm shall be tested using the minimum conductor size recommended. If the range is greater than 2 mm, the conductor fastener shall be tested using the minimum and maximum of conductor sizes.

## 6.3 Environmental influence test

### 6.3.1 General

In order for a conductor fastener to meet the requirements of this document, environmental tests shall be carried out in accordance with ~~to Annex A and/or Annex B~~ Annex A for metallic and composite conductor fasteners or Annex B for non-metallic and composite conductor fasteners.

The selection of the tests to be performed depends upon the conductor fastener material.

Annex D provides a flow chart relating the tests identified in 6.3.2, 6.3.3 and 6.3.4 to the conductor fastener material.

NOTE The sequence of performing the UV test prior to the salt mist test for composite fasteners is due to the fact that during the salt mist test the specimen is covered by a salt layer. This would inhibit the UV exposure test.

### 6.3.2 Metallic


Two sets, each one consisting of three arrangements, shall be assembled and mounted rigidly on an insulating plate (e.g. brick, polytetrafluoroethylene (PTFE)) as shown in Figure 1 in accordance with the manufacturer's installation instructions, for example with the recommended conductors and the tightening torques for screwed fastening conductor fasteners.

The arrangements of specimens shall be subjected to environmental influence tests consisting of a salt mist test as specified in Clause A.2 followed by a humid sulphurous atmosphere test as specified in Clause A.3. An additional test by an ammonia atmosphere as specified in Clause A.4, shall be carried out for conductor fasteners made of copper alloys with copper content of less than 80 %. ~~This is also valid for conductor fasteners having parts made of copper alloys with a copper content of less than 80 %.~~

The specimens are deemed to have passed the tests if there are no signs of corrosive deterioration of the conductor or conductor fastener visible to normal or corrected vision.

NOTE White rust, patina and surface oxidation are not considered to be corrosive deterioration.

Dimensions in millimetres

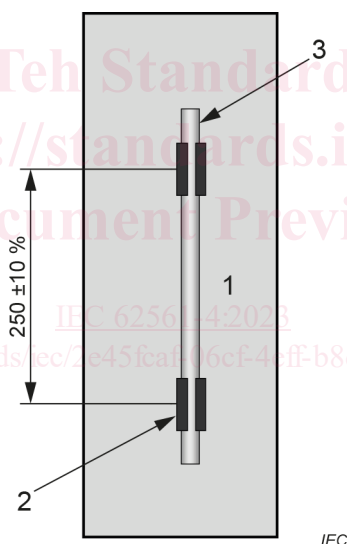

#### Key

- 1 mounting plate
- 2 fastener
- 3 conductor

Figure 1 – Basic arrangement of specimens

### 6.3.3 Non-metallic

Three sets, each one consisting of three arrangements, shall be assembled and mounted rigidly on an insulating plate (e.g. brick, polytetrafluoroethylene (PTFE)) as shown in Figure 1 in accordance with the manufacturer's installation instructions, for example with the recommended conductors and the tightening torques for screwed fastening conductor fasteners.

The arrangements of specimens shall be subjected to an environmental test consisting of an ultraviolet light test as specified in Annex B.