



Designation: F2306/F2306M – 20

Standard Specification for 12 to 60 in. [300 to 1500 mm] Annular Corrugated Profile- Wall Polyethylene (PE) Pipe and Fittings for Gravity-Flow Storm Sewer and Subsurface Drainage Applications¹

This standard is issued under the fixed designation F2306/F2306M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reappraisal. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reappraisal.

1. Scope*

1.1 This specification covers requirements and test methods for annular, corrugated profile wall polyethylene pipe and fittings with an interior liner. The nominal inside diameters covered are 12 to 60 in. [300 to 1500 mm].

1.2 The requirements of this specification are intended to provide pipe and fittings for underground use for gravity-flow storm sewer and subsurface drainage systems.

NOTE 1—Pipe and fittings produced in accordance with this specification shall be installed in compliance with Practice D2321.

1.3 This specification covers pipe and fittings with an interior liner using a corrugated exterior profile (Fig. 1).

1.4 The products manufactured under this standard use either virgin or recycled (post-industrial or post-consumer) materials in accordance with the requirements specified for each.

1.5 *Units*—The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.6 The following precautionary caveat pertains only to the test method portion, Section 7, of this specification. *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.7 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recom-*

mendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 ASTM Standards:²

- D618 Practice for Conditioning Plastics for Testing
- D638 Test Method for Tensile Properties of Plastics
- D1600 Terminology for Abbreviated Terms Relating to Plastics
- D2122 Test Method for Determining Dimensions of Thermoplastic Pipe and Fittings
- D2321 Practice for Underground Installation of Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications
- D2412 Test Method for Determination of External Loading Characteristics of Plastic Pipe by Parallel-Plate Loading
- D2444 Practice for Determination of the Impact Resistance of Thermoplastic Pipe and Fittings by Means of a Tup (Falling Weight)
- D3212 Specification for Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals
- D3350 Specification for Polyethylene Plastics Pipe and Fittings Materials
- D3895 Test Method for Oxidative-Induction Time of Polyolefins by Differential Scanning Calorimetry
- D4218 Test Method for Determination of Carbon Black Content in Polyethylene Compounds by the Muffle-Furnace Technique
- D4883 Test Method for Density of Polyethylene by the Ultrasound Technique
- D5630 Test Method for Ash Content in Plastics
- D7399 Test Method for Determination of the Amount of Polypropylene in Polypropylene/Low Density Polyethylene Mixtures Using Infrared Spectrophotometry
- F412 Terminology Relating to Plastic Piping Systems
- F477 Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe

¹ This specification is under the jurisdiction of ASTM Committee F17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.62 on Sewer.

Current edition approved Nov. 1, 2020. Published December 2020. Originally approved in 2005. Last previous edition approved in 2019 as F2306/F2306M– 19. DOI: 10.1520/F2306_F2306M-20.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

*A Summary of Changes section appears at the end of this standard

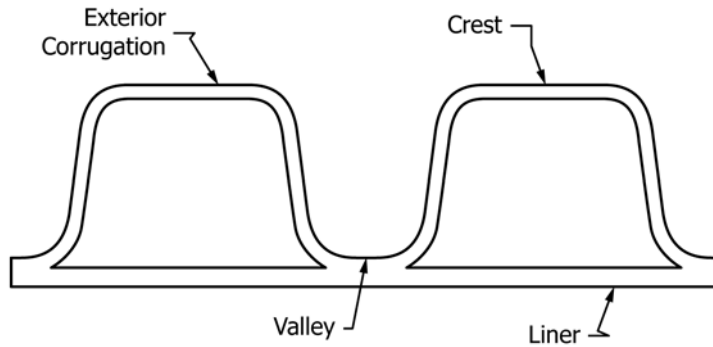


FIG. 1 Typical Annular Corrugated Pipe Profile

F2136 Test Method for Notched, Constant Ligament-Stress (NCLS) Test to Determine Slow-Crack-Growth Resistance of HDPE Resins or HDPE Corrugated Pipe

F3181 Test Method for The Un-notched, Constant Ligament Stress Crack Test (UCLS) for HDPE Materials Containing Post- Consumer Recycled HDPE

F3308 Practice for Sampling and Testing Frequency for Recycled Materials in Polyethylene (PE) Pipe for Non-Pressure Applications

2.2 *AASHTO Standard*.³

AASHTO LRFD Bridge Design Specifications

LRFD, Section 12 Bridge Design Specifications Section 12 – Buried Structures and Tunnel Liners

AASHTO M 145 : Classification of Soils and Aggregate Mixtures

2.3 *Department of Agriculture Standard*:

Standard 606 Soil Conservation Service Engineering⁴

2.4 *Federal Standard*:

Fed. Std. No. 123 Marking for Shipment (Civil Agencies)⁵

2.5 *Military Standard*:

MIL-STD-129 Marking for Shipment and Storage⁵

2.6 *NCHRP (National Cooperative Highway Research Program) Report*.⁶

NCHRP Report 631 Updated Test and Design Methods for Thermoplastic Drainage Pipe

NCHRP Report 870 Performance of Corrugated Pipe Manufactured with Recycled Content

2.7 *ISO Standard*.⁷

ISO 15270 Guidelines for the Recovery and Recycling of Plastic Waste

³ Available from American Association of State Highway and Transportation Officials (AASHTO), 444 N. Capitol St., NW, Suite 249, Washington, DC 20001, <http://www.transportation.org>.

⁴ Available from U.S. Government Printing Office Superintendent of Documents, 732 N. Capitol St., NW, Mail Stop: SDE, Washington, DC 20401. <http://www.gpo.gov/about/bookstore.htm>

⁵ DLA Document Services Building 4/D 700 Robbins Avenue Philadelphia, PA 19111-5094 <http://quicksearch.dla.mil/>

⁶ Transportation Research Board, The National Academies 500 Fifth Street, NW Washington, DC 20001. <http://www.TRB.org>

⁷ Available from International Organization for Standardization (ISO), ISO Central Secretariat, BIBC II, Chemin de Blandonnet 8, CP 401, 1214 Vernier, Geneva, Switzerland, <http://www.iso.org>.

3. Terminology

3.1 *Definitions*—Definitions are in accordance with Terminology **F412** and abbreviations are in accordance with Terminology **D1600**, unless otherwise specified. The abbreviation for polyethylene is PE.

3.2 *Definitions of Terms Specific to This Standard*:

3.2.1 *design diameter, n*—the manufacturer’s stated inside diameter.

3.2.2 *mold line, n*—a line formed on the product as a result of the mold blocks coming together during manufacturing.

3.2.3 *profile wall, n*—a pipe wall construction that presents an interior liner in the waterway but includes ribs, corrugations, or other shapes, which can be either solid or hollow, that helps brace the pipe against diametrical deformation.

3.2.4 *service temperature, n*—the average ambient temperature of the insitu conditions at which the pipe will be operating for the life of the project.

4. Ordering Information

4.1 Orders for product made to this specification shall include the following information to adequately describe the desired product:

4.1.1 This ASTM designation and year of issue,

4.1.2 Perforations:

4.1.2.1 With perforations,

4.1.2.2 Without perforations,

4.1.3 Diameters,

4.1.4 Total footage of each pipe diameter involved,

4.1.5 Pipe laying length, and

4.1.6 Virgin or recycled resins.

4.1.7 Fitting type(s):

4.1.7.1 Size and type of fittings, including mainline and branch diameters, and

4.1.7.2 Number of fittings per diameter.

5. Materials and Manufacture

5.1 *Virgin Resin Products*:

5.1.1 *Pipe and Blow-Molded Fittings*—The pipe and fittings shall be made of virgin PE plastic compound meeting the requirements of Specification **D3350** cell classification 435400C or 435400E, except that carbon black content in compounds meeting cell classification 435400C shall be

greater than 2% but not exceed 4 %. Compounds that have a higher cell classification in one or more properties shall be permitted provided the density of the base resin compound without pigment shall not exceed 0.955 g/cm³ and all other product requirements are met. For slow crack-growth resistance, the plastic compound shall be evaluated using the notched constant ligament stress (NCLS) test according to the procedure described in 7.8. The average failure time of the five test specimens shall exceed 24 h with no single test specimen's failure time less than 18 h.

5.1.2 Rotationally Molded Fittings and Couplings—Compounds used in the manufacture of rotationally molded fittings and couplings shall be virgin PE meeting the requirements of Specification **D3350** and cell classification 213320C or 213320E, except that the carbon black content in compounds meeting cell classification 213320C shall be greater than 2% but not exceed 4%. Compounds that have a higher cell classification in one or more properties shall be permitted provided the density of the base resin shall not exceed 0.940 g/cm³ and all other product requirements are met.

5.1.3 Injection-Molded Fittings and Couplings—Compounds used in the manufacture of injection molded fittings and couplings shall be made of virgin PE meeting the requirements of Specification **D3350** and cell classification 414420C or 414420E, except that the carbon black content in compounds meeting cell classification 213320C shall be greater than 2% but not exceed 4%. Compounds that have a higher cell classification in one or more properties shall be permitted provided all other product requirements are met.

5.1.4 Rework Material—Clean rework material generated from the manufacturer's own pipe and fittings production shall be permitted to be used by the same manufacturer, provided that the material meets the requirements of 5.1.1 or 5.1.2 as applicable for the intended part and pipe or fittings produced meet all the requirements of this specification.

5.2 Recycled Resin Products:

5.2.1 Recycled Resin Pipe—The pipe containing any post-consumer or post-industrial recycled materials shall be made of PE plastic compound recovered and recycled in accordance with Guide ISO 15270 such that the final blended compound meets the following requirements in accordance with Specification **D3350**:

5.2.1.1 Cell classification 435400C or 435400E in accordance with Specification **D3350**.

5.2.1.2 The carbon black content in compounds meeting cell classification 435400C shall be equal to or greater than 2 % but not exceed 4% when tested in accordance with Test Method **D4218**. Compounds that have a higher cell classification in one or more properties shall be permitted provided the density of the compound shall not exceed 0.955 g/cm³ as tested in accordance with Test Method **D4883** and all other product requirements are met.

5.2.1.3 For slow crack growth resistance, extruded pipe shall be evaluated using the notched constant ligament stress (NCLS) test according to the procedure described in 7.8. The average failure time of the five test specimens shall exceed 24 h with no single test specimen's failure time less than 18 h.

5.2.1.4 Crack initiation shall be tested in accordance with the procedures in 7.11. The average failure time of five test specimens shall exceed the minimum required for the applied tensile stress, service temperature and required service life required for the application.

5.2.1.5 Maximum level of polypropylene present by volume shall not be greater than 5 percent when tested in accordance with the procedures in 7.9.

5.2.1.6 Maximum ash content shall not be more than 2 % in accordance with the procedures in 7.10.

5.2.1.7 Samples taken from the extruded pipe supplied to the project shall have a minimum Oxidative-Induction-Time of 20 min when tested in accordance with Test Method **D3895** and break strain of 150 % when tested in accordance with Test Method **D638**.

5.2.1.8 Service life prediction shall be done in accordance with 7.11. The predicted service life shall meet or exceed 100 years.

5.2.1.9 All sampling and testing frequency for recycled resin pipe shall be in accordance with Practice **F3308**.

5.2.2 Recycled Resin Fittings—Fittings made from recycled resins are not permitted under this standard.

NOTE 2—Post-consumer recycled materials contain a wide assortment of polyethylene compounds, which may have a combination of high and low environmental stress crack resistance. Post-industrial recycled materials will have much more consistent quality of compounds, but they will be of the same stress-crack resistance. They may, therefore, have higher or lower environmental stress crack resistance than post-consumer materials. The **F3181** test method will, however, provide predictable and reproducible results for either material.

6. General Requirements

6.1 Workmanship—The pipe and fittings shall be homogeneous throughout and be as uniform as commercially practical in color, opacity, and density. The pipe walls shall be free of cracks, holes, blisters, voids, foreign inclusions, or other defects that are visible to the naked eye and that may affect the wall integrity. The ends shall be cut cleanly and squarely. Holes intentionally placed in perforated pipe are acceptable.

6.1.1 Visible defects, cracks, creases, splits, obstruction to flow in perforations, or in pipe are not permissible.

6.2 Dimensions and Tolerance:

6.2.1 Nominal Size—The nominal size for the pipe and fittings shall be the inside diameter shown in **Table 1**.

6.2.2 Inside Diameter—The average inside diameter for pipe and fittings shall not vary more than ± 1 % from the design diameter when measured in accordance with 7.4.1.

NOTE 3—The outside diameters and the corrugation pitch of products manufactured to this specification are not specified; therefore, compatibility between pipe and fittings from different manufacturers or the same manufacturer shall be verified.

6.2.3 Length—The pipe shall be supplied in any length agreeable to both the owner and the manufacturer. Length shall not be less than 99 % of stated quantity when measured in accordance with 7.4.2.

6.2.4 Minimum Inner-Liner Thickness—The minimum inner-liner thickness of the pipe shall meet the requirements given in **Table 1** when measured in accordance with 7.4.3.

TABLE 1 Pipe Stiffness and Pipe Dimensions

Pipe Inside Diameter		Minimum Pipe Stiffness at 5 % Deflection		Minimum Inner Liner Thickness	
in.	[mm]	lb/in./in.	[kPa]	in.	[mm]
12	[300]	50	[345]	0.035	[0.9]
15	[375]	42	[290]	0.040	[1.0]
18	[450]	40	[275]	0.051	[1.3]
21	[525]	38	[260]	0.060	[1.5]
24	[600]	34	[235]	0.060	[1.5]
27	[675]	30	[205]	0.060	[1.5]
30	[750]	28	[195]	0.060	[1.5]
36	[900]	22	[150]	0.067	[1.7]
42	[1050]	20	[140]	0.071	[1.8]
48	[1200]	18	[125]	0.071	[1.8]
54	[1350]	16	[110] [†]	0.079	[2.0]
60	[1500]	14	[95]	0.079	[2.0]

[†] Editorially corrected in March 2015.

6.2.5 Perforations—Perforations shall be cleanly cut, placed in the valley of the corrugation rib, and uniformly spaced along the length and circumference of the pipe. Dimensions of the perforations and the minimum perforation inlet area shall be as listed in **Table 2**. Other perforation dimensions and configurations shall be permitted, where required to meet the needs of the specifier. All measurements shall be made in accordance with **7.4.4**. Pipe connected by bell and spigot joints shall not be perforated in the area of the bells and spigots.

NOTE 4—For perforated pipe applications, the size of the embedment zone and permeability of the embedment material provide the desired level of infiltration or exfiltration. The pipe or embedment zone shall be wrapped with a geotextile designed to prevent migration of fine soils into the pipe or embedment zone. Where a geotextile is not used, the gradation of the embedment material shall be compatible with the perforation size to avoid backfill migration into the pipe.

6.3 Pipe Stiffness—Minimum pipe stiffness at 5 % deflection shall meet the requirements given in **Table 1** when tested in accordance with **7.5**.

NOTE 5—The 5 % deflection criterion, which was selected for testing convenience, is not a limitation with respect to in-use deflection. The engineer is responsible for establishing the acceptable deflection limit.

6.4 Pipe Flattening—There shall be no evidence of splitting, cracking, breaking, separation of seams, separation of the outer and inner wall, or combinations thereof, when tested in accordance with **7.6**. Additionally, at or below the deflection

limit defined in **Eq 1**, the specimen shall be considered as failing this test when the load does not increase continuously with increasing deflection.

Buckling Deflection Limit:

$$\Delta b = 6.15 \% \cdot \frac{0.5 \cdot D}{D_f \cdot 0.6 h_p} \quad (1)$$

where:

Δb = minimum buckling deflection limit (%)

D = mean diameter (centroid) of pipe (in [mm])

D_f = shape factor (dimensionless fixed value of 4.27 for parallel plate test)

h_p = corrugation height (in [mm])

NOTE 6—Field deflection limits are typically taken at 5 % (see **Annex A1**). **Eq 1** is based on the results from NCHRP Report 631 and is defined as being derived from the standard parallel plate test equation. The constant value 6.15 % (0.0615) in **Eq 1** is the factored combined strain limit for HDPE pipe per AASHTO LRFD Section 12. The constant value 0.6 in this equation is an estimated centroidal distance for typical profiles produced per this specification.

6.5 Pipe Impact Strength—There shall be no evidence of splitting, cracking, breaking, separation of seams, separation of the outer and inner wall, or combinations thereof, when tested in accordance with **7.7**.

6.6 Fittings and Joining Systems:

6.6.1 Only fittings supplied or recommended by the pipe manufacturer should be used. Fittings shall be installed in accordance with the manufacturer's recommendations.

6.6.2 The joining system(s) shall be of a design that preserves alignment during construction and prevents separation at the joints. Bell and spigot, external snap or split couplers are examples of typical designs.

6.6.3 Fittings shall be supplied with joints compatible with the overall system. All joints for gravity-flow Sewer systems shall meet the requirements of **6.6.3.3**. All other joints shall meet the requirements of a soil-tight joint unless otherwise specified by the owner/designer.

6.6.3.1 Soil-tight joints are specified as a function of opening size, channel length, and backfill particle size. If the size of the opening exceeds 3 mm, the length of the channel shall be at least four times the size of the opening. A backfill material containing a high percentage of fine-graded soils requires investigation for the specific type of joint to be used to guard against soil infiltration.

NOTE 7—The ability of a joint to resist soil infiltration (soil tightness) shall be considered. Soil tightness is a function of opening size, channel length, and backfill particle size. A backfill material containing a high percentage of Class III and Class IVA material as defined in Practice **D3231** requires consulting with the manufacturer for the specific type of joint to be used to guard against soil infiltration. Alternatively, the joint shall be permitted to be wrapped with a geotextile designed to prevent migration of these fine soils into the pipe.

6.6.3.2 Silt-tight joints shall be used where the backfill material has a high percentage of fines. Silt tight joints shall meet laboratory test in accordance with Test Method **D3212** except that the joint be tested using 2.0 psi (14 kPa) and utilize a bell and spigot joint with a gasket meeting Specification **F477**.

TABLE 2 Perforation Dimensions

Pipe Inside Diameter		Type of Perforation			
		Circular			
		Maximum Diameter	Minimum Inlet Area		
in.	[mm]	in.	[mm]	in. ² /ft	[cm ² /m]
12	[300]	3/8	[10]	1.5	[30]
15	[375]	3/8	[10]	1.5	[30]
18	[450]	3/8	[10]	1.5	[30]
21	[525]	3/8	[10]	2.0	[40]
24	[600]	3/8	[10]	2.0	[40]
27	[675]	3/8	[10]	2.0	[40]
30	[750]	3/8	[10]	2.0	[40]
36	[900]	3/8	[10]	2.0	[40]
42	[1050]	3/8	[10]	2.0	[40]
48	[1200]	3/8	[10]	2.0	[40]
54	[1350]	3/8	[10]	2.0	[40]
60	[1500]	3/8	[10]	2.0	[40]

6.6.3.3 Watertight joints shall meet a 10.8 psi (74 kPa) laboratory test in accordance with Test Method **D3212** and utilize a bell and spigot design with a gasket meeting Specification **F477**.

7. Test Methods

7.1 Conditioning:

7.1.1 *Referee Testing*—When conditioning is required for referee tests, condition the specimens in accordance with Procedure A of Practice **D618** at 73.4 ± 3.6 °F [23 ± 2 °C] for not less than 40 h prior to test. Conduct tests under the same conditions of temperature.

7.1.2 *Quality Control Testing*—Condition specimens for a minimum of 4 h prior to test in air or 1 h in water at 73.4 ± 3.6 °F [23 ± 2 °C] without regard to relative humidity.

7.2 *Test Conditions*—Conduct tests other than those for routine quality control purposes in the standard laboratory atmosphere of 73.4 ± 3.6 °F [23 ± 2 °C], in the referenced test method or in this specification.

7.3 *Sampling*—The selection of the sample or samples of the pipe and fittings shall be as agreed upon between the owner and the seller. In case of no prior agreement, any sample selected by the testing laboratory shall be deemed permitted.

7.4 Dimensions:

7.4.1 *Inside Diameter*—Measure the inside diameter in accordance with Test Method **D2122**.

7.4.2 *Length*—Measure pipe length in accordance with Test Method **D2122**. These measurements may be taken at ambient temperature.

7.4.3 *Minimum Inner-Liner Thickness*—Measure the thickness of the inner liner in accordance with Test Method **D2122**. Each specimen shall be cut perpendicular to the seam line of the pipe directly through a corrugation allowing a plain view of the inner wall 360° around the circumference in order to obtain a minimum of eight measurements in accordance with Test Method **D2122**.

7.4.4 *Perforations*—Measure dimensions of perforations on a straight specimen without external forces applied. Linear measurements shall be made with an instrument with calibration increments of 0.01 in. [0.25 mm].

7.5 *Pipe Stiffness*—Select three pipe specimens and test for pipe stiffness in accordance with Test Method **D2412**, except for the following conditions:

7.5.1 The test specimens shall be at least one diameter or 24 in. in length, whichever is less. However, the test specimen shall not be less than three full corrugations in length.

7.5.2 Each specimen shall be cut mid-valley to mid-valley (see **Fig. 1**) while still meeting or exceeding the minimum length requirement.

7.5.3 Locate the first specimen in the loading machine with the minimum inner wall thickness located at 9:00 and 3:00 when viewing the specimen from the end. The specimen shall lie flat on the plate within 0.125 in. [3 mm] and shall be straightened by hand bending at room temperature. Use the first location as a reference point for rotation and testing of the other two specimens. Rotate subsequent specimens 45° and

90°, respectively, from the original orientation. Test each specimen in only one position.

7.6 *Flattening*—Flatten the three test specimens from **7.5** between parallel plates until the pipe inside diameter is reduced by 40 %. The rate of loading shall be between 0.50 ± 0.02 in./min [12.5 ± 0.5 mm/min] and 2.00 ± 0.02 in./min [50.0 ± 0.5 mm/min]. It is acceptable to use pipe specimens that have been used to determine pipe stiffness in accordance with **7.5** to determine flattening resistance. If the same pipe specimens are used for both tests, the rate of loading for pipe stiffness shall be as prescribed in Test Method **D2412**. After stiffness is determined, it shall be acceptable to increase the rate of loading up to the maximum prescribed herein. The test specimens, when examined under normal light and the unaided eye, shall meet all the inspection requirements of **6.4** at the maximum deflection level.

7.7 *Impact Resistance*—Test pipe specimens in accordance with Test Method **D2444** except six specimens shall be tested, or six impacts shall be made on one specimen. In the latter case, successive impacts shall be separated by 120 ± 10 ° for impacts made on one circle, or at least 12 in. [305 mm] longitudinally for impacts made on one element. Impact points shall be at least 6 in. [150 mm] from the end of the specimen. Impact strength shall not be less than 100 ft·lbf [136 J]. Tup B shall be used and use a flat plate specimen holder. Condition the specimens for 24 h at a temperature of 4 ± 2 °C, and conduct all tests within 60 s of removal from this atmosphere. The center of the falling tup shall strike on a corrugation crown for all impacts.

7.7.1 In 12 to 18 in. [300 to 450 mm] diameters, the test specimens shall be equal in length to the nominal diameter. In sizes 21 to 60 in. [750 to 1500 mm] diameters, the test specimens shall be equal in length to one-half of the nominal diameter but not less than 18 in. [457 mm].

7.8 *Slow-Crack Growth Resistance of Resin Compounds*—Test basic resin compounds in accordance with the Test Method **F2136**, test except for the following modifications:

7.8.1 The applied stress for the NCLS test shall be 600 psi [4138 kPa].

7.8.2 The test specimen is taken from the extruded pipe and is chopped and molded into a specimen.

7.9 *Determination of Percent Polypropylene for Recycled Resin Compounds*—Test samples of the recycled resin compound in accordance with Test Method **D7399**.

7.10 *Determination of Ash Content in Recycled Compounds*—Test a two gram sample at 1472 °F [800 °C] in accordance with Test Method **D5630**.

7.11 *Determination of Crack Initiation and Service Life Prediction of Pipes Manufactured with Recycled Compounds:*

7.11.1 Crack initiation shall be tested in accordance with the un-notched, constant ligament stress (UCLS) crack test per Test Method **F3181** at a condition of 650 psi [4 482 kPa] stress and 176 °F [80 °C].

7.11.2 For a service life of 100 years in service conditions where the tensile wall stress is 500 psi (3 447 kPa) and the service temperature is 73.4 °F [23 °C], the average failure time

of five specimens shall be greater than or equal to 34 h and no specimen shall fail in less than 18 h.

7.11.3 For service conditions other than stated in 7.11.2, see Table X2.1.

7.11.4 An example calculation providing the basis for these average and minimum UCLS failure times is provided in Appendix X2.

NOTE 8—The UCLS test method and results are based on NCHRP Research Report 870.

8. Inspection

8.1 Inspection of the product shall be as agreed upon between the owner and the manufacturer as part of the purchase contract. Unless otherwise specified in the contract or purchase agreement, the manufacturer is responsible for the performance of all inspection and test requirements specified herein.

8.2 *Notification*—If inspection is specified by the owner, the manufacturer shall notify the owner in advance of the date, time, and place of testing of the pipe or fittings, or both, so that the purchaser may be represented at the test.

8.3 *Access*—The inspector shall have free access to those parts of the manufacturer's plant that are involved in work performed under this specification. The manufacturer shall afford the inspector all reasonable facilities for determining whether the pipe or fittings, or both, meet the requirements of this specification.

9. Rejection and Retesting

9.1 If the results of any test(s) do not meet the requirements of this specification, the test(s) shall be conducted again in accordance with an agreement between the owner and the manufacturer. There shall be no agreement to lower the minimum requirement of the specification by such means as omitting tests that are a part of the specification, substituting or modifying a test method, or by changing the specification limits. In retesting, the product requirements of this specification shall be met, and the test methods designated in this specification shall be followed. If, upon retest, failure occurs, the quantity of product represented by the test(s) does not meet the requirements of this specification.

10. Certification

10.1 When specified in the purchase order or contract, a manufacturer's or independent laboratory's certification shall be furnished to the owner that the products were manufactured,

sampled, tested, and inspected at the time of manufacture in accordance with this specification and have been found to meet the requirements. When specified in the purchase order or contract, a report of the test results shall be furnished. Where requested, certified actual inside diameter shall be provided.

11. Markings

11.1 *Pipe*—Each length of pipe in compliance with this specification shall be clearly marked with the following information: this designation ASTM F2306; the nominal size; the legend PE, the manufacturer's name, trade name or trademark, plant location, and date of manufacturer. The marking shall be applied at the time of manufacture to the pipe in such a manner that it remains legible after installation and inspection. It shall be placed, at least, at each end of each length of pipe or spaced at intervals of not more than 10 ft [3.0 m].

11.2 *Recycled Resin Pipe*—Each length of pipe in compliance with this specification shall be clearly marked with the following information: this designation "ASTM F2306/F2306M"; the nominal pipe size in inches [mm]; the Specification D3350 cell classification per 5.2.1 followed by the statement "contains recycled resin", the manufacturer's name, trade name or trademark, plant location, and date of manufacture. The marking shall be applied to the pipe in such a manner that it remains legible after installation and inspection. It shall be placed, at least, at each end of each length of pipe or spaced at intervals of not more than 10 ft [3.0 m].

11.3 *Fittings*—Each fitting in compliance with this specification shall be clearly marked with the following information: this designation ASTM F2306; the nominal size; the legend PE; the manufacturer's name, trade name or trademark; plant location, and date of manufacture.

12. Packaging

12.1 All pipe and couplings and fittings shall, unless otherwise specified, be packaged for standard commercial shipment.

13. Quality Assurance

13.1 When the product is marked with this designation (ASTM F2306), the manufacturer affirms that the product was manufactured, inspected, sampled, and tested in accordance with this specification and has been found to meet the requirements of this specification.

14. Keywords

14.1 fittings; interior liner; PE; pipe; polyethylene; profile wall; sewer; subdrainage

SUPPLEMENTARY REQUIREMENTS
GOVERNMENT/MILITARY PROCUREMENT

These requirements apply only to federal/military procurement, not domestic sales or transfers.

S1. Responsibility for Inspection

S1.1 Unless otherwise specified in the contract or purchase order, the manufacturer is responsible for the performance of all inspection and test requirements specified herein. The manufacturer may use his own or any other suitable facilities for the performance of the inspection and test requirements specified herein, unless the owner disapproves. The owner shall have the right to perform any of the inspections and tests set forth in this specification, where such inspections are deemed necessary to ensure that material conforms to prescribed requirements.

NOTE S1—In U.S. federal contracts, the contractor is responsible for inspection.

S2. Packaging and Marking for U.S. Government Procurement

S2.1 *Packaging*—Unless otherwise specified in the contract, the materials shall be packaged in accordance with the manufacturer's standard practice in a manner ensuring arrival at destination in satisfactory condition and which will be acceptable to the carrier at lowest rates. Containers and packing shall comply with Uniform Freight Classification rules or National Motor Freight Classification rules.

S2.2 *Marking*—Marking for shipment shall be in accordance with Fed. Std. No. 123 for civil agencies and MIL-STD-129 for military agencies.

NOTE S2—The inclusion of U.S. government procurement requirements shall not be construed as an indication that the U.S. government uses or endorses the products described in this document.

ANNEX
A1. STRUCTURAL DESIGN

A1.1 The appropriate design methodology for pipes 12 in. (300 mm) and larger in diameter covered by this specification (F2306/F2306M), is provided in the AASHTO LRFD Bridge Design Specification, (AASHTO LRFD Specification). Live and dead loads for design along with the necessary load resistance factors for design are provided in Section 3 of the AASHTO LRFD Specification. The actual AASHTO design soil load on corrugated HDPE pipes depends, to a degree, on the relative circumferential stiffness of the HDPE pipe versus the stiffness of the backfill compacted around the pipe.

A1.2 *Material Design Properties*—The referenced AASHTO LRFD Specification (provides both initial and long term material properties (Young's modulus, E and ultimate stress limits, F) for design. Long term material properties are used for all loads that are present over a period of time such as soil overburden and ground water loads. Long term properties are also applicable to pipe deflection effects and both global and local buckling evaluations. Initial material properties are applicable to transient, short term loadings, such as rolling wheel loads. These AASHTO material properties are identical to those utilized for Specification F2306/F2306M materials.

A1.3 *Strain Evaluation*—The AASHTO LRFD methodology for plastic pipes provides a strain (versus stress) evaluation. Ring compression strains are essentially stress /E. Where stress is wall thrust divided by wall area, as defined by

AASHTO. Long term ultimate compression and tension strains are limited to 4.1% and 5% respectively.

A1.3.1 Design deflection levels, typically taken as the 5% AASHTO pipe deflection limit, may be checked for compliance using Spangler's Iowa formula. Pipe deflection introduces additional ring compression on one side (inner or outer surface) of the pipe wall and the primary tension strain on the other. Bending strains are pipe wall design specific in that they depend on the pipe wall's extreme fiber distance and mean radius such that:

$$\varepsilon_B = K (C_{max}/R_{mean})\Delta \quad (A1.1)$$

Where:

- K = defected shape factor (can be taken as 4.27 assuming elliptical deflection)
- C_{max} = extreme fiber distance (neutral axis to extreme fiber)
- R_{mean} = Mean radius
- Δ = pipe deflection (%)
- ε_B = deflection bending strain (%)

A1.3.2 Ring compression strains, however, are also pipe wall geometry specific in that they depend upon the actual, effective area (A_{eff}) of the pipe wall which can be significantly less than the theoretical (gross) pipe wall area as measured geometrically or by weight.