



Designation: D6113 – 21

# Standard Test Method for Using Cone Calorimeter to Determine Fire-Test-Response Characteristics of Insulating Materials Contained in Electrical or Optical Fiber Cables<sup>1</sup>

This standard is issued under the fixed designation D6113; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This is a fire-test-response standard.

1.2 Several fire-test-response characteristics, including the time to sustained flaming, heat release rate, total heat released, effective heat of combustion, and specific extinction area; are measured or calculated by this test method at a constant radiant heat flux. For specific limitations see also 5.7 and Section 6.

1.3 The tests are conducted by burning the electrical insulating materials contained in electrical or optical fiber cables when the cable test specimens, excluding accessories, are subjected to radiant heat.

1.4 The values stated in SI units are to be regarded as the standard. The values given in parentheses are for information only.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.* For specific precautionary statements, see Section 7.

1.6 *This standard measures and describes the response of materials, products, or assemblies to heat and flame under controlled conditions, but does not by itself incorporate all factors required for fire hazard or fire risk assessment of the materials, products or assemblies under actual fire conditions.*

1.7 *Fire testing is inherently hazardous. Adequate safeguards for personnel and property shall be employed in conducting these tests.*

1.8 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recom-*

*mendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

## 2. Referenced Documents

2.1 *ASTM Standards:*<sup>2</sup>

- D618 Practice for Conditioning Plastics for Testing
- D1711 Terminology Relating to Electrical Insulation
- D5424 Test Method for Smoke Obscuration of Insulating Materials Contained in Electrical or Optical Fiber Cables When Burning in a Vertical Cable Tray Configuration
- D5485 Test Method for Determining the Corrosive Effect of Combustion Products Using the Cone Corrosimeter
- D5537 Test Method for Heat Release, Flame Spread, Smoke Obscuration, and Mass Loss Testing of Insulating Materials Contained in Electrical or Optical Fiber Cables When Burning in a Vertical Cable Tray Configuration
- E176 Terminology of Fire Standards
- E603 Guide for Room Fire Experiments
- E691 Practice for Conducting an Interlaboratory Study to Determine the Precision of a Test Method
- E906/E906M Test Method for Heat and Visible Smoke Release Rates for Materials and Products Using a Thermopile Method
- E1354 Test Method for Heat and Visible Smoke Release Rates for Materials and Products Using an Oxygen Consumption Calorimeter
- E1474 Test Method for Determining the Heat Release Rate of Upholstered Furniture and Mattress Components or Composites Using a Bench Scale Oxygen Consumption Calorimeter
- E2058 Test Methods for Measurement of Material Flammability Using a Fire Propagation Apparatus (FPA)
- E2965 Test Method for Determination of Low Levels of Heat Release Rate for Materials and Products Using an Oxygen Consumption Calorimeter

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee D09 on Electrical and Electronic Insulating Materials and is the direct responsibility of Subcommittee D09.17 on Fire and Thermal Properties.

Current edition approved March 1, 2021. Published May 2021. Originally approved in 1997. Last previous edition approved in 2016 as D6113 – 16. DOI: 10.1520/D6113-21.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

## 2.2 CSA Standard:<sup>3</sup>

CSA C22.2 No. 0.3, FT4, Vertical Flame Tests: Cables in Cable Trays, Section 4.11.4 in C22.2 No. 0.3, Test Methods for Electrical Wires and Cables

## 2.3 IEC Standards:<sup>4</sup>

IEC 60695-4 Fire Hazard Testing. Part 4: Terminology Concerning Fire Tests

IEC 60695-5-2 Fire Hazard Testing. Part 5: Assessment of Potential Corrosion Damage by Fire Effluent - Section 2: Guidance on the Selection and Use of Test Methods

## 2.4 IEEE Standard:<sup>5</sup>

IEEE 1202 Standard for Flame Testing of Cables for Use in Cable Tray in Industrial and Commercial Occupancies, IEEE Standard 1202

## 2.5 ISO Standards:<sup>6</sup>

ISO 13943 Fire Safety: Vocabulary

ISO 11907-4 Plastics—Smoke Generation—Determination of the Corrosivity of Fire Effluents—Part 4: Dynamic Decomposition Method Using a Conical Radiant Heater

## 2.6 NFPA Standards:<sup>7</sup>

NFPA 262 Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces

NFPA 287 Standard Test Methods for Measurement of Flammability of Materials in Cleanrooms Using a Fire Propagation Apparatus (FPA)

## 2.7 OSHA Standard:<sup>8</sup>

OSHA 191.1450 Occupational Exposure to Hazardous Chemicals in Laboratories

## 2.8 UL Standards:<sup>9</sup>

ANSI/UL 1581 Reference Standard for Electrical Wires, Cables, and Flexible Cords

ANSI/UL 1666 Standard Test for Flame Propagation Height of Electrical and Optical-Fiber Cables Installed Vertically in Shafts

ANSI/UL 1685 Standard Vertical Tray Fire Propagation and Smoke Release Test for Electrical and Optical Fiber Cables

contained in Terminology E176 shall be used. Use Terminology D1711 for definitions of terms used in this test method and associated with electrical insulation materials.

### 3.2 Definitions of Terms Specific to This Standard:

3.2.1 *cone calorimeter, n*—the apparatus which is used in Test Method E1354 to determine heat release rate, by the principle of oxygen consumption calorimetry, and other fire-test-response characteristics.

3.2.2 *effective heat of combustion, n*—the ratio of the measured heat release to the mass loss, under specified test conditions.

3.2.2.1 *Discussion*—The effective heat of combustion is a function of the test conditions, including heating flux, exposure time and test specimen geometry.

3.2.3 *heat flux, n*—heat transfer to a surface per unit area, per unit time (see also *initial test heat flux*).

3.2.3.1 *Discussion*—The heat flux from an energy source, such as a radiant heater, can be measured at the initiation of a test (such as Test Method E1354 or E906/E906M) and then reported as the initial test heat flux, with the understanding that the burning of the test specimen can generate additional heat flux to the specimen surface. The heat flux can also be measured at any time during a fire test, for example as described in Guide E603, on any surface, and with measurement devices responding to radiative and convective fluxes. Typical units are kW/m<sup>2</sup>, W/cm<sup>2</sup>, or BTU/(s ft<sup>2</sup>).

3.2.4 *heat release rate, n*—the calorific energy released per unit time by the combustion of a material under specified test conditions.

3.2.5 *ignitability, n*—the measure of the ease with which a specimen can be ignited due to the influence of an external energy source, under specified test conditions.

3.2.6 *initial test heat flux, n*—the heat flux set on the test apparatus at the initiation of the test (see also *heat flux*).

3.2.6.1 *Discussion*—The initial test heat flux is the heat flux value commonly used when describing or setting test conditions.

3.2.7 *net heat of combustion, n*—the quantity of heat released by the complete combustion of a unit mass of the material, the water produced being in the vapor state.

3.2.8 *orientation, n*—the plane in which the exposed face of the test specimen is located during testing, which is horizontal facing up for this test.

3.2.9 *oxygen consumption principle, n*—the expression of the relationship between the mass of oxygen consumed during combustion and the heat released.

3.2.10 *smoke obscuration, n*—the reduction in visibility due to the smoke.

3.2.11 *specific extinction area, n*—a measure of smoke obscuration potential per unit mass lost, determined as the product of the extinction coefficient and the volumetric mass flow rate, divided by the mass loss rate.

3.2.12 *sustained flaming, n*—existence of flame on or over the surface of the test specimen for periods of 4 s or more.

## 3. Terminology

### 3.1 Definitions:

3.1.1 For definitions of terms used in this test method and associated with fire issues use Terminology E176, ISO 13943, and IEC 60695-4. Where differences exist in definitions, those

<sup>3</sup> Available from Canadian Standards Association (CSA), 178 Rexdale Blvd., Toronto, ON M9W 1R3, Canada, <http://www.csagroup.org>.

<sup>4</sup> Available from International Electrotechnical Commission (IEC), 3, rue de Varembe, 1st floor, P.O. Box 131, CH-1211, Geneva 20, Switzerland, <https://www.iec.ch>.

<sup>5</sup> Available from Institute of Electrical and Electronics Engineers, Inc. (IEEE), 445 Hoes Ln., Piscataway, NJ 08854-4141, <http://www.ieee.org>.

<sup>6</sup> Available from International Organization for Standardization (ISO), ISO Central Secretariat, Chemin de Blandonnet 8, CP 401, 1214 Vernier, Geneva, Switzerland, <https://www.iso.org>.

<sup>7</sup> Available from National Fire Protection Association (NFPA), 1 Batterymarch Park, Quincy, MA 02169-7471, <http://www.nfpa.org>.

<sup>8</sup> Available from Occupational Safety and Health Administration (OSHA), 200 Constitution Ave., NW, Washington, DC 20210, <http://www.osha.gov>.

<sup>9</sup> Available from Underwriters Laboratories (UL), UL Headquarters, 333 Pfingsten Road, Northbrook, IL, 60062, <http://www.ul.com>.

3.2.12.1 *Discussion*—Flaming of less than 4 s duration is identified as flashing or transitory flaming.

3.2.13 *total heat released, n*—integrated value of the rate of heat release, for a specified time period.

#### 4. Summary of Test Method

4.1 All fire-test-response characteristics in this test method are determined using the apparatus and procedures described in Test Method **E1354**. (See also **9** and **10**.)

4.2 The oxygen consumption principle, used in this test method, is based on the observation that, generally, the net heat of combustion is directly related to the amount of oxygen required for combustion (**1**).<sup>10</sup> Approximately 13.1 MJ of heat are released per 1 kg of oxygen consumed. Test specimens in this test method are burned in ambient air conditions, while being subjected to a prescribed external initial test heat flux. (See also **X5.1**.)

4.3 The heat release is determined by the measurement of the oxygen consumption, as determined by the oxygen concentration and the flow rate in the combustion product stream, as described in Test Method **E1354**.

4.4 The primary measurements are oxygen concentration and exhaust gas flow rate. Additional measurements include the time to sustained flaming, the smoke obscuration generated, the mass loss rate, and the effective heat of combustion. Ignitability is determined by measuring the time from initial exposure to time of sustained flaming of the test specimen.

4.5 A cone calorimeter is used to measure the consumption of oxygen during this test; heat release is then calculated, based on the oxygen consumption principle. The test specimen is mounted horizontally and a spark ignition source is employed.

#### 5. Significance and Use

5.1 This test method is used to determine the heat release rate and a number of other fire-test-response characteristics as a result of exposing insulating materials contained in electrical or optical cables to a prescribed initial test heat flux in the cone calorimeter apparatus.

5.2 Quantitative heat release measurements provide information that is potentially useful for design of electrical or optical cables, and product development.

5.3 Heat release measurements provide useful information for product development by giving a quantitative measure of specific changes in fire performance caused by component and composite modifications. Heat release data from this test method will not be predictive of product behavior if the product will not spread flame over its surface under the fire exposure conditions of interest.

5.4 The fire-test-response characteristics determined by this test method are affected by the thickness of the material used as test specimen, whether as a plaque or as coating on a wire or cable. The diameter of the wire or cable used will also affect the test results.

<sup>10</sup> The boldface numbers given in parentheses refer to a list of references at the end of this test method.

5.5 A radiant exposure is used as an energy source for this test method. This type of source has been used for comparison with heat release rate and flame spread studies of insulating materials constructed into cables when burning in a vertical cable tray configuration (Test Methods **D5424** and **D5537**) (**2-9**). No definitive relationships have been established.

5.6 The value of heat release rate corresponding to the critical limit between propagating cable fires and non-propagating fires is not known.

5.7 This test method does not determine the net heat of combustion.

5.8 It has not been demonstrated that this test method is capable of predicting the response of electrical or optical fiber cables in a full scale fire. In particular, this test method does not address the self-extinguishing characteristics of the cables in a full scale fire.

#### 6. Test Limitations

6.1 If during the test of one or more of the three replicate test specimens, any of the following unusual behavior occurs: molten material overflows the specimen holder trough; a test specimen is displaced from the zone of controlled irradiance (explosive spalling); or the test specimen swells sufficiently prior to ignition to touch the spark plug or swells up to the plane of the heater base during combustion; then test an additional specimen of the identical preconditioned test specimens in the test mode in which the unusual behavior occurred. Do not incorporate data obtained from the tests noted above, yielding inadequate results, in the averaged data but report the occurrence. This test method is not suitable if more than three out of six test specimens tested show any of the above characteristics.

6.2 The applicability of this test method to smoldering ignition of cables has not been demonstrated. This test method is not suitable for initial test heat fluxes below 10 kW/m<sup>2</sup>.

6.3 The validity of the results of this test method for a particular scenario depends on the conditions under which the tests are conducted. In particular, it has been established that the use of a different initial test heat flux will change relative results.

#### 7. Safety Precautions

7.1 The test procedures involve high temperatures and combustion processes. Hazards therefore exist for burns, ignition of extraneous objects or clothing, and inhalation of combustion products. The operator must take appropriate precautions during the insertion and removal of the test specimens, for example, by using protective gloves. Do not touch either the cone heater or the associated fixtures while hot, except with the use of appropriate protective gear.

7.2 Vent the combustion products flowing through the exposure chamber through a properly designed exhaust system. An adequate method of venting the combustion products



captured in the exposure chamber during the test is through an OSHA approved smoke hood<sup>11</sup> at the end of a test.

7.3 Check the exhaust system for proper operation before testing and discharge into a building exhaust system with adequate capacity. Make provisions for collecting and venting any combustion products that for whatever reason are not collected by the exhaust system of the apparatus.

## 8. Test Specimen

### 8.1 Size and Preparation:

8.1.1 The types of test specimens permitted are (a) materials in the form of a flat plaque, or (b) electrical insulating materials contained in electrical or optical cables. The test specimen shall be  $100 \pm 2$  by  $100 \pm 2$  mm (approximately  $4 \pm 0.08$  by  $4 \pm 0.08$  in.) in size, or as close to that as possible. Fill the specimen holder as completely as possible with the cable pieces. Make the thickness of a material test specimen in a flat plaque the same as that of the end use of the material in cable construction. If the end use thickness is not known, or if the test is conducted for other purposes, use a thickness of  $6.3 \pm 0.5$  mm (approximately  $0.25 \pm 0.02$  in.). Ensure that the overall characteristics of the test specimens are those of the wire or cable in its end use (wall thickness and overall diameter).

NOTE 1—Overall test specimen thicknesses of less than 2 mm (approximately 0.08 in.) are not recommended, because potential testing errors become larger.

8.1.2 For test specimens of materials in flat plaques, cut the test specimen to a size of  $100 \pm 2$  by  $100 \pm 2$  mm (approximately  $4 \pm 0.08$  by  $4 \pm 0.08$  in.). Wrap the test specimen in a single layer of aluminum foil (0.03 to 0.04 mm ( $1.2$  to  $1.6 \times 10^{-3}$  in.) thick), shiny side towards the test specimen. Place the edge frame over the test specimen and cut the aluminum foil along the open edges at the top of the edge frame to expose the test specimen. Remove the test specimen from the edge frame, place a grid on the exposed face of the test specimen and insert both the test specimen and the grid into the edge frame.

8.1.3 For test specimens of electrical insulating materials contained in electrical or optical fiber cables, cut the cables to  $100 \pm 2$  mm (approximately  $4 \pm 0.08$  in.) lengths to fill the specimen holder. Seal the ends using an adhesive cement.<sup>12</sup> Apply the adhesive cement to the cable ends such that there are no visible air holes in the coating and that the cement does not overlap the cable ends. Wrap the cable lengths in a single layer of aluminum foil. Place the edge frame over the cable test specimens and cut the aluminum foil along the open edges at the tip of the edge frame and expose the test specimens. Remove the test specimens from the edge frame, place a grid

on the exposed face of the test specimens and insert both the test specimen and the grid into the edge frame.

8.1.4 Optionally, for test specimens of electrical insulating materials contained in electrical or optical fiber cables, cut the cables to  $100 \pm 2$  mm (approximately  $4 \pm 0.08$  in.) lengths to fill the specimen holder, without sealing the ends. Wrap the cable lengths in a single layer of aluminum foil. Place the edge frame over the cable test specimens and cut the aluminum foil along the open edges at the tip of the edge frame and expose the test specimens. Remove the test specimens from the edge frame, place a grid on the exposed face of the test specimens and insert both the test specimen and the grid into the edge frame.

NOTE 2—The objective of sealing the cable ends is to prevent gas evolution through such ends, that is not to be expected when a full length of cable is exposed to a fire in actual use. Moreover, the same method of test specimen preparation is used in Test Method D5485, and the draft international test method ISO CD 11907-4, mentioned in IEC 60695-5-2. However, it is unclear whether the results of the cone calorimeter testing are more meaningful with the cable ends sealed or unsealed.

8.2 Condition the test specimens in accordance with Practice D618 to moisture equilibrium (constant weight) at an ambient temperature of  $23 \pm 3^\circ\text{C}$  and a relative humidity of  $50 \pm 5\%$ .

## 9. Specimen Holder and Mounting

9.1 Two specimen holders are described, one in 9.2 and one in 9.3.

9.2 The first specimen holder is shown in Fig. 1. The bottom is constructed from 2.4 mm nominal stainless steel and has outside dimensions of 106 by 106 by 25 mm height ( $\pm 2$  mm).

9.2.1 An open stainless steel square, 59 mm in inside dimensions, shall be spot welded to the underside of the horizontal specimen holder to facilitate the centering of the specimen under the cone heater. The leading edge of the open square underneath the specimen holder, which is the one opposite the handle, is optional. The open square on the bottom of the specimen holder shall be designed to seat with the sample mount assembly located at the top of the load cell ensuring that the specimen holder is centered with respect to the cone heater.


9.2.2 Optionally, use an edge frame and a grid. The optional edge frame (Fig. 2) is constructed from 1.9 mm nominal stainless steel with outside dimensions of 111 by 111 by 54 mm height ( $\pm 2$  mm). The optional grid (Fig. 3) is constructed from 1 mm nominal stainless steel and has dimensions of 109 by 109 mm ( $\pm 2$  mm). The optional grid has 2 mm ribs and the openings in the center are 20 by 20 mm ( $\pm 1$  mm).

9.2.3 The distance between the bottom surface of the cone heater and the top of the specimen shall be adjusted to be  $25 \pm 1$  mm, except as indicated in (I) below.

(I) The distance between the bottom surface of the cone heater and the top of the specimen shall be adjusted to 60 mm in the case of those dimensionally unstable materials that have the potential to intumesce or deform to such an extent that they are likely to make physical contact with either (a) the spark plug before ignition or (b) the underside of the cone heater after ignition.

<sup>11</sup> Use a smoke hood in compliance with OSHA regulations for Occupational Exposure to Hazardous Chemicals in Laboratories (OSHA 191.1450).

<sup>12</sup> The sole source of supply of the adhesive cement known to the committee at this time is Sauereisen Insa-Lute, available from Sauereisen, 160 Gamma Drive, Pittsburgh, PA 15238. If you are aware of alternative suppliers, please provide this information to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee,<sup>1</sup> which you may attend.

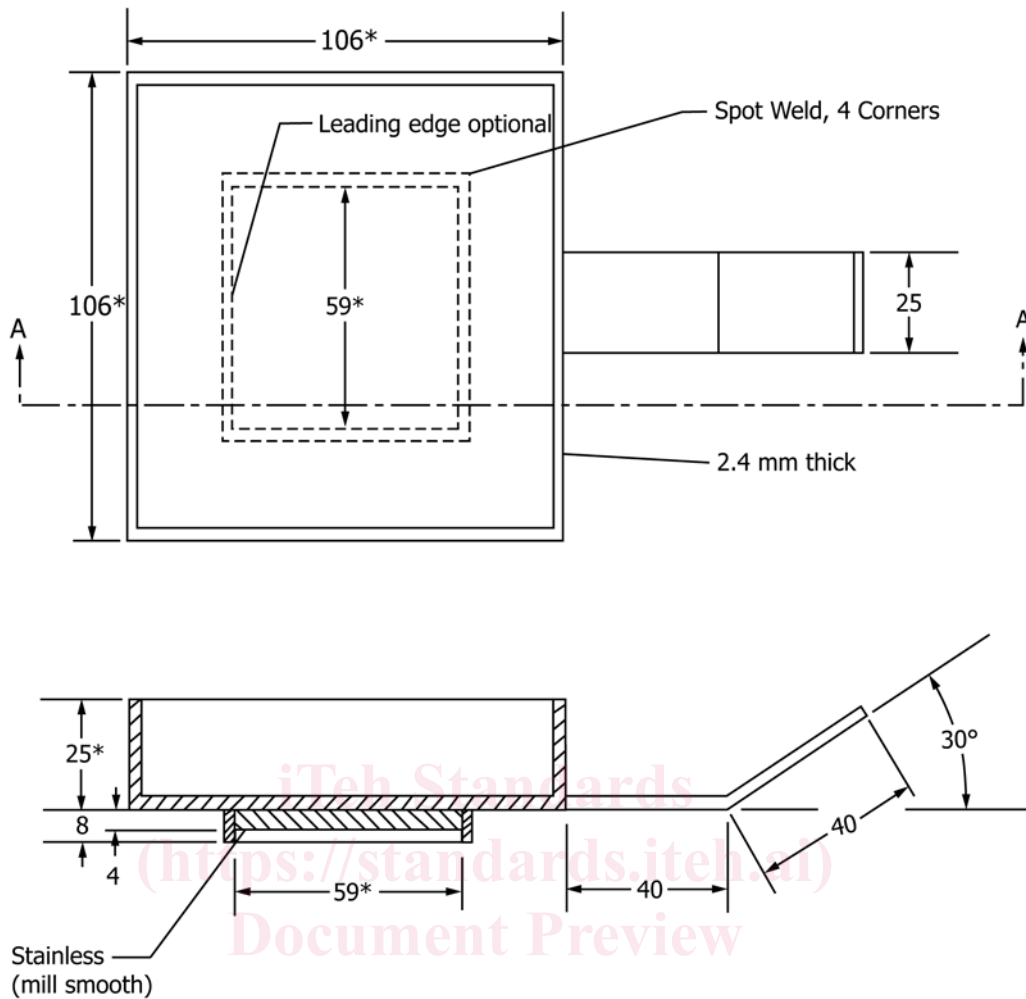

Section A-A

NOTE 1—All dimensions are in millimetres.

NOTE 2—\*Indicates a critical dimension.

FIG. 1 New Specimen Holder

(2) If a test is conducted in accordance with the specimen mounting in (1) above (a 60-mm distance), the heat flux calibration shall be performed with the heat flux meter positioned 60 mm below the cone heater base plate.

(3) If a test has been conducted with a distance of 25 mm and the type of physical contact described in (1) above has occurred, that test shall be deemed invalid and the distance shall be adjusted to 60 mm for future tests.

9.2.4 Intumescent materials. The testing technique to be used when testing intumescent specimens in the horizontal orientation shall be documented in the test report. Options include those shown in (1)–(4) below.

(1) Use a retainer frame or edge frame (Fig. 2). The edge frame is used to reduce unrepresentative edge burning of specimens. The edge frame is constructed from 1.9 mm nominal stainless steel with outside dimensions of 111 by 111 mm by 54 mm height ( $\pm 2$  mm).

(2) Use a wire grid (Fig. 3). The wire grid is used for retaining specimens prone to delamination and is suitable for several types of intumescent specimens. The grid is con-

structed from 1 mm nominal stainless steel and has dimensions of 109 by 109 mm ( $\pm 2$  mm). The grid has 2 mm ribs and the openings in the center are 20 by 20 mm ( $\pm 1$  mm).



(3) Use a separation distance between the cone base plate and the upper specimen surface of 60 mm instead of 25 mm. This technique is suitable for those dimensionally unstable materials that have the potential to intumesce or deform to such an extent that they are likely to make physical contact with either (a) the spark plug before ignition or (b) the underside of the cone heater after ignition.

(4) Use a special mounting procedure suitable for the specimen to be tested.

9.2.5 The bottom of the specimen holder shall be lined with a layer of a low-density (nominal density 65 kg/m<sup>3</sup>) refractory fiber blanket with a thickness of at least 13 mm.

9.3 A second specimen holder is shown in Fig. 4.

9.3.1 The second specimen holder consists of the bottom, the edge frame, retaining pins and wire grid as shown in Fig. 4. The bottom is constructed from 2 mm nominal stainless steel

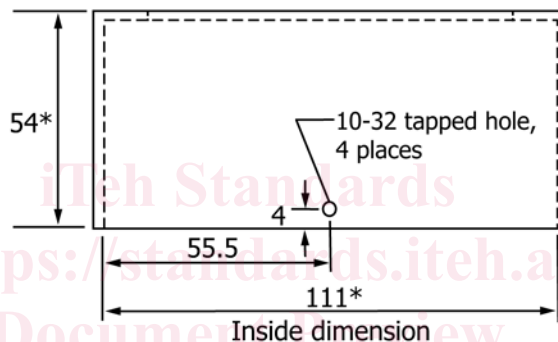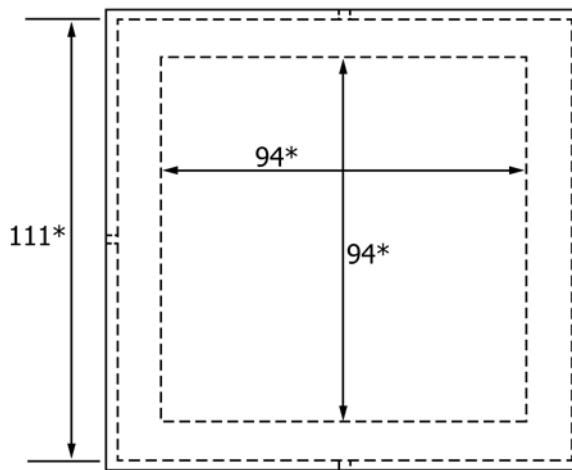

(stainless steel, 1.9 mm thick)

NOTE 1—All dimensions are in millimetres.

NOTE 2—\*Indicates a critical dimension.

[ASTM D6113-21](https://standards.iteh.ai/ASTM-D6113-21)

<https://standards.iteh.ai/catalog/standards/sist/934304b5-8ce5-47af-82a3-a67fefa58353/astm-d6113-21>

FIG. 2 Optional Edge Frame

and has outside dimensions of 111 by 111 ± 2 by 24 ± 2 mm height. The grid is constructed from 1 mm nominal stainless steel and has dimensions of 109 ± 2 by 109 ± 2 mm. The grid has 1 mm ribs and the openings in the center are 19 ± 1 by 19 ± 1 mm. The edge frame is constructed from 2 mm nominal stainless steel with outside dimensions of 116 ± 2 by 116 ± 2 by 56 ± 2 mm height. The frame has an 8 mm lip on the top to provide an opening of 100 by 100 mm on the top. There are two 3 ± 0.5 mm diameter by 130 ± 3 mm long retaining pins to lock the test specimen in the edge frame.

9.3.2 The bottom of the specimen holder shall be lined with a layer of a low density (nominal density 65 kg m<sup>-3</sup>) ceramic fiber refractory blanket with thickness of at least 13 mm. If necessary, fill the edge frame below the test specimens with refractory blanket to the level of the retaining pins. Lock the assembly with retaining pins and place assembly on the bottom specimen holder. The distance between the bottom of the radiant heater and the top of the edge frame is adjusted to 25 ± 1 mm by using a sliding height adjustment.

## 10. Procedure

### 10.1 Preparation:

10.1.1 Calibrate the test apparatus in accordance with Test Method E1354. Position the cone heater for a horizontal specimen orientation and set the radiant initial test heat flux level to the chosen value, with a tolerance of ±1 kW/m<sup>2</sup>.


10.1.2 Verify that the distance between the bottom of the cone heater baseplate and the top of the test specimen is 25 mm (approximately 1 in.).

10.1.3 Position the spark igniter at a distance of 13 mm above the test specimen surface.

NOTE 3—As stated in 6.1, if the test specimen comes in contact with the spark igniter or the heater base plate, the test results will not be usable.

### 10.2 Procedure:

10.2.1 Prepare the data collection system for testing in accordance with the operating procedures for the system in Test Method E1354. Place the test specimen in the specified holder on the load cell. The specimen holder shall be centered

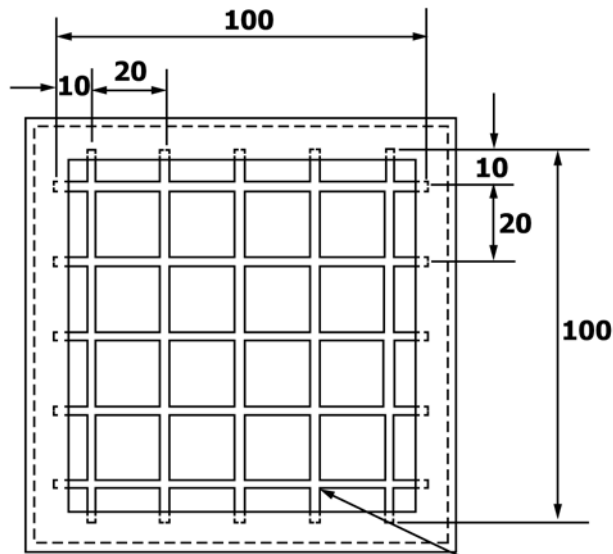

**Sample retaining grid (optional)**

**For use with samples that are expected to intumesce.**

**Material: 2 mm stainless steel rod**

**Weld all intersections**



**Material: Stainless steel, 1.9 mm thick**

NOTE 1—All dimensions are in millimetres.

AS **FIG. 3 Optional Grid**

<https://standards.iteh.ai/catalog/standards/sist/934304b5-8ce5-47af-82a3-a67fefa58353/astm-d6113-21>

with respect to the cone heater. The specimen holder shall be at room temperature initially.

10.2.1.1 Start the data collection. The data collection intervals shall be 5 s or less.

10.2.2 Energize the spark igniter and move it into place as rapidly as possible after test specimen insertion.

10.2.3 Start the timer at the beginning of the test. After flaming is first observed, continue the observation for an additional 4 s. At that point record the time and move the spark igniter out of the flame. Determine the time to flaming ignition. Note that the time to ignition is the time for sustained flaming to start; therefore, if the timer is stopped at the end of the 4 s observation period, the time to be reported is that value, minus 4 s.

NOTE 4—If flaming combustion is not observed, report as “No Ignition was Observed” and not as “Time to Ignition Equals Zero.”

10.2.4 Collect data from the start of the test until the first of the following criteria has been reached: average mass loss over a 1-min period has dropped below 1.5 g or 60 min have elapsed. Ensure that the minimum test period is 30 min.

10.2.5 Observe and record physical changes to the test specimen, such as melting, swelling, and cracking.

10.2.6 Remove the specimen holder.

10.2.7 Replace with an empty specimen holder or insulated pad to prevent thermal damage to the load cell.

10.2.8 Test three test specimens under each condition.

## 11. Calculation

11.1 Use the calculation procedures from Test Method **E1354** for all fire-test-response characteristics.

11.2 Calculate the total heat release per unit area (in kW/m<sup>2</sup>), average specific extinction area (in m<sup>2</sup>/kg) and the effective heat of combustion (in MJ/kg) by using data over the entire period indicated in 10.2.4, beginning with the next reading after the last (if any) negative heat release rate reading at the beginning of the test.

NOTE 5—Certain test specimens do not show visible, sustained flaming but do indicate non-zero heat release or smoke obscuration values.

11.3 Calculate the average mass loss rate (in g/s) over the period starting at the time when 10 % of the ultimate test specimen mass loss occurred and ending at the time when 90 % of the ultimate test specimen mass loss occurred.

NOTE 6—This is done in order to get more consistent results.

MATERIAL:

STAINLESS 1.84 mm THICK

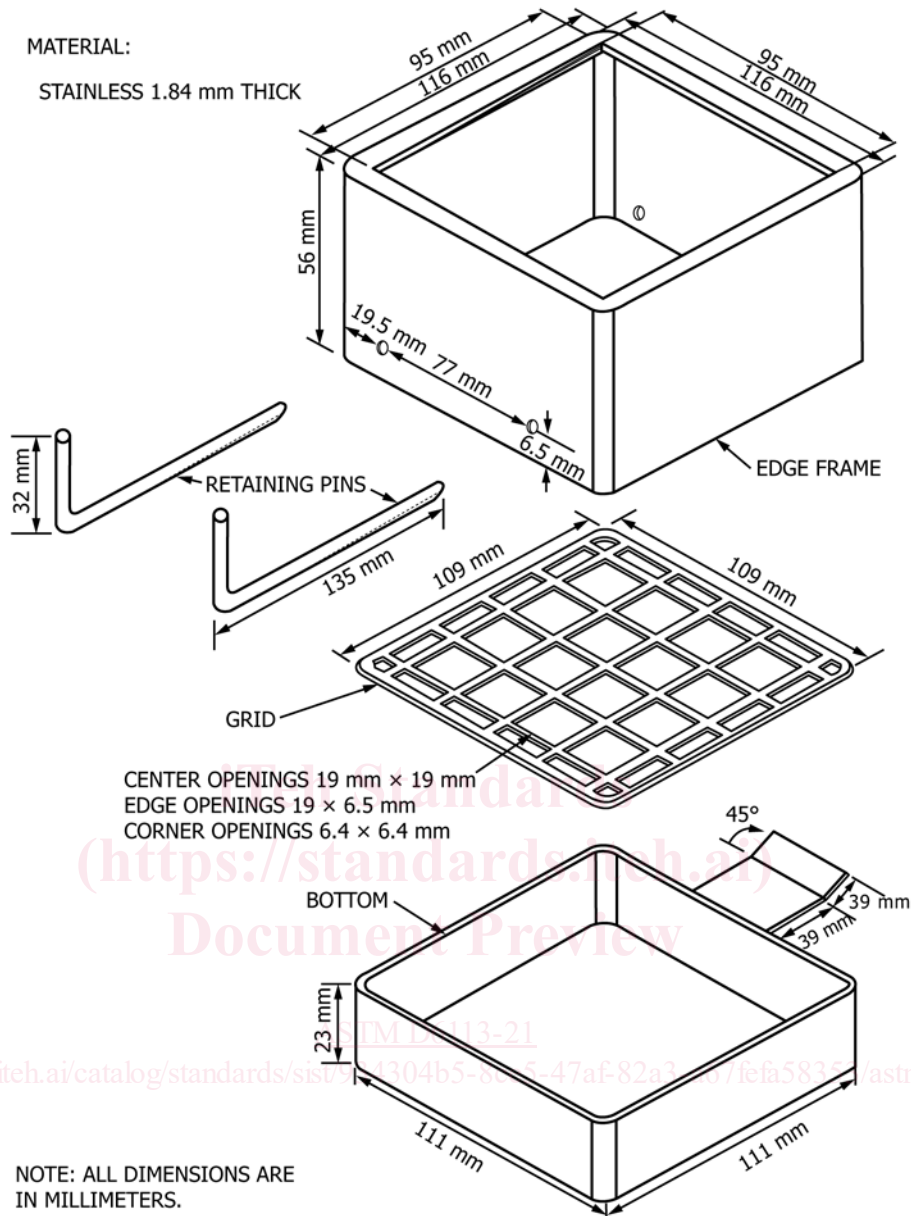


FIG. 4 Alternate Specimen Holder

TABLE 1 Results of Inter-Laboratory Trials for Test Method E1354<sup>A</sup>

Property	TTI	Pk RHR	Avg RHR	THR	EHC	SEA
Units	s	kW/m <sup>2</sup>	kW/m <sup>2</sup>	MJ/m <sup>2</sup>	MJ/kg	m <sup>2</sup> /kg
Range	5 to 150	70 to 1120	70 to 870	5 to 720	7 to 40	30 to 2200
<i>r</i>	...	...	...	...	...	...
<i>A</i>	4.1	13.3	23.3	7.4	1.23	59.0
<i>B</i>	0.125	0.131	0.037	0.068	0.050	0.076
<i>R</i>	...	...	...	...	...	...
<i>A</i>	7.4	60.4	25.5	11.8	2.42	63.0
<i>B</i>	0.220	0.141	0.151	0.088	0.055	0.215

<sup>A</sup> Abbreviations used:

- TTI—time to sustained flaming;
- Pk RHR—maximum heat release rate;
- Avg RHR—average heat release rate in the 180 s following ignition;
- THR—total heat released;
- EHC—effective heat of combustion; range: range of results obtained in the inter-laboratory evaluation
- SEA—average specific extinction area

NOTE 7—For certain materials the mass loss is not representative of the fraction of the test specimen that has burnt. For silicone materials, for example, combustion results in solid residues of products of silicon oxidation, with higher mass than the original test specimen.

## 12. Report

12.1 Report the following information, as a summary, for all test specimens of a particular material or product:

- 12.1.1 Test specimen identification or number,
- 12.1.2 Manufacturer or submitter,
- 12.1.3 Date of test,
- 12.1.4 Composition or generic identification, and
- 12.1.5 Details of preparation.

12.2 Include the following information for each test specimen:

- 12.2.1 Test specimen thickness (mm),



12.2.2 Test specimen initial mass, measured on the load cell (g),

12.2.3 If the test specimen is in the form of electrical insulating materials contained in electrical or optical cables, the number of lengths of cable, and the diameter of the cable,

12.2.4 Initial test heat flux and initial exhaust system flow rate,

12.2.5 Time to sustained flaming (s),

12.2.6 Curve of heat release rate versus time,

12.2.7 Average heat release rate for the first 180 s after ignition (kW/m<sup>2</sup>),

12.2.8 Peak heat release rate (kW/m<sup>2</sup>),

12.2.9 Total heat released by the test specimen per unit area for entire test (MJ/m<sup>2</sup>),

12.2.10 Average effective heat of combustion for entire test (MJ/kg),

12.2.11 Average specific extinction area for entire test (m<sup>2</sup>/kg),

12.2.12 Mass remaining at test termination (g),

12.2.13 Test specimen mass loss (g),

12.2.14 Average test specimen mass loss rate for entire test (g/s),

12.2.15 Additional observations, if any, and

12.2.16 Difficulties encountered in testing, if any.

12.3 Average the following final values for all test specimens:

12.3.1 Time to sustained flaming (s),

12.3.2 Average heat release rate value (kW/m<sup>2</sup>) over the first 180 s after ignition,

12.3.3 Average effective heat of combustion (MJ/kg) for the entire test. This is obtained by dividing the total heat released by the test specimen mass loss,

12.3.4 Peak heat release rate (kW/m<sup>2</sup>),

12.3.5 Total heat released (MJ/m<sup>2</sup>),

12.3.6 Average specific extinction area (m<sup>2</sup>/kg),

12.3.7 Test specimen mass loss (g), and

12.3.8 Average test specimen mass loss rate (g/s).

### 13. Precision and Bias

#### 13.1 Precision:

13.1.1 The precision of test measurements using the cone calorimeter for materials as flat plaques, in accordance with Test Method E1354, has been determined by inter-laboratory trials conducted by ASTM Committee E-5 on Fire Standards. The fire-test-response characteristics chosen for determining repeatability and reproducibility were: time to sustained

flaming, peak heat release rate, average heat release rate over the first 180 s after ignition, the total heat released, the effective heat of combustion and the average specific extinction area. The results were expressed in terms of an equation such as:

$$r \text{ (or } R) = A + B * \text{Property} \quad (1)$$

where:

*r* = intra-laboratory repeatability,

*R* = inter-laboratory reproducibility, and

Property = fire-test-response characteristic considered and *A* and *B* are constants.

13.1.2 Results of tests on plaque specimens for the materials test are shown in Table 1.<sup>13</sup>

13.1.3 An interlaboratory evaluation, using 4 laboratories, was conducted to assess the precision of the procedure for measuring the heat release rate and other fire-test-response characteristics of electrical insulating materials contained in electrical or optical fiber cables using the cone calorimeter. The specimens used were: a flat plaque of an electrical insulating material and four cables, and were described as follows.

13.1.3.1 Plaque P1: a non commercial poly(vinyl chloride) wire and cable type compound, at a thickness of 6 mm.

13.1.3.2 Cable C1: a cable with a white jacket and an outer diameter of 5 mm, with 4 pairs of 24AWG insulated copper conductors. The wire insulation and outer jacket are polyolefin compounds containing no halogens.

13.1.3.3 Cable C2: a plenum rated (CMP) telephone cable with a blue jacket and an outer diameter of 4 mm, with 4 pairs of 24 AWG solid insulated copper conductors. The wire insulation is fluorinated ethylene propylene and the outer jacket is fire retarded poly(vinyl chloride).

13.1.3.4 Cable C3: a riser rated (CMR) inside telephone switchboard cable with a grey jacket and an outer diameter of 9 mm, with 25 pairs of 24 AWG solid bare copper conductors. The wire insulation and outer jacket are fire retarded poly(vinyl chloride).

13.1.3.5 Cable C4: a vertical tray rated (CM) Type TC control with a black jacket and an outer diameter of 15 mm, with 9 solid insulated 12 AWG copper conductors. The wire insulation is poly(vinyl chloride)/nylon insulation and the outer jacket is poly(vinyl chloride).

13.1.4 Tables 2-7 contain the statistical information on precision for repeatability and reproducibility for the following

<sup>13</sup> Supporting data have been filed at ASTM International Headquarters and may be obtained by requesting Research Report RR:E05-1008.

TABLE 2 Intralaboratory and Interlaboratory Precision Results of Round Robin Evaluation—Time to Sustained Flaming(s)

Material	Heat Flux (kW/m <sup>2</sup> )	Average	STD repeat	STD Repro	r	R	RSD repeat	RSD Repro
Plaque P1	50	22.4	3.7	3.7	10	10	16.4	16.4
Plaque P1	25	105.0	1.0		3		1.0	
Cable C1	50	37.2	6.2	6.2	17	17	16.7	16.7
Cable C1	25	236.3	17.2		48		7.3	
Cable C2	50	106.5	65.4	65.4	183	183	61.4	61.4
Cable C2	25	10 000.0	0.0		0		0.0	
Cable C3	50	39.8	12.5	12.5	35	35	31.3	31.3
Cable C3	25	251.0	9.8		28		3.9	
Cable C4	50	47.6	6.4	23.9	18	67	13.4	50.3
Cable C4	25	232.1	120.3	120.3	337	337	51.8	51.8
Average Values			24	39			20	38

**TABLE 3 Intralaboratory and Interlaboratory Precision Results of Round Robin Evaluation—Peak Rate of Heat Release (kW/m<sup>2</sup>)**

Material	Heat Flux (kW/m <sup>2</sup> )	Average	STD repeat	STD Repro	r	R	RSD repeat	RSD Repro
Plaque P1	50	210.3	31.2	31.2	87	87	14.8	14.8
Plaque P1	25	165.6	2.2		6		1.3	
Cable C1	50	292.6	29.0	45.2	81	127	9.9	15.4
Cable C1	25	204.6	5.1		14		2.5	
Cable C2	50	54.8	13.0	13.3	37	37	23.8	24.3
Cable C2	25	9.2	6.2		17		67.4	
Cable C3	50	116.1	8.7	9.9	24	28	7.5	8.5
Cable C3	25	109.8	4.3		12		3.9	
Cable C4	50	185.1	28.2	28.2	79	79	15.2	15.2
Cable C4	25	115.2	10.2	12.6	28	35	8.8	10.9
Average Values			14	23			16	15

**TABLE 4 Intralaboratory and Interlaboratory Precision Results of Round Robin Evaluation—Average (3 min) Rate of Heat Release (kW/m<sup>2</sup>)**

Material	Heat Flux (kW/m <sup>2</sup> )	Average	STD repeat	STD Repro	r	R	RSD repeat	RSD Repro
Plaque P1	50	159.4	21.6	21.6	61	61	13.6	13.6
Plaque P1	25	134.9	4.3		12		1.0	
Cable C1	50	165.7	20.3	24.4	57	68	16.7	16.7
Cable C1	25	85.3	10.4		29		7.3	
Cable C2	50	24.2	6.7	7.2	19	20	27.7	29.7
Cable C2	25	1.7	0.4		1		0.0	
Cable C3	50	100.4	8.1	9.4	23	26	8.1	9.4
Cable C3	25	83.0	1.3		4		1.6	
Cable C4	50	106.9	9.3	10.6	26	30	8.7	9.9
Cable C4	25	42.8	34.0	34.0	95	95	79.4	79.4
Average Values			12	18			16	26

**TABLE 5 Intralaboratory and Interlaboratory Precision Results of Round Robin Evaluation—Total Heat Released (kJ)**

Material	Heat Flux (kW/m <sup>2</sup> )	Average	STD repeat	STD Repro	r	R	RSD repeat	RSD Repro
Plaque P1	50	860.3	50.9	72.3	142	202	5.9	8.4
Plaque P1	25	1011.1	10.8		30		1.1	
Cable C1	50	492.2	33.6	36.0	94	101	6.8	7.3
Cable C1	25	484.0	28.8		81		5.9	
Cable C2	50	88.9	32.3	43.3	90	121	36.4	48.7
Cable C2	25	129.7	19.8		55		15.3	
Cable C3	50	474.2	33.9	46.6	95	131	7.1	9.8
Cable C3	25	475.5	8.7		24		1.8	
Cable C4	50	1202.7	117.8	117.8	330	330	9.8	9.8
Cable C4	25	1181.8	118.5	123.5	332	346	10.0	10.5
Average Values			46	73			10	16

properties: time to sustained flaming, peak heat release rate, average heat release rate over the first 180 s after ignition, the total heat released, the effective heat of combustion and the average specific extinction area.

NOTE 8—Two laboratories did not report specific extinction area data.

13.1.4.1 The abbreviations used in the tables are as follows: Average is the overall average of the individual lab averages; STD repeat is the overall standard deviation for repeatability; STD Repro is the overall standard deviation for reproducibility; r is the intra-laboratory repeatability; R is the inter-laboratory reproducibility; RSD repeat is relative standard deviation for repeatability (namely 100 times the ratio of standard deviation and average) and RSD Repro is relative standard deviation for reproducibility. The formulas used are found in Practice E691.

13.1.5 Figs. 5-10 contain plots of the standard deviations for repeatability (and reproducibility) versus the corresponding averages.

13.2 Bias—For solid test specimens of unknown chemical composition, as used in building materials, furnishings, and common occupant fuel load, documentation exists (1, 10) stating that the use of the relationship that approximately 13.1 MJ of heat are released per 1 kg of oxygen consumed results in an expected error band of  $\pm 5\%$  compared to true value. For homogeneous materials with only a single pyrolysis mechanism, this uncertainty is reduced by determining the net heat of combustion from oxygen bomb measurements and the oxygen-fuel stoichiometric mass ratio from ultimate elemental analysis. For most testing, this is not practical, since test specimens are composites, and usually non-homogeneous.

**TABLE 6 Intralaboratory and Interlaboratory Precision Results of Round Robin Evaluation—Effective Heat of Combustion (MJ/kg)**

Material	Heat Flux (kW/m <sup>2</sup> )	Average	STD repeat	STD Repro	r	R	RSD repeat	RSD Repro
P1	50	14.5	0.8	1.0	2	3	5.9	7.1
P1	25	17.2	0.4		1		2.0	
C1	50	27.9	3.4	3.4	9	9	12.1	12.1
C1	25	31.7	1.2		3		3.7	
C2	50	3.5	1.4	1.4	4	4	38.8	38.8
C2	25	1.6	0.2		1		14.7	
C3	50	11.2	1.0	1.2	3	3	9.3	10.9
C3	25	12.2	0.8		2		6.2	
C4	50	15.0	1.7	1.7	5	5	11.2	11.2
C4	25	14.8	2.2	2.2	6	6	14.8	14.8
Average Values			1	2			12	16

**TABLE 7 Intralaboratory and Interlaboratory Precision Results of Round Robin Evaluation—Specific Extinction Area (kg/m<sup>2</sup>)**

Material	Heat Flux (kW/m <sup>2</sup> )	Average	STD repeat	STD Repro	r	R	RSD repeat	RSD Repro
P1	50	1312.4	105.8	105.8	296	296	8.1	8.1
P1	25	1035.0	24.3		68		2.4	
C1	50	522.1	137.7	137.7	385	385	26.4	26.4
C1	25	294.3	35.6		100		12.1	
C2	50	221.3	31.3	31.3	88	88	14.2	14.2
C2	25	292.7	42.0		117		14.3	
C3	50	966.4	143.7	143.7	402	402	14.9	14.9
C3	25	451.3	12.5		35		2.8	
C4	50	1100.8	76.0	80.4	213	225	6.9	7.3
C4	25	730.6	62.6	66.0	175	185	8.6	9.0
Average Values			67	94			11	13

Therefore, they often exhibit several degradation reactions. Therefore, for unknown samples, a  $\pm 5\%$  accuracy limit is seen. For reference materials, however, careful determination of the ratio of the net heat of combustion to the oxygen-fuel stoichiometric mass ratio makes this source of uncertainty substantially less.

#### 14. Keywords

14.1 cable; cone calorimeter; electrical cable; electrical insulation; fire; fire-test response; heat release; heat release rate; optical fiber cable; oxygen consumption calorimetry; smoke obscuration

[ASTM D6113-21](https://standards.iteh.ai/catalog/standards/sist/934304b5-8ce5-47af-82a3-a67fefa58353/astm-d6113-21)

<https://standards.iteh.ai/catalog/standards/sist/934304b5-8ce5-47af-82a3-a67fefa58353/astm-d6113-21>