



Designation: ~~D6065 – 11 (Reapproved 2015)~~ D6065 – 21

Standard Practice for Handling, Transportation, and Storage of HFC-227ea 1,1,1,2,3,3,3-Heptafluoropropane (CF₃CHFCF₃)¹

This standard is issued under the fixed designation D6065; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice covers guidance and direction to suppliers, reclaimers, purchasers, and users in the handling, transportation, and storage of HFC-227ea.

1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate ~~safety~~ safety, health, and ~~health~~ environmental practices and determine the applicability of regulatory limitations prior to use.*

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

[ASTM D6065-21](https://standards.iteh.ai/catalog/standards/sist/4047db15-e559-4969-a566-60fd07328d4/astm-d6065-21)

<https://standards.iteh.ai/catalog/standards/sist/4047db15-e559-4969-a566-60fd07328d4/astm-d6065-21>

2.1 ~~ASTM Standards:~~ Standard:²

D6064 Specification for HFC-227ea, 1,1,1,2,3,3,3-Heptafluoropropane (CF₃CHFCF₃)

2.2 *CGA Standards:*³

C-1 Methods for Hydrostatic Pressure Testing of Compressed Gas Cylinders

C-6 Standards for Visual Inspection of Steel Compressed Gas Cylinders

C-7 Guide to Preparation of Precautionary Labeling and Marking of Compressed Gas Containers Classification and Labeling of Compressed Gases

P-1 Standard for Safe Handling of Compressed Gases in Containers

SB-1 Hazards of Refilling or Reusing Compressed Refrigerant (Halogenated Hydrocarbon) Gas Cylinders

SB-5 Hazards of Reusing Disposable Refrigerant (Halogenated Hydrocarbon) Gas Cylinders

SB-18 Use of Refrigerant (Halogenated Hydrocarbons) Recovery Cylinders

¹ This practice is under the jurisdiction of ASTM Committee D26 on Halogenated Organic Solvents and Fire Extinguishing Agents and is the direct responsibility of Subcommittee D26.09 on Fire Extinguishing Agents.

Current edition approved June 1, 2015 June 1, 2021. Published June 2015 June 2021. Originally approved in 1996. Last previous edition approved in 2011 2015 as ~~D6065 – 11~~ D6065 – 11 (2015). DOI: 10.1520/D6065-11R15.10.1520/D6065-21.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the ~~standard's~~ standard's Document Summary page on the ASTM website.

³ Available from Compressed Gas Association, 14501 George Carter Way, Suite 103, Chantilly, VA 20151-1788, 8484 Westpark Drive, Suite 220, McLean, VA 22102, <http://www.cganet.com>.

2.3 U.S. Government Standards:⁴

~~49 CFR Part 172 Hazardous Materials Table, Special Provisions, Hazardous Materials Communications, Emergency Response Information, Training Requirements, and Security Plans~~
~~Code of Federal Regulations (CFR) Title 49, 49 CFR Part 172.101~~ ~~Part 82.106~~ Purpose and Use of Hazardous Materials Table
~~Code of Federal Regulations (CFR) Title 49, 49 CFR Part 173~~ ~~Part 173~~, U.S. Department of Transportation (DOT) Specifications, Shippers—General Requirements for Shipping Shippers—General Requirements for Shipments and Packagings
~~Code of Federal Regulations (CFR) Title 49, 49 CFR Part 178~~ ~~Part 178~~, U.S. DOT Specifications, Specifications for Packagings
~~Code of Federal Regulations (CFR) Title 49, 49 CFR Part 180~~ ~~Part 180~~, U.S. DOT, Continuing Qualifications Continuing Qualification and Maintenance of Packagings

3. Terminology

3.1 Definitions of Terms Specific to This Standard:

3.1.1 ~~containers~~—containers, n—storage vessels for HFC-227ea.

3.1.2 ~~cylinders~~—cylinders, n—containers of HFC-227ea.

3.1.3 ~~HFC-227ea~~—HFC-227ea, n—1,1,1,2,3,3,3-Heptafluoropropane; a compound used to inert or suppress a fire or explosion hazard.

3.1.4 ~~insulated~~—insulated, adj—placed in an isolated situation to protect and prevent the transfer of damage.

4. Significance and Use

4.1 This practice provides requirements for the handling, transportation, and storage of HFC-227ea encountered in distribution through both commercial and military channels. It is intended to ensure that HFC-227ea is handled, transported, and stored in such a way that its physical property virtues are not degraded. Transport may be by various means, such as, but not limited to, highway, rail, water, and air.

5. Practice

5.1 To ensure safe handling, loading, unloading, storing, and transporting of material, personnel shall be trained in the CGA publications and ~~Title 49 CFR~~ regulations as listed in 2.2 and 2.3, respectively.

<https://standards.iteh.ai/catalog/standards/sist/4047db15-e559-4969-a566-60fd07328d4/astm-d6065-21>

5.2 Handling:

5.2.1 Handling shall be in accordance with CGA Publication ~~No. P-1, P-1~~ and as specified by the manufacturer.

5.2.1.1 Personnel who handle or store, or both, cylinders of HFC-227ea shall be trained properly to recognize and identify the characteristics of the product and the proper methods of safely handling full, partially full, and empty cylinders.

5.2.2 All HFC-227ea transfers between storage containers and recycling processes shall be performed by personnel trained in handling procedures.

5.2.3 The HFC-227ea recycling and transfer processes shall be in conjunction with the equipment specified by the manufacturer.

5.2.4 ~~HFC-227ea~~ The handling of HFC-227ea shall be in nonsmoking, heater-free, ventilated areas to preclude product accumulation. Provisions shall be made to ensure that service areas limit area HFC-227ea concentrations do not exceed 10.5 % for 1 min and 0.1 % for 8 h.

5.2.5 Cylinders shall not be overfilled. The liquid portion of the liquefied gases must not completely fill the ~~container's~~ container's internal volume at any temperature up to and including ~~130°F (54°C)~~ 130 °F (54 °C). The maximum permitted filling density for pure HFC-227ea shall be 79 lb/ft³ (1265 kg/m³). The maximum permitted filling density for HFC-227ea super pressurized with nitrogen to ~~600/360 psig (25.8 bar) at 70°F (21°C)~~ 70 °F (21 °C) shall be 72 lb/ft³ (1153 kg/m³). The maximum filling density for

⁴ ~~Available~~ Code of Federal Regulations (CFR) documents are available from U.S. Government Publishing Office, Office (GPO), 732, N. Capitol St., NW, Washington, DC 20401-0001, <http://www.gpo.gov>.

HFC-227ea super pressurized with nitrogen to 600 psig (42.4 bar) at 70°F (21 °C) shall be 68 lb/ft³. Filling density requirements are specified in Title 49 CFR, CFR Part 173.304 and Title 49 CFR, CFR Part 173.305.

5.2.6 Handling of materials should be done in a manner that prevents contamination or comingling of halocarbon materials other than of HFC-227ea.

5.2.7 Cylinders shall be free of dirt and contamination that would contribute to or would cause deterioration of product during shipment or storage. Precautions should be taken to prevent the entry of oil, water, or any other foreign matter into containers. Unique coatings or preservatives applied prior to shipment to protect the containers are not considered contamination.

5.3 Transportation:

5.3.1 Transportation shall be as specified in accordance with DOT Department of Transportation (DOT) regulations of Title 49 CFR.

5.3.1.1 Shipment of materials between collectors, recyclers, and reclaimers should be within approved DOT guidelines for Class 2, Division 2.2, regulated materials. Any further provisions for special transportation or packaging should be agreed upon between the collectors, recyclers, and reclaimers.

5.3.1.2 The minimum design pressure requirements shall be as indicated in Title 49 CFR, CFR Part 173.301. The pressure inside the container at 70°F (21 °C) shall not exceed the service pressure for which the container is marked. The pressure inside the container at 130°F (54 °C) shall not exceed 5/4 times the service pressure for which the container is marked. Fig. 1 illustrates the effect of temperature on cylinders filled with HFC-227ea. Fig. 2 and Fig. 3 illustrate the effect of temperature on mixtures of HFC-227ea and nitrogen for the cases of HFC-227ea superpressurized at 70°F with nitrogen to a total pressure of 360 psig (25.8 bar) and 600 psig (42.4 bar), respectively.

5.3.2 Transportation shall be by suitable vehicles to preclude cylinder damage by excessive mechanical vibration, shock, freezing, or deleterious high temperatures throughout the entire transport route.

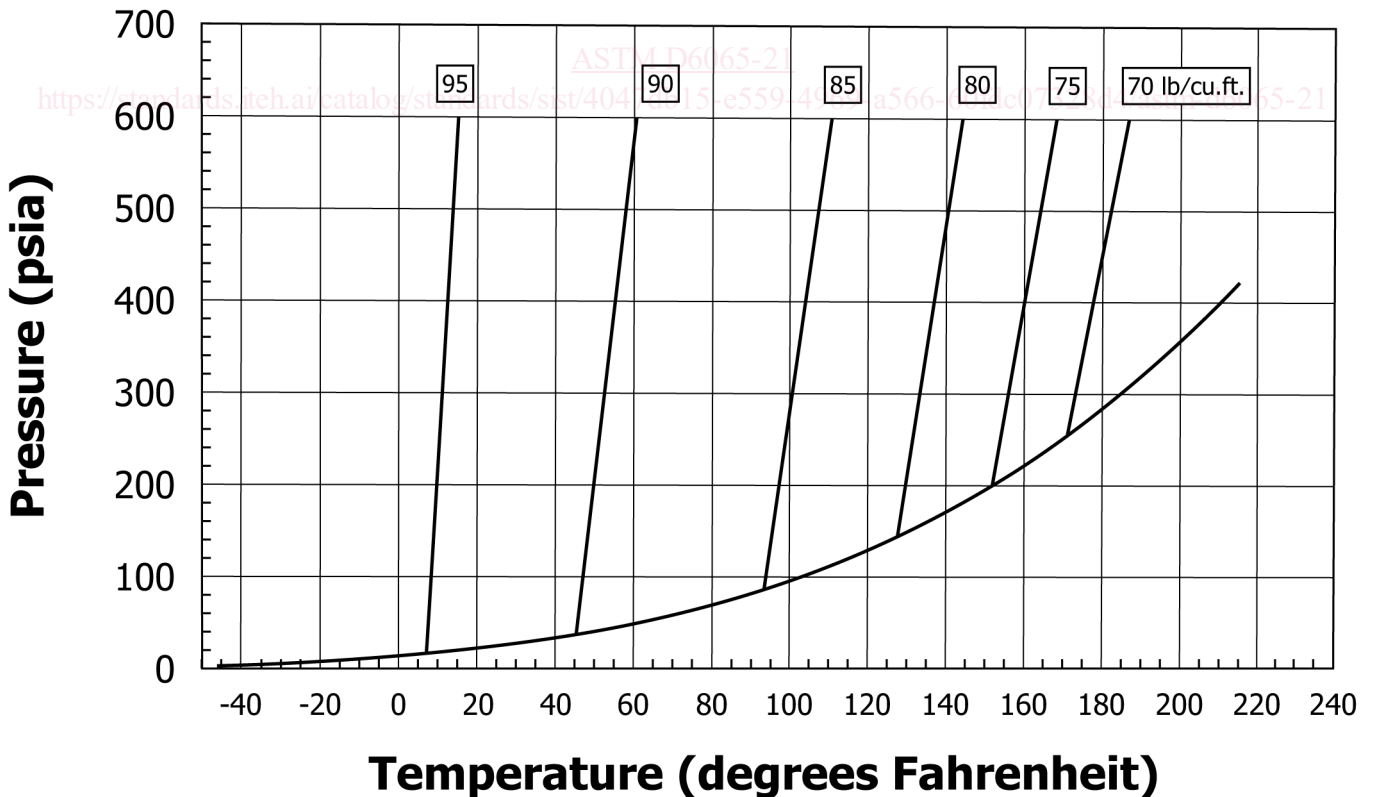


FIG. 1 HFC-227ea Isometric Diagram

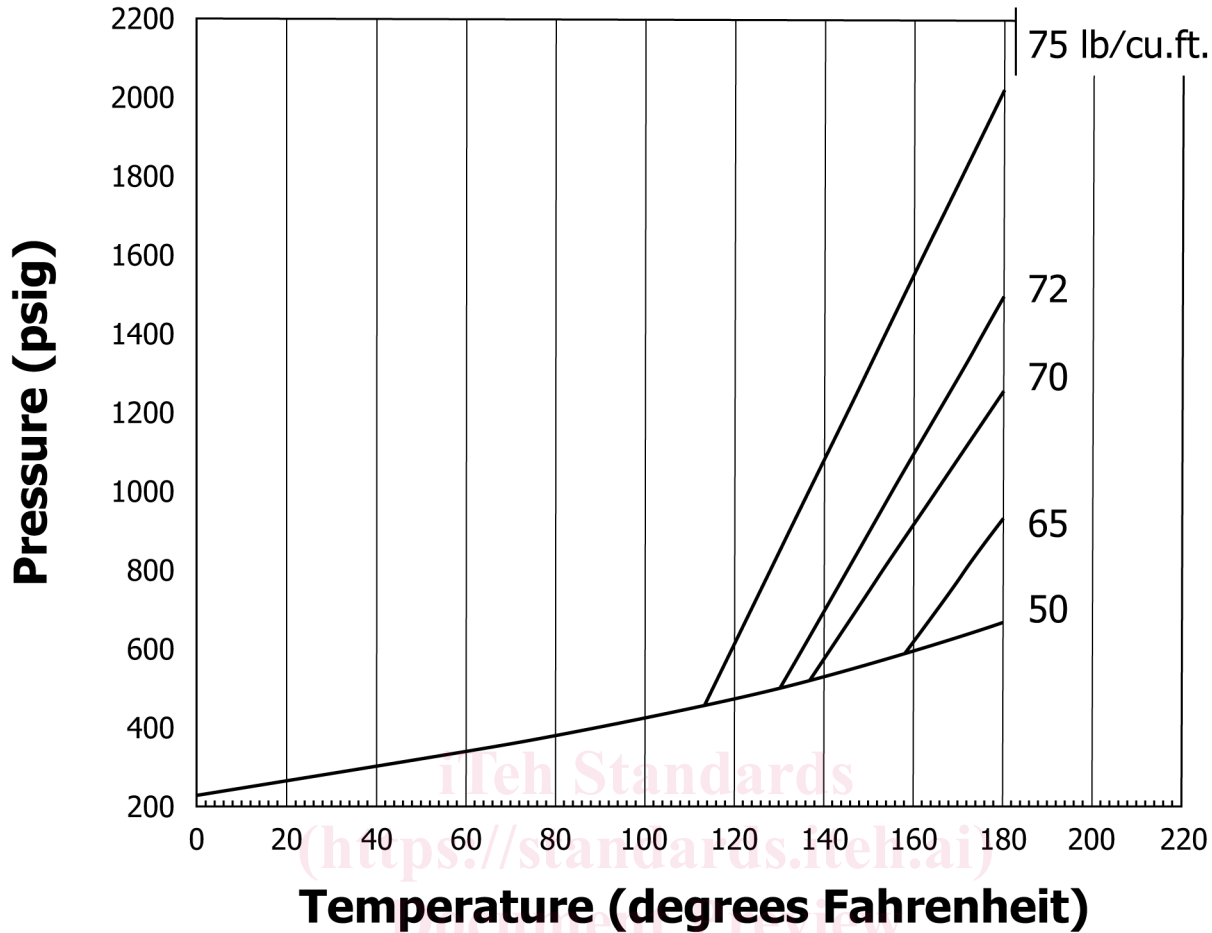


FIG. 2 Isometric Diagram HFC-227ea Pressurized to 360 psig (25.8 bar) With Nitrogen at 70°F (21°C) 70 °F (21 °C)

ASTM D6065-21

<https://standards.iteh.ai/catalog/standards/sist/4047db15-e559-4969-a566-60fd07328d4/astm-d6065-21>

5.3.2.1 Should cylinders be expected to be subjected to unacceptable transport conditions, the cylinders should be placed under insulated conditions.

5.3.3 Compressed gas cylinder permanent marking requirements shall be as specified under 49 CFR Part 178 of Title 49 CFR and must be maintained in legible condition as required by Part 173 of Title 49 CFR. Warning labels shall be affixed to cylinders conforming to requirements of Part 82.106 of Title 40 CFR. 49 CFR Part 173.

5.4 Storage:

5.4.1 Storage shall be in accordance with CGA Publication No. P-1, P-1 in qualified cylinders in accordance with Title 49 CFR, CFR Parts 173 and 178.

5.4.2 Cylinders should be stored in areas that will protect vessels from physical and environmental damage and tampering from unauthorized personnel.

5.4.2.1 Facilities should be of construction and orientation so that safety requirements are fulfilled for the storage of pressurized cylinders.

5.4.3 Storage cylinders shall be fitted with pressure release mechanisms to limit vessel pressure to not more than the rated working pressure of the HFC-227ea container in use at any particular time.

5.4.3.1 Periodic hydrostatic testing and reinspection of cylinders used for recycled HFC-227ea shall comply with Title 49 CFR Part 180.