



Designation: **D7374–08 (Reapproved 2015) D7374 – 21**

Standard Practice for Evaluating Elevated Temperature Performance of Adhesives Used in End-Jointed Lumber¹

This standard is issued under the fixed designation D7374; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This standard practice is to be used to evaluate the elevated temperature performance of adhesives used in end-jointed lumber.

1.2 A symmetric wall assembly containing end-jointed lumber studs is exposed to a standard fire exposure specified in Test Methods **E119**.

1.3 The wall assembly shall sustain the applied load during a standard fire exposure specified in Test Methods **E119** for a period of 60 min or more.

1.4 This practice is used to evaluate the performance of adhesives used in end-jointed lumber to heat and flame under controlled conditions, but it does not by itself incorporate all factors required for fire hazard or fire risk assessment under actual fire conditions.

1.5 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.6 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.7 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 *ASTM Standards:*²

C1396/C1396M Specification for Gypsum Board

D9 Terminology Relating to Wood and Wood-Based Products

D4688 Test Method for Evaluating Structural Adhesives for Finger Jointing Lumber

D6513 Practice for Calculating the Superimposed Load on Wood-frame Walls for Standard Fire-Resistance Tests

E119 Test Methods for Fire Tests of Building Construction and Materials

¹ This practice is under the jurisdiction of ASTM Committee **D07** on Wood and is the direct responsibility of Subcommittee **D07.02** on Lumber and Engineered Wood Products.

Current edition approved May 1, 2015; July 15, 2021. Published June 2015; August 2021. Originally approved in 2008. Last previous edition approved in 2008 as **D7374–08–08 (2015)**. DOI: 10.1520/D7374-08R15; 10.1520/D7374-21.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

F1667 Specification for Driven Fasteners: Nails, Spikes, and Staples

2.2 Other Standards:

ANSI/AF&PA NDS National Design Specification for Wood Construction³

3. Terminology

3.1 Definitions:

3.1.1 For general definitions of terms related to wood, refer to Terminology D9.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *end-jointed lumber—end joint, n—*lumber containing one or more end-joints. *joint* formed by adhesive bonding of machined, mated surfaces at the ends of two pieces of lumber.

3.2.1.1 Discussion—

Typical end joint configurations include finger joints and scarf joints.

3.2.2 *end-joints—finger joint, n—*an end joint formed by bonding two pieces of lumber end-to-end, often by machining a set of interlocking “fingers” (finger-joint) into each end of adjoining pieces, using an adhesive to form an adhesive bonded joint. *multiple interlocking tapered profiles (“fingers”).*

3.2.3 *scarf joint, n—*end joint formed by a single tapered profile.

3.2.4 *end-jointed lumber—*lumber containing one or more end joints.

4. Summary of Practice

4.1 This practice shall be used to evaluate end-jointed lumber adhesives intended for use in end-jointed lumber by fire testing a wall assembly under a vertical load associated with the highest visual grade for the species group of Douglas Fir–Larch or Southern Pine. The results are deemed applicable to all other species, grades, and joint configurations.

NOTE 1—In the United States, the visual grade and species with the highest capacity in the ANSI/AF&PA NDS are Select Structural Douglas-fir Larch and Dense Select Structural Southern Pine.

5. Significance and Use

5.1 End-jointed lumber studs used in fire resistance-rated assemblies shall be able to support the superimposed design load for the specified time under an elevated temperature exposure, when a wall assembly is exposed to a standard fire specified in Test Methods E119. Light-weight wood assemblies utilize gypsum wallboard or other types of membrane protection to accomplish a requisite fire resistance rating for the assembly. However, wood studs and the end-joints in the studs shall resist the developed elevated temperature environment for the duration of the rating. This practice provides a method for evaluating the elevated temperature performance of an adhesive used in end-jointed lumber as compared with the elevated temperature performance of solid wood.

6. Wall Assembly

6.1 A load-bearing wall meeting the following assembly description shall be used.

6.1.1 Framing Elements:

6.1.1.1 *Studs*—Nine pieces of 2 × 4 (nominal) end-jointed lumber shall be used for wall studs. Each piece of end-jointed lumber shall be 115.5 in. (2934 mm) long and have at least one end-joint within the middle third of the length. Studs shall be symmetrically placed within the 10-ft (3.05-m) long by 10-ft (3.05-m) high wall assembly with interior studs spaced 16 in. (406 mm) on center as shown in Fig. 1. The moisture content of the end-jointed lumber shall be no greater than 15 % at the time of the fire test.

NOTE 2—When producing end-jointed lumber for use in this standard practice, consideration should be given to the unique production conditions, such

³ Available from American Forest and Paper Association (AF&PA), 1111 19th St., NW, Suite 800, Washington, DC 20036, <http://www.afandpa.org>.

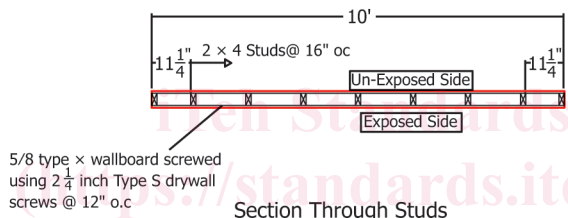
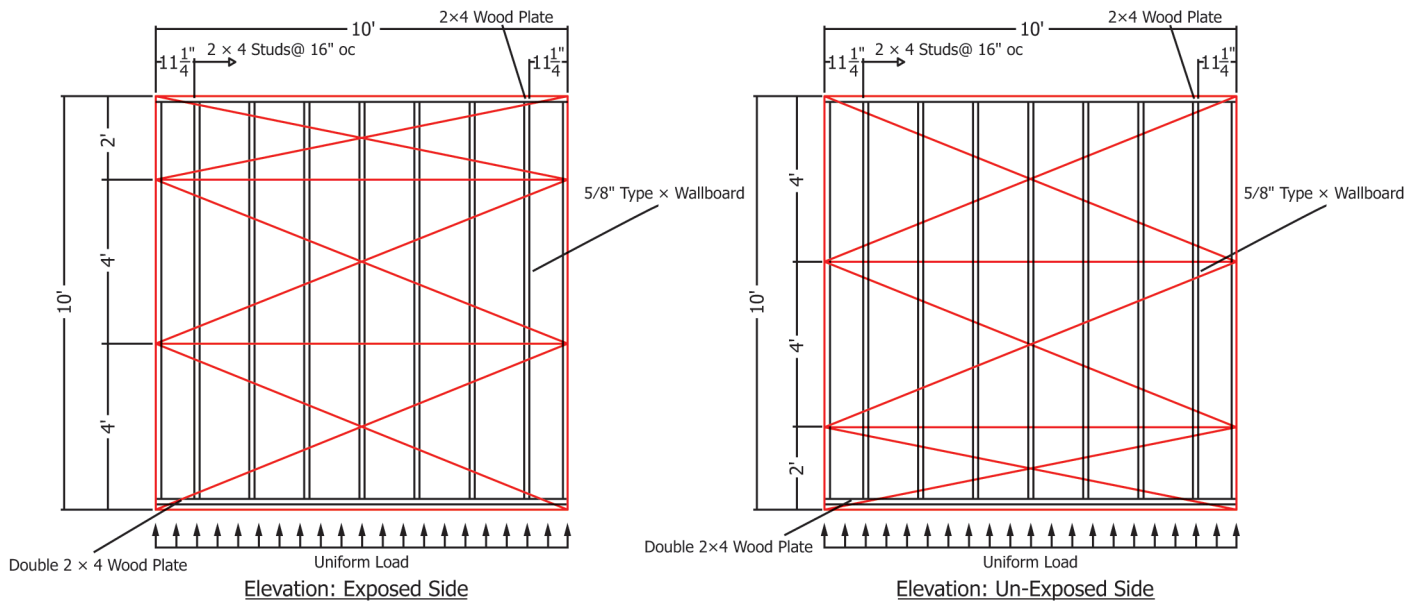


FIG. 1 Assembly Details

ASTM D7374-21

as wood moisture content, applied spread rate, pressure, and curing temperature of the adhesive in accordance with the adhesive manufacturer’s recommendations.

6.1.1.2 *Plates*—Studs shall be attached to a double top plate and a single bottom plate as shown in Fig. 1. Plates shall be the same species as the stud material. The first top plate and the bottom plate shall be endnailed to the studs using 2-16d common nails or 3-16d box nails. The second top plate is attached to the first top plate using a single row of 16d common nails at 16 in. (406 mm) on center or 1-16d box nails at 12 in. (305 mm) on center. Nails shall be in accordance with Specification F1667.

NOTE 3—In Fig. 1, double top plates are located at the bottom of test wall to be adjacent to the movable load beam. Double top plates are located at the top of the test wall when the load beam is along the top.

6.1.1.3 *Blocking*—Blocking between studs shall not be permitted.

6.1.2 *Insulation*—The cavity between studs shall be filled with 3 1/2-in. (89-mm) in. (89 mm) thick mineral wool insulation having a nominal density of 2.5 pcf (40 kg/m³).

6.1.3 *Sheathing*—A single layer of 5/8-in. (16-mm) in. (16 mm) Type X gypsum wallboard (in accordance with Specification C1396/C1396M), 4 ft (1.22 m) wide, shall be applied to each side of the assembly with the long axis perpendicular to the studs as shown in Fig. 1. Horizontal joints shall be unblocked. No vertical joints are required.

6.1.4 *Fasteners*—Gypsum wallboard shall be attached to all framing members, including top and bottom plates, as shown in Fig. 1 using 2 1/4-in. (57-mm) in. (57 mm) Type S drywall screws spaced 12 in. (305 mm) on center.

NOTE 4—Screws have been shown to increase the temperature in the surrounding wood and insertion into end-joints should be minimized.