



Designation: C76M – 22

Standard Specification for Reinforced Concrete Culvert, Storm Drain, and Sewer Pipe (Metric)¹

This standard is issued under the fixed designation C76M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

1. Scope*

1.1 This specification covers reinforced concrete pipe intended to be used for the conveyance of sewage, industrial wastes, and storm water, and for the construction of culverts.

1.2 This specification is the SI companion to Specification C76; therefore, no inch-pound equivalents are presented in this specification. Reinforced concrete pipe that conform to the requirements of C76 are acceptable under this Specification C76M unless prohibited by the Owner.

NOTE 1—This specification is a manufacturing and purchase specification only, and does not include requirements for bedding, backfill, or the relationship between field load condition and the strength classification of pipe. However, experience has shown that the successful performance of this product depends upon the proper selection of the class of pipe, type of bedding and backfill, controlled manufacture in the plant, and care and installation conforms to the construction specifications. The owner of the reinforced concrete pipe specified herein is cautioned that he must correlate the field requirements with the class of pipe specified and provide inspection at the construction site.

NOTE 2—Attention is called to the specification for reinforced concrete D-load culvert, storm drain, and sewer pipe (ASTM Designation C655M).

1.3 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 ASTM Standards:²

A36/A36M Specification for Carbon Structural Steel

A615/A615M Specification for Deformed and Plain Carbon-

Steel Bars for Concrete Reinforcement

A706/A706M Specification for Deformed and Plain Low-Alloy Steel Bars for Concrete Reinforcement

A1064/A1064M Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete

C33/C33M Specification for Concrete Aggregates

C150/C150M Specification for Portland Cement

C260/C260M Specification for Air-Entraining Admixtures for Concrete

C309 Specification for Liquid Membrane-Forming Compounds for Curing Concrete

C443M Specification for Joints for Concrete Pipe and Manholes, Using Rubber Gaskets (Metric)

C494/C494M Specification for Chemical Admixtures for Concrete

C497M Test Methods for Concrete Pipe, Concrete Box Sections, Manhole Sections, or Tile (Metric)

C595/C595M Specification for Blended Hydraulic Cements

C618 Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete

C655M Specification for Reinforced Concrete D-Load Culvert, Storm Drain, and Sewer Pipe (Metric)

C822 Terminology Relating to Concrete Pipe and Related Products

C989/C989M Specification for Slag Cement for Use in Concrete and Mortars

C990M Specification for Joints for Concrete Pipe, Manholes, and Precast Box Sections Using Preformed Flexible Joint Sealants (Metric)

C1017/C1017M Specification for Chemical Admixtures for Use in Producing Flowing Concrete (Withdrawn 2022)³

C1116/C1116M Specification for Fiber-Reinforced Concrete

C1602/C1602M Specification for Mixing Water Used in the Production of Hydraulic Cement Concrete

C1628 Specification for Joints for Concrete Gravity Flow Sewer Pipe, Using Rubber Gaskets

¹ This specification is under the jurisdiction of ASTM Committee C13 on Concrete Pipe and is the direct responsibility of Subcommittee C13.02 on Reinforced Sewer and Culvert Pipe.

Current edition approved March 1, 2022. Published March 2022. Originally approved in 1980. Last previous edition approved in 2020 as C76M - 20. DOI: 10.1520/C0076M-22.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ The last approved version of this historical standard is referenced on www.astm.org.

*A Summary of Changes section appears at the end of this standard

3. Terminology

3.1 *Definitions*—For definitions of terms relating to concrete pipe, see Terminology C822.

4. Classification

4.1 Pipe manufactured in accordance with this specification shall be of five classes identified as Class I, Class II, Class III, Class IV, and Class V. The corresponding strength requirements are prescribed in Tables 1-5.

5. Basis of Acceptance

5.1 Unless otherwise designated by the owner at the time of, or before placing an order, there are two separate and alternative bases of acceptance. Independent of the method of acceptance, the pipe shall be designed to meet both the 0.01-in. crack and ultimate strength requirements specified in Tables 1-5.

5.1.1 *Acceptance on the Basis of Plant Load-Bearing Tests, Material Tests, and Inspection of Manufactured Pipe for Visual Defects and Imperfections*—Acceptability of the pipe in all diameters and classes produced in accordance with 7.1 or 7.2 shall be determined by the results of the three-edge bearing tests as defined in 11.3.1; by such material tests as are required in 6.2, 6.3, 6.5 and 6.6; by an absorption test of the concrete from the wall of the pipe as required in 11.9; and by visual inspection of the finished pipe to determine its conformance with the accepted material requirements and its freedom from defects.

5.1.2 *Acceptance on the Basis of Material Test and Inspection of Manufactured Pipe for Defects and Imperfections*—Acceptability of the pipe in all diameters and classes produced in accordance with 7.2 shall be determined by the results of such material tests as are required in 6.2, 6.3, 6.5 and 6.6; by

crushing tests on concrete cores or cured concrete cylinders; by an absorption test of the concrete from the wall of the pipe for each mix design that is used on an order; and by inspection of the finished pipe including amount and placement of reinforcement to determine its conformance with the accepted design and its freedom from defects.

5.1.3 When agreed upon between the owner and manufacturer, any portion or any combination of the tests itemized in 5.1.1 or 5.1.2 may form the basis of acceptance.

5.2 *Age for Acceptance*—Pipe shall be considered ready for acceptance when it conforms to the requirements as indicated by the specified tests.

6. Materials

6.1 *Reinforced Concrete*—The reinforced concrete shall consist of cementitious materials, mineral aggregates, water, and admixtures, if any, in which steel has been embedded in such a manner that the steel and concrete act together.


6.2 *Cementitious Materials*:

6.2.1 *Cement*—Cement shall conform to the requirements for portland cement of Specification C150/C150M or shall be portland blast-furnace slag cement, portland-limestone cement, or portland-pozzolan cement conforming to the requirements of Specification C595/C595M, except that the pozzolan constituent in the Type IP portland-pozzolan cement shall be fly ash.

6.2.2 *Slag Cement*—Slag cement shall conform to the requirements of Grade 100 or 120 of Specification C989/C989M.

6.2.3 *Fly Ash*—Fly ash shall conform to the requirements of Class F or Class C of Specification C618.

6.2.4 *Allowable Combinations of Cementitious Materials*—The combination of cementitious materials used in the concrete shall be one of the following:

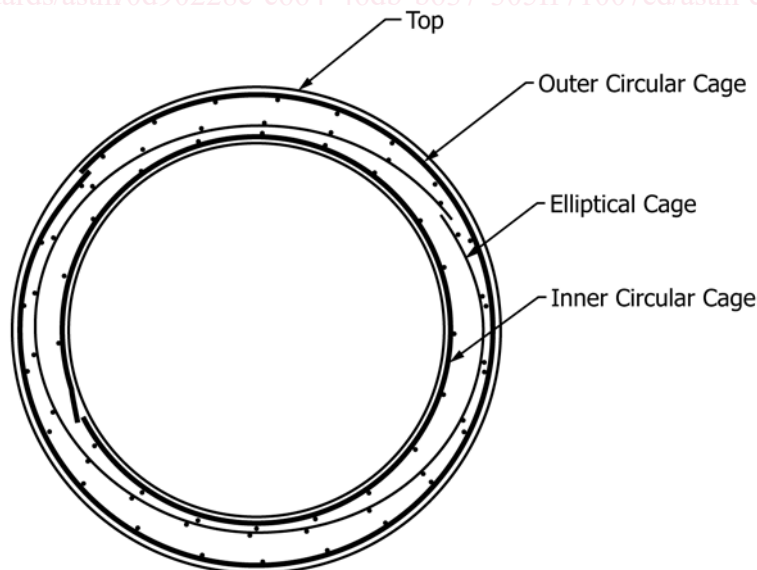

NOTE 1—The total reinforcement area of the inner circular cage and the elliptical cage shall not be less than that specified for the inner cage in Tables 1-5.

NOTE 2—The total reinforcement area of the outer circular cage and the elliptical cage shall not be less than that specified for the outer cage in Tables 1-5.

FIG. 1 Triple Cage Reinforcement