



Designation: C1492 – 22

Standard Specification for Concrete Roof Tile¹

This standard is issued under the fixed designation C1492; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This specification covers concrete tiles intended for the use as roof covering where durability and appearance are required to provide a weather-resistant surface of specified design.

1.2 Tiles are manufactured from portland cement, water, and mineral aggregates with or without the inclusion of other materials.

1.3 Tiles are shaped during manufacturing by molding, pressing, or extrusion. The shaping method can be used to describe the tile.

1.4 Other constituents, such as chemical and mineral admixtures established as suitable for use in concrete, shall conform to ASTM standard specifications where applicable, or shall be shown by tests or experience not to be detrimental to the durability of concrete.

1.5 Tiles are generally planar or undulating rectangular shapes available in a variety of cross-sectional areas profiles, shapes, sizes, surface textures, and colors.

NOTE 1—Concrete roof tiles covered by this specification are made from lightweight or normal weight aggregates, or both.

NOTE 2—When particular features are desired, such as color, surface texture for appearance, or other special features, such properties should be specified by the purchaser. However, the local sellers should be consulted as to the availability of concrete roof tile having a desired feature.

1.6 The text of this specification references notes and footnotes, which provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the standard.

1.7 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.8 *This international standard was developed in accordance with internationally recognized principles on standard-*

ization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

2. Referenced Documents

2.1 *ASTM Standards:*²

C33/C33M Specification for Concrete Aggregates

C67/C67M Test Methods for Sampling and Testing Brick and Structural Clay Tile

C90 Specification for Loadbearing Concrete Masonry Units

C140/C140M Test Methods for Sampling and Testing Concrete Masonry Units and Related Units

C150/C150M Specification for Portland Cement

C260/C260M Specification for Air-Entraining Admixtures for Concrete

C331/C331M Specification for Lightweight Aggregates for Concrete Masonry Units

C494/C494M Specification for Chemical Admixtures for Concrete

C595/C595M Specification for Blended Hydraulic Cements

C618 Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete

C979/C979M Specification for Pigments for Integrally Colored Concrete

C989/C989M Specification for Slag Cement for Use in Concrete and Mortars

C1157/C1157M Performance Specification for Hydraulic Cement

3. Terminology

3.1 *Definitions*—The following terms are used in connection with concrete roof tiles:

3.2 *batten lugs, n*—protrusions on the underside of the tile designed to engage over the upper edge of tiling battens.

3.3 *head lap, n*—distance of overlap measured from the uppermost course to the point that it laps over the undermost course.

¹ This specification is under the jurisdiction of ASTM Committee C15 on Manufactured Masonry Units and is the direct responsibility of Subcommittee C15.06 on Roofing Tile.

Current edition approved March 1, 2022. Published April 2022. Originally published in 2001. Last previous edition approved in 2016 as C1492–03(2016). DOI: 10.1520/C1492-22.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

3.4 *high profile tile, n*—tile with a rise to width ratio greater than 1:5.

3.5 *interlocking tile, n*—tiles with a system of ribs or grooves enabling the lateral joining of adjacent tiles in the same horizontal row, with the overlapping lock covering the underlapping lock.

3.6 *length, n*—maximum overall dimension of the tile measured parallel to the water course.

3.7 *low profile tile, n*—tile with a rise equal to or less than ½ in.

3.8 *medium profile tile, n*—tile with a rise greater than ½ in. and a rise-to-width ratio of less than or equal to 1:5.

3.9 *nail hole, n*—small opening passing partially or totally through the tile to allow the penetration of a nail or screw for the purpose of fastening the tile to a support.

3.10 *non-interlocking tile, n*—tiles that butt at the sides without lapping adjacent tiles.

3.11 *nose lugs, n*—protrusion on the underside of the nose of each tile, contoured to fit into the main water courses of the tile immediately below, inhibiting the entry of wind-driven rain.

3.12 *profile, n*—contour of the top surface of the tile when viewed from the nose end.

3.13 *rise, n*—vertical distance from the underside of the batten lug to the highest point of the surface profile.

3.14 *side lap, n*—continuous longitudinal overlap of a tile on its neighbor.

3.15 *thickness, n*—any vertical measurement of the cross section of the tiles excluding the lapping area, nose lugs, and weather checks.

3.16 *weather checks, n*—protrusions below the tile designed to restrict the flow of water between two consecutive courses of tiles.

3.17 *width, n*—maximum overall dimension of the tile measured perpendicular to the length or water channel

3.18 *water course, n*—valley portion of a profiled tile along which water drains.

4. Classification

4.1 Concrete roof tiles manufactured in accordance with this specification are of the following types:

4.1.1 *Type I*—High Profile Tile.

4.1.2 *Type II*—Medium Profile Tile.

4.1.3 *Type III*—Low Profile Tile.

4.1.4 *Type IV*—Accessory Tile, shall include those tile such as ridge, rake, hip, and valley tile used in conjunction with those tile listed in 4.1.1 – 4.1.3.

5. Materials and Manufacture

5.1 Cementitious materials shall conform to the following applicable ASTM specifications.

5.1.1 *Portland Cement*—Specification C150/C150M.

5.1.2 *Modified Portland Cement*—Specification C90.

5.1.3 *Blended Cement*—Specification C595/C595M.

5.1.4 *Pozzolans*—Specification C618.

5.1.5 *Ground Granulated Blast Furnace Slag*—Specification C989/C989M.

5.1.6 Performance Specification C1157/C1157M.

5.2 Aggregates such as normal weight and lightweight shall conform to the following ASTM specifications, except that grading requirements do not apply.

5.2.1 *Normal Weight Aggregates*—Specification C33/C33M.

5.2.2 *Lightweight Aggregates*—Specification C331/C331M.

5.3 *Admixtures* shall conform to the following applicable specifications.

5.3.1 *Air-Entrained Admixtures*—Specification C260/C260M.

5.3.2 *Pigments*—Specification C979/C979M.

5.3.3 *Other Admixtures*—Specification C494/C494M.

6. Standard Methods of Sampling Concrete Tile

6.1 Tile sampling shall be appropriate for one of the following three purposes:

6.1.1 Resolution of quality disputes.

6.1.2 Third party certification.

6.1.3 Production or job shipment verification.

6.2 Tile sampling for the purpose listed in 6.1 shall be taken according to Table 1. To be rated as in compliance with this standard, the indicated number of tile sampled in accordance with Table 1 must pass the specified test.

6.2.1 In the event of a failure in any of the specified tests indicated in Table 1, a second set of specimens shall be taken and tested in accordance with the criteria listed in Table 2.

6.2.2 Provided that the number of failures in the re-test sample are less than the maximum allowed in Table 2, the lot shall be rated as being in compliance with this specification.

6.3 *Sampling Procedure*—Buyer and seller shall agree on the method of sampling prior to shipment. The random sampling method shall be used.

7. Standard Methods of Testing Concrete Roof Tiles

7.1 The following tests are required on concrete roof tiles:

7.1.1 Dimensional Tolerances.

7.1.2 Freeze Thaw (see 7.3.1).

7.1.3 Transverse Strength.

7.1.4 Permeability.

7.1.5 Water Absorption.

7.2 *Testing for Dimensional Tolerances and Weight:*

TABLE 1 Physical Testing Criteria

NOTE 1—Number of tile to be sampled and tested for determining compliance with this specification (see 6.2).

Test	Quality Dispute Resolution	Third Party Certification	Job – Production Verification	
			Up to 250 000 Tile	Over 250 000 Tile
Dimensional	5	5	5	5
Transverse	3	5	3	5
Permeability	3	3	3	5
Water Absorption	3	3	3	5
Freeze Thaw	5	5	Annual Test	Annual Test

TABLE 2 Retest Criteria

NOTE 1—Retest criteria of the specific test that failed (see 6.2.1).

NOTE 2—If 250 000 tiles were in the lot, then 32 specimens would be taken for the retest of the specific test that failed. If 3 or less of the 32 specimens failed, the lot would be rated as passing; however, if 4 or more of the 32 specimens failed, the lot would have failed the specific test.

Number of Tile in the Lot	Number of Specimens	Maximum Number of Failures Allowed for Acceptance
Less than 151	3	0
151–3200	13	1
3200–35 000	20	2
35 001–500 000	32	3
Over 500 000	50	5

7.2.1 *Dimensions*—The total variation in dimensions of tiles (length, width, and height), when measured in accordance with Test Methods C140/C140M, shall not be more than $\pm 5\%$ from the manufacturer’s designated dimensions.

7.2.2 *Weight*—The total variation in weight of tiles, when measured in accordance with Test Methods C140/C140M and Table 1 of this specification, shall not be more than $\pm 5\%$ from the nominal weight specified by the supplier.

7.3 *Freezing and Thawing*—Tiles shall be subjected to 50 cycles of freezing and thawing of Test Methods C67/C67M as modified in 7.3.4.

7.3.1 A lot shall be rated as passing without repeating a freezing and thawing test provided that a previous lot made by the supplier from similar materials, by the same production plant, and within the previous 12 months, passed the test, and provided also that a sample of five tiles selected from the lot has an average and individual minimum transverse strength not less than the previously tested sample and has average and

individual maximum water absorption not greater than those of the previously tested sample.

7.3.2 Only tile passing freeze-thaw testing shall be installed in areas subjected to weathering indices of 50 or greater and lot tags or certification that the lot of tile has passed the freeze-thaw testing accompanies the lot. See Fig. 1 for weathering indices map.

7.3.3 Tile not tested for freeze-thaw shall state clearly that the lot has not been tested for freeze-thaw acceptance on all lot tags or certification.

7.3.4 Modify Test Methods C67/C67M procedure for freezing and thawing as follows:

7.3.4.1 The test specimens shall consist of five whole tile.

7.3.4.2 The freezing trays and containers shall be of sufficient size and depth to allow the tiles to be completely submerged in water when placed horizontally.

7.3.4.3 The tile shall be completely submerged in water when the trays are placed in the freezing chamber.

7.3.4.4 Tile shall be tested individually or shall be stacked on top of each other in the tray, provided that spacers of at least ¼ in. (6 mm) thick are used between adjacent tile and that the total stack is completely submerged.

NOTE 3—A large capacity freezer is generally necessary to accomplish freezing in the manner specified in Test Methods C67/C67M for trays containing more than one tile. It is permitted to use custom trays to enclose the tile(s) and minimize the volume of water required to completely submerge the tile(s).

7.3.5 Tile is considered to have passed the freezing and thawing test if, at the completion of 50 cycles, all specimens remain unbroken and no individual specimen loses more than 1 % of original dry weight.

7.4 *Transverse Strength*:

<https://standards.iteh.ai/catalog/standards/sist/c566be1d-a581-4f69-93d1-98641cecb56/astm-c1492-22>

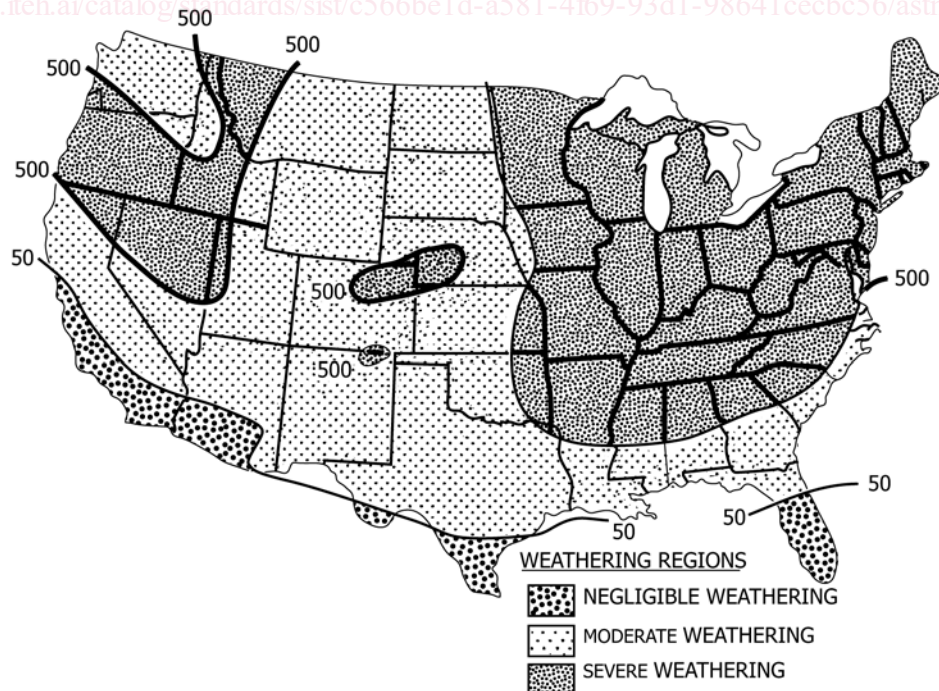


FIG. 1 Weathering Indices in the United States

7.4.1 *Apparatus*—The transverse breaking strength of tiles shall be determined as described in the Modulus of Rupture (Flexural Test) in Test Methods C67/C67M except as modified in 7.4.2 – 7.4.9.

7.4.2 Five tiles shall be tested wet after a 24-h submersion in water at a temperature of $75 \pm 10^\circ\text{F}$ ($24 \pm 6^\circ\text{C}$) or five tiles shall be tested dry after heating in a ventilated oven for 24 h at a temperature of 230 to 239°F (100 to 115°C).

7.4.3 Tiles shall be considered to comply with this specification if they comply with either the wet or dry transverse strength required. The choice of method, wet or dry, shall be mutually agreed upon between specifier and supplier.

7.4.4 The span for the test shall be 12 in. (30.5 cm) $\pm 5\%$ or $\frac{2}{3}$ the length of the tile, whichever is greater. The span is measured between the centers of the lower support members (see Fig. 2).

7.4.4.1 It is permitted to use a shorter span than required by 7.4.4 when the length of the tile to be tested, or the installed unsupported span of the tile, is not sufficient to allow a 12 in. (30.5 cm) span to be used. In that case a shorter span, not less than $\frac{2}{3}$ of the length of the tile, or the total length of the longest unsupported span as installed, whichever is less, shall be used.


7.4.5 The tile shall be tested in a three-point bending mode in a horizontal plane with the bottom surface of the tile resting on two lower support members and with the load being applied to the upper (exposed) surface of the tile by a third member

moving in a direction perpendicular to the plane of the tile and at mid-span (that is, equidistant from each of the lower support members). A schematic of the assembly for testing a typical “S” tile is shown in Fig. 2.

7.4.5.1 The two support members and the loading member shall each be of metal or hardwood with 1 in. (25 mm) $\pm 5\%$ wide faces. The faces shall be shaped (see Note 4) to closely conform to the profile of the surface of the tile upon which they bear during the test (the profile can, therefore, be different for each member depending on the profile and cross-sectional shape of the tile). The total height of the support members shall not be more than 1 in. (25 mm) greater than the rise of the profile. If hardwood, they should be backed up with steel bearing plates at least $\frac{1}{2}$ in. (13 mm) thick. A rubber shim strip $\frac{3}{16}$ in. (4.8 mm) $\pm 10\%$ thick of hardness no greater than shore durometer 30 (A scale), and 1 in. (25 mm) $\pm 5\%$ wide, shall be placed between the faces of the support and loading members and the surface of the tile.

NOTE 4—The intent of the defined loading system is (1) to apply the bending force with a loading member that pushes against as much of the profiled surface of the tile as practical, (2) to support the tile on members that support as much of the profiled surface of the tile as is practical, and (3) to ensure that the contact area of both the loading and support members is equally distributed on either side of the tile’s centerline in the long direction to avoid nonsymmetrical loading.

For tile with complex profiles and cross sections but with flat bearing surfaces that are at least 50 % of the width of the tile and that are also

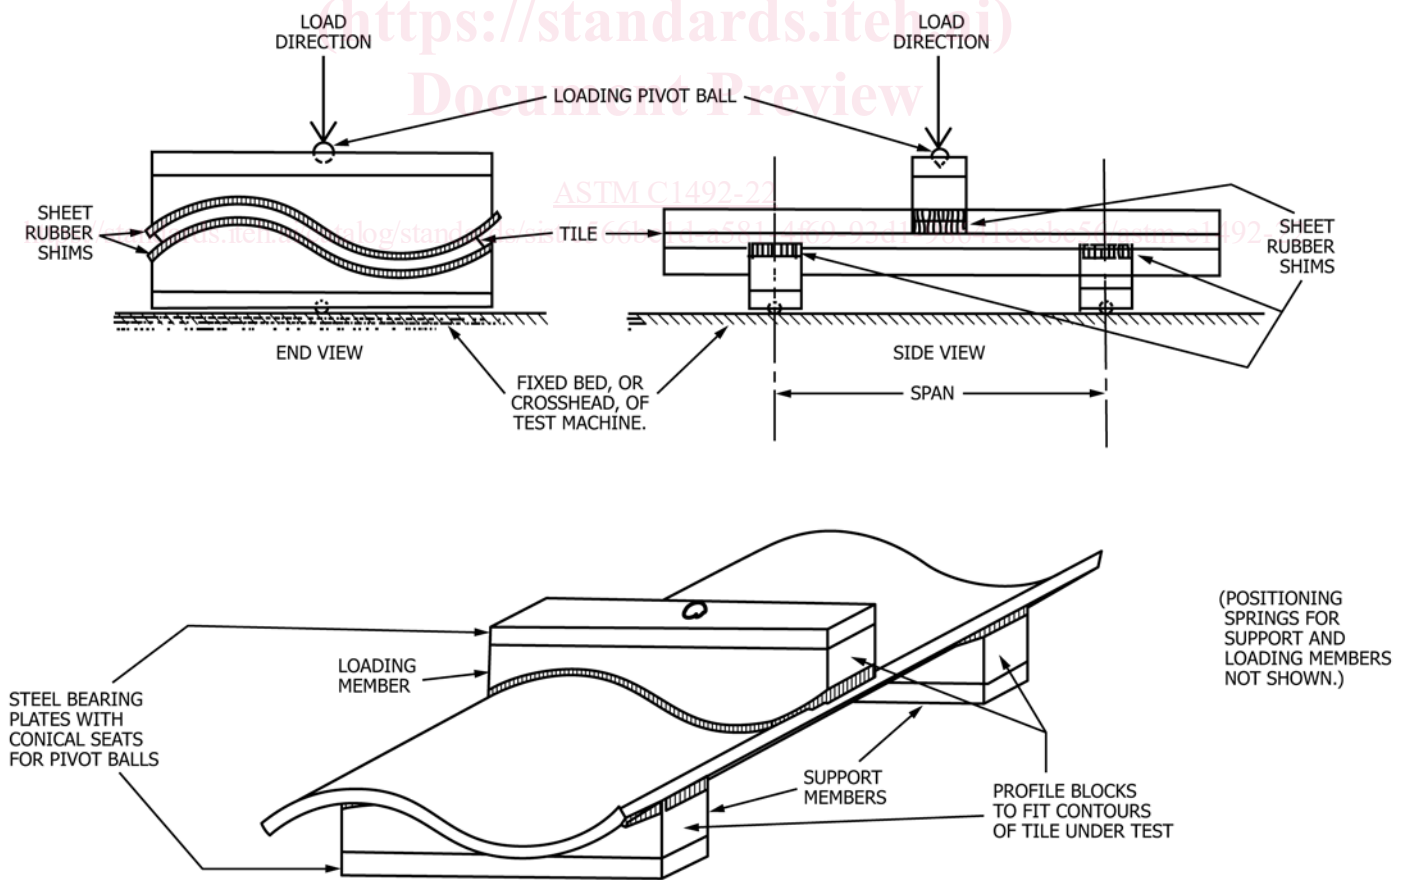

NOTE—See text for dimensions.

FIG. 2 Schematic of Assembly for Flexure Strength Testing