



Designation: ~~C1479–16 (Reapproved 2021)~~ C1479/C1479M – 22

Standard Practice for Installation of Precast Concrete Sewer, Storm Drain, and Culvert Pipe Using Standard Installations¹

This standard is issued under the fixed designation ~~C1479~~; C1479/C1479M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice covers the installation of precast concrete pipe intended to be used for the conveyance of sewage, industrial wastes, and storm water and for the construction of culverts.

1.2 ~~This practice is the inch-pound companion to Practice C1479. The values stated in either Imperial/US or SI units are to be regarded separately as standard. The SI units are shown in brackets. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other.~~

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 ASTM Standards:²

~~C822 Terminology Relating to Concrete Pipe and Related Products~~

~~C1417 Specification for Manufacture of Reinforced Concrete Sewer, Storm Drain, and Culvert Pipe for Direct Design~~

~~C1479M Practice for Installation of Precast Concrete Sewer, Storm Drain, and Culvert Pipe Using Standard Installations (Metric)~~

~~D698 Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft³ (600 kN-m/m³))~~

~~D1557 Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft³ (2,700 kN-m/m³))~~

~~D2487 Practice for Classification of Soils for Engineering Purposes (Unified Soil Classification System)~~

~~D2488 Practice for Description and Identification of Soils (Visual-Manual Procedures)~~

~~IEEE/ASTM SI 10 Standard for Use of the International System of Units (SI): The Modern Metric System~~

2.2 AASHTO Standards:³

~~Standard Specifications for Highway Bridges~~

~~M 145 Classification of Soils and Soil—Aggregate Mixtures for Highway Construction Purposes~~

¹ This practice is under the jurisdiction of ASTM Committee C13 on Concrete Pipe and is the direct responsibility of Subcommittee C13.05 on Special Projects. Current edition approved Jan. 1, 2021/April 1, 2022. Published January 2021/April 2022. Originally approved in 2000. Last previous edition approved in 2016/2021 as C1479–16/C1479–16(2021). DOI: 10.1520/C1479-16R21.10.1520/C1479_C1479M-22.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ Available from American Association of State Highway and Transportation Officials (AASHTO), 444 N. Capitol St., NW, Suite 249, Washington, DC 20001, http://www.transportation.org.

- T 99 The Moisture-Density Relations of Soils Using a 5.5 lb (2.5 kg) Rammer and a 12-in. (305 mm) Drop
- T 180 The Moisture-Density Relations of Soils Using a 10 lb (4.54 kg) Rammer and an 18-in. (457 mm) Drop
- T 310 In-Place Density and Moisture Content of Soil and Soil—Aggregate by Nuclear Methods (Shallow Depth)

2.3 ASCE Standards:⁴

ASCE 15 Standard Practice for the Direct Design of Buried Precast Reinforced Concrete Pipe Using Standard Installations (SIDD)

3. Terminology

- 3.1 For definitions of terms relating to concrete pipe, see Terminology C822.
- 3.2 For terminology related to soil classifications, see Practice D2487 and Practice D2488.
- 3.3 For terminology and definitions of terms relating to structural design, see ASCE 15.
- 3.4 Fig. 1 illustrates Fig. 1, Fig. 3, Fig. 5, and Fig. 7 illustrate the definitions and limits of the terms: foundation, subgrade, bedding, outer bedding, middle bedding, haunch, lower side, backfill or overfill, invert, crown, springline, top of pipe, and bottom of pipe as used in this practice.

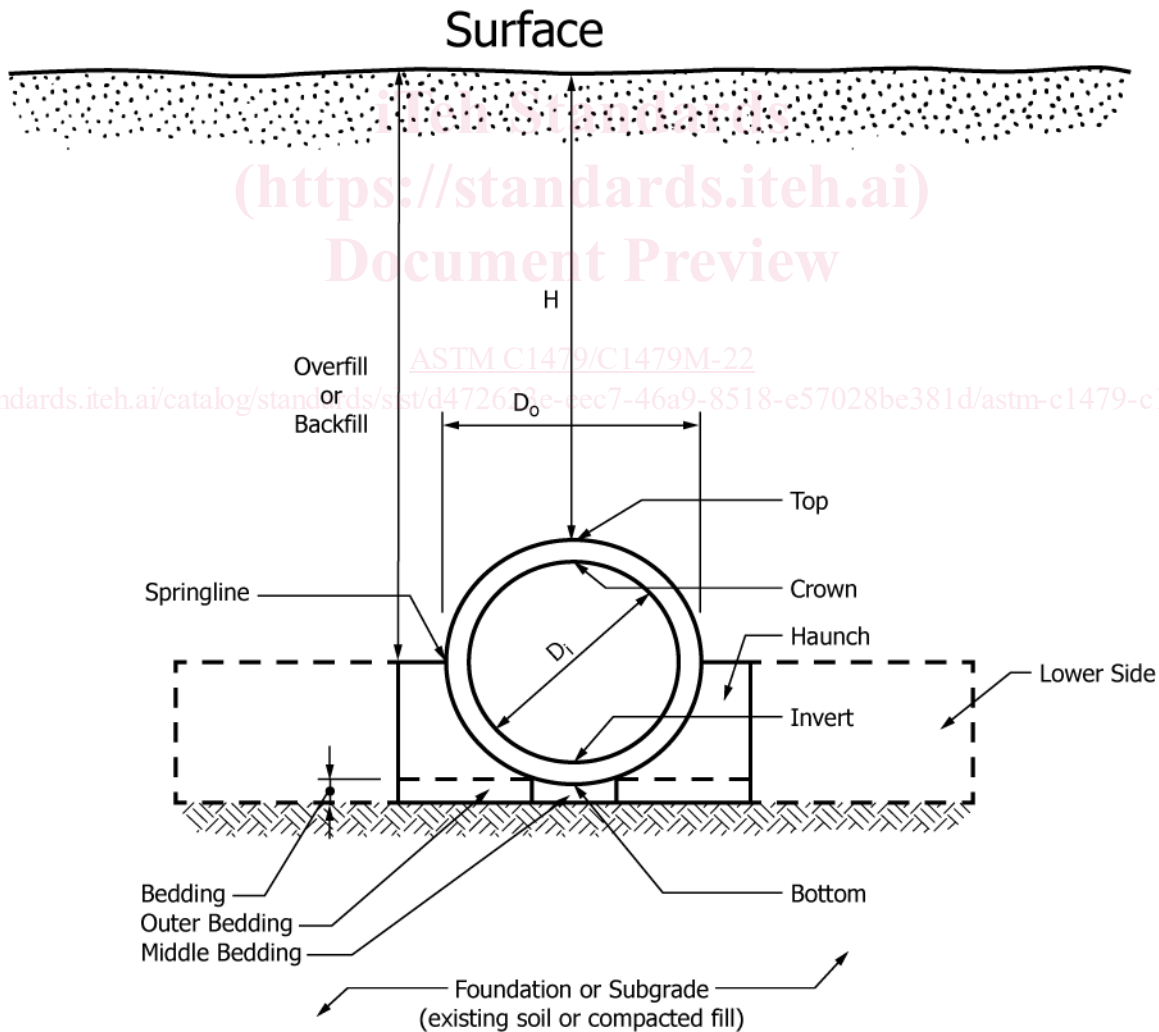


FIG. 1 Pipe/Installation—Round Pipe Installation Terminology

⁴ Available from American Society of Civil Engineers (ASCE), 1801 Alexander Bell Dr., Reston, VA 20191, <http://www.asce.org>.

4. Significance and Use

4.1 This practice is useful as a reference by an owner and the owner’s engineer in preparing project specifications.


5. Notations

D_i = inside diameter of pipe, in.
 D_o = outside diameter of pipe, in.
 H = design height of earth above top of pipe, ft.
 w = unit weight of soil, lb/ft³.

D_i = inside diameter of pipe, in. [mm]
 D_o = outside diameter of pipe, in. [mm]
 H = design height of earth above top of pipe, ft [m]
 w = unit weight of soil, lb/ft³ [N/m³]

6. Standard Installations

6.1 The precast concrete pipe/soil system shall be constructed to conform to the requirements of Figs. 2 and 3 Fig. 2 for round pipe,

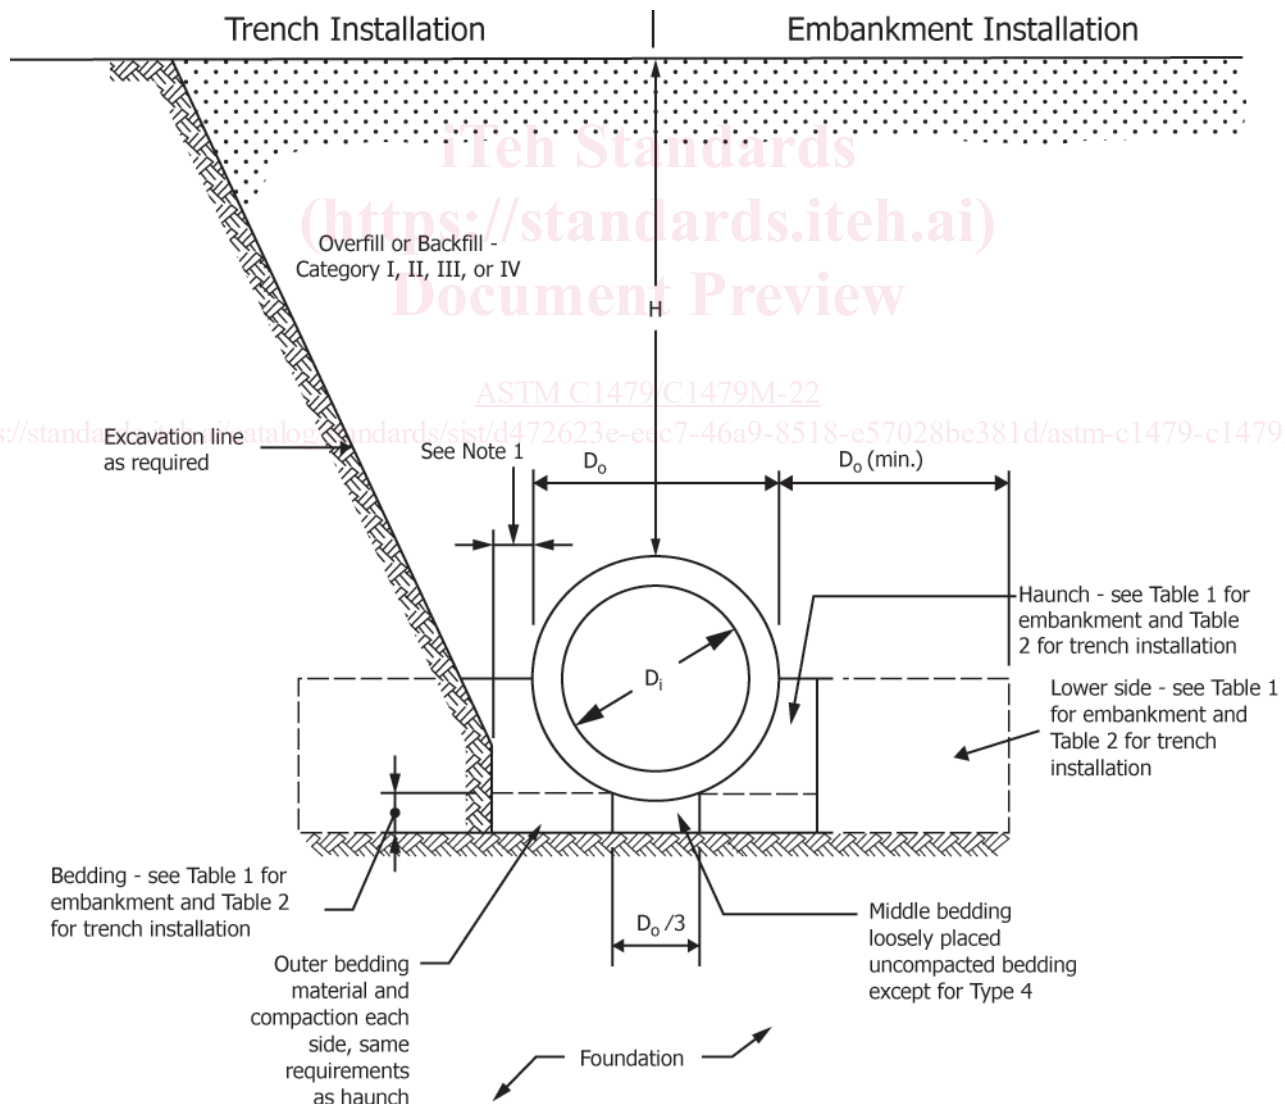

NOTE 1—Clearance between pipe and trench wall shall be adequate to enable specified compaction but not less than $D_o/6$.

FIG. 2 Round Pipe Standard Embankment/Trench/Embankment Installations

Fig. 4 for horizontal elliptical pipe, Fig. 6 for vertical elliptical pipe, and Fig. 8 for arch pipe and Tables 1 and 2 as designated on the plans.

7. Excavation

7.1 When rock or other unyielding foundation material is encountered, it shall be removed at least to the requirements shown in Figs. 2 and 3 Fig. 2, Fig. 4, Fig. 6, and Fig. 8 and Tables 1 and 2. Overexcavated areas shall be backfilled with approved materials and compacted to at least the standard proctor density specified for the bedding.

7.2 Where surface water or groundwater conditions exist, the site and trench shall be dewatered.

8. Foundation

8.1 The foundation shall be moderately firm to hard in situ soil, stabilized soil, or compacted fill material.

8.2 When unsuitable or unstable material is encountered, the foundation shall be stabilized.

8.3 Methods to prevent migration of soil fines shall be provided when groundwater or existing soil conditions are conducive to


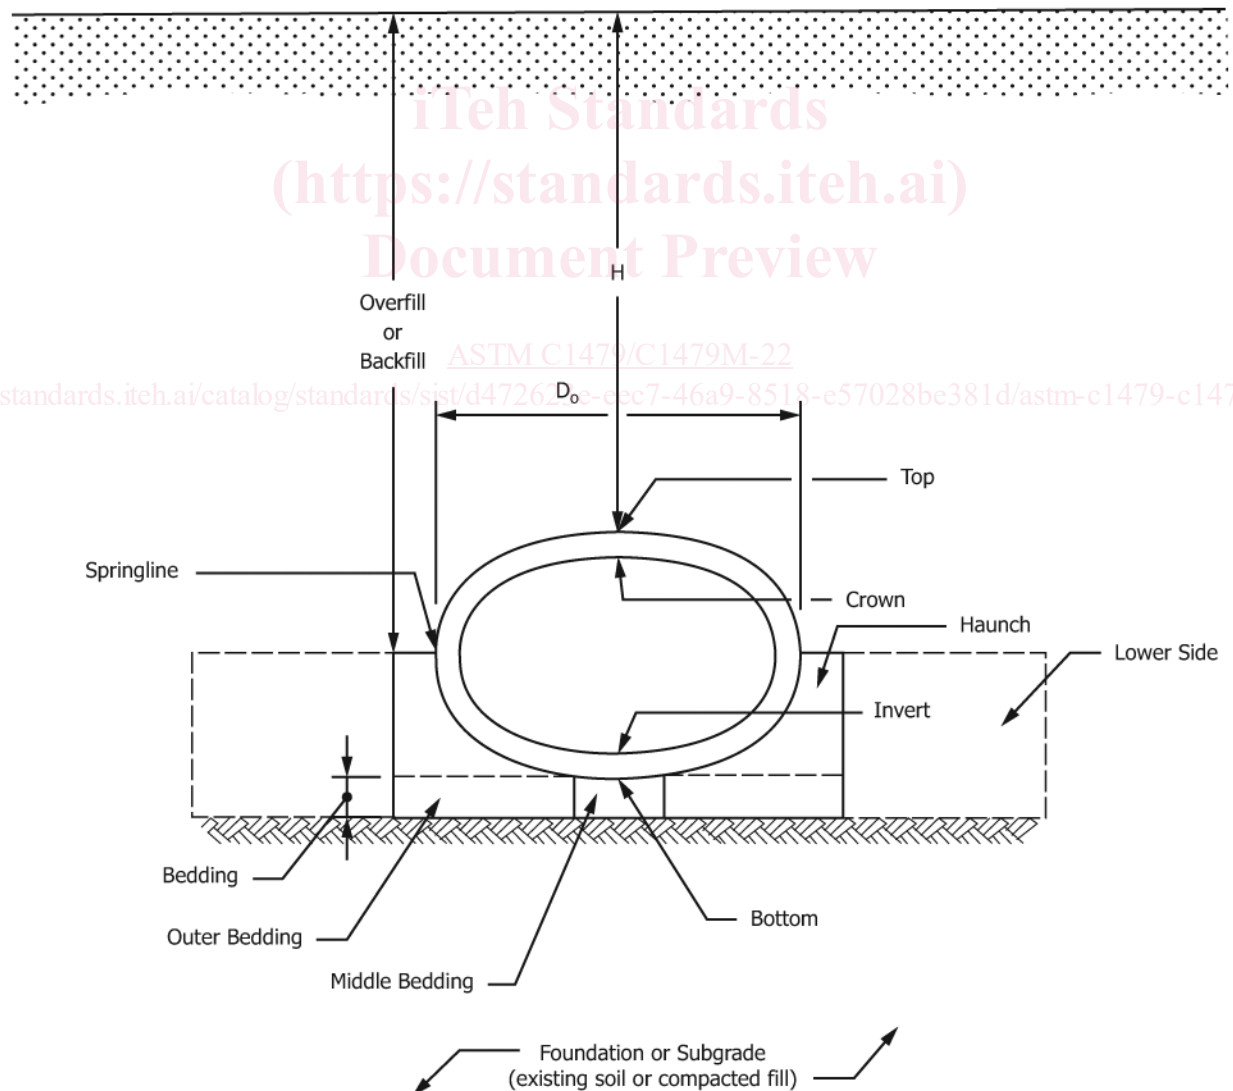


FIG. 3 Horizontal Elliptical Pipe Installation Terminology

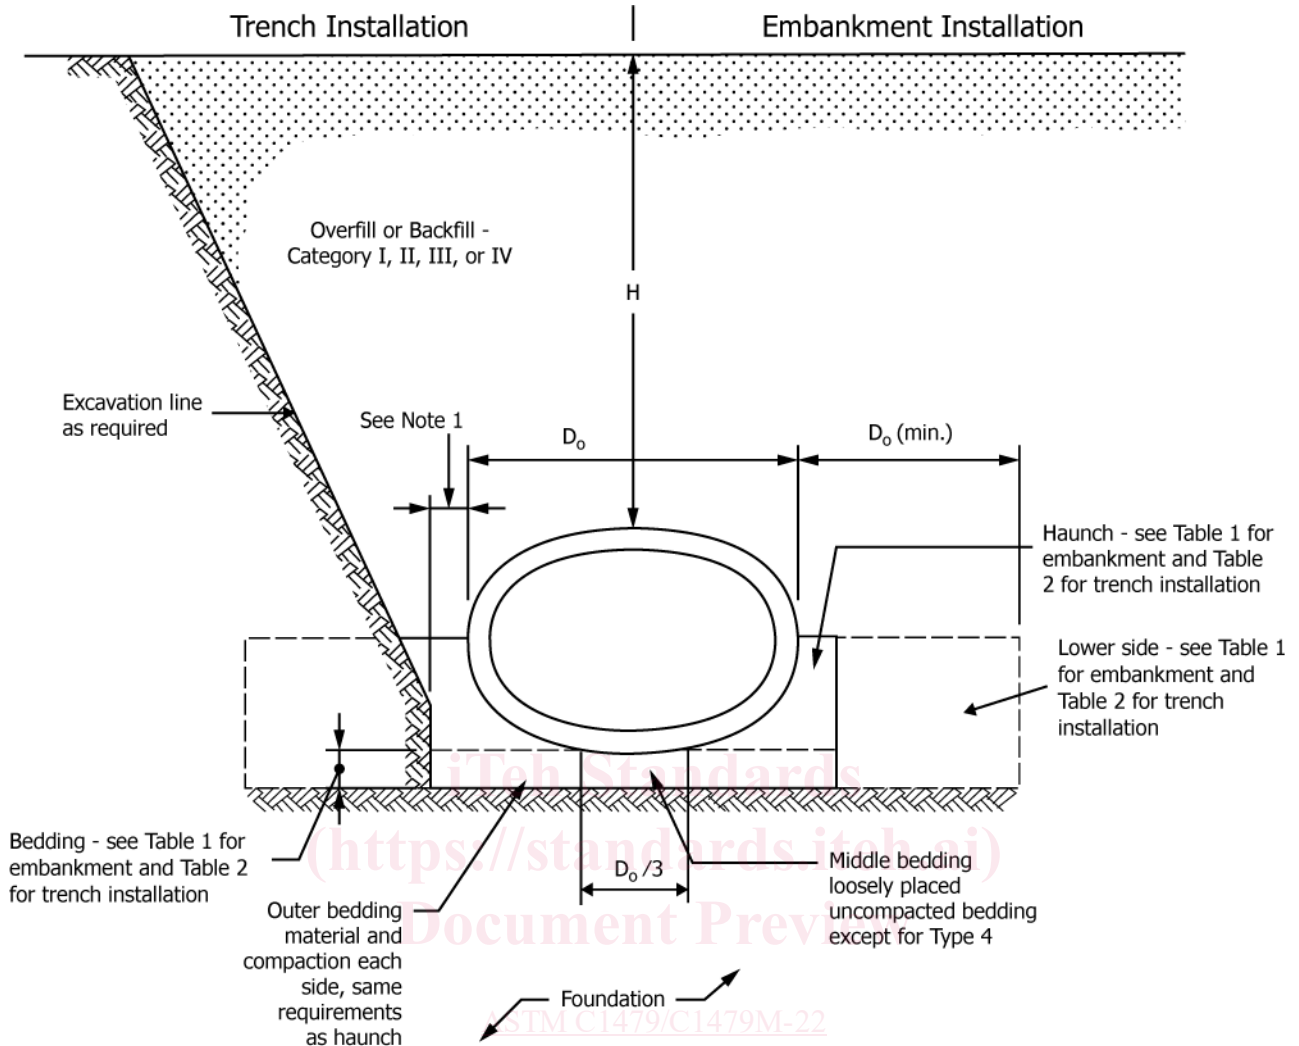

NOTE 1—Clearance between pipe and trench wall shall be adequate to enable specified compaction but not less than $D_o/6$.

FIG. 34 Standard Trench/Embankment Installations

particle migration. Gravelly soils, with little or no fines, could migrate may allow migration of fines from elsewhere in the pipe envelope under certain conditions, causing lack of support.

8.4 Pipe installed over an unyielding foundation shall be cushioned so as to prevent blasting shock when future blasting is anticipated in the area.

9. Bedding

9.1 The bedding shall be constructed uniformly over the full length of the pipe barrel, as required for the designated standard installation, to distribute the loadbearing reaction uniformly on the pipe barrel over its full length, and to maintain the required pipe grade. See Fig. 49. If placed in layers, the thickness of the layers shall be as required to achieve the specified compaction and as required by the project specifications.

9.2 The bedding layers for standard installation Types 1, 2, and 3 shall be placed to be as uniform as possible, but shall be loosely placed uncompacted material under the middle third of the pipe prior to placement of the pipe.

9.3 The maximum aggregate size shall be 1 in. [25 mm] when the bedding thickness is less than 6 in. [150 mm] and 1½-in. [38 mm] when the bedding thickness is 6 in. [150 mm] or greater, except as noted in 9.4.

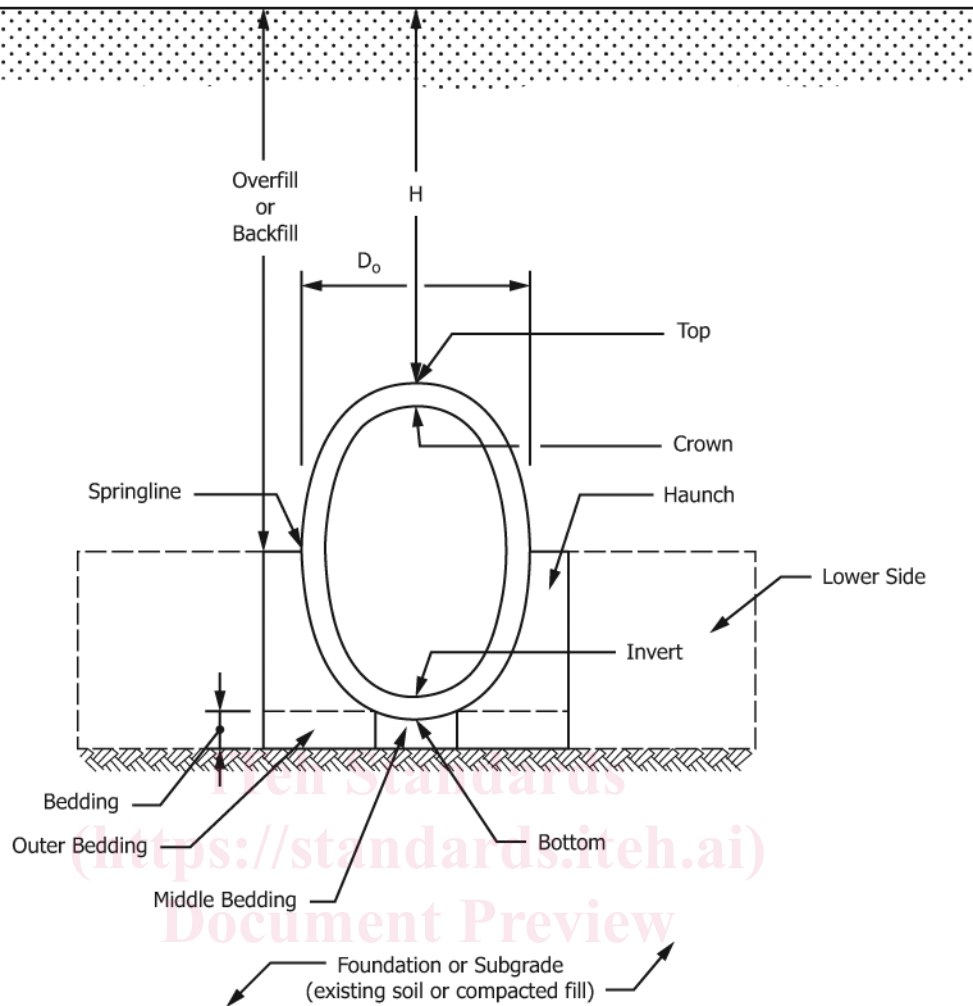


FIG. 5 Vertical Elliptical Pipe Installation Terminology

<https://standards.iteh.ai/catalog/standards/sist/d472623e-ec7-46a9-8518-e57028bc381d/astm-c1479-c1479m-22>

9.4 When in situ soils conforming to project specifications are used in constructing the outer bedding for Type 3 and 4 installations, the maximum aggregate size shall not be greater than 3 in. [75 mm], or half the bedding thickness, whichever is less.

9.5 The use of aggregate sizes larger than 1 in. [25 mm] shall be limited to 20 % of the bedding material by weight.

9.6 Bell holes shall be excavated in the bedding or foundation, or both, when installing pipe with expanded bells so that the pipe is supported by the barrel and not by the bells. See Fig. 49.

9.7 Any outer bedding under the lower side areas shall be compacted to at least the same requirements as for the lower side areas.


10. Pipe Placement and Joining

10.1 Pipe shall be installed to the line and grade shown on the project plans and specifications. The joint shall be as specified in the project specifications and shall be installed in accordance with the pipe manufacturer's recommendations.

NOTE 1—(Advisory) Where practical, work should be started at the lowest end of the pipeline and the pipe laid with the bell end up grade.

10.2 If required, the top of the pipe section being laid shall be positioned to the correct rotational orientation and then joined.

10.3 The bedding grade under the middle third of the pipe outside diameter shall be prepared before laying the pipe section.

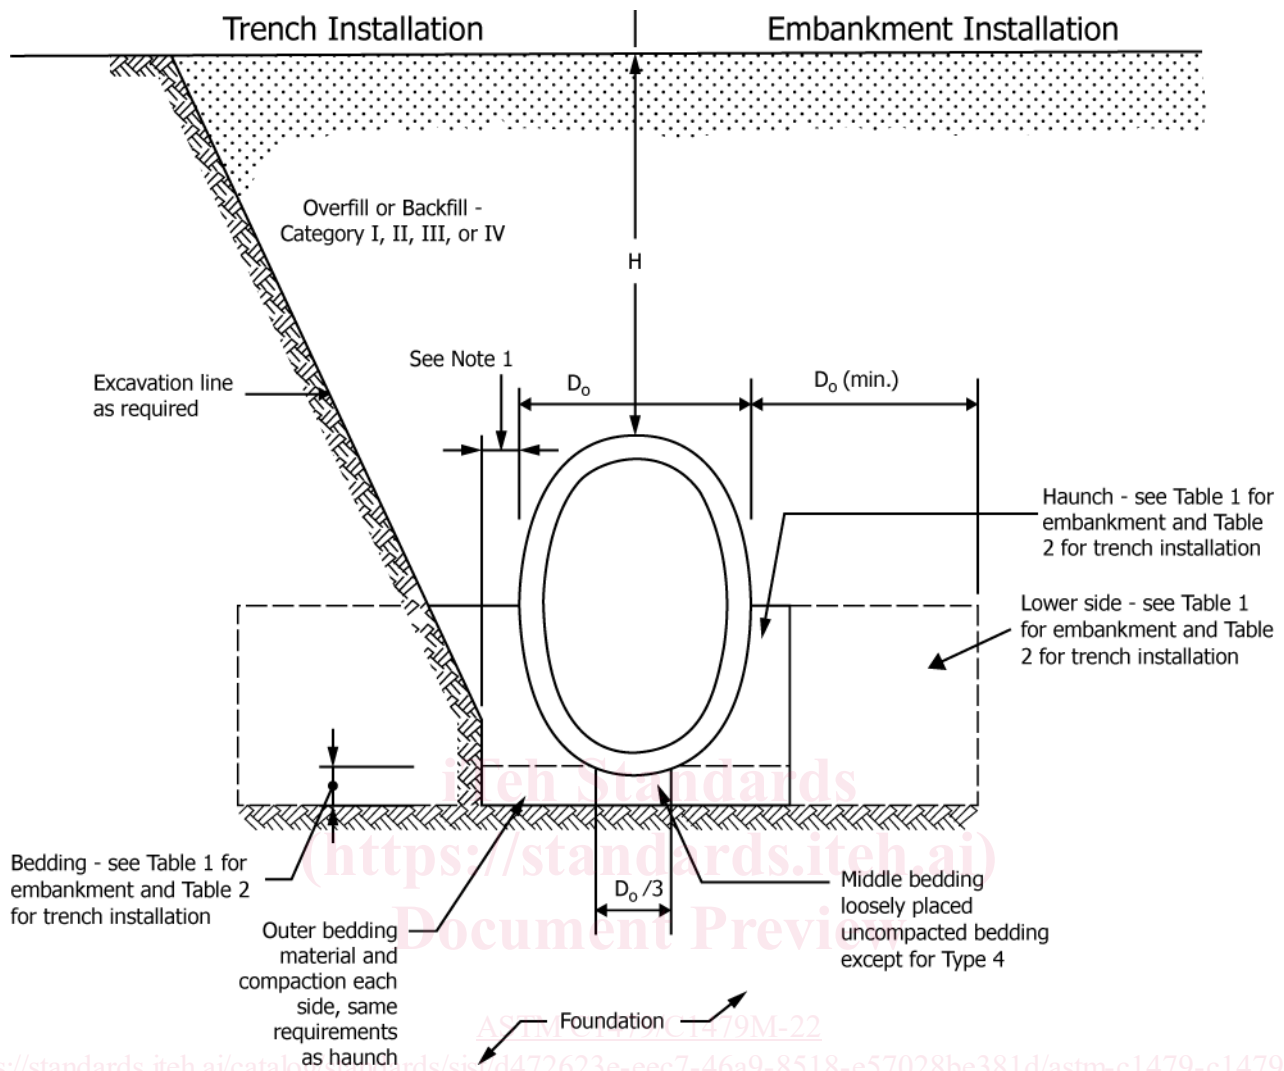

NOTE 1—Clearance between pipe and trench wall shall be adequate to enable specified compaction but not less than $D_o/6$.

FIG. 6 Vertical Elliptical Pipe Standard Trench/Embankment Installations

Making adjustments in grade by exerting force on the barrel of the pipe with excavating equipment, by lifting and dropping the pipe, or by lifting the pipe and packing bedding material under it shall be prohibited. If the installed pipe section is not on grade, the pipe section shall be completely unjoined, the grade corrected, and the pipe then rejoined.

11. Haunch

11.1 The haunch shall be constructed using the specified soil type and the minimum compaction level required for the designated standard installation. It shall be placed and compacted uniformly for the full length of the pipe barrel so as to distribute the load-bearing reaction uniformly to the bedding over the full length of the pipe barrel. If placed in layers, the thickness of the layers shall be as required to achieve the specified compaction and as required by the project specifications.

11.2 The maximum aggregate size for the haunch shall be the same as the maximum aggregate size in the bedding as defined in 9.3, except as noted in 11.3.

11.3 When in situ soils conforming to project specifications are used in constructing the pipe haunches for Type 3 and 4 installations, the maximum aggregate size shall not be greater than 3 in. [75 mm].

11.4 The use of aggregate sizes larger than 1 in. [25 mm] shall be limited to 20 % of the haunch material by weight.