



**Designation: E1827–11 (Reapproved 2017) E1827 – 22**

## **Standard Test Methods for Determining Airtightness of Buildings Using an Orifice Blower Door<sup>1</sup>**

This standard is issued under the fixed designation E1827; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

### **1. Scope**

1.1 These test methods describe two techniques for measuring air leakage rates through a building envelope in buildings that may be configured to a single zone. Both techniques use an orifice blower door to induce pressure differences across the building envelope and to measure those pressure differences and the resulting airflows. The measurements of pressure differences and airflows are used to determine airtightness and other leakage characteristics of the envelope.

1.2 These test methods allow testing under depressurization and pressurization.

1.3 These test methods are applicable to small indoor-outdoor temperature differentials and low wind pressure conditions; the uncertainty in the measured results increases with increasing wind speeds and temperature differentials.

1.4 These test methods do not measure air change rate under normal conditions of weather and building operation. To measure air change rate directly, use Test Method **E741**.

1.5 The text of these test methods reference notes and footnotes that provide explanatory material. These notes and footnotes, excluding those in tables and figures, shall not be considered as requirements of the standard.

1.6 The values stated in SI units are to be regarded as standard. The values given in parentheses after SI units are provided for information only and are not considered standard.

1.7 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.* For specific hazard statements see Section 7.

1.8 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

### **2. Referenced Documents**

#### **2.1 ASTM Standards:<sup>2</sup>**

<sup>1</sup> These test methods are under the jurisdiction of ASTM Committee **E06** on Performance of Buildings and are the direct responsibility of Subcommittee **E06.41** on Air Leakage and Ventilation Performance.

Current edition approved Sept. 1, 2017/Oct. 1, 2022. Published September 2017/October 2022. Originally approved in 1996. Last previous edition approved in 2014/2017 as **E1827–11**:**E1827 – 11** (2017). DOI: 40.1520/E1827-11R17; 10.1520/E1827-22.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's standard's Document Summary page on the ASTM website.

[E456 Terminology Relating to Quality and Statistics](#)

[E631 Terminology of Building Constructions](#)

[E741 Test Method for Determining Air Change in a Single Zone by Means of a Tracer Gas Dilution](#)

[E779 Test Method for Determining Air Leakage Rate by Fan Pressurization](#)

[E1186 Practices for Air Leakage Site Detection in Building Envelopes and Air Barrier Systems](#)

[E1258 Test Method for Airflow Calibration of Fan Pressurization Devices](#)

[E3158 Test Method for Measuring the Air Leakage Rate of a Large or Multizone Building](#)

2.2 *ISO International Standard*:<sup>3</sup>

[ISO 9972 Thermal Insulation—Determination of Building Airtightness—Fan Pressurization Method](#)

2.3 *Other Standard*:<sup>3</sup>

[ANSI/ASME PTC 19.1–1985 Part 1: Measurement Uncertainty, Instruments, and Apparatus](#)

### 3. Terminology

#### 3.1 Definitions:

3.1.1 For definitions of general terms related to building construction used in this test methods, refer to Terminology [E631](#) and for general terms related to accuracy, bias, precision, and uncertainty refer to Terminology [E456](#).

#### 3.2 Definitions of Terms Specific to This Standard:

3.2.1  $ACH_{50, n}$ —the ratio of the air leakage rate at 50 Pa (0.2 in. H<sub>2</sub>O), corrected for a standard air density, to the volume of the test zone (1/h).

3.2.2 *air leakage rate,  $Q_{env, n}$* —the total volume of air passing through the test zone envelope per unit of time (m<sup>3</sup>/s, ft<sup>3</sup>/min).

3.2.3 *airtightness,  $n$* —the degree to which a test zone envelope resists the flow of air.

iteh Standards  
(<https://standards.iteh.ai>)  
Document Preview

[ASTM E1827-22](#)

<https://standards.iteh.ai/catalog/standards/sist/808b6772-0f1c-4713-af63-2ec54e7726e2/astm-e1827-22>

---

<sup>3</sup> Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

NOTE 1— $ACH_{50}$ , air leakage rate, and effective leakage area are examples of measures of building airtightness.

3.2.4 *blower door, n*—a fan pressurization device incorporating a controllable fan and instruments for airflow measurement and building pressure difference measurement that mounts securely in a door or other opening.

3.2.5 *building pressure difference, P, n*—the pressure difference across the test zone envelope (Pa, in. H<sub>2</sub>O).

3.2.6 *fan airflow rate, Q<sub>fan</sub>, n*—the volume of airflow through the blower door per unit of time (m<sup>3</sup>/s, ft<sup>3</sup>/min).

3.2.7 *nominal airflow rate, Q<sub>nom</sub>, n*—the flow rate indicated by the blower door using the manufacturer’s calibration coefficients (m<sup>3</sup>/s, ft<sup>3</sup>/min).

3.2.8 *orifice blower door, n*—a blower door in which airflow rate is determined by means of the pressure drop across an orifice or nozzle.

3.2.9 *precision index of the average, n*—the sample standard deviation divided by the square root of the number of samples.<sup>3</sup>

3.2.10 *pressure station, n*—a specified induced change in the building pressure difference from the initial zero-flow building pressure difference (Pa, in. H<sub>2</sub>O).

3.2.11 *single zone, n*—a space in which the pressure differences between any two places, as indicated on a manometer, differ by no more than 2.5 Pa (0.01 in. H<sub>2</sub>O) during fan pressurization at a building pressure difference of 50 Pa (0.2 in. H<sub>2</sub>O) and by no more than 5 % of the highest building pressure difference achieved.

NOTE 2—A multiroom space that is interconnected within itself with door-sized openings through any partitions or floors is likely to satisfy this criterion if the fan airflow rate is less than 3 m<sup>3</sup>/s (6 × 10<sup>3</sup> ft<sup>3</sup>/min) and the test zone envelope is not extremely leaky.

3.2.12 *test zone, n*—a building or a portion of a building that is configured as a single zone for the purpose of this standard.

NOTE 3—For detached dwellings, the test zone envelope normally comprises the thermal envelope.

3.2.13 *test zone envelope, n*—the barrier or series of barriers between a test zone and the outdoors.

NOTE 4—The user establishes the test zone envelope at such places as basements or neighboring rooms by choosing the level of resistance to airflow between the test zone and outdoors with such measures as opening or closing windows and doors to, from, and within the adjacent spaces.

3.2.14 *zero-flow building pressure difference, n*—the natural building pressure difference measured when there is no flow through the blower door.

3.3 *Symbols*—The following is a summary of the principal symbols used in these test methods:

<i>Alt</i>	= altitude at site, m (ft),
<i>C</i>	= flow coefficient at standard conditions, m <sup>3</sup> /s (Pa <sup><i>n</i></sup> ) ft <sup>3</sup> /min (in. H <sub>2</sub> O <sup><i>n</i></sup> ), <sup>4</sup>
<i>L</i>	= effective leakage area at standard conditions, m <sup>2</sup> (in. <sup>2</sup> ),
<i>n</i>	= envelope flow exponent (dimensionless),
<i>P</i>	= building pressure difference (see 3.2.5),
<i>P</i> <sub>1</sub>	= average pressure, <i>P</i> <sub>sta</sub> <sup>-</sup> , at the primary pressure station, Pa (in. H <sub>2</sub> O),
<i>P</i> <sub>2</sub>	= average pressure, <i>P</i> <sub>sta</sub> <sup>-</sup> , at the secondary pressure station, Pa (in. H <sub>2</sub> O),
<i>P</i> <sub>ref</sub>	= the reference pressure differential across the building envelope, Pa (in. H <sub>2</sub> O),
<i>P</i> <sub>sta</sub>	= station pressure, Pa (in. H <sub>2</sub> O),
<i>P</i> <sub>test</sub>	= test pressure, Pa (in. H <sub>2</sub> O),
<i>P</i> <sub>zero1</sub>	= zero-airflow pressure before test, Pa (in. H <sub>2</sub> O),

<sup>4</sup> Historically, a variety of other units have been used.

$P_{zero2}$	= zero-airflow pressure after test, Pa (in. H <sub>2</sub> O),
$Q_{env}$	= the air leakage rate, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$Q_{env1}$	= average air leakage rate, $Q_{env}^-$ , at the primary pressure station, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$Q_{env2}$	= average air leakage rate, $Q_{env}^-$ , at the secondary pressure station, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$Q_{fan}$	= fan airflow rate (see 3.2.6),
$Q_{nom}$	= nominal airflow rate (see 3.2.7),
$T$	= temperature, °C (°F),
$t$	= value from a two-tailed student $t$ table for the 95 % confidence level,
$\delta n$	= measurement uncertainty of the envelope flow exponent (dimensionless),
$V_{zone}$	= volume of the test zone, m <sup>3</sup> (ft <sup>3</sup> ),
$\delta Q_{env}$	= measurement uncertainty of the average air leakage rate, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$\delta Q_{50}$	= the measurement uncertainty of $Q_{50}$ , m <sup>3</sup> /s (ft <sup>3</sup> /min),
$\delta Q_{bias}$	= estimated bias of the flow rate, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$\delta Q_{bias1}$	= estimated bias of the flow rate at the primary pressure station, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$\delta Q_{bias2}$	= estimated bias of the flow rate at the secondary pressure station, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$\delta Q_{precision}$	= precision index of the average measured flow rate, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$\delta Q_{prec1}$	= precision index of the average measured flow rate at the primary pressure station, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$\delta Q_{prec2}$	= precision index of the average measured flow rate at the secondary pressure station, m <sup>3</sup> /s (ft <sup>3</sup> /min),
$\delta P$	= measurement uncertainty of the average measured pressure differential across the building envelope, Pa (in. H <sub>2</sub> O),
$\delta P_{bias}$	= estimated bias of the pressure differential across the building envelope, Pa (in. H <sub>2</sub> O),
$\delta P_{bias1}$	= estimated bias of the pressure differential across the building envelope at the primary pressure station, Pa (in. H <sub>2</sub> O),
$\delta P_{bias2}$	= estimated bias of the pressure differential across the building envelope at the secondary pressure station, Pa (in. H <sub>2</sub> O),
$\delta P_{precision}$	= precision index of the average measured pressure differential across the building envelope, Pa (in. H <sub>2</sub> O),
$\delta P_{prec1}$	= precision index of the average measured pressure differential across the building envelope at the primary pressure station, Pa (in. H <sub>2</sub> O),
$\delta P_{prec2}$	= precision index of the average measured pressure differential across the building envelope at the secondary pressure station, Pa (in. H <sub>2</sub> O),
$\delta V_{zone}$	= measurement uncertainty of the zone volume, m <sup>3</sup> (ft <sup>3</sup> ),
$\mu$	= dynamic viscosity, kg/m·s (lbm/ft·hr),
$\rho$	= air density, kg/m <sup>3</sup> (lbm/ft <sup>3</sup> ), and
$\rho_{cal}$	= air density at which the calibration values are valid, kg/m <sup>3</sup> (lbm/ft <sup>3</sup> ).

## 4. Summary of Test Methods

4.1 *Pressure versus Flow*—These test methods consist of mechanical depressurization or pressurization of a building zone during which measurements of fan airflow rates are made at one or more pressure stations. The air leakage characteristics of a building envelope are evaluated from the relationship between the building pressure differences and the resulting airflow rates. Two alternative measurement and analysis procedures are specified in this standard, the single-point method and the two-point method.

4.1.1 *Single-Point Method*—This method provides air leakage estimates by making multiple flow measurements near  $P_1 = 50$  Pa (0.2 in. H<sub>2</sub>O) and assuming a building flow exponent of  $n = 0.65$ .

4.1.2 *Two-Point Method*—This method provides air leakage estimates by making multiple flow measurements near  $P_1 = 50$  Pa (0.2 in. H<sub>2</sub>O) and near  $P_2 = 12.5$  Pa (0.05 in. H<sub>2</sub>O) that permit estimates of the building flow coefficient and flow exponent.

## 5. Significance and Use

5.1 *Airtightness*—Building airtightness is one factor that affects building air change rates under normal conditions of weather and building operation. These air change rates account for a significant portion of the space-conditioning load and affect occupant comfort, indoor air quality, and building durability. These test methods produce results that characterize the airtightness of the building envelope. These results can be used to compare the relative airtightness of similar buildings, determine airtightness improvements from retrofit measures applied to an existing building, and predict air leakage. Use of this standard in conjunction with Practices E1186 permits the identification of leakage sources and rates of leakage from different components of the same building envelope. These test methods evolved from Test Method E779 to apply to orifice blower doors.

5.1.1 *Applicability to Natural Conditions*—Pressures across building envelopes under normal conditions of weather and building operation vary substantially among various locations on the envelope and are generally much lower than the pressures during the test. Therefore, airtightness measurements using these test methods cannot be interpreted as direct measurements of natural infiltration or air change rates that would occur under natural conditions. However, airtightness measurements can be used to

provide air leakage parameters for models of natural infiltration. Such models can estimate average annual ventilation rates and the associated energy costs. Test Method E741 measure natural air exchange rates using tracer gas dilution techniques.

5.1.2 *Relation to Test Method E779*—These test methods are specific adaptations of Test Method E779 to orifice blower doors. For nonorifice blower doors or for buildings too large to use blower doors, use Test Method E779.

5.1.3 *Relation to Test Method E3158*—These test methods are applicable for buildings that are configured as a single zone. For testing of multi-zone buildings, use Test Method E3158.

5.2 *Single-Point Method*—Use this method to provide air leakage estimates for assessing improvements in airtightness.

5.3 *Two-Point Method*—Use this method to provide air leakage parameters for use as inputs to natural ventilation models. The two-point method uses more complex data analysis techniques and requires more accurate measurements (Tables X1.1 and X1.2) than the single-point method. It can be used to estimate the building leakage characteristics at building pressure differences as low as 4 Pa (0.016 in. H<sub>2</sub>O). A variety of reference pressures for building envelope leaks has been used or suggested for characterizing building airtightness. These pressures include 4 Pa (0.016 in. H<sub>2</sub>O), 10 Pa (0.04 in. H<sub>2</sub>O), 30 Pa (0.12 in. H<sub>2</sub>O), and 50 Pa (0.2 in. H<sub>2</sub>O). The ASHRAE Handbook of Fundamentals uses 4 Pa.

5.4 *Depressurization versus Pressurization*—Depending on the goals of the test method, the user may choose depressurization or pressurization or both. This standard permits both depressurization and pressurization measurements to compensate for asymmetric flow in the two directions. Depressurization is appropriate for testing the building envelope tightness to include the tightness of such items as backdraft dampers that inhibit infiltration but open during a pressurization test. Combining the results of depressurization and pressurization measurements can minimize wind and stack-pressure effects on calculating airtightness but may overestimate air leakage due to backdraft dampers that open only under pressurization.

5.5 *Effects of Wind and Temperature Differences*—Calm winds and moderate temperatures during the test improve precision and bias. Pressure gradients over the envelope caused by inside-outside temperature differences and wind cause bias in the measurement by changing the building pressure differences over the test envelope from what would occur in the absence of these factors. Wind also causes pressure fluctuations that affect measurement precision and cause the data to be autocorrelated.

## 6. Apparatus

6.1 *Blower Door*—An orifice blower door (see Fig. 1).

ASTM E1827-22  
<https://standards.iteh.ai/catalog/standards/sist/808b6772-0ffc-4713-af63-2ec54e7726e2/astm-e1827-22>

6.2 *Measurement Precision and Bias*—Appendix X1 lists recommended values for the precision and bias of the measurements of airflow, pressure difference, wind speed, and temperature to obtain the precision and bias for test results described in 11.2 for the single-point method and 11.3 for the two-point method.

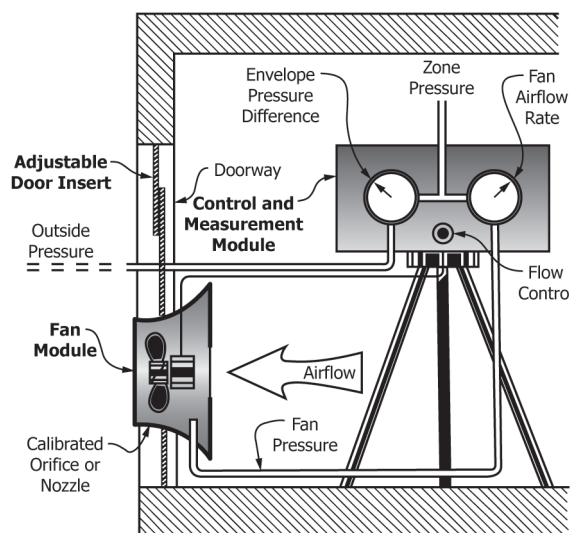


FIG. 1 Blower Door Assembly

6.2.1 *Fan with Controllable Flow*—The fan shall have sufficient capacity to generate at least a 40 Pa (0.20 in. H<sub>2</sub>O) building pressure difference in the zone tested and be controllable over a calibrated range sufficient to generate the building pressure differences required by this standard.

NOTE 5—For testing most single family houses, a range of airflows from 0.1 m<sup>3</sup>/s to 3 m<sup>3</sup>/s (200 ft<sup>3</sup>/min to 6000 ft<sup>3</sup>/min) is usually adequate.

6.2.2 *Airflow Measurement*—The procedure for calibrating the airflow measurement device shall be provided with the instrument together with estimates of the precision and bias of the instrument. The air density ( $\rho_{cal}$ ) for which any calibration equations or tables were calculated shall be reported. If the instrument automatically compensates for changes in air density, the instructions shall note this fact.

6.2.3 *Pressure Measurement*—The procedure for calibrating the pressure measurement device shall be provided with the instrument together with estimates of the precision and bias of the instrument.

6.3 *Wind Speed Measurement* (two-point method only)—A device to measure the site wind speed.

6.4 *Air Temperature Measurement*—A thermometer or electronic sensor with readout.

6.5 *Barometer* (optional)—A device to measure the site barometric pressure.

6.6 *Data Acquisition* (optional)—Automated data acquisition equipment to record (in machine readable form) data on airflow and building pressure differences within 10 s of each other and (optionally) temperature, wind speed, and barometric pressure.

6.7 *Pressure and Flow Measurement System* (two-point method only)—The flow and pressure measurement system shall measure flow and pressure differentials within 20 s of each other.

6.8 *Wind Pressure Averaging System* (optional)—A system to reduce the effect of pressure variations from static probes outside the building envelope and of pressure fluctuations over time. It shall have a manifold that accepts multiple tubes of equal lengths sufficient to reach representative surfaces of the building.

## 7. Hazards

ASTM E1827-22

<https://standards.iteh.ai/catalog/standards/sist/808b6772-0ffc-4713-af63-2ec54e7726e2/astm-e1827-22>

7.1 *Eye Protection*—Glass should not break at the building pressure differences normally applied to the test structure. However, for added safety, adequate precautions such as the use of eye protection should be taken to protect the personnel.

7.2 *Safety Clothing*—Use safety equipment required for general field work, including safety shoes and hard hats.

7.3 *Equipment Guards*—The air-moving equipment shall have a proper guard or cage to house the fan or blower and to prevent accidental access to any moving parts of the equipment.

7.4 *Noise Protection*—Make hearing protection available for personnel who must be close to the noise that may be generated by the fan.

7.5 *Debris and Fumes*—The blower or fan forces a large volume of air into or out of a building while operating. Exercise care not to damage plants, pets, occupants, or internal furnishings due to influx of cold or warm air. Exercise similar cautions against sucking debris or exhaust gases from fireplaces and flues into the interior of the building. Active combustion devices require a properly trained technician to shut them off or to determine the safety of conducting the test.

## 8. Procedure

8.1 *Establish Test Objectives*—Determine the configuration of the building envelope to be tested. The most common objectives are to evaluate the effect of construction quality on leaks in the building envelope (hereafter called closed) or to assess the envelope's impact on natural air change rates (hereafter called occupied). Choose the envelope condition appropriate to the objective.

8.1.1 *Residential Construction*—Use **Table 1** to determine the recommended test envelope conditions for residential construction.

8.1.1.1 *Closed*—Close all operable openings and seal other intentional openings to evaluate envelope airtightness without including intentional openings.

8.1.1.2 *Occupied* (default)—Leave all operable openings in the conditions typical of occupancy to assess the envelope’s effect on natural air change rates. This shall be the default option if no compelling reason exists to choose **8.1.1.1**.

8.2 *Ancillary Measurements:*

8.2.1 *Environmental Measurements*—Measure and record the wind speed 2 m (6 ft) above the ground and 10 m (30 ft) upwind from the building, when practical, outside temperature, and inside temperature at the beginning of each fan pressurization test. Circle or otherwise emphasize the readings if wind speed is greater than 2 m/s (4 mph) or outside temperature is outside the bounds of 55 °C to 35 °C (~~41~~41 °F to 95 °F).

8.2.2 *Determine Site Altitude*—Determine the altitude of the measurement site, *Alt* in meters or feet, above mean sea level within 100 m (3 × 10<sup>2</sup> ft).

8.3 *Building Preparation:*

8.3.1 *Establish Test Zone Envelope*—Define the test zone envelope appropriate for the goals of the test. Open all doors, windows, and other openings that connect portions of the building outside the test zone envelope with the outdoors.

NOTE 6—For example, if the first floor is to be the lower boundary of the test zone envelope, open basement doors and windows. If the floor and the basement are part of the test zone envelope, close those doors and windows.

8.3.2 *Establish Test Zone*—All interior building doors in the test zone shall be open to create a uniform inside pressure. If door-sized openings are not present within the test zone, perform measurements to confirm that the single-zone criterion referred to in **3.2.11** has been met.

8.3.3 *Building Components*—To follow the recommended preparation of a residential building, choose the column in **Table 1** appropriate for the purpose of the test. Adjust all building components in accordance with the appropriate entry in **Table 1**.

<https://standards.iteh.ai/catalog/standards/sist/808b6772-0f1c-4713-af63-2ec54e7726e2/astm-e1827-22>

**TABLE 1 Recommended Test Envelope Conditions**

Building Component	Envelope Conditions	
	Occupied (Default)	Closed
Vented combustion appliance	Off	Off
Pilot light	As found	As found
Flue to nonwood combustion appliance	Sealed	No preparation
Flues for fireplaces and wood stoves with dampers	Closed	Closed
Flues for fireplaces and wood stoves without dampers	Ashes removed	Ashes removed
Fireplace and wood stove doors and air inlet dampers	Closed	Closed
Fireplace without firebox doors	No preparation	No preparation
Furnace room door for furnace outside test zone	Closed	Closed
Combustion air intake damper for wood stove or fireplace	Closed	Closed
Make up air intake damper for furnace inside test zone	Sealed	Closed
Make up air intake for furnace inside test zone without damper	Sealed	No preparation
Exhaust and supply fans	Off	Off
Fan inlet grills with motorized damper	Closed	Closed
Fan inlet grills without motorized damper	Sealed	No preparation
Ventilators designed for continuous use	Sealed	Sealed
Supply and exhaust ventilator dampers	Sealed	Held closed
Clothes dryer	Off	Off
Clothes dryer vent	No preparation	No preparation
Ventilation to other zones	Sealed	Sealed
Windows and exterior doors	Latched	Latched
Window air conditioners	Sealed	No preparation
Openings leading to outside the test zone	Closed	Closed
Openings within the test zone	Open	Open
Floor drains and plumbing traps	Filled	Filled

#### 8.4 Blower Door Measurements:

8.4.1 *Installation*—Install the blower door in an entry with minimal obstructions of airflow to and from the rest of the building. Orient the blower door appropriately for depressurization or pressurization as required.

8.4.2 *Zero the Pressure Sensor*—Connect the inside-outside pressure sensor ports together and zero the pressure difference sensor. Reconnect the inside-outside pressure sensor to measure the pressure difference across the envelope.

NOTE 7—Some blower doors may perform this or an equivalent step automatically. Follow the manufacturer's instructions accordingly. When mechanical pressure gauges are used, obtaining a reproducible gauge zero may require running the gauges over their full scale several times until a reproducible zero can be demonstrated. The gauges should return to within 1 Pa (0.004 in. H<sub>2</sub>O) of zero after a measurement.

8.4.3 *Primary Pressure Station*—The target primary station for induced building pressure difference shall be  $P_1 = 50$  Pa (0.20 in. H<sub>2</sub>O). A minimum of five replicate measurements of pressure and airflow at the primary pressure station are required. For the single-point method, only primary-station pressures are required. If 50 Pa is not achieved, use the highest sustainable pressure obtained.

8.4.4 *Secondary Pressure Station (two-point method)*—When using the two-point method, the secondary target pressure station shall be  $P_2 = 12.5$  Pa (0.05 in. H<sub>2</sub>O). A minimum of five replicate measurements of pressure and airflow at the secondary pressure station are required. In all cases  $P_2$  shall be less than or equal to one third of  $P_1$  ( $P_1 \geq 3 P_2$ ).

8.4.5 *Determining the Zero-Flow Pressure Difference*—Before and after each measurement at a pressure station, seal the fan opening in the blower door. Measure and record the inside-outside pressure differential at zero airflow in Pa (in. H<sub>2</sub>O).

8.4.6 *Pressure and Flow Measurements*—For each replicate measurement, measure and record the airflow rate in cubic metres per second (cubic feet per minute). Record the measured value for pressure each time in Pa (in. H<sub>2</sub>O). Pressure and flow measurements must occur within 20 s of each other.

8.4.7 *Pressurization and Depressurization*—When performing both pressurization and depressurization measurements, record the pressurization and depressurization data separately and perform separate calculations.

### 9. Data Analysis and Calculations

ASTM E1827-22

<https://standards.iteh.ai/catalog/standards/sist/808b6772-0f1c-4713-af63-2ec54e7726e2/astm-e1827-22>

#### 9.1 Station Pressure Calculation:

9.1.1 *Test Station Pressure*—Calculate the station pressure for each replicate measurement, using Eq 1:

$$P_{sta} = P_{test} - \left( \frac{P_{zero1} + P_{zero2}}{2} \right) \quad (1)$$

where:

$P_{sta}$  = station pressure, Pa (in. H<sub>2</sub>O),

$P_{test}$  = test pressure, Pa (in. H<sub>2</sub>O),

$P_{zero1}$  = zero-airflow pressure before replicate measurement, Pa (in. H<sub>2</sub>O), and

$P_{zero2}$  = zero-airflow pressure after replicate measurement, Pa (in. H<sub>2</sub>O).

9.1.2 *Station Pressure Averages*—For all replicates at a station pressure, calculate the average  $P_{sta}$ ,  $P_{sta}^-$ , and standard deviation of the values of  $P_{sta}$ .

#### 9.2 Flow Calculation:

9.2.1 *Calculate Air Densities*—Use Eq 2 to calculate inside air density or Eq 3 to calculate outside air density. Use Eq A4.1 and A4.2 for inch-pound units.

$$\rho_m = 1.2041 \left( \frac{1 - 0.0065 \cdot Alt}{293} \right)^{5.2553} \left( \frac{293}{T_m + 273} \right) \quad (2)$$



$$\rho_{out} = 1.2041 \left( \frac{1 - 0.0065 \cdot Alt}{293} \right)^{5.2553} \left( \frac{293}{T_{out} + 273} \right) \quad (3)$$

where:

$Alt$  = altitude at site, m,  
 $\rho$  = air density, kg/m<sup>3</sup>, and  
 $T$  = temperature, °C.

NOTE 8—The standard conditions used in calculations in this standard are 20 °C (68 °F) for temperature, 1.2041 kg/m<sup>3</sup> (0.07517 lbf/ft<sup>3</sup>) for air density, and mean sea level for altitude.

9.2.2 *Calculate Dynamic Viscosities*—Calculate the dynamic viscosities for inside ( $\mu_{in} = \mu$ , when  $T = T_{in}$ ) and outside ( $\mu_{out} = \mu$ , when  $T = T_{out}$ ) air at the site using [Eq A5.1](#) or [Eq A5.2](#).

9.2.3 *Nominal Airflow Rate*—Use the manufacturer’s calibration coefficient values to convert all measurements to nominal airflow,  $Q_{nom}$ . Include raw data for flow calculations in the test report.

9.2.4 *Fan Airflow Rate*—Calculate fan airflow rate for depressurization if the apparatus does not provide an automatic calculation. Use [Eq 4](#) for depressurization or [Eq 5](#) for pressurization, as follows:

$$Q_{fan} = Q_{nom} \left( \frac{\rho_{cal}}{\rho_{in}} \right)^{0.5} \quad (4)$$

$$Q_{fan} = Q_{nom} \left( \frac{\rho_{cal}}{\rho_{out}} \right)^{0.5} \quad (5)$$

where:

$Q_{fan}$  = the fan airflow rate, m<sup>3</sup>/s (ft<sup>3</sup>/min),  
 $Q_{nom}$  = the fan airflow rate uncorrected for air density and dynamic viscosity, m<sup>3</sup>/s (ft<sup>3</sup>/min), and  
 $\rho_{cal}$  = air density at which the calibration values are valid, kg/m<sup>3</sup> (lbf/ft<sup>3</sup>).

9.2.5 *Calculate Air Leakage Rate*—Convert all the fan airflow rates to air leakage rates, the air leakage passing through the test zone envelope. Use [Eq 6](#) for depressurization and [Eq 7](#) for pressurization:

$$Q_{env} = Q_{fan} \left( \frac{\rho_{in}}{\rho_{out}} \right) \quad (6)$$

$$Q_{env} = Q_{fan} \left( \frac{\rho_{out}}{\rho_{in}} \right) \quad (7)$$

where:

$Q_{env}$  = the air leakage rate, m<sup>3</sup>/s (ft<sup>3</sup>/min).

### 9.3 Single-Point Method:

9.3.1 *Air Leakage at 50 Pa (0.2 in. H<sub>2</sub>O)*—Calculate the average of the values of  $Q_{env}$ ,  $Q_{env}^-$ , and the standard deviation of the values of  $Q_{env}$ . Estimate the standard air leakage rate at 50 Pa (0.2 in. H<sub>2</sub>O) using [Eq 8](#) for depressurization and [Eq 9](#) for pressurization. For inch-pound units, use [Eq A4.3](#) or [Eq A4.4](#).

$$Q_{50} = Q_{env1} \left( \frac{50 \text{ Pa}}{P_1} \right)^{0.65} \left( \frac{\rho_{out}}{1.2041} \right)^{0.35} \left( \frac{\mu_{out}}{0.00001813} \right)^{0.3} \quad (8)$$

$$Q_{50} = Q_{env1} \left( \frac{50 \text{ Pa}}{P_1} \right)^{0.65} \left( \frac{\rho_{in}}{1.2041} \right)^{0.35} \left( \frac{\mu_{in}}{0.00001813} \right)^{0.3} \quad (9)$$

where:

$P_1$  = average pressure,  $P_{star}^-$ , at the primary pressure station, Pa, and  
 $Q_{env1}$  = average air leakage rate,  $Q_{env}^-$ , at the primary pressure station, m<sup>3</sup>/s.

9.3.2  $ACH_{50}$ —As an option, calculate  $ACH_{50}$  using Eq 10. For inch-pound units, use Eq A4.5.

$$ACH_{50} = \left( \frac{3600 \cdot Q_{50}}{V_{zone}} \right) \quad (10)$$

where:

$V_{zone}$  = volume of the test zone, m<sup>3</sup>.

9.3.3 *Calculation of Uncertainty*—Calculate the uncertainty of  $Q_{env}^-$  using A3.2. As an option, calculate the uncertainty of  $ACH_{50}$  using A3.2.

9.4 *Two-Point Method*:

9.4.1 *Calculation of Flow Exponent, Flow Coefficient, and Effective Leakage Area*—Calculate the average and standard deviation of  $Q_{env1}$ ,  $Q_{env2}$ ,  $P_1$ , and  $P_2$  at the primary and secondary pressure stations,

where:

$Q_{env1}$  = average air leakage rate,  $Q_{env}^-$ , at the primary pressure station, m<sup>3</sup>/s (ft<sup>3</sup>/min),  
 $Q_{env2}$  = average air leakage rate,  $Q_{env}^-$ , at the secondary pressure station, m<sup>3</sup>/s (ft<sup>3</sup>/min),  
 $P_1$  = average primary station pressure, Pa (in. H<sub>2</sub>O), and  
 $P_2$  = average secondary station pressure, Pa (in. H<sub>2</sub>O).

9.4.1.1 *Power Law*—The envelope leakage is assumed to follow a power law equation that relates the blower-door induced building pressure difference to the air leakage rate (Eq A4.6 in inch-pound units):

$$Q_{env}(P, \rho, \mu) = C \cdot P^n \left( \frac{1.2041}{\rho} \right)^{1-n} \left( \frac{0.00001813}{\mu} \right)^{2n-1} \quad (11)$$

where:

$C$  = flow coefficient, m<sup>3</sup>/s (Pa) <sup>$n$</sup> ,

$n$  = flow exponent (dimensionless), and

$P$  = blower-door induced building pressure difference, Pa.

Once  $C$  and  $n$  have been determined, subject to precision and accuracy constraints, use Eq 11 to determine what the test zone envelope airflow would be for any uniform building pressure difference, air density, and air temperature.

9.4.1.2 *Flow Exponent*—Estimate the flow exponent,  $n$ , derived from the power law equation:

$$n = \frac{\ln\left(\frac{Q_{env1}}{Q_{env2}}\right)}{\ln\left(\frac{P_1}{P_2}\right)} \quad (12)$$

9.4.1.3 *Flow Coefficient*—To estimate effective leakage area at the site elevation, calculate the flow coefficient  $C$  using Eq 13 for depressurization and Eq 14 for pressurization derived from the power law and the estimated value of  $n$ :

$$C = \frac{Q_{env1}}{(P_1)^n} \left( \frac{P_{out}}{1.2041} \right)^{1-n} \left( \frac{\mu_{out}}{0.00001813} \right)^{2n-1} \quad (13)$$

$$C = \frac{Q_{env1}}{(P_1)^n} \left( \frac{P_{in}}{1.2041} \right)^{1-n} \left( \frac{\mu_{in}}{0.00001813} \right)^{2n-1} \quad (14)$$

9.4.1.4 *Effective Leakage Area*—To estimate the effective leakage area in SI units at standard conditions, use  $C$ , the exponent,  $n$ , and the standard air density,  $\rho_e = 1.204097$  kg/m<sup>3</sup> in Eq 15 to calculate  $L$ . Choose a reference pressure,  $P_{ref}$ , as required:

$$L = C \cdot P_{ref}^{(n-0.5)} \cdot (\rho_e/2)^{0.5} \quad (15)$$

where:

$L$  = effective leakage area, m<sup>2</sup>.

(Use Eq A4.9 for inch-pound units. If both depressurization and pressurization tests were performed, calculate and report an  $L$  separately for each.)

NOTE 9—Effective leakage area,  $L$ , in this standard differs from a similar measure of airtightness,<sup>5</sup> the equivalent leakage area,  $ELA$ , at the same reference pressure by several factors, including differing corrections for a discharge coefficient and dynamic viscosity.

9.4.1.5 Average the effective leakage areas computed by pressurization and depressurization if both types of pressurization were performed.

9.4.2 *Calculation of Uncertainty*—Calculate the uncertainty of  $Q, L, n$ , and  $C$  using A3.3.

## 10. Report

10.1 Report the following information:

10.2 *Building Description:*

10.2.1 *Location*—Street, city, state or province, zip or postal code, country.

10.2.1.1 *Elevation*—Above mean sea level in ~~m (ft)~~; meters (feet).

10.2.2 *Construction:*

10.2.2.1 Date built (estimate if unknown),

10.2.2.2 Floor areas for conditioned space, attic, basement, and crawl space,

10.2.2.3 Surface area of the building envelope, and

10.2.2.4 Volumes for conditioned spaces, attic, basement, and crawl space.

10.2.3 *Condition of Openings in Building Envelope:*

10.2.3.1 Type of test selected in 8.1.18-1.3,<sup>2</sup> closed or occupied,

10.2.3.2 Condition of all building elements described in Table 1, and

10.2.3.3 Statement whether the test zone was interconnected with at least a door-sized opening; if not, the results of pressure measurements between portions of the zone.

10.2.4 *HVAC System:*

10.2.4.1 Location and sizes of ducts that penetrate the test zone envelope.

10.3 *Procedure:*

10.3.1 Technique employed, single-point or two-point, depressurization or pressurization, or both,

10.3.2 Test equipment used, manufacturer, model, serial number,

10.3.3 Calibration date of fan pressurization device, and

<sup>5</sup> CGSB, “Determination of the Airtightness of Building Envelopes by the Fan Depressurization Method,” National Standard of Canada, CAN/CGSB-149.10-M86, Canadian General Standards Board, Ottawa, 1986.