



Designation: D5635/D5635M – 18 (Reapproved 2022)

# Standard Test Method for Dynamic Puncture Resistance of Roofing Membrane Specimens<sup>1</sup>

This standard is issued under the fixed designation D5635/D5635M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This test method covers the evaluation of the dynamic puncture energy that roofing membrane specimens can withstand, without allowing the passage of water, when subjected to impact from a rigid object having a sharp edge.

1.2 This laboratory test can be conducted at any desired temperature using membrane specimens manufactured in a factory or prepared in a laboratory.

1.3 Roof membrane specimens to which the test method is applicable include bituminous built-up, polymer-modified bitumens, vulcanized rubbers, non-vulcanized polymeric, and thermoplastic materials.

1.3.1 The applicability of this test method to these membrane specimens includes their use in vegetative roof systems.

1.4 This test method is not applicable to aggregate-surfaced membrane specimens; however, it is applicable to specimens having factory-applied granules.

1.5 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the standard.

1.6 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.7 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee D08 on Roofing and Waterproofing and is the direct responsibility of Subcommittee D08.20 on Roofing Membrane Systems.

Current edition approved Nov. 1, 2022. Published November 2022. Originally approved in 1994. Last previous edition approved in 2018 as D5635/D5635M – 18. DOI: 10.1520/D5635\_D5635M-18R22.

## 2. Referenced Documents

2.1 *ASTM Standards*:<sup>2</sup>

C578 Specification for Rigid, Cellular Polystyrene Thermal Insulation

D1079 Terminology Relating to Roofing and Waterproofing

## 3. Terminology

3.1 *Definitions*:

3.1.1 For definitions of terms used in this test method, refer to Terminology D1079.

## 4. Summary of Test Method

4.1 The roofing membrane test specimen, set on a thermal insulation substrate, is subjected to a predetermined dynamic impact energy created by a rigid falling puncture head. The head falls through a quarter-circle trajectory from a vertical position to horizontal position under gravitational acceleration.

4.2 The predetermined dynamic puncture energy is selected as follows:

4.2.1 In accordance with a performance requirement given in a standard specification in which this test method is cited, or

4.2.2 Through agreement between the party requesting the test and the testing laboratory.

4.3 Puncture of the test specimen is assessed by visual examination and, if necessary, verified by conducting a watertightness test.

## 5. Significance and Use

5.1 An important factor affecting the performance of membrane roofing systems is their ability to resist dynamic puncture impacts. This test method provides a means to assess dynamic puncture resistance.

5.2 This test method can be used to compare the dynamic puncture resistance of a single type of membrane as a function of a variety of insulation substrates or, conversely, to compare

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

the resistance of a number of membrane specimens set on a single type of insulation.

5.3 The effect of temperature on puncture resistance can be studied by conducting the test under controlled conditions using such equipment as an environmental chamber, oven, or freezer.

5.4 The test method can be useful in developing performance criteria for membrane roofing systems.

5.5 The test method can be useful in developing classifications of dynamic puncture resistance of membrane roofing systems.

5.6 While it is considered that the results obtained by this laboratory test can afford a measure of the dynamic puncture resistance of membrane roofing systems in the field (provided that service loads and temperature conditions are known), no direct correlation has yet been established.

5.7 This test method can be useful for evaluating the dynamic puncture resistance of membranes used in vegetative roof systems.

**6. Apparatus**

6.1 *Dynamic Puncture Device*—The dynamic puncture device consists primarily of a heavy base, a falling arm, and puncture head (see Fig. 1).

6.1.1 The falling arm is attached to the base so that it can rotate freely (for example, using ball bearings) from a vertical to horizontal position. The length of the arm is sufficiently long so that the puncture head can be secured to it at a distance that is 0.51 m [1.67 ft] ±0.5 % from the point of rotation at the base.

6.1.2 The shape and dimensions of a typical puncture head are given in Fig. 2. When mounted on the arm, the face of the puncture head is parallel to axis of rotation. Several heads of different masses may be needed. Alternatively, a means for adding weights to a given puncture head to increase its mass can be used. The head and additional weights shall constitute a continuous series of masses from 1 to 10 kg [2.2 to 22 lb] in

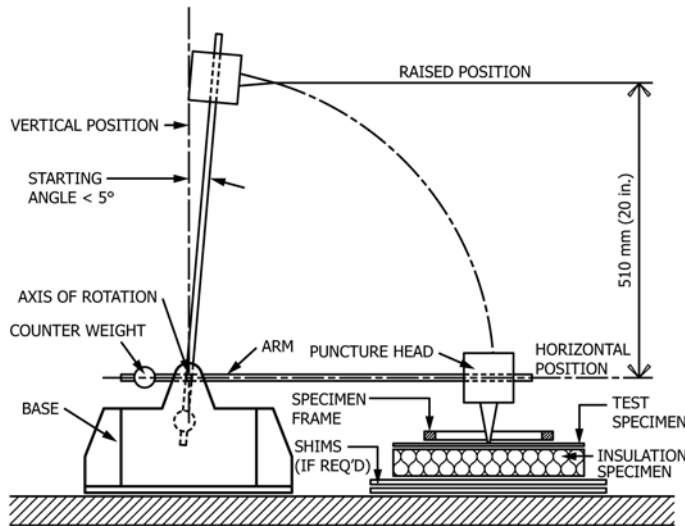


FIG. 1 Schematic of the Dynamic Puncture Device

0.5 kg [1.1 lb] increments. The mass of the puncture head shall be within ±0.5 % of that selected.

NOTE 1—It is suggested that the puncture head be fabricated from 1018 mild steel to minimize risk of damage during its use. No matter the metal from which the puncture head is made, users of the test device should periodically examine the puncture head to check that damage has not occurred during use.

6.1.3 A counterweight, equivalent to the mass of the falling arm, is placed on the arm on the side of the axis of rotation opposite to that holding the puncture head. The presence of the counterweight eliminates the need to include the mass of the arm in the determination of the puncture energy. Alternatively, if a counterweight is not used, then the mass of the arm shall be included in the determination of the impact energy.

6.1.4 The device shall incorporate a mechanism that allows the puncture head to be kept stationary in an upright position, forming an angle from the vertical not exceeding 5°. This mechanism shall allow release of the arm so that it falls freely without any additional motion imposed.

NOTE 2—A vacuum release mechanism has been found suitable for this purpose.

6.1.5 The base of the device, supporting the arm and puncture head, is placed on a horizontal surface that is sufficiently stable. This surface shall not shake, vibrate, or otherwise move when the test is conducted at maximum impact energy. The arm and puncture head of the dynamic puncture device shall be horizontal when the puncture head contacts the horizontal surface of the test specimen (see Fig. 1). Heavy rigid shims having length and width dimensions larger than those of the test specimen and substrate may be used.

6.2 *Specimen Frame*—A frame, having minimum exterior and interior dimensions of 250 by 250 mm [9.8 by 9.8 in.] and 200 by 200 mm [7.9 by 7.9 in.], respectively, and a minimum mass of 2.5 kg [5.5 lb] is used to hold the test specimen in place on the insulation substrate during the test. Adhere medium abrasive, 60 grit sandpaper to the bottom surface of the specimen frame.

NOTE 3—The bottom surface of the frame is that surface which sets on the specimen. The use of sandpaper assists in securing the specimen during test. Double-sided adhesive tape has been found suitable for adhering the sandpaper to metal frames. The sandpaper is replaced with new pieces when it no longer assists in securing the specimen during test.

6.2.1 It is not prohibited to use clamping for holding the test specimen in place on the insulation substrate and for inhibiting the test specimen from slipping under the specimen frame during impact (Note 4).


NOTE 4—Nonreinforced rubber membrane materials have been found to be prone to such slipping when clamping is not used.

**7. Sampling and Sample Preparation**

7.1 *Single-Ply Samples*—Cut the test specimens directly from the sheet membrane material in accordance with 8.1.

7.2 *Multi-Ply Samples Prepared in the Laboratory:*

7.2.1 Condition all components at 23 ± 2 °C [74 ± 3 °F] and 50 ± 5 % relative humidity for 24 ± 0.25 h prior to constructing the membrane sample.

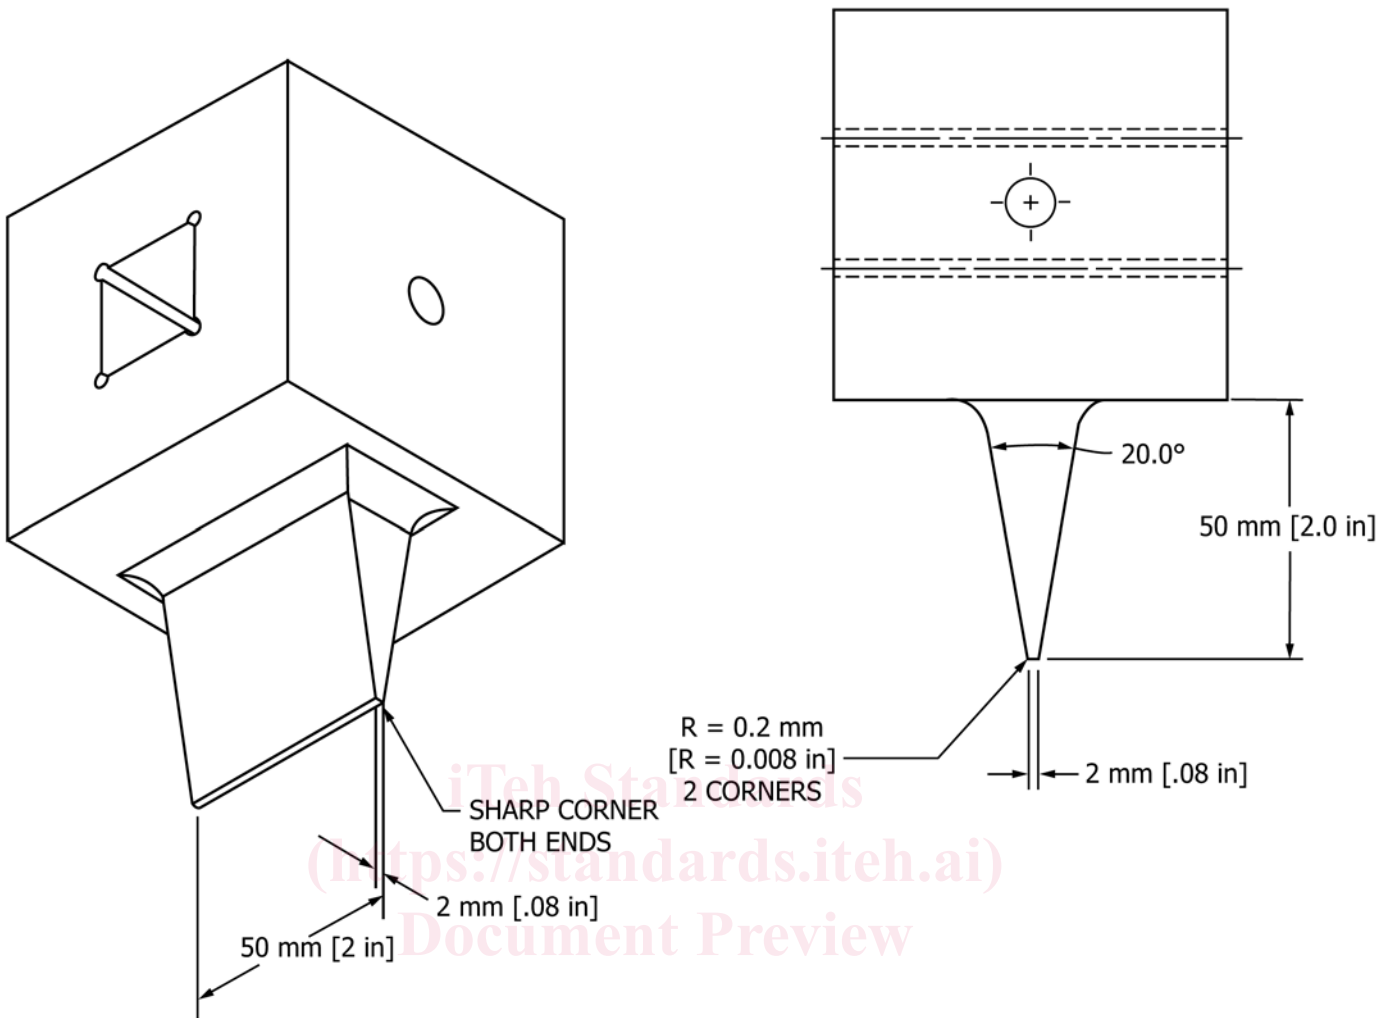

NOTE 1—Dimensions are in millimetres.

ASTM D5635/D5635M-18(2022)

FIG. 2 Shape and Dimensions of Puncture Head

7.2.2 Prepare the multi-ply membrane samples at least 0.90 by 1.20 m [3 by 4 ft] in accordance with the membrane manufacturer's instructions or by using other preparation methods at the discretion of the test laboratory. The method of preparation shall be described in the report of the test. The quantity of material in each layer of the membrane sample shall be within 10 % of that specified, and the entire sample shall be within 5 %. Cut the test specimens directly from this larger membrane sample, in accordance with 8.1.

## 8. Test Specimens

8.1 *Dimensions*—The dimensions of the membrane test specimens and insulation substrates are 250 by 250 mm [9.8 by 9.8 in.]. Cut the test specimens and substrates to size using a metal template having these dimensions.

8.2 *Number of Specimens*—A minimum of three test specimens is necessary to conduct the test.

8.3 *Type of Membrane Specimen Substrate*—The use of any roof insulation as a membrane specimen substrate is allowable. The membrane substrate shall be expanded polystyrene board

conforming to Specification C578, Type IX, and having a thickness of 38 mm [1.5 in.]  $\pm 15\%$  unless otherwise specified. Whatever insulation is used, the sections used as the specimen substrate throughout the test shall be taken from the same manufactured lot.

## 9. Conditioning and Test Temperature Selection

9.1 Condition the apparatus and all specimens at the selected test temperature  $\pm 2\text{ }^\circ\text{C}$  [ $\pm 3\text{ }^\circ\text{F}$ ] for a minimum of 8 h prior to testing.

9.2 It is not prohibited to conduct tests across a range of cold, room, and elevated temperatures. Unless otherwise specified, the test shall be conducted at  $23\text{ }^\circ\text{C}$  [ $74\text{ }^\circ\text{F}$ ].

9.2.1 The selected temperature shall be maintained at  $\pm 2\text{ }^\circ\text{C}$  [ $\pm 3\text{ }^\circ\text{F}$ ] throughout the test.

## 10. Procedure

10.1 *Impact Energy*—Conduct the dynamic puncture test at an impact energy (see X1.2) that is selected as follows: