



Designation: C634 – 22

Standard Terminology Relating to Building and Environmental Acoustics¹

This standard is issued under the fixed designation C634; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

INTRODUCTION

In some of the entries, those that are measures of physical quantities, the term is followed by several items: an abbreviation or a symbol, or both, the dimensions of quantities, the measurement units, and the part of speech. The abbreviation, where applicable, indicates the term as typically referenced. The symbol stands for the magnitude of the quantity in mathematical expressions. The dimensions of a quantity express its measure in terms of three fundamental quantities: M for mass, L for length, and T for time. Speed, for instance, is the quotient obtained when the distance an object moves is divided by the time involved. The dimensions are $[LT^{-1}]$, the negative exponent indicating division. The measurement units are consistently in SI, Le Système International d'Unités. Those still using the cgs (centimetre-gram-second) or the inchpound system of units are referred for most of the conversion factors to [IEEE/ ASTM SI 10](#). Some conversion factors are listed in Section 6 of this document for convenient reference.

The dimensions of a quantity are the same regardless of the units in which the quantity is measured. Speed has the dimensions $[LT^{-1}]$ whether it is measured in miles per hour, feet per second, or metres per second. Quantities with different dimensions are not the same. Flow resistance and specific flow resistance, for instance, are quantities of different kinds even though the names are similar. On the other hand, quantities with the same dimensions are not necessarily of the same kind. Sound energy density, for instance, has the same dimensions as sound pressure, $[ML^{-1}T^{-2}]$, but it is not a kind of sound pressure. Nor is absorption with the dimensions $[L^2]$ a kind of area.

1. Scope

1.1 This terminology covers terms, related definitions, and descriptions of terms used or likely to be used in building and environmental acoustics standards. Definitions of terms are special-purpose definitions that are consistent with the standard definitions but are written to ensure that a specific building and environmental acoustics standard is properly understood and precisely interpreted. The primary focus of this document is upon terms, definitions and descriptions found within standards under the jurisdiction of ASTM Committee E33; however, terms, definitions and descriptions that are of general interest to the field of acoustics are also included.

1.2 This building and environmental acoustics standard cannot be used to provide quantitative measures.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the*

responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 ASTM Standards:²

[C367/C367M Test Methods for Strength Properties of Prefabricated Architectural Acoustical Tile or Lay-In Ceiling Panels](#)

[C384 Test Method for Impedance and Absorption of Acoustical Materials by Impedance Tube Method](#)

[C423 Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method](#)

¹ This terminology is under the jurisdiction of ASTM Committee E33 on Building and Environmental Acoustics and is the direct responsibility of Subcommittee E33.07 on Definitions and Editorial.

Current edition approved Oct. 1, 2022. Published February 2023. Originally approved in 1969. Last previous edition approved in 2021 as C634 – 13 (2021). DOI: 10.1520/C0634-22.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

- C522** Test Method for Airflow Resistance of Acoustical Materials
- C635/C635M** Specification for Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings
- C636/C636M** Practice for Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-In Panels
- E90** Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements
- E336** Test Method for Measurement of Airborne Sound Attenuation between Rooms in Buildings
- E413** Classification for Rating Sound Insulation
- E477** Test Method for Laboratory Measurements of Acoustical and Airflow Performance of Duct Liner Materials and Prefabricated Silencers
- E492** Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine
- E557** Guide for Architectural Design and Installation Practices for Sound Isolation between Spaces Separated by Operable Partitions
- E596** Test Method for Laboratory Measurement of Noise Reduction of Sound-Isolating Enclosures
- E756** Test Method for Measuring Vibration-Damping Properties of Materials
- E795** Practices for Mounting Test Specimens During Sound Absorption Tests
- E966** Guide for Field Measurements of Airborne Sound Attenuation of Building Facades and Facade Elements
- E989** Classification for Determination of Single-Number Metrics for Impact Noise
- E1007** Test Method for Field Measurement of Tapping Machine Impact Sound Transmission Through Floor-Ceiling Assemblies and Associated Support Structures
- E1014** Guide for Measurement of Outdoor A-Weighted Sound Levels
- E1042** Classification for Acoustically Absorptive Materials Applied by Trowel or Spray
- E1050** Test Method for Impedance and Absorption of Acoustical Materials Using a Tube, Two Microphones and a Digital Frequency Analysis System
- E1110** Classification for Determination of Articulation Class
- E1111/E1111M** Test Method for Measuring the Interzone Attenuation of Open Office Components
- E1123** Practices for Mounting Test Specimens for Sound Transmission Loss Testing of Naval and Marine Ship Bulkhead Treatment Materials
- E1124** Test Method for Field Measurement of Sound Power Level by the Two-Surface Method
- E1130** Test Method for Objective Measurement of Speech Privacy in Open Plan Spaces Using Articulation Index
- E1179** Specification for Sound Sources Used for Testing Open Office Components and Systems
- E1222** Test Method for Laboratory Measurement of the Insertion Loss of Pipe Lagging Systems
- E1264** Classification for Acoustical Ceiling Products
- E1265** Test Method for Measuring Insertion Loss of Pneumatic Exhaust Silencers
- E1289** Specification for Reference Specimen for Sound Transmission Loss
- E1332** Classification for Rating Outdoor-Indoor Sound Attenuation
- E1374** Guide for Office Acoustics and Applicable ASTM Standards
- E1414/E1414M** Test Method for Airborne Sound Attenuation between Rooms Sharing a Common Ceiling Plenum
- E1503** Test Method for Conducting Outdoor Sound Measurements Using a Statistical Sound Analysis System
- E1573** Test Method for Measurement and Reporting of Masking Sound Levels Using A-Weighted and One-Third-Octave-Band Sound Pressure Levels
- E1574** Test Method for Measurement of Sound in Residential Spaces
- E1686** Guide for Applying Environmental Noise Measurement Methods and Criteria
- E1704** Guide for Specifying Acoustical Performance of Sound-Isolating Enclosures
- E1780** Guide for Measuring Outdoor Sound Received from a Nearby Fixed Source
- E2179** Test Method for Laboratory Measurement of the Effectiveness of Floor Coverings in Reducing Impact Sound Transmission Through Concrete Floors
- E2202** Practice for Measurement of Equipment-Generated Continuous Noise for Assessment of Health Hazards
- E2235** Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods
- E2249** Test Method for Laboratory Measurement of Airborne Transmission Loss of Building Partitions and Elements Using Sound Intensity
- E2459** Guide for Measurement of In-Duct Sound Pressure Levels from Large Industrial Gas Turbines and Fans
- E2611** Test Method for Normal Incidence Determination of Porous Material Acoustical Properties Based on the Transfer Matrix Method
- E2638** Test Method for Objective Measurement of the Speech Privacy Provided by a Closed Room
- E2963** Test Method for Laboratory Measurement of Acoustical Effectiveness of Ship Noise Treatments Laboratory Measurement of Acoustical Effectiveness for Marine Bulkhead and Deck Treatments
- E2964** Test Method for Measurement of the Normalized Insertion Loss of Doors
- E3090/E3090M** Test Methods for Strength Properties of Metal Ceiling Suspension Systems
- E3091** Specification for Systems to Measure Sound Levels
- E3133** Test Method for Laboratory Measurement of Floor Impact Sound Radiation Using the Tapping Machine (Withdrawn 2023)³
- E3222** Classification for Determination of High-frequency Impact Sound Ratings
- IEEE/ ASTM SI 10** Standard for Use of the International

³ The last approved version of this historical standard is referenced on www.astm.org.

System of Units (SI): The Modern Metric System

2.2 ASA/ANSI Standards:⁴

- ASA/ANSI S1.1-2013 Acoustical Terminology
- ASA/ANSI S1.4-2014, Part 1 / NAIS IEC 61672-1 Electroacoustics – Sound Level Meters – Part 1: Specifications
- ASA/ANSI S1.6-2016 Preferred Frequencies and Filter Band Center Frequencies for Acoustical Measurements
- ASA/ANSI S1.11-2014, Part 1/NAIS IEC 61260-1 Electroacoustics – Octave-Band and Fractional Octave-Band Analog and Digital Filters – Part 1: Specifications
- ANSI S1.43-1997 (R2007) Specifications For Integrating-Averaging Sound Level Meters
- ASA/ANSI S12.9-2013 Quantities And Procedures For Description And Measurement Of Environmental Sound – Part 1: Basic Quantities And Definitions

2.3 Other Standards:

- IEEE P260.4-2018 IEEE Standard for Letter Symbols and Abbreviations for Quantities Used in Acoustics
- ASME B1.20.1-2013 (R2018) Pipe Threads, General Purpose, Inch
- 2017 ASHRAE Handbook Fundamentals, Chapter 37, Measurement and Instruments
- ISO 9614-1:1993 Acoustics — Determination of Sound Power Levels of Noise Sources Using Sound Intensity — Part 1: Measurement at Discrete Points
- ISO 9614-2:1996 Acoustics — Determination of Sound Power Levels of Noise Sources Using Sound Intensity — Part 2: Measurement by Scanning
- ISO 9614-3:2002 Acoustics — Determination of Sound Power Levels of Noise Sources Using Sound Intensity — Part 3: Precision Method for Measurement by Scanning
- ISO 15186-1:2000 Acoustics — Measurement of Sound Insulation in Buildings and of Building Elements Using Sound Intensity — Part 1: Laboratory Measurements
- ISO 16283-1:2014 Acoustics — Field measurement of sound insulation in buildings and of building elements — Part 1: Airborne sound Insulation
- ISO/TR 25417:2007 Acoustics — Definitions of basic quantities and terms
- IEC 61043 Ed. 1.0 b:1993 Electroacoustics — Instruments For The Measurement Of Sound Intensity — Measurements With Pairs Of Pressure Sensing Microphones
- IEC 61094-4 (1995) Measurement Microphones Part 4: Specifications for Working Standard Microphones

3. Significance and Use

3.1 *Definitions*—Terms and related definitions given in Section 4 are intended for use uniformly and consistently in all building and environmental acoustic test standards in which they appear.

3.2 *Definitions of Terms Specific to Each Standard:*

3.2.1 As indicated in Section 4, terms and their definitions are intended to provide a precise understanding and interpretation of the building and environmental acoustic test standards in which they appear.

3.2.2 A specific definition of a given term is applicable to the standard or standards in which the term is described and used.

3.2.3 Different definitions of the same term are acceptable provided each one is consistent with and is not in conflict with the standard definition for the same term, that is, the general concept the term describes.

3.2.4 If a standard under the jurisdiction of ASTM Committee E33 specially defines a term, i.e. provides a definition different in any way from what is given in Section 4 of Terminology C634, that standard shall list the term and its description under the subheading, *Definitions of Terms Specific to This Standard*.

3.2.4.1 *Discussion*—The mandatory language of section 3.2.4 is consistent with the mandatory language from §E2 of Form and Style for ASTM Standards (April 2020) and with the ASTM Committee E33 bylaws in place when this standard was published; it reflects a situation that exists, it does not prescribe anything.

3.3 Definitions for some terms associated with building and environmental acoustic issues and not included in Terminology C634 are found in ISO/TR 25417 or IEEE P260.4. When discrepancies exist, the definition in Terminology C634 shall prevail.

4. Terminology

4.1 Terms and their standard definitions within the scope of this standard are given in Section 4 in alphabetical order. Appendix X1 contains the definitions of terms from the “Definitions of Terms Specific to This Standard” sections from all standards under the jurisdiction of ASTM Committee E33.

4.2 Discussions associated with definitions are printed directly under the appropriate definition. The date following each definition or discussion indicates the year of introduction or of latest revision of that particular definition or discussion.

4.2.1 *Discussion*—If the year of introduction or last review of the term and its definition or discussion is unknown, the year stated indicates the year the definition or discussion was brought into compliance with this paradigm.

4.3 If the exact term sought by the user cannot be found in 4.4, it is possible that the term may exist within Section 5, Compound Terms.

4.4 *Terms and their Definitions:*

acoustic impedance, $Z[ML^{-4}T^{-1}]$, (mks acoustic ohm or Pa·s/m³), n —of a surface, for a given frequency, the complex quotient obtained when the sound pressure averaged over the surface is divided by the volume velocity through the surface. The real and imaginary components are called, respectively, **acoustic resistance** and **acoustic reactance**.

$$Z = R + jX \quad (1)$$

where:

R = the real component of acoustic impedance, and
 X = the imaginary component of acoustic impedance.

(2021)

acoustical barrier, n —contiguous objects such as solid walls, buildings, or earthen berms that substantially block the direct

⁴ Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

path of sound between a source and receiver, and which, if they have an open edge or edges allowing diffraction around them, are sufficiently wide and high to cause significant reduction of the sound traveling from the source to the receiver. (2021)

acoustical material, n —any material considered in terms of its acoustical properties. *Commonly and especially*, a material designed to absorb sound. (2021)

admittance ratio, ypc [dimensionless], n —the reciprocal of the impedance ratio. The real and imaginary components are called, respectively, **conductance ratio** and **susceptance ratio**. (2021)

$$ypc \equiv gpc - j bpc \quad (2)$$

where:

gpc = the real component of admittance ratio, and
 bpc = the imaginary component of admittance ratio.
 (2021)

airborne sound, n —sound that arrives at the point of interest, such as one side of a partition, by propagation through air. (2021)

airflow resistance, R [$ML^{-4}T^{-1}$], (mks acoustic ohm or Pa·s/m³), n —the quotient of the air pressure difference across a specimen divided by the volume velocity of airflow through the specimen. The pressure difference and the volume velocity may be either steady or alternating. (2021)

airflow resistivity, r_0 [$ML^{-3}T^{-1}$], (mks rayl/m or Pa·s/m²), n —of a homogeneous material, the quotient of its specific airflow resistance divided by its thickness. (2021)

ambient noise, n —the composite of airborne sound from many sources near and far associated with a given environment. No particular sound is singled out for interest. (2021)

arithmetic mean sound pressure level, n —of several related sound pressure levels measured at different positions or different times, or both, in a specified frequency band, the sum of the sound pressure levels divided by the number of levels. (2021)

DISCUSSION—The arithmetic mean sound pressure level is sometimes used to approximate the **average sound pressure level**. The accuracy of this approximation depends upon the range of sound pressure levels. (2021)

average sound pressure level, \bar{L}_p [dimensionless], n —of several related sound pressure levels measured at different positions or different times, or both, in a specified frequency band, ten times the common logarithm of the arithmetic mean of the squared pressure ratios from which the individual levels were derived. (2021)

DISCUSSION—1—An average sound pressure level obtained by averaging the A-weighted sound level continuously over a specified period is called the **time-average sound level**. (2021)

DISCUSSION—2—Since, by definition, a squared pressure ratio, p_i^2/p_0^2 , is equal to $10^{L_i/10}$, average sound pressure level is calculated from the expression:

$$\bar{L}_p = 10 \log_{10} \left(\frac{1}{n} \sum_{i=1}^n 10^{L_i/10} \right) \quad (3)$$

where:

\bar{L}_p = average sound pressure level, dB,
 n = number of individual sound pressure levels,
 p_i = rms pressure at an individual position or time, or both, Pa,
 p_0 = 20 μPa, reference sound pressure, and
 L_i = an individual sound pressure level, dB.

If conditions warrant, an integral expression may be used:

$$\bar{L}_p = 10 \log_{10} \left(\frac{1}{T} \int_{t_1}^{t_2} (p^2(t)/p_0^2) dt \right) \quad (4)$$

where:

\bar{L}_p = average sound pressure level during a specified time interval, dB,
 T = $t_2 - t_1$ = a specified time interval, s, min, h, or day,
 $p(t)$ = instantaneous sound pressure, Pa, and
 p_0 = 20 μPa, reference sound pressure.
 (2021)

background noise, n —noise from all sources unrelated to a particular sound that is the object of interest. Background noise may include airborne, structureborne, and instrument noise. (2021)

cutoff frequency, n —of an anechoic wedge or set of wedges, the lowest frequency above which the normal incidence sound absorption coefficient is at least 0.990. (2021)

damp, v —to cause a loss or dissipation of the oscillatory or vibrational energy of an electrical or mechanical system. (2021)

decay rate, d [T^{-1}], (dB/s), n —for airborne sound, the rate of decrease of sound pressure level after the source of sound has stopped; for vibration, the rate of decrease of vibratory acceleration, velocity, or displacement level after the excitation has stopped. (2021)

decibel, dB [dimensionless], n —the term used to identify ten times the common logarithm of the ratio of two like quantities proportional to power or energy. (See **level**, **sound transmission loss**.) Thus, one decibel corresponds to a power ratio of $10^{0.1}$ and n decibels corresponds to a power ratio of $(10^{0.1})^n$. (2021)

DISCUSSION—Since the decibel expresses the ratio of two like quantities, it has no dimensions. It is, however, common practice to treat “decibel” as a unit as, for example, in the sentence, “The average sound pressure level in the room is 45 decibels.” (2021)

diffraction, n —a change in the direction of propagation of sound energy in the neighborhood of a boundary discontinuity, such as the edge of a reflective or absorptive surface. (2021)

diffuse sound field, n —the sound in a region where the sound intensity is the same in all directions and at every point. (2021)

direct sound field, n —the sound that arrives directly from a source without reflection. (2021)

dummy microphone, *n*—a microphone substitute which has electrical characteristics identical to a functional microphone, but which has essentially no sensitivity to incident sound pressure. (2021)

field sound transmission class, FSTC[*dimensionless*], *n*—sound transmission class calculated in accordance with Classification E413 using values of field transmission loss. (2021)

field transmission loss, FTL[*dimensionless*], *n*—sound transmission loss measured in accordance with Annex A1 of Test Method E336. (2021)

flanking transmission, *n*—transmission of sound from the source to a receiving location by a path other than that under consideration. (2021)

impact insulation class, IIC[*dimensionless*], *n*—a single-number rating derived from measured values of normalized impact sound pressure levels in accordance with Annex A1 of Test Method E492. It provides an estimate of the impact sound insulating performance of a floor-ceiling assembly. (2021)

impedance ratio, $z/\rho c$ [*dimensionless*], *n*—the ratio of the specific normal acoustic impedance at a surface to the characteristic impedance of the medium. The real and imaginary components are called, respectively, **resistance ratio** and **reactance ratio**. (2021)

$$z/\rho c = r/\rho c + jx/\rho c \quad (5)$$

where:

$r/\rho c$ = the real component of impedance ratio, and

$x/\rho c$ = the imaginary component of impedance ratio.

(2021)

impulsive sound, *n*—a brief, intrusive sound, such as that associated with a tire blowout, operation of a punch press, the discharge of a firearm, a door slam, or a shout, usually characterized by a rapid rise time in the initial pressure pulse of less than a few milliseconds, and by a decay time of less than a few seconds. (2021)

DISCUSSION—No mathematical description exists to unequivocally define the presence of impulsive sound. (2021)

insertion loss, IL[*dimensionless*], *n*—of a silencer or other sound-reducing element, in a specified frequency band, the decrease in sound power level, measured at the location of the receiver, when a sound insulator or a sound attenuator is inserted in the transmission path between the source and the receiver. (2021)

interference, *n*—any activity or event that could produce anomalous measurements. (2021)

level, L[*dimensionless*], *n*—ten times the common logarithm of the ratio of a quantity proportional to power or energy to a reference quantity of the same kind. (See **sound power level**, **sound pressure level**.) The quantity so obtained is expressed in decibels. (2021)

level reduction, LR[*dimensionless*], *n*—in a specified frequency band, the decrease in sound pressure level, measured

at the location of the receiver, when a barrier or other sound-reducing element is placed between the source and the receiver. (2021)

DISCUSSION—Level reduction is a useful measure in circumstances when measures of transmission loss, insertion loss, or noise reduction are not possible. (2021)

maximum sound level, L_{AFmax} [*dimensionless*], (dB), *n*—Ten times the common logarithm of the square of the ratio of the largest frequency-weighted and exponential-time-weighted (or otherwise time-averaged) sound pressure during the measurement period to the square of the reference-sound-pressure of 20 μ Pa. The subscripts designate the frequency weighting (A or C), and time the weighting or averaging (F for fast, S for slow, I for impulse, or a number with proper units to indicate time interval). (2021)

DISCUSSION—The time weighting or averaging time must be specified. The frequency weighting should be specified; otherwise, A-weighting will be understood. (2021)

measurement plan, *n*—a document formally describing the specific steps to be taken during a measurement, including any unique requirements. (2021)

measurement set, *n*—the set of acoustical measurements and related data obtained at a single measurement location during a specified time interval. (2021)

DISCUSSION—The specified time interval may include brief documented periods during which data recording or analysis are paused for the purpose of eliminating the effects of interference. (2021)

metric sabin, [L^2], *n*—the unit of measure of sound absorption in the metre-kilogram-second system of units. (2021)

noise isolation class, NIC[*dimensionless*], *n*—a single-number rating calculated in accordance with Classification E413 using measured values of noise reduction. It provides an estimate of the sound isolation between two enclosed spaces that are acoustically connected by one or more paths. (2021)

noise reduction, NR[*dimensionless*], *n*—the difference between the average sound pressure levels either at two well defined locations based on existing conditions, or at a single location before and after some mitigation measure is implemented. (2021)

DISCUSSION—Specific standards may use a more restrictive definition related to the difference either between two locations or before and after a mitigation measure, and some standards may require the noise reduction to be measured in specified frequency bands. (2021)

noise reduction coefficient, NRC[*dimensionless*], *n*—a single-number rating, the average, rounded to the nearest 0.05, of the sound absorption coefficients of a material for the four one-third octave bands at 250 Hz, 500 Hz, 1000 Hz, and 2000 Hz, inclusive, measured according to the test method described in Test Method C423. (2021)

normal incidence sound absorption coefficient, α_n [*dimensionless*], *n*—of a surface, at a specified frequency, the fraction of the perpendicularly incident sound power absorbed or otherwise not reflected. (2021)

normal mode, *n*—of a room, one of the possible ways in which the air in a room, considered as an elastic body, will vibrate

naturally when subjected to an acoustical disturbance. With each normal mode is associated a resonance frequency and, in general, a group of wave propagation directions comprising a closed path. (2021)

normalized noise isolation class, NNIC[*dimensionless*], *n*—a single-number rating calculated in accordance with Classification E413 using measured values of normalized noise reduction. (See **normalized noise reduction**.) (2021)

normalized noise reduction, NNR[*dimensionless*], *n*—between two rooms, in a specified frequency band, the value that the noise reduction in a given field test would have if the reverberation time in the receiving room were 0.5 s. NNR is calculated as follows:

$$\text{NNR} = \text{NR} + 10 \log_{10}(T/0.5) \quad (6)$$

where:

NR = noise reduction, dB and

T = reverberation time in receiving room, s.

(2021)

DISCUSSION—The normalized noise reduction is intended to approximate the noise reduction that would exist between two ordinarily furnished rooms. (2021)

octave band, *n*—a band of sound frequencies for which the highest frequency in the range is (within 2%) twice the lowest frequency. The position of the band is identified by the rounded geometric mean of the highest frequency and the lowest frequency of the band. The nominal mid-band frequencies of “preferred” octave bands as defined in ANSI S1.6 fall in the series 16, 31.5, 63, 125, 250, 500, 1000 Hz etc. (2021)

octave band sound pressure level, OBSPL or $L_{p1/f}$ where *f* indicates the nominal center frequency of a specific band if applicable[*dimensionless*], (dB), *n*—sound pressure level for sound filtered using an octave-band filter meeting the requirements of ANSI S1.11. (2021)

outdoor-indoor transmission loss, OITL[*dimensionless*], *n*—of a building facade, in a specified frequency band, ten times the common logarithm of the ratio of the airborne sound power incident on the exterior of the facade to the sound power transmitted by the facade and radiated to the interior. The quantity so obtained is expressed in decibels. (2021)

particle velocity, $u[LT^{-1}]$, (m/s), *n*—a fluctuating velocity superimposed by the presence of sound on the other velocities the particles of the medium may have. In analogy with alternating voltage its magnitude can be expressed in several ways, such as instantaneous particle velocity or peak particle velocity, but the unqualified term means root-mean-square particle velocity. In air, the other velocities are those due to thermal agitation and wind currents. (2021)

peak sound pressure level, $L_{PK}[dimensionless]$, (dB), *n*—ten times the common logarithm of the square of the ratio of the largest absolute value of the instantaneous sound pressure in a stated frequency band during a specified time interval to the reference sound pressure of 20 μPa . (2021)

percentile level, $L_x[dimensionless]$, (dB), *n*—of a time varying level, the level exceeded *x* percent of the time during the stated measurement period. (2021)

DISCUSSION—Percentile levels are affected by measurement parameters such as bandwidth, frequency weighting, time weighting, and sampling rate that must be explicitly stated. (2021)

pink noise, *n*—noise with a continuous frequency spectrum and with equal power per constant percentage bandwidth. For example, equal power in any one-third octave band. (2021)

receiving room, *n*—in architectural acoustical measurements, the room in which the sound transmitted from the source room is measured. (2021)

reverberant sound field, *n*—the sound in an enclosed or partially enclosed space that has been reflected repeatedly or continuously from the boundaries. (2021)

reverberation, *n*—the persistence of sound in an enclosed or partially enclosed space after the source of sound has stopped; by extension, in some contexts, the sound that so persists. (2021)

reverberation room, *n*—a room so designed that the reverberant sound field closely approximates a diffuse sound field, both in the steady state when the sound source is on, and during decay after the source of sound has stopped. (2021)

reverberation time, $T_{60}[T]$, (s), *n*—for airborne sound, the time it takes a reverberant sound field to decay 60 dB after the source is interrupted. (2021)

DISCUSSION—If an ambient sound field limits the ability to measure 60 dB of decay, then this time can be extrapolated from the measure of the shorter decay. (2021)

sabin, [L^2], *n*—the unit of measure of sound absorption in the inch-pound system. (2021)

self-noise, *n*—extraneous non-acoustical signals, generated or induced in a measurement system. (2021)

sound absorption, *n*—(1) the process of dissipating sound energy. (2) the property possessed by materials, objects and structures such as rooms of absorbing sound energy. (3) A , [L^2]; metric sabin—in a specified frequency band, the measure of the magnitude of the absorptive property of a material, an object, or a structure such as a room. (2021)

DISCUSSION—Sound energy passing through a wall or opening may be regarded as being absorbed in certain calculations. (2021)

sound absorption average, SAA[*dimensionless*], *n*—a single number rating, the average, rounded to the nearest 0.01, of the sound absorption coefficients of a material for the twelve one-third octave bands from 200 through 2500 Hz, inclusive, measured according to the test method described in Test Method C423. (2021)

sound absorption coefficient, $\alpha[dimensionless]$, (metric sabin/ m^2), *n*—of a surface, in a specified frequency band, the measure of the absorptive property of a material as approximated by the method of Test Method C423. Ideally, the fraction of the randomly incident sound power absorbed or otherwise not reflected. (2021)

sound attenuation, n —the reduction of sound pressure as it travels from the source to a receiving location. Sound absorption is often involved as, for instance, in a lined duct. Spherical spreading and scattering are other attenuation mechanisms. (2021)

sound energy, $E[ML^2T^{-2}]$, (J), n —energy added to an elastic medium by the presence of sound, consisting of potential energy in the form of deviations from static pressure and of kinetic energy in the form of particle velocity. (2021)

sound insulation, n —the capacity of a structure to prevent sound from reaching a receiving location. Sound energy is not necessarily absorbed; impedance mismatch, or reflection back toward the source, is often the principal mechanism. (2021)

DISCUSSION—Sound insulation is a matter of degree. No partition is a perfect insulator of sound. (2021)

sound intensity, $I[MT^{-3}]$, (W/m²), n —the quotient obtained when the average rate of energy flow in a specified direction and sense is divided by the area, perpendicular to that direction, through or toward which it flows. The intensity at a point is the limit of that quotient as the area that includes the point approaches zero. (2021)

sound isolation, n —the degree of acoustical separation between two locations, especially adjacent rooms. (2021)

DISCUSSION—This qualitative term may be used in lieu of the more quantitative term **noise reduction**. Sound isolation is achieved by using sound-insulating or sound-attenuating elements. (2021)

sound level, L_{AF} [*dimensionless*], (dB), n —of airborne sound, a sound pressure level obtained using a signal to which a standard frequency-weighting and exponential time weighting has been applied, where the subscript A designates the frequency weighting and the subscript F designates fast exponential time weighting (the A is replaced by C to designate C-weighting, and the F by either S or I to designate slow or impulse time weighting). (2021)

NOTE 1—Standard frequency-weightings designated A and C, and exponential time weightings designated fast, slow, and impulses, are defined in ANSI S1.4, Specification for Sound Level Meters.⁴

NOTE 2—The frequency-weighting and exponential time weighting must be specified unless made clear from the context.

NOTE 3—The frequency-weighting modifies the amplitude of the signal as a function of frequency to adjust for differences in perception of sound at different frequencies.

NOTE 4—In symbols, A-weighted sound level L_{AF} , at running time, t , is

$$L_{AF}(t) = 10^* \log_{10} \left\{ \frac{\frac{1}{T} \int_{-\infty}^t P_A^2(\xi) e^{-(t-\xi)/T} d\xi}{P_o^2} \right\} \quad (7)$$

where:

T = the time constant for the time averaging, s ($T = 0.125$ s for “Fast” time weighting),

ξ = a dummy variable of integration,

$P_A^2(\xi)$ = the squared, instantaneous, time varying, A-weighted sound pressure, Pa, and

P_o = the reference sound pressure of 20 μ Pa.

(2021)

sound power, $W[ML^2T^{-3}]$, (W), n —in a specified frequency band, the rate at which acoustic energy is radiated from a

source. *In general*, the rate of flow of sound energy, whether from a source, through an area, or into an absorber. (2021)

sound power level, L_W [*dimensionless*], n —of airborne sound, ten times the common logarithm of the ratio of the sound power under consideration to the standard reference power of 1 pW. The quantity so obtained is expressed in decibels. (2021)

sound pressure, $p[ML^{-1}T^{-2}]$, (Pa), n —a fluctuating pressure superimposed on the static pressure by the presence of sound. In analogy with alternating voltage its magnitude can be expressed in several ways, such as instantaneous sound pressure or peak sound pressure, but the unqualified term means root-mean-square sound pressure. In air, the static pressure is barometric pressure. (2021)

sound pressure level, L_p [*dimensionless*], n —of airborne sound, ten times the common logarithm of the ratio of the square of the sound pressure under consideration to the square of the standard reference pressure of 20 μ Pa. The quantity so obtained is expressed in decibels. (2021)

DISCUSSION—The pressures are squared because pressure squared, rather than pressure, is proportional to power or energy. (2021)

sound transmission class, STC [*dimensionless*], n —a single-number rating calculated in accordance with Classification E413 using values of sound transmission loss. It provides an estimate of the performance of a partition in certain common sound insulation problems. (2021)

sound transmission coefficient, τ [*dimensionless*], n —of a partition, in a specified frequency band, the fraction of the airborne sound power incident on the partition that is transmitted by the partition and radiated on the other side. (2021)

DISCUSSION—Unless qualified, the term denotes the value obtained when the specimen is exposed to a diffuse sound field as approximated, for example, in reverberation rooms meeting the requirements of Test Method E90. (2021)

sound transmission loss, TL [*dimensionless*], n —of a partition, in a specified frequency band, ten times the common logarithm of the ratio of the airborne sound power incident on the partition to the sound power transmitted by the partition and radiated on the other side. The quantity so obtained is expressed in decibels. (2021)

DISCUSSION—Unless qualified, the term denotes the sound transmission loss obtained when the specimen is exposed to a diffuse sound field as approximated, for example, in reverberation rooms meeting the requirements of Test Method E90. (2021)

source room, n —in architectural acoustical measurements, the room that contains the noise source or sources. (2021)

specific airflow resistance, $r[ML^{-2}T^{-1}]$, (mks rayl or Pa·s/m), n —the product of the airflow resistance of a specimen and its area. This is equivalent to the quotient of the air pressure difference across the specimen divided by the linear velocity, measured outside the specimen, of airflow through the specimen. (2021)

specific normal acoustic impedance, $z[ML^{-2}T^{-1}]$, (mks rayl or Pa·s/m), n —at a surface, the complex quotient obtained

when the sound pressure averaged over the surface is divided by the component of the particle velocity normal to the surface. The real and imaginary components of the specific normal acoustic impedance are called, respectively, **specific normal acoustic resistance** and **specific normal acoustic reactance**. (2021)

$$z \equiv r + jx \quad (8)$$

where:

r = the real component of the specific normal acoustic impedance, and

x = the imaginary component of the specific normal acoustic impedance.

(2021)

thermal insulation, n —a material or assembly of materials used primarily to provide resistance to heat flow. (2021)

time-average sound level, TAV or L_{AT} where the subscript T is the time of the interval of measurement [*dimensionless*], (dB), n —ten times the logarithm to the base ten of the ratio of mean-square instantaneous A-weighted sound pressure, during a stated time interval T, to the square of the standard reference sound pressure. (2021)

DISCUSSION— Time-average sound level is also termed equivalent sound level or equivalent continuous sound level with corresponding abbreviation LEQ and symbol L_{AeqT} . (2021)

tonal, *adj*—in reference to audible sound, capable of exciting an auditory sensation having pitch. (2021)

unit, n —*measurement*, a precisely specified quantity in terms of which the magnitudes of other quantities of the same kind can be stated. (2021)

vibration isolation, n —a reduction, attained by the use of a resilient coupling, in the capacity of a system to vibrate in response to mechanical excitation. (2021)

white noise, n —noise with a continuous frequency spectrum and with equal power per unit bandwidth. For example, equal power in any band of 100-Hz width. (2021)

5. Compound Terms

5.1 The definitions of compound terms may be found in the alphabetical section under the word in boldface type as listed below.

A-weighted, **sound level**

absorption, **sound**

absorption coefficient, **normal incidence sound**

absorption coefficient, **sound**

acoustic admittance, **specific normal**

acoustic impedance, **specific normal**

acoustic reactance—see **acoustic impedance**

acoustic resistance—see **acoustic impedance**

admittance, **specific normal acoustic**

airflow resistance, **specific**

attenuation, **sound**

C-weighted, **sound level**

class, **field sound transmission**

class, **impact insulation**

class, **noise isolation**

class, **sound transmission**

coefficient, **noise reduction**

coefficient, **normal incidence sound absorption**

coefficient, **sound absorption**

coefficient, **sound transmission**

conductance ratio—see **admittance ratio**

density, **sound energy**

energy, **sound**

energy density, **sound**

equivalent continuous sound level, see **time-average sound level**

equivalent sound level, see **time-average sound level**

exponential time weighting—see **sound level**

fast, **sound level**

fast exponential time weighting—see **sound level**

field, **diffuse sound**

field, **direct sound**

field, **reverberant sound**

frequency, **cutoff**

frequency weighted, **sound level**

impedance, **acoustic**

impedance, **specific normal acoustic**

impedance of the medium, **characteristic**

impulse, **sound level**

impulse exponential time weighting—see **sound level**

insulation, **sound**

insulation, **thermal**

insulation class, **impact**

intensity, **sound**

isolation, **sound**

isolation, **vibration**

isolation class, **noise**

level, **arithmetic mean sound pressure**

level, **sound**

level, **sound power**

level, **sound pressure**

loss, **field transmission**

loss, **insertion**

loss, **sound transmission**

material, **acoustical**

mode, **normal**

noise, **ambient**

noise, **background**

noise, **pink**

noise, **white**

noise isolation class, **normalized**

noise reduction, **normalized**

normal acoustic admittance, **specific**

normal acoustic impedance, **specific**

power, **sound**

power level, **sound**

pressure, **sound**

pressure level, **arithmetic mean sound**

pressure level, **average sound**

pressure level, equivalent sound—see **average sound**

pressure level

pressure level, **sound**

rate, **decay**

ratio, **admittance**
 ratio, conductance—see **admittance** ratio
 ratio, **impedance**
 ratio, reactance—see **impedance** ratio
 ratio, resistance—see **impedance** ratio
 ratio, susceptance—see **admittance** ratio
 reactance, acoustic—see **acoustic** impedance
 reactance ratio—see **impedance** ratio
 reduction, **level**
 reduction, **noise**
 reduction, **normalized noise**
 reduction coefficient, **noise**
 resistance, acoustic—see **acoustic** impedance
 resistance, **airflow**
 resistance, **specific** airflow
 resistance ratio—see **impedance** ratio
 resistivity, **airflow**
 room, **receiving**
 room, **reverberation**
 room, **source**
 sabin, **metric**
 slow, **sound level**
 slow exponential time weighting—see **sound level**
 sound, **absorption average**
 sound, **airborne**
 sound, **structureborne**
 sound absorption coefficient, **normal** incidence
 sound field, **diffuse**
 sound field, **direct**
 sound field, **reverberant**
 sound level, equivalent—see **average** sound pressure level
 sound transmission class, **field**

TABLE 1 Conversion Factors

Quantity	to convert from	to	multiply by
acoustic impedance	cgs acoustic ohm	mks acoustic ohm (Pa·s/m ³)	10 ⁵
specific acoustic impedance	cgs rayl	mks rayl (Pa·s/m)	10
airflow resistivity	cgs rayl/cm	mks rayl/m (Pa·s/m ²)	10 ³
absorption	sabin	metric sabin	0.0929

susceptance ratio—see **admittance** ratio
 time weighting—see **sound level**
 transmission class, **field** sound
 transmission class, **sound**
 transmission coefficient, **sound**
 transmission, **flanking**
 transmission loss, **field**
 transmission loss, **outdoor-indoor**
 transmission loss, **sound**
 velocity, **particle**

6. Conversion Factors

6.1 Most factors for converting from measurements in other systems to the International System, SI, are listed in **IEEE/ASTM SI 10**. A few conversion factors that are not listed explicitly are listed in **Table 1**.

7. Keywords

7.1 acoustic; acoustic classification; acoustic measurement; acoustics; ASTM committee E33; building acoustics; building and environmental acoustics; definitions; environmental acoustics; standard terminology; terminology

ASTM C634-22

APPENDIXES

(Nonmandatory Information)

X1. DEFINITIONS OF TERMS FROM ASTM COMMITTEE E33 STANDARDS

INTRODUCTION

Terms from the section on “Definitions of Terms Specific to This Standard” from ASTM Committee E33 standards, their definitions, and the standard(s) to which they apply are given below in alphabetical order.

NOTE X1.1—Given the fact that there may be time between when a new term is added or changed within an ASTM Committee E33 standard and when that addition or change can be reflected within this Terminology Standard, this section may not represent a completely comprehensive list of all terms and their definitions from specific ASTM Committee E33 standards.

NOTE X1.2—While this appendix is non-mandatory, the sections within each ASTM standard where these terms are defined are mandatory. Therefore, if any discrepancies exist, the terms as defined in the individual ASTM standards shall take precedence.

absorption normalized impact sound pressure level,
 ANISPL[*dimensionless*](dB), *n*—into a receiving room of at

least 40 m³ in a specified frequency band, the impact sound pressure level (ISPL) normalized to a reference absorption of 10 m² in the receiving room. (2021)

DISCUSSION—10 m² is equivalent to 108 Sabins. (2021) **E1007**

absorption-normalized high-frequency impact rating,
 AHIR[*dimensionless*], *n*—the single-number rating calculated in accordance with this classification using the absorption normalized impact sound pressure levels measured in a building, as described in Test Method **E1007**. (2021)

DISCUSSION—This rating is the high-frequency analog of the apparent impact insulation class (AIIC). (2021) **E3222**

acceptance, n —a measure of the vibration velocity level induced in a structure that is exposed to a diffuse sound field composed of one or more frequencies (see Eq 6). (2021) **E2963**

acoustical duct liner material, n —a material that has sound absorptive properties and is attached to the inside wall of a duct to attenuate the sound that propagates down that section of duct. (2021) **E477**

acoustical effectiveness, n —a measure of the change in a particular acoustical parameter that is created by the addition of a material to the base structure. (2021) **E2963**

acoustical panel, n —a form of a prefabricated sound absorbing ceiling element used with exposed suspension systems. (2021) **E1264**

acoustical tile, n —a form of a prefabricated sound absorbing ceiling element used with concealed or semi-exposed suspension systems, stapling, or adhesive bonding. (2021) **E1264**

airflow generated noise, n —the sound created by aerodynamic turbulence caused by air flowing through a device. (2021) **E477**

airflow resistance, R [$ML^{-4}T^{-1}$](mks acoustic ohm or Pa·s/m³), n —the quotient of the air pressure difference across a specimen divided by the volume velocity of airflow through the specimen. (2021) **C522**

airflow resistivity, r_o [$ML^{-3}T^{-1}$](mks rayl/m or Pa·s/m²), n —of a homogeneous material, the quotient of its specific airflow resistance divided by its thickness. (2021)

DISCUSSION—The term **airflow resistivity** has meaning only when applied to a specimen that is homogeneous in directions parallel to a and perpendicular to its surface but not necessarily isotropic. (2021) **C522**

anechoic tube, n —a constant diameter tube of sufficient length that a sound wave reflected from the far end of the tube termination arrives at the microphone position sufficiently attenuated that it will not appreciably affect the microphone reading. (2021) **E2459**

apparent impact insulation class, AIIC[*dimensionless*], n —a single-number rating derived from values of ANISPL in accordance with Classification **E989**. (2021) **E1007**

apparent outdoor-indoor transmission class, AOITC(θ)[*dimensionless*], n —of a building façade or façade element, a single-number rating calculated in accordance with Classification **E1332** using measured values of apparent outdoor-indoor transmission loss at a specified angle or range of angles. (2021) **E1332**

apparent outdoor-indoor transmission loss, AOITC(θ)[*dimensionless*](dB), n —of a building façade or façade element, the value of outdoor-indoor transmission loss obtained on a test facade element as installed, in a

specified frequency band, for a source at a specified angle θ or range of angles as measured from the normal to the center of the specimen surface, without flanking tests to identify or eliminate extraneous transmission paths. (2021) **E1332**

apparent sound transmission class, ASTC[*dimensionless*], n —a single number rating obtained by applying the classification procedure of Classification **E413** to apparent transmission loss data. (2021) **E336**

apparent transmission loss, ATL[*dimensionless*](dB), n —of a partition installed in a building, in a specified frequency band is operationally defined as:

$$ATL = \bar{L}_1 - \bar{L}_2 + 10 \log \left(\frac{S}{A_2} \right) \quad (X1.1)$$

where:

S = the area of the partition common to both source and receiving rooms, m²

A_2 = the sound absorption in the receiving room, m²

\bar{L}_1 = the source room average sound pressure level, dB and

\bar{L}_2 = the receiving room average sound pressure level resulting from the combined effect of direct and flanking transmission, dB. (2021)

DISCUSSION—log is taken to mean log₁₀, unless otherwise indicated. (2021)

DISCUSSION—This definition attributes all the power transmitted into the receiving room, by direct and flanking paths, to the area of the partition common to both rooms. If flanking transmission is significant, the ATL will be less than the TL for the partition. Apparent transmission loss (ATL) is equivalent in meaning to apparent sound reduction index (ASRI) used by ISO 16283-1:2014. (2021) **E336, E2964**

A-weighted sound pressure level, L_{pA} [*dimensionless*](dB), n —sound pressure level measurements made with the A-weighting filter applied as defined in ASA/ANSI S1.4. (2021) **E1704**

background noise, n —the total sound pressure level of all noise sources of interference in a system used for the production, detection, measurement, or recording of a signal, independent of the presence of the signal. (2021) **E477**

background noise, n —to include sound propagating to the measurement space from sources which are not under control of the proprietor or occupant of the measurement space. (2021) **E1574**

backing board, n —a flat sheet of gypsum board to which acoustical tile is attached using adhesive, screws, staples, or other suitable means (Fig. X1.1c). (2021) **C635/C635M**

base structure or test structure, n —the structure representing a bulkhead, deck, or shell of a ship. (2021)

DISCUSSION—The base structure is typically constructed with steel or aluminum stiffened plating, though other construction types are possible. This is the structure to which treatments are applied. (2021) **E2963**

bow, n —the maximum component of deviation in the vertical plane of a main runner, cross runner, or wall molding where the centroidal axis of these structural components has been

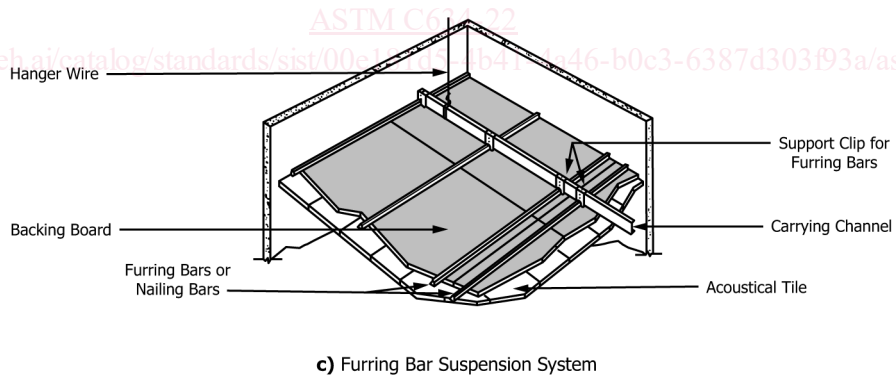
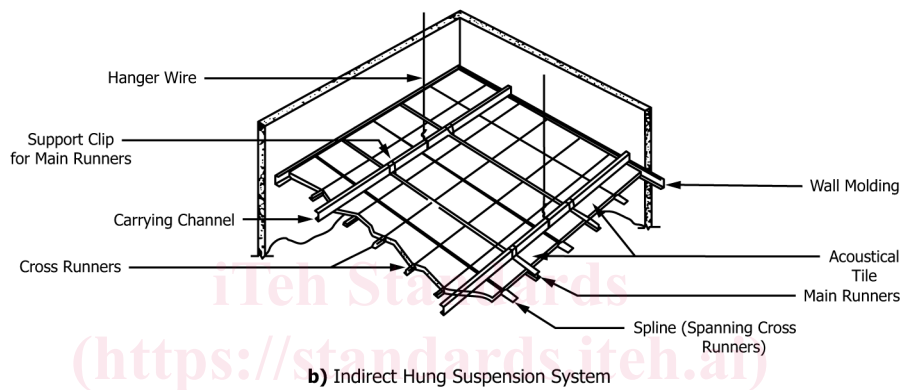
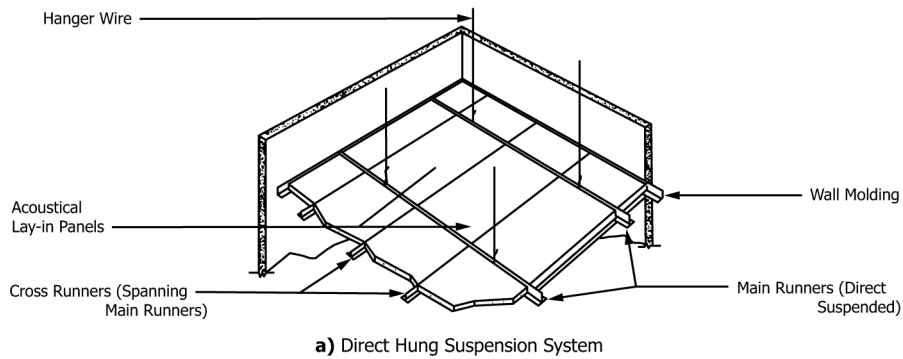


FIG. X1.1 Three Types of Ceiling Suspension Systems Showing All Components

permanently deformed from end to end into the shape of a simple regular curve during the manufacturing process. (2021)

C635/C635M

butt, n—a joint detail for acoustical tile, butt bevel, or butt square edge, without kerfing of the edges, intended for adhesive bonding to solid backing. (2021)

E1264

camber, n—the maximum component of deviation in the horizontal plane of a main runner, cross runner, or wall molding where the centroidal axis of these structural components has been permanently deformed from end to end into the shape of a simple regular curve during the manufacturing process. (2021)

C635/C635M

carrying channel, *n*—metal section that supports the entire structural grid network in some forms of mechanical ceiling suspension systems. (2021) **C635/C635M, E3090/E3090M**

cast or molded, *adj*—making ceiling products in a way that the raw materials are mixed with water or liquid binder, then deposited in a mold or form, and then dried/cured before being de-molded. (2021) **E1264**

ceiling attenuation, D_c [*dimensionless*], *n*—the noise reduction between the source and receiving rooms where flanking transmission by all paths are at least 10 decibels lower than the path through the ceiling and plenum.

$$D_c = \bar{L}_1 - \bar{L}_2 \quad (X1.2)$$

where \bar{L}_1 is the average one-third octave band sound pressure level in the source room; \bar{L}_2 is the average one-third octave band sound pressure level in the receiving room. (2021) **E1414/E1414M**

ceiling attenuation class, CAC[*dimensionless*], *n*—a single figure rating derived from the normalized ceiling attenuation values in accordance with Classification **E413**, except that the resultant rating shall be designated ceiling attenuation class. (2021) **E1414/E1414M**

ceiling suspension system, *n*—the entire network or grid of structural components, as defined by the ceiling suspension system manufacturer, that provides support for acoustical ceiling tile, acoustical ceiling panels, lighting fixtures, flexible sprinkler hose fittings and air diffusers. (2021) **C635/C635M, E3090/E3090M**

community noise equivalent level, CNEL[*dimensionless*](dB), *n*—see **day-evening-night average sound level**. (2021) **E1686**

conformal surface, *n*—the locus of points which lie at a fixed distance from the reference surface of a piece of equipment. Two conformal surfaces are used in this test method. These are surfaces over which the measuring microphones are swept. They are located at two different distances from the equipment. **Fig. X1.2** shows a typical arrangement of these surfaces for a generalized piece of equipment. (2021) **E1124**

constituent surface area, *n*—a portion of the conformal surface. (2021) **E1124**

constrained-layer (shear) damper, *n*—a treatment to control the vibration of a structure by bonding a layer of damping material between the structure’s surface and an additional elastic layer (that is, the constraining layer), whose relative stiffness is greater than that of the damping material, so that energy is dissipated through cyclic deformation of the damping material, primarily in shear. (2021) **E756**

coupled space, *n*—a secondary space that is adjacent to and partially open to the primary space on the same side of the separating partition and which meets spatial and sound level distribution requirements sufficient to allow the secondary space to be included as part of the measurement space with the primary space. (2021)

DISCUSSION—**Fig. X1.3** and **Fig. X1.4** illustrate conditions that are candidates for coupled spaces. (2021)

DISCUSSION—To qualify as a coupled space in this standard the space must meet requirements specified in 9.4.1. (2021) **E336**

coupled space, *n*—a secondary space which is adjacent to and partially open to the receiving room and which meets spatial and sound level distribution requirements sufficient to allow the secondary space to be included as part of the measurement space with the primary space. (2021)

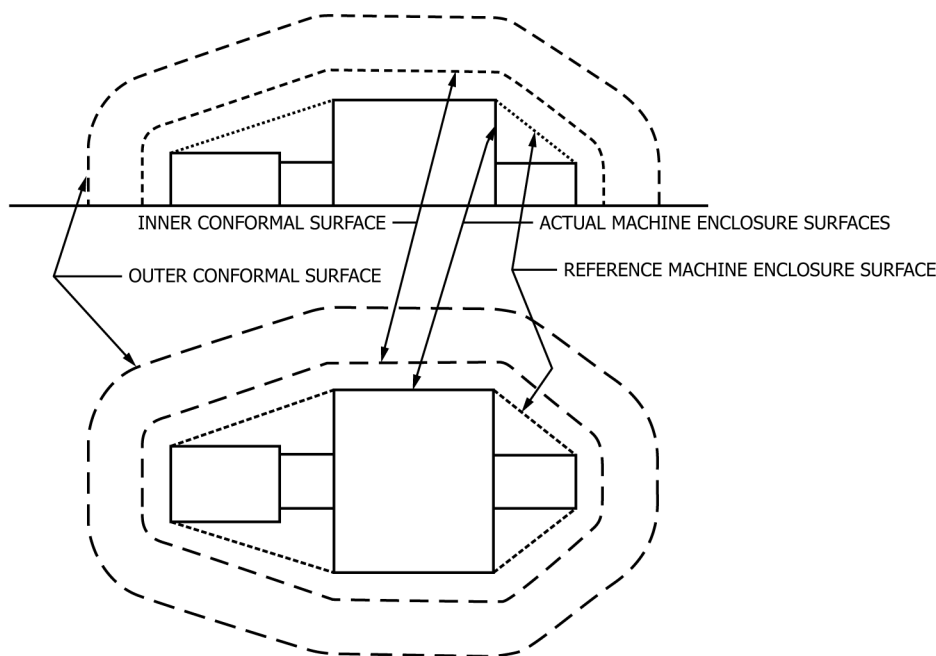


FIG. X1.2 Configuration of Conformal Surfaces, General Case