



Designation: C1228 – 96 (Reapproved 2023)

Standard Practice for Preparing Coupons for Flexural and Washout Tests on Glass Fiber Reinforced Concrete¹

This standard is issued under the fixed designation C1228; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice covers preparation of test coupons to be used in tests of plant manufactured thin-section glass fiber reinforced concrete (GFRC).

1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

- 2.1 *ASTM Standards*:²
- C947 Test Method for Flexural Properties of Thin-Section Glass-Fiber-Reinforced Concrete (Using Simple Beam With Third-Point Loading)
 - C1229 Test Method for Determination of Glass Fiber Content in Glass Fiber Reinforced Concrete (GFRC) (Wash-Out Test)

3. Significance and Use

3.1 Flexural strengths, as determined by Test Method C947, are used for quality control and design of GFRC products and

¹ This practice is under the jurisdiction of ASTM Committee C27 on Precast Concrete Products and is the direct responsibility of Subcommittee C27.40 on Glass Fiber Reinforced Concrete.

Current edition approved May 1, 2023. Published May 2023. Originally approved in 1993. Last previous edition approved in 2015 as C1228 – 96(2015). DOI: 10.1520/C1228-96R23.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

may be used to verify compliance with specifications and to collect data in research and development programs. It is, therefore, important that coupons be prepared according to a standard practice. The coupons are used to make test specimens for Test Method C947 and for Test Method C1229 to determine the amount of glass fiber reinforcement per unit volume of GFRC for quality control purposes.

4. Apparatus

4.1 *Form*—The form shall be rectangular in shape; made from wood, fiberglass reinforced plastic (FRP), GFRC, or steel with dimensions of ½ in. (13 mm) deep by 18 in. (450 mm) wide and 48 in. (1200 mm) long.

4.2 *Steel Trowel*, at least 20 in. (500 mm) long.

4.3 *Serrated Roller*, with handle.

4.4 *Strike-Off Bar (screed)*, at least 20 in. (500 mm) long, for leveling and thickness control of specimens.

5. Sampling

5.1 Sampling shall be in accordance with governing specifications.

6. Procedure

6.1 For plant manufactured product quality control purposes, spray the glass fiber reinforced material into the test form using the same method as used in production. The methods and conditions should be the same as for production materials except no mist coat or face mix should be used.

6.2 Trim off excess material from the sides of the form using a steel trowel.

6.3 Trowel surface smooth using a steel trowel.

6.4 See Fig. 1 for cutting layout for flexural test coupons and washout test coupons.

7. Curing

7.1 Cure the sample panel using the same methods and conditions as that used for production products.

8. Coding

8.1 Identify each sample board, and coupons.

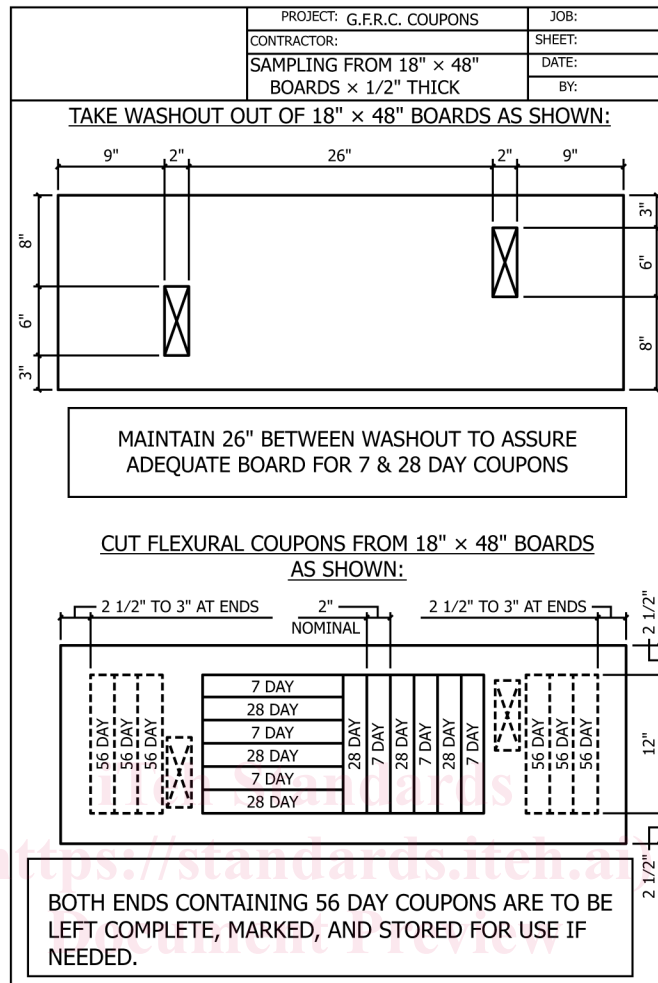


FIG. 1 Locations for Coupons Taken from 18 by 48 by 1/2-in. (450 by 1200 by 13-mm) GFRB Board

<https://standards.iteh.ai/catalog/standards/sist/d0dde0d6-cf20-4d0e-a96d-13e8b6748a54/astm-c1228-962023>

9. Retained Samples

9.1 Retain samples as prescribed by Test Method C947.

10. Keywords

10.1 coupons; flexural tests; glass fiber content; glass fiber reinforced concrete (GFRB); strength

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org). Permission rights to photocopy the standard may also be secured from the Copyright Clearance Center, 222 Rosewood Drive, Danvers, MA 01923, Tel: (978) 646-2600; http://www.copyright.com/