



Designation: **C941 – 16 C941 – 23**

Standard Test Method for Water Retentivity of Grout Mixtures for Preplaced-Aggregate Concrete in the Laboratory¹

This standard is issued under the fixed designation C941; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reappraisal. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reappraisal.

1. Scope*

1.1 This test method covers the procedure for determining the water retentivity of freshly mixed hydraulic cement grout mixtures for preplaced-aggregate (PA) concrete.

1.2 The values stated in SI units are to be regarded as standard. No other units of measurement are included in this standard.

1.3 The text of this standard refers to notes and footnotes that provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the standard.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health, safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use. (Warning—Fresh hydraulic cementitious mixtures are caustic and may cause chemical burns to exposed skin and tissue upon prolonged exposure.²)*

1.5 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

<https://standards.iteh.ai/catalog/standards/sist/99417e95-2ee3-4980-9d93-886937d666fd/astm-c941-23>

2. Referenced Documents

2.1 *ASTM Standards:*³

[C125 Terminology Relating to Concrete and Concrete Aggregates](#)

[C219 Terminology Relating to Hydraulic and Other Inorganic Cements](#)

[E832 Specification for Laboratory Filter Papers](#)

3. Terminology

3.1 *Definitions:*

3.1.1 For definitions of terms used in this test method, refer to Terminologies [C125](#) and [C219](#).

¹ This test method is under the jurisdiction of ASTM Committee C09 on Concrete and Concrete Aggregates and is the direct responsibility of Subcommittee C09.41 on Hydraulic Cement Grouts.

Current edition approved Feb. 1, 2016 June 15, 2023. Published April 2016 July 2023. Originally approved in 1981. Last previous edition approved in 2016 as C941C941 – 16, –10. DOI: 10.1520/C0941-16.10.1520/C0941-23.

² See Section on Safety Precautions, Manual of Aggregate and Concrete Testing, Annual Book of ASTM Standards, Vol. 04.02.

³ For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For Annual Book of ASTM Standards volume information, refer to the standard's Document Summary page on the ASTM website.

*A Summary of Changes section appears at the end of this standard

4. Summary of Test Method

4.1 The time required for the extraction of a standard amount of water by vacuum from a grout specimen is measured.

5. Significance and Use

5.1 This test method measures the ability of a grout mixture to retain its mixing water.

5.2 It is used for qualifying grout fluidifiers to be used in the production of PA concrete.

5.3 It may be used to compare the effects of various admixtures or materials combinations on the water retentivity properties of any cement-water grout.

6. Apparatus

6.1 *Extraction Apparatus*, assembled as in Fig. 1, including the following:

6.1.1 *Funnel*, porcelain Büchner filtering, 111 mm inside diameter at the perforated plate and 500 mL in volume.

6.1.2 *Filter Paper*, Specification E832, Type 2, Class G, disk, 11-cm diameter filter paper.

6.1.3 *Graduated Cylinder*, ~~250 mL~~ 250 mL cut down to about ~~130 mL~~ 130 mL.

6.1.4 *Vacuum Gage* or manometer graduated in increments of 1 kPa to 100 kPa vacuum.

6.1.5 *Vacuum Pump* or other source of reduced pressure, capable of maintaining a minimum vacuum of 95 kPa on a system having a volume of not less than 1 L.

6.2 *Stop Watch*, having a least reading of not more than ~~0.2 s~~ 0.2 s.

6.3 *Thermometer*, accurate to ~~0.5°C~~ 0.5 °C, for measuring ambient and grout temperatures.

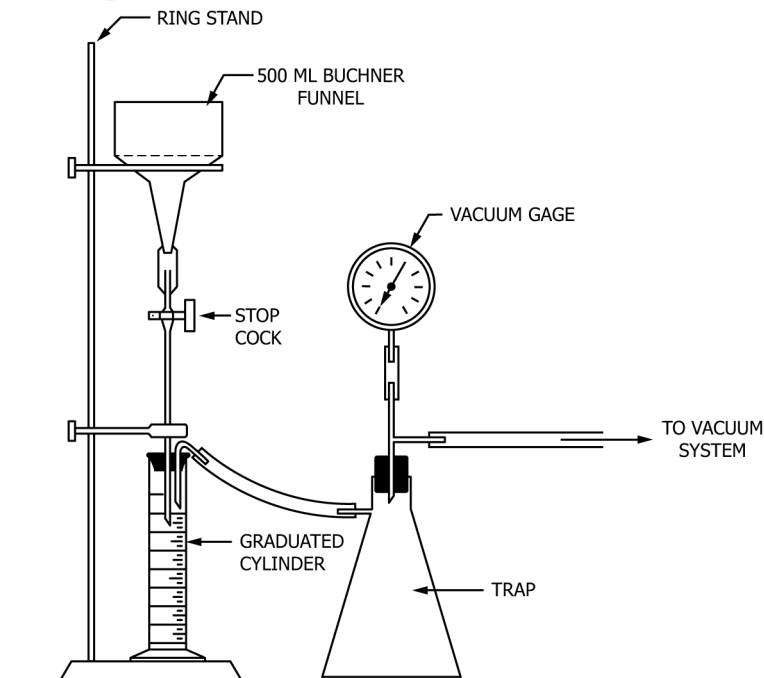


FIG. 1 Extraction Apparatus

7. Sampling

7.1 The test sample shall consist of at least ~~500 mL~~ 500 mL of freshly mixed grout representative of grout in the mixer. Bring the temperature of the laboratory sample of grout to ~~$23.0 \pm 2.0^\circ\text{C}$~~ $23.0^\circ\text{C} \pm 2.0^\circ\text{C}$ and record the ~~temperature~~ temperature.

7.2 Maintain the ambient temperature of the room in which the test is performed at ~~$23.0 \pm 2^\circ\text{C}$~~ $23.0^\circ\text{C} \pm 2^\circ\text{C}$ and record the temperature.

8. Procedure

8.1 Place a wetted filter paper on the perforated plate of the filtering funnel (see Fig. 1). Keep the top of the filtering funnel level. Apply and maintain a vacuum of at least 95 kPa in the system below the stopcock for the duration of the test. Introduce grout into the funnel until it is filled flush with the top. Open the stopcock between the filtering funnel and the graduated cylinder and at the same time start the stop watch. Perform these operations not more than 1 min after taking the grout sample from the mixer.

8.2 When 60 mL of water have been removed from the specimen, stop the stop watch.

8.3 If using this method for acceptance testing of a grout fluidifier, take the test sample within 1 min after completion of ~~33 min~~ to $3\frac{1}{4}$ min mixing.

9. Report

9.1 Report the following information:

9.1.1 Identification of the grout specimen,

9.1.2 Measured time to extract 60 mL of water from the specimen, to the nearest 1 s,

9.1.3 Temperature of the grout sample at the beginning of the test, and

9.1.4 Ambient temperature during the test.

10. Precision and Bias

10.1 *Precision*—The single laboratory, three operators standard deviation has been found to be 11 s.

10.2 *Bias*—No statement on bias can be prepared because there are no standard reference materials.

11. Keywords

11.1 grout fluidifier; preplaced-aggregate concrete; water retentivity

SUMMARY OF CHANGES

Committee C09 has identified the location of selected changes to this specification since the last ~~issue~~, issue (~~C941C941 – 16–10~~) that may impact the use of this specification. (Approved ~~Feb. 1, 2016~~) June 15, 2023)

(1) Revised units statement (~~1.2~~) and deleted inch-pound units throughout.

(1) Replaced the term “sample” with “specimen” in Added warning to 4.1.4; 8.2; with 9.1.1, and note; added 9.1.2.1.3.

(3) Added 7.2.

(4) Revised 8.1.

(5) Removed second sentence of 10.1.