



Designation: D8040 – 18 (Reapproved 2023)

Standard Test Method for Corrosion Test for Heat Transfer Fluids in Glassware¹

This standard is issued under the fixed designation D8040; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This test method covers a simple beaker-type procedure for evaluating the effects of heat transfer fluids (HTF) on metal specimens under controlled laboratory conditions. Fluids tested under this method are specifically designed for heating and air conditioning (HVAC) systems.

1.2 The values stated in SI units are to be regarded as the standard. The values given in parentheses are for information only.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.* Specific hazards statements are given in 10.1.7.2, 10.1.7.3, 10.1.7.4, and A1.1.6.

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 *ASTM Standards:*²

[B32 Specification for Solder Metal](#)

[B36/B36M Specification for Brass Plate, Sheet, Strip, and Rolled Bar](#)

[D1384 Test Method for Corrosion Test for Engine Coolants in Glassware](#)

[E1 Specification for ASTM Liquid-in-Glass Thermometers](#)

[E177 Practice for Use of the Terms Precision and Bias in ASTM Test Methods](#)

[E178 Practice for Dealing With Outlying Observations](#)

[E230 Specification for Temperature-Electromotive Force \(emf\) Tables for Standardized Thermocouples](#)

[E691 Practice for Conducting an Interlaboratory Study to Determine the Precision of a Test Method](#)

2.2 *ASTM Adjunct:*³

All-glass apparatus for corrosion test (2 drawings)

3. Summary of Test Method

3.1 In this test method, specimens of metals typical of those present in HVAC systems are totally immersed in aerated HTF solutions for 336 h at 88 °C (190 °F). The corrosion-inhibitive properties of the test solution are evaluated on the basis of the weight changes incurred by the specimens. Each test is run in triplicate, and the average weight change is determined for each metal. A single test may occasionally be completely out of line (see 11.2).

4. Significance and Use

4.1 This test method will generally distinguish between HTFs that are definitely deleterious from the corrosion standpoint and those that are suitable for further evaluation. However, the results of this test method cannot stand alone as evidence of satisfactory corrosion inhibition. The actual service value of an HTF formulation can be determined by more comprehensive evaluation and field tests, agreed between customer and supplier.

5. Apparatus

5.1 *Container*, a 1000 mL, tall-form, spoutless beaker, made of heat-resistant glass, for containing the HTF solution and test

¹ This test method is under the jurisdiction of ASTM Committee D15 on Engine Coolants and Related Fluids and is the direct responsibility of Subcommittee D15.30 on Industrial Heat Transfer Fluids.

Current edition approved Sept. 1, 2023. Published September 2023. Originally approved in 2017. Last previous edition approved in 2018 as D8040 – 18. DOI: 10.1520/D8040-18R23.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ Details available from ASTM International Headquarters. Order Adjunct No. ADJD1384. Original adjunct produced in 1980.

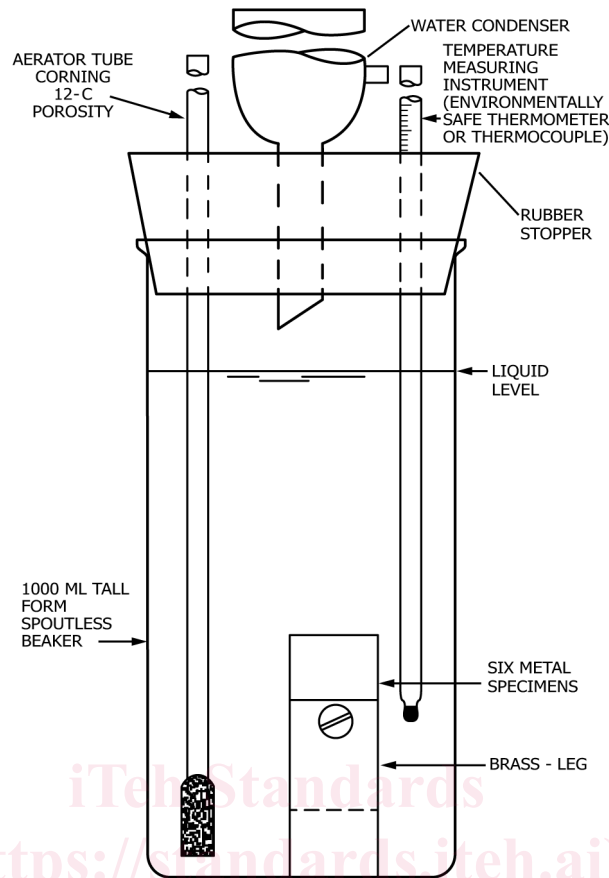


FIG. 1 Metal Specimens and Equipment for 336 h Corrosion Test

specimens. The beaker shall be tightly closed with a No. 15 rubber stopper, having drill holes to accommodate a water condenser, an aerator tube, and a thermometer as shown in Fig. 1. Optionally, an all-glass apparatus may be used.⁴

5.2 *Condenser*, a water condenser of the reflux, glass-tube type, having a 400 mm (16 in.) condenser jacket.

5.3 *Aerator Tube*, a gas-dispersion tube, porosity size 12-C,⁵ to ensure continuous aeration without plugging.

5.4 *Temperature Measuring Instrument (Environmentally Safe Thermometer or Thermocouple)*, an ASTM Partial Immersion Temperature Measuring Instrument having a range from -20 °C to 150 °C (0 °F to 302 °F) and conforming to the requirements for Thermometer 1C (1F), as prescribed in Specification E1 or Thermocouple as summarized in Specification E230.

⁴ The sole source of supply of the apparatus known to the committee at this time is Corning Glass Works. Gas-dispersion tube No. 39533, manufactured by Corning Glass Works, 44-5 Crystal St., Corning, NY, has generally been found satisfactory for this purpose. Optionally, a capillary tip bleed tube with 0.28 in. (7 mm) bore and 11.2 in. (280 mm) length may be used when consistent early plugging of gas dispersion tubes occurs. The tube, catalog No. 7815-19, may be obtained from Corning Glass Works, Corning, NY 14830. If you are aware of alternative suppliers, please provide this information to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee,¹ which you may attend.

⁵ If a water bath is used, a significant reduction in evaporation rate is achieved by addition of floating plastic chips on the water surface.

5.5 *Heater*, a constant-temperature bath containing a high-boiling liquid (see Note 1) that is capable of giving continuous service with the specified temperature control. The size of the bath will be determined by the number of corrosion tests that are to be run concurrently.

NOTE 1—The specimens prescribed in this test method may not be the same as that of alloys currently used for HVAC cooling system components. However, they offer a broad range of metals and are customarily used for research and product screening. Specimens other than those designated in this test method may be used by mutual agreement of the parties involved.

6. Metal Test Specimens

6.1 *Type*—The following metal test specimens⁶ shall be used:

6.1.1 *Steel*, UNS G10200 (SAE 1020),⁷ cut from 1.59 mm ($\frac{1}{16}$ in.) cold-rolled sheet stock to size 50.8 mm by 25.4 mm (2 in. by 1 in.). Chemical composition of the carbon steel is as follows: carbon, 0.17 % to 0.23 %; manganese, 0.30 % to 0.60 %; phosphorus, 0.040 % maximum; sulfur, 0.050 % maximum.

⁶ Unified numbering system for metals and alloys, SAE-ASTM, July 1995.

⁷ A round-robin evaluation of coated solder report is available from ASTM International Headquarters and may be obtained by requesting Research Report RR:D15-0132. Contact ASTM Customer Service at service@astm.org.

6.1.2 *Copper*, conforming to UNS C11000 (SAE CA110)⁷ or UNS C11300 (SAE CA113).⁷ Cold-rolled, cut from 1.59 mm (1/16 in.) sheet stock to size 50.8 mm by 25.4 mm (2 in. by 1 in.).

6.1.3 *Brass*, conforming to Alloy UNS C26000 (SAE CA 260).⁸ Half-hard, cut from 1.59 mm (1/16 in.) sheet stock to size 50.8 mm by 25.4 mm (2 in. by 1 in.).

6.1.4 *Solder*—A brass specimen as described in 6.1.3, coated with solder conforming to Alloy Grade 30A (SAE 3A) of Specification B32.⁸ Solder-coated specimens may be prepared, or used specimens recoated for reuse, by the procedure given in Annex A1. A solid solder specimen cut from 1.59 mm (1/16 in.) sheet stock of Alloy Grade 30A (SAE 3A) to size 50.8 mm by 25.4 mm (2 in. by 1 in.) may be used subject to mutual agreement of the parties involved. The use of a solid solder specimen must be reported along with the metal specimen weight loss results.

6.1.4.1 When agreed upon between the supplier and the purchaser of HTF, the standard solder specimen may be replaced with one having a different alloy composition than standard Alloy Grade 30A or 30B. Use of specimens other than standard Alloy Grade 30A or 30B shall be noted in the test report.

NOTE 2—Where non-standard alloy is used, the standard flux shown in A1.1.5 may not be satisfactory. A low corrosive flux may be required.

6.1.5 *Cast Aluminum*, conforming to Alloy UNS A23190 (SAE 329).⁷ Specimen size, 50.8 mm by 25.4 mm by 3.18 mm (2 in. by 1 in. by 1/8 in.).

6.1.6 *Cast Iron*, conforming to Alloy UNS F10007 (SAE G3500).⁶ Specimen size, 50.8 mm by 25.4 mm by 3.18 mm (2 in. by 1 in. by 1/8 in.).

6.2 Arrangement (See Fig. 2):

6.2.1 *Metal Specimen Arrangement*—None of the hardware used in metal specimen arrangement (metal specimen, screws, washers, metal spacers, insulating sleeves, insulating spacers and nuts) can be reused for a test. The metal test specimens shall be drilled through the center with a 6.75 mm (17/64 in.) drill to accommodate a 50.8 mm (2 in.) 10–24 brass machine screw covered with a thin-walled insulating sleeve. Tetrafluoroethylene tubing with a 6.35 mm (1/4 in.) outside diameter 1.59 mm (1/16 in.) wide and a wall thickness of 0.4 mm (1/64 in.) is satisfactory. Two half-hard brass legs shall be cut from 1.59 mm (1/16 in.) sheet stock to size 50.8 mm by 25.4 mm (2 in. by 1 in.). A 6.35 mm (1/4 in.) diameter hole shall be drilled in each leg with the center 6.35 mm (1/4 in.) from the top and 12.7 mm (1/2 in.) from each side. The test “bundle” shall be made up on the insulated screw with the specimens in the following order: brass leg, copper, solder, brass, steel, cast iron, cast aluminum, and brass leg. The specimens shall be separated by 4.76 mm (3/16 in.) thick solid metal spacers having a 6.75 mm (17/64 in.) inside diameter and a 11.11 mm (7/16 in.) outside diameter. Insulating spacers made from tetrafluoroethylene shall be used between the brass legs and the specimen “bundle,” and between the brass and steel specimens. Brass spacers shall be used between the brass, solder, and copper specimens, and steel spacers between the cast iron, steel, and cast aluminum specimens. The nut shall be tightened firmly to ensure good electrical contact between the test specimens in each section of the “bundle.”

6.2.2 *Alternate Metal Specimen Arrangement*—When agreed upon between the supplier and the purchaser, an alternate metal specimen arrangement may be used to evaluate multiple solder alloys, such as high lead Alloy Grade L50113⁸ consisting of 97 % lead, 2.5 % tin, 0.3 % silver, concurrently with Standard Alloy Grade 30A or 30B. It is recommended that the metal specimen arrangement be modified by replacing the copper specimen with the high lead solder specimen and arranging specimens in the bundle as follows:

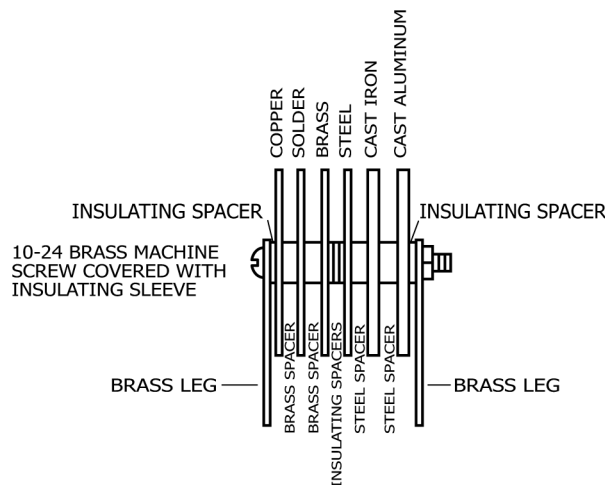


FIG. 2 Metal Specimen Arrangement

⁸ A round-robin evaluation of nitric acid cleaning of aluminum specimens is available from ASTM International Headquarters and may be obtained by requesting Research Report RR:D15-1018. Contact ASTM Customer Service at service@astm.org.

High Lead Solder Brass Alloy Grade 30A or 30B Steel Cast Iron Cast Aluminum

Use of alternate specimens and metal specimens arrangements shall be noted in the test report.

7. Preparation of Test Specimens

7.1 Sand the cast iron and cast aluminum specimens on the 25.4 mm by 50.8 mm (1 in. by 2 in.) cut surfaces with “coarse” grade (No. 1) emery cloth. Remove any burrs from coupon edges and hole. Scrub all specimens vigorously, using a moistened bristle brush and ground pumice powder or fine silicon carbide grit until the entire metal area is bright, shiny, and free from any visible oxide film or tarnish.

7.2 Rinse the specimens thoroughly with tap water; then rinse with acetone, dry, and weigh to the nearest 1 mg. Cast aluminum specimens should be dried in a 100 °C oven for 1 h, to a constant weight, prior to recording the weight.

NOTE 3—If the test specimens are not to be used immediately, keep them in a desiccator until required.

8. Test Solutions

8.1 The concentration of the heat transfer fluid (HTF) to be tested shall be as follows:

8.1.1 Prediluted HTFs at concentrations higher than 30 % by weight of the freeze depressant, must be diluted to 30 % by weight with deionized water (demineralized) and shall be mixed with 99 mg of sodium sulfate, 110 mg of sodium chloride, and 92 mg of sodium bicarbonate per liter of test solution.

8.1.2 HTF concentrates shall be diluted to 30 % by weight using deionized water (demineralized). The diluted solution shall then be mixed with 99 mg of sodium sulfate, 110 mg of sodium chloride, and 92 mg of sodium bicarbonate per liter of test solution.

9. Test Conditions

9.1 *Beaker Assembly*—The arrangement of the assembled metal specimens with relation to the aerator tube and other components is shown in Fig. 1. Note that the tip of the condenser just emerges from the bottom of the rubber stopper.

9.2 *Test Temperature*—The test solution shall be maintained at a temperature of 88 °C ± 2 °C (190 °F ± 5 °F).

9.3 *Aeration Rate*—The aeration rate shall be 100 mL/min ± 10 mL/min. The aerator tube should be located at least 12.7 mm (½ in.) away from the test “bundle” to avoid direct contact with the metal specimens.

9.4 *Test Duration*—The test shall be run continuously for 2 weeks (336 h).

10. Procedure

10.1 Make triplicate tests concurrently on each heat transfer fluid solution in accordance with the following procedure:

10.1.1 Carefully clean the test beaker, condenser, rubber stopper, and aerator tube, and thoroughly rinse with water.

10.1.2 Bolt the specimens together in the order given in 6.2 and place the “bundle” in the test beaker as shown in Fig. 1.

10.1.3 Pour 750 mL of the prepared test solution into the 1000 mL beaker.

10.1.4 Fit the condenser and aeration tube to the beaker, and set the aeration rate at 100 mL/min, using a flow meter or other suitable device.

10.1.5 Raise the temperature of the test solution to 88 °C (190 °F). Pass water through the condenser at a rate sufficient to maintain adequate cooling.

10.1.6 Check the tests once each working day to ensure proper solution temperature, aeration rate, and solution level. The tests may operate unattended on weekends and holidays. Make up evaporation losses during the corrosion tests by addition of distilled or deionized water.

10.1.7 At the end of the test, *immediately* disassemble specimens and brush very lightly with a soft bristle brush and water to remove loosely held corrosion products. To remove the more tenacious corrosion products and films, the individual specimens shall then be subjected to additional cleaning treatments as follows:

10.1.7.1 *Iron and Steel*—Remove adherent deposits by means of a brass scraper or brass bristle brush, followed by scrubbing with a wet bristle brush and fine pumice to clean the specimen completely.

10.1.7.2 *Copper and Brass*—Dip in a 1+1 mixture of concentrated HCl (sp gr 1.19) and water for 15 s to remove tarnish films, rinse with tap water to remove acid, and scrub with a wet bristle brush and fine pumice powder. (**Warning**—HCl is a strong acid. Avoid contact with skin and eyes. Handle in a fume hood.)

10.1.7.3 *Aluminum*—In a fume hood, dip for 10 min in an aqueous solution containing 4 parts concentrated nitric acid (HNO₃, 70 mass %) plus one part distilled water at 25 °C (76 °F). Rinse thoroughly with water, then brush very lightly with a soft bristle brush to remove any loose films, and again rinse with water.⁹ Dry the specimen in a 100 °C oven for 1 h, to a constant weight prior to recording the weight. (**Warning**—HNO₃ is a strong toxic oxidant and acid. Avoid contact with skin, eyes, and clothing. Do not breathe vapor. Handle in a fume hood.)

10.1.7.4 *Solder*—Immerse for 5 min in boiling 1 % glacial acetic acid. Rinse in water to remove the acid, and brush very gently with a soft bristle brush to remove any loosened material. (**Warning**—Avoid contact with skin and eyes with glacial acetic acid. Handle in a fume hood.)

10.1.8 The acid dip times given in 10.1.7 for the cleaning of nonferrous specimens are average values found to be adequate in most cases. Other times, suggested by experience, may be used if necessary, if gross weight losses are adjusted by the appropriate tare.

10.1.9 Follow each of the four operations noted above by thorough rinsing, first in tap water and then in acetone. Then

⁹ The sole source of supply of the apparatus known to the committee at this time is Industrial Chemical Co. *Low-Corrosive Flux (Acid Bromide)*—a suitable flux, is available from Industrial Chemical Co., Detroit, MI, labeled No. REZ 55-F. Manufacturer’s dilution recommendations should be followed. If you are aware of alternative suppliers, please provide this information to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee,¹ which you may attend.