



Designation: **C1231/C1231M – 15 C1231/C1231M – 23**

Standard Practice for Use of Unbonded Caps in Determination of Compressive Strength of Hardened Cylindrical Concrete Specimens¹

This standard is issued under the fixed designation C1231/C1231M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope*

1.1 This practice covers requirements for a capping system using unbonded caps for testing concrete cylinders molded in accordance with Practice **C31/C31M** or **C192/C192M**, or cores obtained in accordance with Test Method **C42/C42M**. *Unbonded neoprene caps of a defined hardness are permitted to be used for testing for a specified maximum number of reuses without qualification testing up to a certain concrete compressive strength level. Above that strength, level neoprene caps will require qualification testing. Qualification testing is required for all elastomeric materials other than neoprene regardless of the concrete strength.*

1.2 Unbonded caps are not to be used for acceptance testing of concrete with compressive strength below 10 MPa [1500 psi] or above 80 MPa [12 000 psi].

1.3 The text of this standard refers to notes and footnotes that provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the standard.

1.4 Units—The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, to ensure conformance with the standard, each system shall be used independently of the other, and values from the two systems shall not be combined. Combining values from the two systems may result in non-conformance with the standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use. (Warning—Concrete specimens tested with unbonded caps rupture more violently than comparable specimens tested with bonded caps. The safety precautions given in the Manual of Aggregate and Concrete Testing are recommended.)²*

1.6 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

¹ This practice is under the jurisdiction of ASTM Committee C09 on Concrete and Concrete Aggregates and is the direct responsibility of Subcommittee C09.61 on Testing for Strength.

Current edition approved Dec. 1, 2015/Oct. 1, 2023. Published February 2016/October 2023. Originally approved in 1993. Last previous edition approved in 2014 as C1231/C1231M – 14. DOI: 10.1520/C1231_C1231M-15-23. DOI: 10.1520/C1231_C1231M-23.

² Section on Safety Precautions, Manual of Aggregate and Concrete Testing, *Annual Book of ASTM Standards*, Vol 04.02.

*A Summary of Changes section appears at the end of this standard

2. Referenced Documents

2.1 ASTM Standards:³

- C31/C31M Practice for Making and Curing Concrete Test Specimens in the Field
- C39/C39M Test Method for Compressive Strength of Cylindrical Concrete Specimens
- C42/C42M Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete
- C192/C192M Practice for Making and Curing Concrete Test Specimens in the Laboratory
- E617/C617/C617M Practice for Capping Cylindrical Concrete Specimens
- D2000 Classification System for Rubber Products in Automotive Applications

3. Terminology

3.1 Definitions of Terms Specific to This Standard:

- 3.1.1 *pad, n*—an unbonded elastomeric pad.
- 3.1.2 *unbonded cap, n*—a metal retainer and an elastomeric pad.

4. Significance and Use

4.1 This practice provides for using an unbonded capping system in testing hardened concrete cylinders made in accordance with Practices C31/C31M or C192/C192M, or cores obtained in accordance with Test Method C42/C42M in lieu of the capping systems described in Practice E617/C617/C617M.

4.2 The elastomeric pads deform in initial loading to conform to the contour of the ends of the test specimens and are restrained from excessive lateral spreading by plates and metal rings to provide a uniform distribution of load from the bearing blocks of the testing machine to the ends of the concrete or mortar specimens.

5. Materials and Apparatus

5.1 Materials and equipment necessary to produce ends of the reference specimens that conform to planeness requirements of Test Method C39/C39M and the requirements of Practice E617/C617/C617M. This may include grinding equipment or capping materials and equipment to produce neat cement paste, high strength gypsum plaster, or sulfur mortar caps.

5.2 Elastomeric Pads:

5.2.1 Pads shall be $13 \text{ mm} \pm 2 \text{ mm}$ [$\frac{1}{2} \text{ in.} \pm \frac{1}{16} \text{ in.}$] thick and the diameter shall not be more than 2 mm [$\frac{1}{16} \text{ in.}$] smaller than the inside diameter of the retaining ring.

5.2.2 Pads shall be made from polychloroprene (neoprene) meeting the requirements of Classification D2000 as follows:

Shore A Durometer	Classification D2000 Line Call-Out
50	M2BC514
60	M2BC614
70	M2BC714

The tolerance on Shore A durometer hardness is ± 5 . Table 1 provides requirements for use of caps made from material meeting the requirements of Classification D2000, above.

5.2.3 Other elastomeric materials that meet the performance requirements of qualification tests in Section 8 are permitted.

5.2.4 Elastomeric pads shall be supplied with the following information:

5.2.4.1 The manufacturer's or supplier's name,

5.2.4.2 The Shore A hardness, and

³ For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For Annual Book of ASTM Standards volume information, refer to the standard's Document Summary page on the ASTM website.

TABLE 1 Requirements for Use of Polychloroprene(Neoprene) Pads

Compressive Strength, ^A MPa [psi]	Shore A Durometer Hardness	Qualification Tests Required	Maximum Reuses
Less than 10 [1 500]		Not permitted	
10 to 40 [1 500 to 6 000]	50	None	100
17 to 50 [2 500 to 7 000]	60	None	100
28 to 50 [4 000 to 7 000]	70	None	100
50 to 80 [7 000 to 12 000]	70	Required	50
Greater than 80 [12 000]		Not permitted	

^A Compressive strength of concrete at age of testing as specified in Contract Documents. For acceptance testing, it is the specified compressive strength f'_c .

5.2.4.3 The applicable range of concrete compressive strength from **Table 1** or from qualification testing.

5.2.5 The user shall maintain a record indicating the date the pads are placed in service, the pad durometer, and the number of uses to which they have been subjected.

5.3 *Retainers* are a pair of metal fixtures used to provide support for and alignment of the neoprene pads and the test specimen ends (**Note 1** and **Fig. 1**). Each retainer (upper and lower) includes a (retaining) ring that is welded to or manufactured integrally with a base plate. The height of the retaining ring shall be 25 ± 3 mm [1.0 ± 0.1 in.]. The inside diameter of the retaining ring shall not be less than 102% or greater than 107% of the diameter of the specimen. For test specimens having nominal diameters of 100 mm [4 in.] or less, the thickness of the retaining ring shall be at least 9 mm [0.35 in.] and the thickness of the baseplate shall be at least 8 mm [0.30 in.]. For test specimens having nominal diameters greater than 100 mm [4 in.], the thickness of the retaining ring and baseplate shall be at least 12 mm [0.47 in.]. The surface of the baseplate that contacts the bearing block of the testing machine shall be plane to within 0.05 mm [0.002 in.]. The bearing surfaces of the retainers shall not have gouges, grooves, protrusions, or indentations greater than 0.25 mm [0.010 in.] deep or greater than 32 mm² [0.05 in.²] in surface area.

Document Preview

Retainer Internal Diameter shall not be less than 102% or greater than 107% of cylinder diameter.

<https://standards.iteh.ai/catalog/standards/sis/6114960-23cc-40e2-b73a-89af52558abb/astm-c1231-c1231m-23>

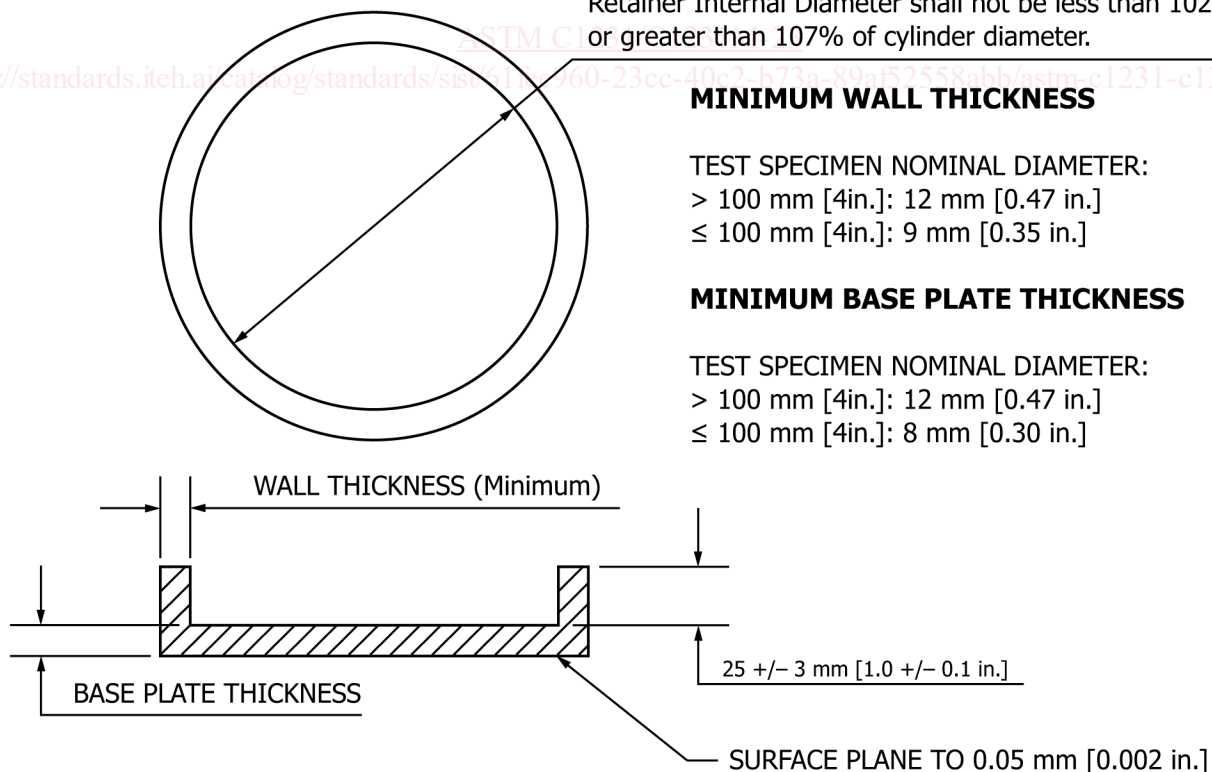


FIG. 1 Example of Retaining Ring and Base Plate

NOTE 1—Retainers made from steel and some aluminum alloys have been found acceptable.

6. Test Specimens

6.1 Specimens shall be cylinders made in accordance with Practices **C31/C31M** or **C192/C192M**, or cores obtained in accordance with Test Method **C42/C42M**.

6.2 Depressions under a straight edge measured with a round wire gage across any diameter shall not exceed 5 mm [0.20 in.]. If the specimen ends do not meet this tolerance, the specimen shall not be tested unless irregularities are corrected by sawing or grinding.

7. Procedure

7.1 Unbonded caps are permitted to be used on one or both ends of a test specimen in lieu of a cap or caps meeting Practice **C617/C617M**, provided the caps meet the requirements of Section 5. Pad hardness shall be in accordance with **Table 1**.

NOTE 2—The specified strength in the contract documents is for various stages of construction. This may include strength test requirements for formwork removal or release of prestress in addition to the test requirements for verification of specified compressive strength. Therefore, pad selection is based on the strength requirement for the designated stage of construction.

7.2 Replace pads that do not meet the dimensional requirements of 5.2 or that exceed the maximum reuse limits of **Table 1**. Insert pad in the retainer before it is placed on the specimen.

NOTE 3—Some manufacturers recommend dusting the pads and the ends of the specimens with corn starch or talcum powder prior to testing.

7.3 Complete the load application, testing, calculation, and reporting of results in accordance with Test Method **C39/C39M**.

NOTE 4—Some users have reported damage to testing machines from the sudden release of energy stored in the elastomeric pads.

NOTE 5—Occasionally, specimens tested with unbonded caps may develop early cracking, but continue to carry increasing load. For this reason Test Method **C39/C39M** requires test specimens to be loaded until it is certain that they have been compressed beyond their ultimate capacity.

8. Qualification of Unbonded Capping Systems and Verification of Reuse of Pads

8.1 **Table 1** specifies the conditions under which polychloroprene (neoprene) unbonded pads must be qualified under this section depending on the concrete strength and the Shore A hardness. Unbonded pads made of other elastomeric materials must be qualified using the procedures in this section.

8.2 When qualification tests are required they must be made by either the supplier or user of the unbonded pads. The user of the pads must retain a copy of the current qualification test report to demonstrate compliance with this practice. See **X1.1**.

8.3 The compressive strength of molded cylinders tested with unbonded caps shall be compared with that of companion cylinders tested with ends ground or capped to meet requirements of Test Method **C39/C39M** and Practice **C617/C617M**.

8.4 To be acceptable, tests must demonstrate that at a 95 % confidence level ($\alpha = 0.05$), the average strength obtained using unbonded caps is not less than 98 % of the average strength of companion cylinders capped or ground in accordance with 8.3.

8.4.1 When required, qualification tests in accordance with 8.5 shall be made on initial use of an unbonded cap at both the highest and lowest strength levels anticipated to establish an acceptable range of cylinder strength for use. In practice individual cylinders shall not have strengths more than 10 % greater than the high strength level or more than 10 % less than the low strength level qualified or specified in **Table 1**. Qualification tests shall be repeated whenever there is a change in the design or dimensions of the retaining rings, or when there is a change in pad composition or thickness, or the Shore A hardness changes by more than five units. Initial qualification tests shall include verification that after the specified maximum number of reuses the pads meet the requirements of 8.4.

8.4.2 When tests are made to establish a permissible number of reuses exceeding those in **Table 1**, only those tests or reuses which