



Designation: D3737 – 18 (Reapproved 2023)^{ε1}

Standard Practice for Establishing Allowable Properties for Structural Glued Laminated Timber (Glulam)¹

This standard is issued under the fixed designation D3737; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

^{ε1} NOTE—Editorial changes were made throughout in October 2023.

1. Scope

1.1 This practice covers the procedures for establishing allowable properties for structural glued laminated timber. Included are the allowable stresses for bending, tension and compression parallel to the grain, horizontal shear, compression perpendicular to the grain, and radial tension and compression in curved members. Also included are modulus of elasticity and modulus of rigidity.

1.2 This practice is limited to the calculation of allowable properties subject to the given procedures for the selection and arrangement of grades of lumber of the species considered.

1.3 Requirements for production, inspection and certification are not included, but in order to justify the allowable properties developed using procedures in this practice, manufacturers must conform to recognized manufacturing standards. Refer to ANSI A190.1 and CSA O122.

1.4 The values stated in inch-pound units are to be regarded as standard. The values given in SI units are mathematical conversions that are provided for information only and are not considered standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.6 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

¹ This practice is under the jurisdiction of ASTM Committee D07 on Wood and is the direct responsibility of Subcommittee D07.02 on Lumber and Engineered Wood Products.

Current edition approved Oct. 1, 2023. Published November 2023. Originally approved in 1978. Last previous edition approved in 2018 as D3737 – 18^{ε1}. DOI: 10.1520/D3737-18R23E01.

2. Referenced Documents

2.1 ASTM Standards:²

D9 Terminology Relating to Wood and Wood-Based Products

D143 Test Methods for Small Clear Specimens of Timber

D198 Test Methods of Static Tests of Lumber in Structural Sizes

D245 Practice for Establishing Structural Grades and Related Allowable Properties for Visually Graded Lumber

D2395 Test Methods for Density and Specific Gravity (Relative Density) of Wood and Wood-Based Materials

D2555 Practice for Establishing Clear Wood Strength Values

D2915 Practice for Sampling and Data-Analysis for Structural Wood and Wood-Based Products

D4761 Test Methods for Mechanical Properties of Lumber and Wood-Based Structural Materials

D5456 Specification for Evaluation of Structural Composite Lumber Products

D6570 Practice for Assigning Allowable Properties for Mechanically Graded Lumber

E105 Guide for Probability Sampling of Materials

2.2 Other Standards:

ANSI A190.1 Structural Glued Laminated Timber³

ANSI/AWC National Design Specification for Wood Construction⁴

CSA O122 Structural Glued Laminated Timber⁵

3. Terminology

3.1 Definitions:

3.1.1 *alternative lumber*—laminated veneer lumber (LVL), laminated strand lumber (LSL), oriented strand lumber (OSL),

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ Available from APA – The Engineered Wood Association, Tacoma, WA 98466, <http://www.apawood.org>.

⁴ Available from American Wood Council (AWC), 222 Catocin Circle, SE, Suite 201, Leesburg, VA 20175, <http://www.awc.org>.

⁵ Available from Canadian Standards Association (CSA), 5060 Spectrum Way, Mississauga, ON L4W 5N6, Canada, <http://www.csa.ca>.

or parallel strand lumber (PSL) meeting the requirements of Specification **D5456**; or solid-sawn lumber that is produced according to Practice **D6570** and the grading rules of the applicable grading or inspection agency.

3.1.2 *E-rated lumber*—lumber graded for use in manufacturing structural glued laminated timber by nondestructive measurement of a modulus of elasticity (E) and by visual inspection in accordance with the grading rules of the applicable grading or inspection agency.

3.1.3 *glulam*—term used to denote structural glued laminated timber, which is a product made from suitably selected and prepared pieces of wood bonded together with an adhesive either in a straight or curved form with the grain of all pieces essentially parallel to the longitudinal axis of the member.

3.1.4 *horizontally laminated timber*—member designed to resist bending loads applied perpendicularly to the wide faces of the laminations (referred to as bending about the x - x axis).

3.1.5 *lamination*—layer of lumber within the glued laminated timber.

3.1.6 *modulus of elasticity (E)*—for laminating, E is designated in two categories to distinguish mode of measurement and application.

3.1.6.1 *Long-Span E (LSE)—modulus of elasticity* calculated from deflection measured in a flat-wise static bending test of lumber with a center-point loading and a span-to-depth ratio ($\frac{1}{4}$) of approximately 100 or the *modulus of elasticity* obtained from Practice **D2555** and multiplied by the appropriate factors from **Tables 1-6**.

3.1.6.2 *member E (E_{axial} , E_x , E_y)*—allowable *modulus of elasticity* values of the structural glued laminated member as defined in this practice.

3.1.7 *vertically laminated timber*—member designed to resist bending loads applied parallel to the wide faces of the laminations (referred to as bending about the y - y axis).

3.1.8 *visually graded lumber*—lumber graded by visual inspection in accordance with the grading rules of the applicable grading or inspection agency.

3.1.9 *GDC*—ratio of the cross-sectional area of the local grain deviation, which may or may not be associated with a

knot, away from the edge of the lumber to the cross-sectional area of the lumber (see **Fig. 1**).

3.1.10 *GDE*—ratio of the cross-sectional area of the local grain deviation, which may or may not be associated with a knot, at the edge of the lumber to the cross-sectional area of the lumber (see **Fig. 1**).

3.1.11 *GDS*—projected sum of all *GDE* and *GDC* values within a one-foot length of lumber as defined in **Fig. 1**.

3.1.12 *KC*—ratio of the cross-sectional area of a knot located away from the edge of the lumber to the cross-sectional area of lumber. When a knot at the edge of the wide face and a knot located away from the edge are in the same cross-section, the combination of the two shall be used in determining *KC* (see **Fig. 2**).

3.1.13 *KE*—ratio of cross-sectional area of a knot at the edge of wide face of lumber to the cross-sectional area of the lumber (see **Fig. 2**).

3.1.14 *SR_{IT}*—required strength ratio of the tension lamination at the outermost fiber.

4. Materials Requirements

4.1 Requirements for Laminations:

4.1.1 Laminations of glulam shall be of lumber with net thickness of 2 in. (5 cm) or less.

4.1.2 Lumber is permitted to be joined end to end with structural end joints to form long-length laminations. End joints shall be qualified and quality controlled in accordance with a recognized manufacturing standard.

4.1.3 Lumber is permitted to be placed or joined side to side to form wide laminations.

4.1.4 Dimension lumber used to form laminations shall be visually graded or *E-rated* according to established grading rules.

4.1.5 Alternative lumber material is permitted by demonstrating equivalence to a dimension lumber grade in accordance with **Annex A1**.

4.1.6 For the analysis of a glulam layup, all laminations in a single cross-section shall be of equal thickness.

4.1.7 The analytical procedures of this standard practice are based on specific lamination characteristics.

4.1.7.1 Lumber properties including knot size and frequency, physical properties such as specific gravity, and mechanical properties such as modulus of elasticity shall be based on measurements of 2 by 6 lumber for definition of grade characteristics.

4.1.7.2 The effect of decay or compression failures upon strength cannot be readily determined, thus these defects shall be prohibited from laminating grades insofar as existing inspection and grading technology permit. Firm white speck or light white pocket is permissible in grades of lumber that permit knots to occupy up to one third or more of the cross-section provided their extent in combination with knots does not exceed that of the largest edge knot permitted. The exception is that firm white speck and light white pocket shall be excluded from end joints in tension members and the outer 10 % of the total depth on the tension side of bending members.

TABLE 1 Adjustment Factors for Clear Wood Stresses (Practice **D2555)**

| Property | Multipliers for Average or 5 th Percentile | | Seasoning Factor for a 12 % Average Moisture Content |
|-------------------------------|---|--------------------------------|--|
| | Softwoods | Hardwoods | |
| Bending | 0.476 ($\frac{1}{2.1}$) | 0.435 ($\frac{1}{2.3}$) | 1.35 |
| Compression parallel to grain | 0.526 ($\frac{1}{1.9}$) | 0.476 ($\frac{1}{2.1}$) | 1.75 |
| Modulus of elasticity | 1.095 ($\frac{1}{0.913}$) | 1.095 ($\frac{1}{0.913}$) | 1.20 |
| Horizontal shear | 0.244 ($\frac{1}{4.1}$) | 0.222 ($\frac{1}{4.5}$) | 1.13 |

TABLE 2 Bending Stress Index Based on Large Beam Tests and Modulus of Elasticity Values for Visually Graded Lumber

NOTE 1—Appendix X1 provides one method of developing new data.

| Species | Growth Classification ^A | Bending Stress Index ^B | | Modulus of Elasticity | |
|-------------------|------------------------------------|-----------------------------------|------|-----------------------|--------|
| | | psi | MPa | million psi | MPa |
| Douglas Fir-Larch | medium grain | 3000 | 20.7 | 1.9 | 13 100 |
| | close grain | 3250 | 22.4 | 2.0 | 13 800 |
| | dense | 3500 | 24.1 | 2.1 | 14 500 |
| Southern Pine | coarse grain ^C | 2000 | 13.8 | 1.5 | 10 300 |
| | medium grain | 3000 | 20.7 | 1.8 | 12 400 |
| | dense | 3500 | 24.1 | 2.0 | 13 800 |
| Hem-Fir | medium grain | 2560 | 17.7 | 1.7 | 11 700 |
| | dense ^D | 3000 | 20.7 | 1.8 | 12 400 |

^A Classification for “dense” wood shall follow Practice D245.

^B Values shown are based on full-size beam tests. As a result, these values incorporate the effects of some features such as grain deviations in lumber along with influences of end and face bonding influences. Beams designed using these values and tested in accordance with Test Methods D198 will yield strength values such that the lower 5th percentile will exceed the design bending stress by a factor of 2.1 with 75 % confidence. Analysis of test data assumed a log-normal distribution. For unsymmetric combinations, tests have shown that values up to 40 % higher than those listed may be applied to the compression side of bending members.

^C Also applicable to minor species of southern pine regardless of growth rate.

^D Specific gravity, based on oven-dry weight and volume at 12 % moisture content, must equal or exceed 0.39.

TABLE 3 Bending Stress Indexes and Compression Stress Index Parallel to Grain for E-Rated Lumber Used in Laminating^A

| Long -Span, E, psi | Bending Stress Index ^A | | Compression Stress Index Parallel to Grain ^{B,C} | |
|--------------------------|--------------------------------------|------|---|------|
| | psi | MPa | psi | MPa |
| | 1 600 000 | 2560 | 17.7 | 1900 |
| 1 900 000 | 3000 | 20.7 | 2400 | 16.5 |
| 2 100 000 | 3500 | 24.1 | 2800 | 19.3 |
| 2 300 000 | 4000 | 27.6 | 3100 | 21.4 |

^A Values shall be not higher than obtained by interpolation for intermediate E values.

^B Values are for 12-in. (0.30 m) deep members at 12 % moisture content (dry).

^C Values are for members at 12 % moisture content (dry) values.

TABLE 4 Parallel-to-Grain Stress Modification Factors Associated with Slope of Grain for Designing Glulam Combinations

| Slope of Grain | Stress Modification Factor | |
|----------------|----------------------------|-------------|
| | Tension | Compression |
| 1:4 | 0.27 | 0.46 |
| 1:6 | 0.40 | 0.56 |
| 1:8 | 0.53 | 0.66 |
| 1:10 | 0.61 | 0.74 |
| 1:12 | 0.69 | 0.82 |
| 1:14 | 0.74 | 0.87 |
| 1:15 | 0.76 | 1.00 |
| 1:16 | 0.80 | 1.00 |
| 1:18 | 0.85 | 1.00 |
| 1:20 | 1.00 | 1.00 |

TABLE 5 Constant Used to Adjust Vertically Laminated Bending Strength Ratio

| Strength Ratio (SR_1) | C_1 |
|---------------------------|-------|
| 0.45 or greater | 1.238 |
| 0.40 | 1.292 |
| 0.35 | 1.346 |
| 0.30 | 1.400 |
| 0.26 or less | 1.444 |

4.1.7.3 Compression wood (as defined in Terminology D9) in readily identifiable and damaging form shall be limited in accordance with 4.1.7.3 (1) and 4.1.7.3 (2).

TABLE 6 Grade Adjustment Factors for Modulus of Elasticity

| Bending Strength Ratio ^A | Adjustment Factor |
|-------------------------------------|-------------------|
| 0.55 or greater | 1.00 |
| 0.45 to 0.54 | 0.90 |
| 0.44 or less | 0.80 |

^A Determined in accordance with Practice D245.

(1) For dry service conditions, grades permitting knots up to one half of the cross-section may contain streaks of compression wood occupying as much as 20 % of the cross-section. Streaks of compression wood up to one eighth of the cross-section may be permitted in other grades.

(2) For wet service conditions, or for pressure-treated members, the conditions of 4.1.7.3 (1) apply except that compression wood is limited to 5 % of the cross-section of the laminations in tension members and in the outer 10 % of the total depth on the tension side of bending members.

4.1.7.4 Lumber shall be free of shakes and splits that make an angle of less than 45° with the wide face of the piece. Pitch pockets shall be limited in size to the area of the largest knot permitted, and pitch streaks shall be limited to one sixth of the width of the lumber.

4.2 Requirements for Adhesives:


4.2.1 Adhesives for use in glulam shall be rigid (non-elastomeric) to ensure composite action of the laminations and shall be sufficiently strong to transfer stresses required by the intended use of the member.

4.2.2 Adhesives shall be sufficiently durable to provide bond for the life of the glulam member in its expected service environment.

4.3 Tension Laminations—for horizontally laminated bending members shall meet the requirements herein.

4.3.1 The results of full-size beam tests reported in Refs (1-3)⁶ have yielded an empirical relationship between the size of knots in the tension zone and bending strength. This relationship dictates that special grading considerations be

⁶ The boldface numbers in parentheses refer to a list of references at the end of this practice.

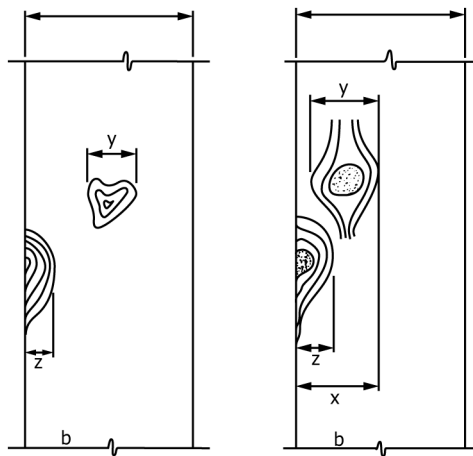


$GDC = y/b$
 $GDE = z/b$
 $GDS = x/b$ where $x = y + z$

(a) Example of grain deviations not associated with a knot where the projected grain deviations do not overlap.

$GDC = y/b$
 $GDE = z/b$
 $GDS = x/b$ where $x < y + z$

(b) Example of grain deviations associated with knots where the projected grain deviations overlap.

FIG. 1 Knot and Grain Deviation Measurement at the Outer 5 % on the Tension Side of a Member Occurring in a 1-ft Length

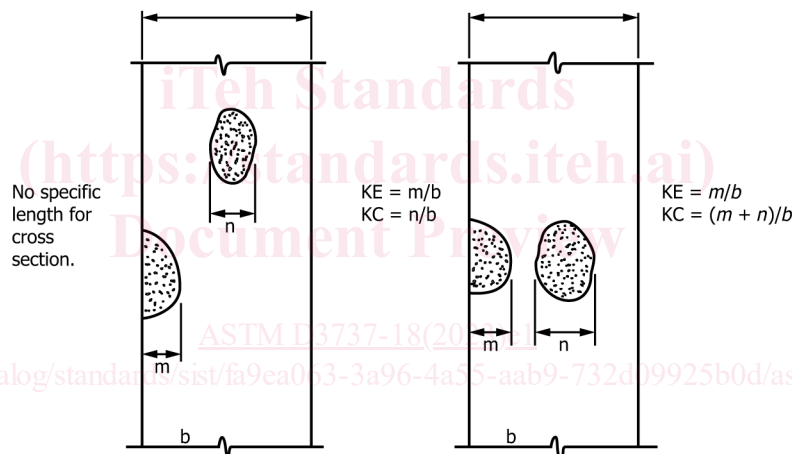

NOTE 1—When edge knots and centerline knots occur at the same cross section, the sum of the edge knots and centerline knots is used in calculating KC as shown in (b).

FIG. 2 Knot Measurement for the Next Inner 5 % on the Tension Side of a Bending Member

applied to the laminations used in the outer 10 % of the beam depth on the tension side. This tension side may exist on the top or bottom of the beam, or both, depending upon loading and support conditions. If horizontally laminated timbers are manufactured without applying these special tension lamination grading considerations, the allowable bending stress shall be reduced by multiplying the allowable stress calculated in 7.2.1.1 by 0.85 if the depth is 15 in. (0.38 m) or less or by 0.75 if the depth exceeds 15 in. (0.38 m).

4.3.2 Visually Graded Lumber:

4.3.2.1 Definitions of terms required for calculation of knot and grain deviation restrictions are listed in 3.1.9 – 3.1.14.

4.3.2.2 Knots and local grain deviations are expressed as a ratio of the cross-sectional area they occupy to the cross-sectional area of the lumber based on the dressed width of the

lumber. They are measured using the displacement technique. Knots are measured to the lateral extremes of the knot; grain deviations (with or without knots) are measured to the lateral extremes of the zone within which the local slope of grain exceeds the allowable slope of grain for the grade. Eq 8-11 which follow yield the maximum allowable knot and grain deviation ratios in the outer 10 % of depth. It is suggested these ratios be adjusted downward to the nearest 0.05 or to the next nearest convenient fraction (such as 1/3).

4.3.2.3 Beams Greater than 15 in. (0.38 m) in Depth:

(1) Outer 5 %—Grain deviation shall be limited in accordance with Eq 1 and 2.

$$GDS \leq 1.55(1 - SR_{it}) \tag{1}$$

$$GDS \leq 1.82(1 - SR_{it}) \tag{2}$$

(a) Eq 1 shall be used when *GDE*, with or without *GDC*, is used to determine *GDS* (Fig. 1). Eq 2 shall apply when *GDE* is not used to determine *GDS*. In addition, general slope of grain shall not exceed 1:16 if the required strength ratio of the tension lamination is 0.60 or greater. If SR_{II} is less than 0.60, the general slope of grain shall not exceed 1:12.

(2) *Next Inner 5 %*—Knots are restricted in accordance with Eq 3 and 4.

$$KE = 0.66 - 0.45 SR_{II} \quad (3)$$

$$KC = 1.20 - 0.93 SR_{II} \quad (4)$$

(a) General slope of grain shall be limited in accordance with the strength requirements of the individual laminations.

4.3.2.4 Beams 12 in. (0.30 m) to 15 in. (0.38 m) in Depth:

(1) *Outer 5 %*—The requirements of 4.3.2.3 (1) apply except that SR_{II} shall be multiplied by 0.90 in Eq 1 and 2. The value of $0.9 SR_{II}$ shall not be taken as less than 0.50.

(2) *Next Inner 5 %*—General slope of grain shall be limited in accordance with the strength requirements of the individual laminations.

4.3.2.5 Beams of Four or More Laminations and Less than 12 in. (0.30 m) in Depth:

(1) *Outer 5 %*—The requirements of 4.3.2.3 (1) apply except that SR_{II} shall be multiplied by 0.80 in Eq 1 and 2. The value of $0.80 SR_{II}$ shall not be taken as less than 0.50.

(2) *Next Inner 5 %*—General slope of grain shall be limited in accordance with the strength requirements of the individual laminations.

4.3.2.6 Density Requirements:

(1) *Outer 5 %*—Density requirements shall apply to the full length of the piece of lumber. In order to ensure that lumber is near-average or above specific gravity for the species, visually graded tension laminations shall have a minimum specific gravity of at least 94 % of the recognized species average from Practice D2555 based on dry weight and volume at 12 % moisture content. The minimum specific gravity of the piece of lumber shall be the average specific gravity of the entire piece. Rate of growth and percentage of latewood requirements for tension laminations shall apply to the full length of lumber. Visual inspection alone is not an acceptable method of determining specific gravity.

4.3.2.7 Other Requirements:

(1) *Outer 5 %*—Wide-ringed or lightweight pith associated wood has a pronounced effect on finger joint strength. The amount of material not meeting rate of growth and density requirements, in combination with compression wood, shall be limited to 1/8 of the cross-section of the piece of lumber. In addition, for wet service conditions or pressure-treated members, compression wood is limited to a maximum of 5 % of the cross-section.

4.3.3 E-Rated Lumber:

4.3.3.1 Grading Requirements:

(1) *Outer 5 %*—In addition to having the required modulus of elasticity, *E*-rated lumber must meet the requirements for visually graded lumber given in 4.3.2.2, 4.3.2.3 (1), and

4.3.2.4 (1), with the exception of the knot and slope of grain requirements as given in 4.3.3.3.

4.3.3.2 Other Requirements:

(1) *Outer 5 %*—Wide-ringed or lightweight pith associated wood and compression wood are limited in the same manner as for visually graded lumber, except that there are no density requirements. Material not meeting medium grain rate of growth, in combination with compression wood, shall be limited to 1/8 of the cross-section of the piece of lumber. In addition, for wet conditions of use or pressure-treated members, compression wood is limited to a maximum of 5 % of the cross-section.

4.3.3.3 The portions of the piece not subjected to mechanical *E* measurements shall have visual criteria applied to ensure piece quality. Edge knots up to the size permitted in the grade are acceptable. Other knots are limited to the visual requirements of the bending stress index for which the *E*-rated lumber is qualified. For tension laminations, the slope of grain shall not exceed 1:12 and wide-ringed or pith-associated wood and compression wood is limited as in 4.3.3.2. Medium grain growth requirements shall be met for Douglas Fir-Larch and Southern Pine.

4.3.4 Tension laminations to meet the requirements identified in 4.3.1 may be qualified by test as an alternative to the grading criteria of 4.3.2 and 4.3.3. The procedure given in Annex A1 shall be used.

5. Allowable Properties for Glulam Members

5.1 Allowable properties for individual laminations shall be obtained by multiplying the stress index values from Section 6 by the stress modification factors from Section 7 and modifying for specific conditions from Section 8. Allowable properties for glulam members shall be calculated as described in 5.3 – 5.11.

5.2 Allowable properties shall be rounded to the significant digits as follows:

| | |
|--|--|
| Bending, tension parallel to grain, and compression parallel to grain | 0 to 1000 psi to nearest 25 psi (0.3 MPa) 1000 to 2000 psi to nearest 50 psi (0.5 MPa) 2000 to 3000 psi to nearest 100 psi (1 MPa) |
| Horizontal shear | Nearest 5 psi (0.05 MPa) |
| Compression perpendicular to grain and radial stresses in curved members | Nearest 5 psi (0.05 MPa) |
| Modulus of elasticity | Nearest 100 000 psi (500 MPa) |

5.3 The allowable bending stress for horizontally laminated timbers shall be calculated as shown by example in Annex A4.

5.4 The allowable bending stress of vertically laminated timbers shall be determined by the following equation:

$$F_{by} = \text{Min} \left\{ \frac{F_{byi}}{E_i} \right\} (E_{avg}) \geq \text{Min} \{ F_{byi} \} \quad (5)$$

where:

F_{by} = allowable bending stress of the vertically laminated timber,

- E_{avg} = weighted average of the component lamination *LSE* values,
- $F_{by\ i}$ = allowable bending stress for the i^{th} lamination in the combination which is obtained by multiplying the stress index value from 6.1.1 or 6.1.1.1 by the lower of the stress modification factors from 7.2.2.1 and 7.2.2.2 and modifying for specific conditions from Section 8.
- E_i = *LSE* for the i^{th} lamination.

5.5 *Compression Parallel to Grain*—The allowable stress for compression parallel to grain shall be calculated as shown by example in Annex A5.

5.6 *Tension Parallel to Grain*—The allowable stress for tension parallel to grain shall be the minimum allowable stress of the individual laminations in the member, which is obtained by multiplying the tension stress index from 6.1.3 by the lower of the stress modification factors from 7.4.2 and 7.4.3 and modifying for specific conditions from Section 8.

5.7 Member *E*:

5.7.1 *Axially Loaded Timbers*— E_{axial} shall be the weighted average of the individual lamination grade *LSE* values modified for specific conditions from Section 8.

5.7.2 *Vertically Laminated Timbers*— E_y shall be 95 % of the weighted average of the individual lamination grade *LSE* values modified for specific conditions from Section 8.

5.7.3 *Horizontally Laminated Timbers*— E_x shall be 95 % of the apparent modulus of elasticity as determined by a transformed section analysis using the *LSE* values for each grade in the combination modified for specific conditions from Section 8.

5.8 Horizontal Shear:

5.8.1 *Horizontally Laminated Timbers*—For horizontally laminated timbers, the allowable stress in horizontal shear shall be determined using the following equation:

$$F_{vx} = \text{Min} \left(\frac{F_{vx,i}}{1 - \left(\frac{c_i}{c} \right)^2} \right) \quad (6)$$

where:

- F_{vx} = allowable shear stress for the horizontally laminated member,
- $F_{vx,i}$ = allowable shear stress for the i^{th} lamination, which is determined by multiplying the shear stress index from 6.1.5 or 6.1.5.1 by the shear stress modification factor from 7.6.1 modified for specific condition from Section 8,
- c_i = distance from the neutral axis of the horizontally laminated timber to the innermost fiber of the i^{th} lamination,
- c = distance from the neutral axis of the horizontally laminated timber to the outermost fiber in the member, and
- i = 1 to n .

Because the test procedure referenced in 6.1.5.1 utilizes prismatic beams subject to static, monotonic loading and produces significantly higher values than the procedure described in 6.1.5, shear stress values determined using 6.1.5.1

shall be limited to straight beams of constant cross-section, which are not subject to impact or cyclic loads.

5.8.2 *Vertically Laminated Timbers*—For vertically laminated timbers, the allowable stress in horizontal shear shall be the weighted average of the allowable stresses for the individual laminations, which are determined by multiplying the shear stress index from 6.1.5 or 6.1.5.1 by the appropriate shear stress modification factor from 7.6.2 modified for specific conditions from Section 8. Because the test procedure referenced in 6.1.5.1 utilizes prismatic beams subject to static, monotonic loading and produces significantly higher values than the procedure described in 6.1.5, shear stress values determined using 6.1.5.1 shall be limited to straight beams of constant cross-section, which are not subject to impact or cyclic loads.

5.9 *Compression Perpendicular to Grain*—Allowable stresses in compression perpendicular to grain for the glulam member shall be determined based on the location of the applied stress. The allowable stress for the lamination, as determined by multiplying the stress index from 6.1.6 by the stress modification factor from 7.7.1 at the location of the applied stress shall be the allowable stress for the glulam member.

5.10 The modulus of rigidity of glulam members can be considered to have a constant relationship to the modulus of elasticity. For design purposes, the relationship $G = E_x/K$ shall be used for members consisting of a single grade, where $K = 16$ when specific data is not available. For members consisting of multiple grades of lumber the modulus of rigidity shall be obtained by using the *LSE* of the lowest grade applied to the entire member.

5.11 Radial Stress in Curved Members:

5.11.1 *Radial Tension*—The allowable stress for radial tension in curved members shall be equal to the allowable stress for radial tension for the lamination with the lowest value.

5.11.2 *Radial Compression*—The allowable stress for radial compression in curved members shall be equal to the allowable stress for compression perpendicular to the grain for the lamination with the lowest value.

6. Stress Index Values for Laminations

6.1 *Visually Graded Lumber*—Practice D2555 provides information on clear wood strength properties and their expected variation for small clear, straight-grained specimens of green lumber. Based on these clear wood properties, stress index values shall be calculated, unless otherwise permitted herein.

6.1.1 *Bending*—The bending stress index shall be determined by calculating the 5th percentile of modulus of rupture in accordance with Practice D2555, multiplying by the appropriate factors in Table 1, and multiplying by 0.743 to adjust to a 12-in. (0.3 m) deep, uniformly loaded simple beam with a 21:1 span-to-depth ratio.

6.1.1.1 As an alternative to 6.1.1, testing and analysis of large glulam beams of Douglas Fir-Larch, Southern Pine and Hem-Fir indicate that the stress indices given in Table 2 may be used for Douglas Fir-Larch, grown within the states of

Wyoming, Montana, Washington, Idaho, Oregon, and California; for Southern Pine consisting of the four principal species: Longleaf, Slash, Shortleaf, and Loblolly; and for Hem-Fir consisting of Western Hemlock, California Red Fir, Grand Fir, Noble Fir, Pacific Silver Fir, and White Fir.

6.1.2 *Compression Parallel to the Grain*—The compression stress index parallel to grain shall be determined by calculating the 5th percentile strength in compression parallel to the grain in accordance with Practice **D2555** and multiplying by the appropriate factors from **Table 1**.

6.1.3 *Tension Parallel to the Grain*—The tension stress index parallel to grain shall be five eighths of the bending stress index obtained in **6.1.1** or **6.1.1.1**.

6.1.4 *Modulus of Elasticity*—The stress index value for modulus of elasticity shall be the average long-span modulus of elasticity as defined in **3.1.6.1**.

6.1.4.1 As an alternative to **6.1.4**, values from **Table 2** based on testing of large samples of lumber of the species groups listed in **6.1.1.1** and multiplied by appropriate factors from **Table 6** are permitted to be used for *LSE*.

6.1.5 *Horizontal Shear*—The horizontal shear stress index shall be the lower 5th percentile of clear wood shear strength, determined in accordance with Practice **D2915** using the data given in Practice **D2555** and multiplying by the appropriate factors from **Table 1**. The horizontal shear stress index for coarse-grain Douglas Fir-Larch and Southern Pine shall be 70 % of the value used for medium-grain materials.

6.1.5.1 As an alternative to **6.1.5**, the horizontal shear stress index shall be permitted to be determined from flexural tests of full-size beams in accordance with the principles of Test Methods **D198** with specific loading details as shown in **Annex A7**. Laminating lumber used in the critical core area of the test beams subjected to maximum shear stresses shall be selected such that it is representative of the population of on-grade lumber used in normal production for the species and grade being evaluated. The required number of samples and the lower 5th percentile tolerance limit of shear strength shall be determined in accordance with Practice **D2915** and the analysis procedures given in **Annex A7**. The horizontal shear stress index is determined by multiplying the lower 5th percentile tolerance limit of shear strength by 0.476 (or 1/2.1). Reassessment of the horizontal shear stress index derived from this section shall be conducted for beam configurations that are not included in the consideration of the testing described in this section, or if there is a significant change in the lumber resource or in the lamination grading system or the manufacturing process.

6.1.6 *Compression Perpendicular to the Grain*—The stress index value for compression perpendicular to grain shall be determined as follows **(4)**:

$$F_{C\perp} = (2674 SG - 551.3) (1.9/1.67) \quad (7)$$

where:

$F_{C\perp}$ = stress index value in compression perpendicular to grain; and

SG = average green specific gravity from Practice **D2555** or, for a species group, the standing timber volume weighted average green specific gravity, adjusted as shown in **6.1.6.1**, **6.1.6.2**, or **6.1.6.3**.

6.1.6.1 For purposes of calculating stress index values in compression perpendicular to grain for visually graded material, the average green specific gravity of a species or species group which have an average green specific gravity of 0.36 or above shall be reduced by the following amounts for various rates of growth and density to account for variation in the specific gravity.

Dense grain—0.03
Close grain—0.05
Medium grain—0.06
Coarse grain—0.09

6.1.6.2 When the average green specific gravity of a species or species group is 0.35 or less the reductions shall be as follows:

Close grain—0.03
Medium grain—0.04

6.1.6.3 As an alternative to the method specified in **5.6.1** of Practice **D245**, lumber is permitted to be qualified as dense by weighing. The lumber specific gravity, adjusted to a green condition using Test Methods **D2395**, Appendix X1 conversion formula, shall meet the reduced specific gravity as specified in **6.1.6.1**. The reduced value shall be used in **Eq 2** to determine the stress index value in compression perpendicular to grain.

6.1.7 *Radial Tension*—The stress index for radial tension shall be limited to one third of the value for horizontal shear as determined in accordance with **6.1.5**, except for Douglas Fir-Larch, Hem-Fir, Douglas Fir South, Eastern Spruce, Canadian Spruce Pine, and mixed Softwood Species, which are prescriptively limited to 15 psi (0.10 MPa) for other than wind or earthquake loads. For wind and earthquake loading of all species groups, the allowable stress shall be one third of the allowable stress for horizontal shear determined in accordance with **6.1.5**.

6.2 *E-Rated Lumber*—This method is based on lumber that has been *E*-rated and visually graded in accordance with **Annex A1**. *E*-rated lumber is designated by the modulus of elasticity (*E*) and the size of the edge characteristics permitted in the grade, for example, $1.6E^{-1/3}$, etc. Edge characteristics include knots, knot holes, burls, localized grain deviation or decay (partially or wholly) at edges of wide faces.

6.2.1 *Bending*—Bending stress index values for *E*-rated lumber with various *LSE* values are given in **Table 3**.

6.2.2 *Compression Parallel to Grain*—Compression parallel to grain stress index values for *E*-rated laminations shall be as given in **Table 3**.

6.2.3 *Tension Parallel to Grain*—The tension stress index for *E*-rated Laminations shall be five eighths of the bending stress index obtained in **6.2.1**.

6.2.4 *Modulus of Elasticity*—The stress index for modulus of elasticity for *E*-rated laminations shall be the *LSE* as defined in **3.1.6.1**.

6.2.4.1 *LSE* values shall be permitted to be determined by tests of lumber meeting the criteria of **Annex A2**.

6.2.5 Horizontal Shear—The stress index value for horizontal shear for *E*-rated laminations shall be determined in the same manner as for visually graded laminations in 6.1.5 or 6.1.5.1.

6.2.6 Compression Perpendicular to Grain—The stress index in compression perpendicular to grain for *E*-rated laminations shall be determined as follows, using the *LSE* listed in Table 3 and the growth rate classifications.

(1) *Dense*—If the average *LSE* of the *E*-rated grade equals or exceeds that of the dense classification for the species, the stress index for the dense visual grade of the species or species group per 6.1.6 shall be used.

(2) *Medium Grain*—If the average *LSE* of the *E*-rated grade is less than the average *LSE* of the species or species groups, but not more than 300 000 psi below the average, the stress index determined for medium grain lumber per 6.1.6 shall be used.

(3) *Other*—When the average *LSE* of the *E*-rated grade is less than the average *LSE* of the species or species group minus 300 000 psi, the stress index value shall be determined by using a specific gravity of 0.8 times the average specific gravity of the species in solving Eq 2. (The value obtained is approximately the same as that used for coarse grain lumber.)

6.2.6.1 As an alternative to 6.2.6, the allowable stress for compression perpendicular to grain is permitted to be determined in accordance with the applicable provisions of Refs (5-8).

6.2.7 Radial Tension—The stress index in radial tension shall be determined in the same manner as for visually graded laminations in 6.1.7.

7. Stress Modification Factors (SMF) for Laminations

7.1 For some strength properties, knots, slope of grain, and other characteristics may affect the strength and therefore reductions in the stress index values are required. This section discusses the stress modification factors applicable to laminations in structural glued laminated timber.

7.1.1 Special tension lamination grades of lumber as described in 4.3 are required to justify the bending stress modification factors determined in 7.2.1.1.

7.1.2 Slope of grain stress modification factors shall not be applicable to *E*-rated laminations. However, slope of grain restrictions in 4.3.2.3 (a) for tension laminations in the outer 5 % of bending members shall apply to *E*-rated laminations.

7.2 Bending Stress Modification Factor—The bending stress modification factor for each lamination shall be the lower of the two modification factors determined separately on the basis of knots and on the basis of slope of grain.

7.2.1 Horizontally Laminated Timbers—The bending stress modification factor for laminations in horizontally laminated timbers (SMF_{bx}) shall be the lower of the two stress modification factors determined separately for knots and slope of grain as follows:

7.2.1.1 Knots—The bending stress modification factor for knots ($SMF_{bx\ knots}$) shall be determined for the lamination at the

outer edge of each grade zone. All laminations in the same grade zone shall be permitted to use the same stress modification factor for knots. Transformed section analysis shall be used to locate the neutral axis of the beam. The “half beam” on each side of the neutral axis shall be considered independently after locating the neutral axis. Knots affect strength less if located in laminations near the neutral axis than in outer laminations. Thus, the influence of knots depends both on their size and position and can be measured by their moment of inertia. Tests of glulam beams have provided an empirical relationship between the ratio I_K/I_G and bending strength. I_K is defined as the moment of inertia of all knots within 6 in. (152 mm) of the critical cross-section and I_G is the gross moment of inertia. Knot properties shall be determined following the procedures given in Annex A3 and I_K/I_G ratios shall be calculated following procedures given in Annex A4. Additional information is given in Refs (1) and (9). The stress modification factor in bending shall be determined from the following relationship:

$$SMF_{bx\ knots} = \left(1 + 3\frac{I_K}{I_G}\right) \left(1 - \frac{I_K}{I_G}\right)^3 \left(1 - \frac{I_K}{2I_G}\right) \quad (8)$$

where:

$SMF_{bx\ knots}$ = bending stress modification factor.

(1) For visually graded laminations, the minimum value of $SMF_{bx\ knots}$ shall not be less than the strength ratio in flatwise bending as determined by formula X1.2 of Practice D245.

(2) For *E*-rated laminations, the minimum value of $SMF_{bx\ knots}$ shall not be less than the appropriate factor from Table 7.

7.2.1.2 Slope of Grain—The bending stress modification factor for slope of grain ($SMF_{bx\ SOG}$) for each lamination shall be as given in Table 4. Stress modification factors given for tension shall apply to laminations in the tension side of bending members while those given for compression shall apply to laminations in the compression side.

7.2.2 Vertically Laminated Timbers—The bending stress modification factor for laminations in vertically laminated timbers shall be the lower of the two modification factors determined separately for knots and slope of grain as follows:

7.2.2.1 Knots—The bending stress modification factor for knots ($SMF_{by\ knots}$) shall be determined from the following empirical relationship (10):

TABLE 7 Minimum Bending and Compression Parallel to Grain Stress Modification Factors for Members of *E*-Rated Lumber

| <i>E</i> -Grade Designation ^A | Minimum Stress Modification Factor (SMF) | | |
|--|--|------------------------------|-------------------------------|
| | Horizontally Laminated Bending | Vertically Laminated Bending | Compression Parallel to Grain |
| 1/6 | 0.80 | 0.70 | 0.80 |
| 1/4 | 0.75 | 0.65 | 0.75 |
| 1/2 | 0.50 | 0.25 | 0.50 |

^A The second part of the *E*-grade designation (for example, 2.0-1/6) indicates fraction of cross-section that can be occupied by edge characteristics which include knots, knot holes, burls, distorted grain, or decay partially or wholly at edges of wide faces.

$$SMF_{by\ knots} = C_1(SR_1^{\gamma})(N^{\alpha})(1 - 1.645\Omega_1/N^{1/2}) \quad (9)$$

where:

- C_1 = empirical constant from **Table 5**,
 SR_1 = strength ratio from Practice **D245** for an individual piece of lumber loaded on edge,
 γ = empirical constant equal to 0.81,
 α = 0.329 (1 – 1.049SR₁),
 N = number of laminations in the member of the same grade or higher up to 5 (for members with five or more laminations of the same grade or higher, $N = 5$), and
 Ω_1 = coefficient of variation (COV) of bending strength for individual laminations. The applicable COV for individual laminations of visually graded lumber shall be 0.36. The applicable COV for *E*-rated laminations shall be 0.24, except for grades that permit the edge characteristics to occupy up to one half of the cross-section: in which case, the coefficient of variation shall be 0.36.

7.2.2.2 Slope of Grain—The bending stress modification factor for slope of grain ($SMF_{by\ SOG}$) for each lamination shall be equal to the appropriate slope of grain stress modification factor for tension from **Table 4**.

7.3 Stress Modification Factors in Compression Parallel to the Grain:

7.3.1 The compression stress modification factor (SMF_c) for laminations in members with four or more laminations shall be the lower of the two modification factors determined separately from knots and slope of grain as follows:

7.3.2 Knots—A single compression stress modification factor for knots ($SMF_{c\ knots}$) shall be determined for the entire cross-section. $SMF_{c\ knots}$ shall be applied to each lamination in the cross-section. Tests have shown that the axial compressive strength of short compression members is related to the ratio of the area of knots in the cross-section to the gross cross sectional area. Procedures for estimating values of this ratio for compression members are given in **Annex A5**. The stress modification factor for knots shall be determined from the following empirical relationship.

$$SMF_{c\ knots} = \frac{(A_K/A_G)^3}{4} - (A_K/A_G)^2 - \frac{(A_K/A_G)}{4} + 1 \quad (10)$$

where:

- $SMF_{c\ knots}$ = compression stress modification factor for knots, and
 A_K/A_G = ratio of the area of knots in the cross-section to gross cross-sectional area as defined in **Annex A5**.

For members with grades of lumber placed unsymmetrically, an additional adjustment, given in **Annex A5**, is necessary to compensate for additional bending stresses.

7.3.3 Slope of Grain—The compression stress modification factor for slope of grain ($SMF_{c\ SOG}$) for each lamination shall be as given in **Table 4**.

7.3.4 The stress modification factor in compression parallel to grain for laminations in members of two or three laminations shall be the same as the strength ratio determined using Practice **D245** for a single piece of lumber of the applicable grade.

7.4 Stress Modification Factor in Tension Parallel to the Grain:

7.4.1 The stress modification factor for tension parallel to grain (SMF_t) for each lamination shall be the lower of the two modification factors determined separately on the basis of knots and on the basis of slope of grain as follows:

7.4.2 Knots—The tension stress modification factor for knots ($SMF_{t\ knots}$) shall be determined as follows:

$$SMF_{t\ knots} = 1 - Y_2 \quad (11)$$

where:

- $SMF_{t\ knots}$ = tensile stress modification factor, and
 Y_2 = maximum edge knot size permitted in the grade expressed in a decimal fraction of the dressed width of the wide face of the piece of lumber used for the lamination. Centerline knot size for visually graded laminations shall be limited to that resulting in an equivalent edgewise bending strength ratio as determined by Practice **D245**.

7.4.3 Slope of Grain—The tension stress modification factor for each lamination shall be as given in **Table 4**.

7.5 Modulus of Elasticity (E)—When *LSE* is determined by test methods other than those described in **3.1.6.1**, then modification factors described in section 4.3 of Practice **D2915** shall be applied.

7.6 Horizontal Shear:

7.6.1 Horizontally Laminated Timbers—The stress modification factor for horizontal shear for laminations in horizontally laminated timbers shall be calculated as the ratio of the wane-free width to total surfaced width. Thus, when wane up to 1/6 of the width is allowed along both edges, the stress modification factor shall be 2/3 .

7.6.2 Vertically Laminated Timbers—For members consisting of four or more laminations, one out of four pieces is assumed to have a check or split that limits its modification factor in shear to 1/2 resulting in a modification factor of the composite of 7/8 . For two and three lamination beams, the modification factor is 3/4 and 5/6 . For vertically laminated timbers composed of 3, 5, 7, or 9 laminations with unbonded edge joints, an additional modification factor of 0.4 shall be applied to each lamination. For all other vertically laminated timbers composed of laminations with unbonded edge joints, an additional modification factor of 0.5 shall be applied to each lamination.

7.7 Compression Perpendicular to Grain and Radial Compression:

7.7.1 A stress modification factor of 1.0 shall be applicable to all laminations.

7.8 Radial Tension:

7.8.1 A stress modification factor of 1.0 shall be applicable to all laminations.

8. Adjustment of Properties for End-Use Conditions

8.1 The allowable properties developed using Sections 6 and 7 are based on normal load duration, 12 % average moisture content conditions, and approximately 68 °F (20 °C) temperatures. Bending stress is for a 12-in. (0.3 m) deep straight beam, uniformly loaded with a 21:1 span-to-depth ratio. Design at other conditions requires modifications.

8.2 *Moisture Content*—Two different moisture conditions are recognized for structural glued laminated timber members: dry service and wet service. Dry service is the use condition where the moisture content of the wood is less than 16 %. Wet service is the use where wood attains moisture contents of 16 % or more. For wet service conditions, properties developed using Sections 6 and 7 shall be multiplied by the appropriate factors given in Table 8.

8.3 *Duration of Load*—Normal load duration contemplates fully stressing a member to its allowable value either continuously or cumulatively for ten years. For other durations of load, all properties except *E* and compression perpendicular to grain are permitted to be increased in accordance with Practice D245. For longer durations of load, all properties except *E* and compression perpendicular to grain shall be decreased in accordance with Practice D245.

8.4 *Flat Use Factor*—For bending members with the load applied parallel to the wide face of the laminations (vertically laminated members), the bending stress shall be adjusted for depths other than 12 in. (0.3 m) by multiplying by $(12/d)^{1/9}$ where *d* is the beam depth, in inches, or $(0.3/d)^{1/9}$ where *d* is the beam depth in metres.

8.5 *Volume Factor*—For bending members with the load applied perpendicular to the wide face of the laminations (horizontally laminated members), the bending stress shall be adjusted for sizes greater than the standard size beam (as defined below) by multiplying by the volume effect factor, C_v , defined as follows:

$$C_v = [5.125/w]^{1/x} [12/d]^{1/x} [21/L]^{1/x} \leq 1.0 \quad (12)$$

where:

- d* = beam depth, in.;
- w* = beam width, in.;
- L* = length of beam between points of zero moment, ft; and
- x* = determined by procedures outlined in Annex A8.

TABLE 8 Wet-Use Adjustment Factors

| Type of Stress | Wet-Use Factor |
|--|----------------|
| Bending | 0.800 |
| Compression parallel to the grain | 0.730 |
| Tension parallel to the grain | 0.800 |
| Modulus of elasticity | 0.833 |
| Horizontal shear | 0.875 |
| Compression perpendicular to the grain | 0.530 |

The standard beam is assumed to be uniformly loaded and is defined as having a depth of 12 in. (0.3 m), a width of 5½ in. (0.13 m) and a length of 21 ft (6.4 m). For other than uniformly loaded members, adjustments for method of loading (Table 9) are necessary.

8.6 *Curvature*—For the curved portion of members, the allowable bending stress shall be reduced by the curvature factor, $C_c = 1 - 2000(t/R)^2$ where *t* is the lamination thickness and *R* is the radius of curvature, both in similar units of measurement. Experience has shown that in order to minimize breakage problems during manufacture, the *t/R* ratio should not exceed 1/100 for hardwoods and southern pine and 1/125 for other softwood species.

8.7 Treated Wood:

8.7.1 Allowable properties associated with pressure preservative treated or fire-retardant treated members, whether the lumber is treated prior to gluing or the entire member is treated following gluing, shall take into account possible reductions due to high temperatures, pressure, or chemical effects associated with the treating process. When reductions are applicable, they shall be based on tests of material subjected to the specific treatment conditions.

8.7.2 Members incised prior to preservative treatment may be subjected to a strength reduction depending on member size and the incision pattern and configuration. Such reductions shall be based on tests of the incised material.

8.8 *Temperature*—Reductions in some allowable properties are applicable when the member is exposed to abnormally high temperatures, especially for extended periods of time, or for exposure combining high temperatures and high moisture content. Increases to some allowable properties may be applicable for members used in continuous cold climatic conditions. See guidelines given in Ref (11).

8.9 *Shear Deflection*—Member *E* values for bending combinations, calculated in accordance with Section 5, are applicable for a 21:1 span-to-depth ratio and assume that up to 5 % of the deflection will be due to shear and about 95 % due to bending when loaded uniformly. Such values may be applied to all loading conditions with span-to-depth ratios greater than 14:1 and the maximum deflection error due to shear will be of the order of 5 % or less. For more precise deflection calculations or for span-to-depth ratios less than 14:1, the effect of shear deflections should be considered separately.

9. Keywords

9.1 clear wood; glulam; lumber; structural glued-laminated timber; timber

TABLE 9 Bending Stress Adjustment Factors for Loading Conditions

| Loading Conditions for Simply Supported Beams | Adjustment Factor |
|---|-------------------|
| Single concentrated load | 1.08 |
| Uniform load | 1.00 |
| Third-point load | 0.97 |

TABLE 10 Adjustment Factors for Span-to-Depth Ratios

| Span-to-Depth Ratio | Adjustment Factor |
|---------------------|-------------------|
| 7 | 1.06 |
| 14 | 1.02 |
| 21 | 1.00 |
| 28 | 0.98 |
| 35 | 0.97 |

ANNEXES

(Mandatory Information)

A1. QUALIFICATION OF LAMINATIONS BY TEST

A1.1 If lumber is to be qualified by test as equivalent to visually graded or *E*-rated laminations, procedures in this section shall be followed. Tests shall include *LSE*, tensile strength, and specific gravity. Values for compression perpendicular to the grain and horizontal shear shall be determined following procedures previously described in this standard.

A1.1.1 Qualification shall be carried out on the size and grade of product for which qualification is desired, except that qualification at a specified width will satisfy qualification requirements for the next smallest width.

A1.1.1.1 If qualification of a width by test is used to qualify the next smaller width, selection criteria for the grade of both widths must be identical.

NOTE A1.1.—As an example, qualification of a 2.0*E*, ½ edge knot grade in nominal 2 by 6 for a tension lamination target will qualify the same grade in 2 by 4 if the same *E* selection levels and edge knot selection criteria are used.

A1.1.1.2 Principles of Practice **D2915** shall be followed in sampling. A sample of 50 or more is required for *E* measurements; a minimum of 58 is required for tensile strength.

A1.2 Qualification by test shall include a flatwise bending modulus of elasticity on a 100:1 span-to-depth ratio (see **3.1.6.2**).

A1.2.1 Qualification tests for *LSE* shall be carried out in accordance with Test Methods **D198** or **D4761**.

A1.2.2 To qualify by *E* criterion, the average *LSE* (*E*) of the sample shall meet the following criteria:

$$(E) [1 + 0.237(COV)] \geq E_o \quad (A1.1)$$

where:

COV = coefficient of variation of *E* in the candidate stock, and

*E*_o = average *LSE* of the target grade for which replacement is sought.

NOTE A1.2.—For example, assume the target grade is 302-24 from *D*. Fir L with an *LSE* of 2.1×10^6 psi. The candidate stock is *MSR* lumber. The *COV* of the qualification sample does not exceed 0.11 as given in the ANSI/AWC NDS. The product of *LSE* of the candidate sample and 1.026 must equal or exceed 2.1×10^6 psi. As a second example, assume the target grade is 302-24 from Hem-Fir SSS with an *LSE* of 1.8×10^6 psi. The candidate stock is visually graded; the *COV* in the NDS for visually graded lumber is 0.25. The product of *LSE* of the candidate stock and 1.059 must equal or exceed 1.8×10^6 psi.

A1.3 Qualification shall include a strength test of full-size laminations in tension.

A1.3.1 Tensile testing procedures shall follow the principles of Test Methods **D198** or **D4761** with a minimum gage length of 8 ft (2.4 m).

A1.3.2 To qualify by tensile strength criteria, the lower tolerance limit of the 5th percentile with 75 % confidence shall be determined from the qualification sample. The analysis procedure of Practice **D2915** shall be followed.

A1.3.3 For tension laminations, the 5th percentile so determined must equal or exceed the following multiple of the allowable bending property of the target grade for which qualification is desired: for beams over 15 in. (0.38 m) deep - 1.67, for beams 12 in. to 15 in. (0.30 m to 0.38 m) deep - 1.50, and for beams less than 12 in. (0.30 m) deep - 1.34.

A1.3.4 For other laminating grades, the 5th percentile shall equal or exceed the 5th percentile of the laminating grade for which replacement is sought.

A2. GLUED LAMINATED TIMBERS MANUFACTURED WITH *E*-RATED LUMBER

A2.1 General

A2.1.1 Glued laminated timbers are permitted to be made with *E*-rated lumber or a combination of *E*-rated lumber and visually graded lumber. For the combination of *E*-rated lumber and visually graded lumber, the visually graded lumber is commonly used in the inner zones or core, but it may be used in any location. *E* rating of lumber is accomplished by several different methods in commercial practice. For laminating, the specific requirements are included in A2.2 and A2.3.

A2.2 *E*-Rated Requirements

A2.2.1 Any method is permitted to be used for sorting *E*-rated lumber provided that quality control requirements ensure that the *LSE* of the lumber meets or exceeds the requirements for the specified grade mean *LSE* and a lower 5th percentile calculated as follows:

$$E_{05} = 0.955 E_{\text{mean}} - 0.233 \quad (\text{A2.1})$$

where:

$$E_{05} = 5^{\text{th}} \text{ percentile } LSE, \text{ in million psi, and}$$

$$E_{\text{mean}} = \text{average } LSE, \text{ in million psi.}$$

A2.3 Visual Grading Requirements

A2.3.1 In addition to the requirements of Section 4, edge characteristics defined as knots, knot holes, burls, or distorted grain located partially or wholly at edges of wide faces must not occupy more of the cross-section than indicated by the grade designation. For example, in a 2.1*E*-1/8 grade, the edge characteristics described above must not exceed one sixth of the cross-section.

A2.4 Designation

A2.4.1 *E*-rated lumber for laminating shall be designated by the *LSE* and the fraction of the cross-section at the edge that may contain the growth characteristics given in A2.3.

A3. SAMPLING OF LUMBER FOR KNOT AND MODULUS OF ELASTICITY DATA

A3.1 Data on knot properties for the grades of lumber to be used are needed in order to determine the design levels for the bending strength of horizontally laminated timbers and to determine compression parallel to grain strength. Data on *LSE* of the lumber is needed in order to calculate stress distributions in beams and to determine the stiffness of the beams. Different levels of sampling are recognized for collecting these data, one during development of a laminating grade and another during the actual use of grade in production of glulam members. Guidelines for sampling material are given in Practice E105. In addition, an alternative method of sampling is given in A3.2.2 when a limited amount of information exists for a particular species of lumber.

A3.2 Knot Data

A3.2.1 Data Collection:

A3.2.1.1 *Development*—During the development of the laminating grade, not less than 100 pieces or 1000 lineal ft (300 m) of lumber randomly chosen from a representative group shall be used as a sample for each grade of lumber. No special selection of the pieces should be made; the only requirement is that they meet the grade but not qualify for a higher grade.

A3.2.1.2 *Confirmation*—After the laminating grade has been put in use, not less than 200 pieces of a grade or –2000 lineal ft (600 m) shall be randomly chosen in at least 20 sampling visits to glulam manufacturers representing at least 75 % of the regional production of that grade. If the grade is being used by four or less glulam manufacturers, it is recommended that at least two visits be made to collect the sample. This confirming survey shall be used to modify, if necessary,

combinations based on the development survey. A3.2.2 of this annex shall be used to evaluate the confirming knot data.

A3.2.1.3 *Use*—After the confirming survey has been made, subsequent surveys shall be conducted at least every three years. The results shall be reviewed in accordance with A3.2.2. Alternatively, a continuous sampling procedure may be used in which knot data are collected on a frequent, periodic basis and the accumulated data reviewed for changes sufficient to require design changes. Accumulated data shall be analyzed at intervals not exceeding two years.

A3.2.1.4 Resampling for knot data is required if knot size measurement or interpretation are changed or if design properties associated with knot data (for example, stress index values, *LSE*) are increased.

A3.2.1.5 Guidelines for measuring knots and for calculating knot properties are given in Annex A6.

A3.2.1.6 Knot data for horizontally laminated combinations must include the average of the sum of all knot sizes within each 1-ft (0.30 m) length, taken at 0.2-ft (0.06 m) intervals, and the determination of the 99.5-percentile knot size.

A3.2.1.7 Knot data for glulam combinations loaded in compression parallel to grain must include the average and the standard deviation for the largest knot size within each 3-ft (0.90 m) length taken at 6-in. (152 mm) intervals.

A3.2.2 *Requirements for Evaluation of New Knot Data*—New knot data is reviewed for acceptance to judge the adequacy of the new data to better represent the target populations. Where knot values are already in use, new data may be presented to substantiate, augment, or replace the