



Designation: ~~C880/C880M—18~~^{ε1} C880/C880M – 23

Standard Test Method for Flexural Strength of Dimension Stone¹

This standard is issued under the fixed designation C880/C880M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

^{ε1} NOTE—In 9.2 the value in brackets was corrected editorially from [4 MPa] to [4 MPa/min] in May 2022.

1. Scope

1.1 This test method covers the procedure for determining the flexural strength of stone by use of a simple beam using quarter-point loading.

1.2 Stone tests shall be made when pertinent for the situation when the load is perpendicular to the bedding plane and when the load is parallel to the bedding plane.

1.3 As required, the flexural tests shall also be conducted under wet conditions.

1.4 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.6 *This international standard was developed in accordance with internationally recognized principles of standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 *ASTM Standards:*²

- E4 Practices for Force Calibration and Verification of Testing Machines
- C119 Terminology Relating to Dimension Stone
- C1799 Guide to Dimension Stone Test Specimen Sampling and Preparation
- E2586 Practice for Calculating and Using Basic Statistics

3. Terminology

3.1 *Definitions*—All definitions are in accordance with Terminology C119.

¹ This test method is under the jurisdiction of ASTM Committee C18 on Dimension Stone and is the direct responsibility of Subcommittee C18.01 on Test Methods. Current edition approved Oct. 1, 2018; Sept. 1, 2023. Published October 2018; December 2023. Originally approved in 1978. Last previous edition approved in 2015; 2018 as C880/C880M-15-18^{ε1}. DOI: 10.1520/C0880-C0880M-18E01.10.1520/C0880_C0880M-23.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

4. Significance and Use

4.1 This test method is useful in indicating the differences in flexural strength between the various dimension stones. This test method also provides one element in comparing stones of the same type.

5. Apparatus

5.1 *Testing Machine* (Fig. 1), conforming to the requirements of the applicable sections of Practices E4. The quarter-point loading method shall be used in making flexure tests of stone employing bearing blocks which will ensure that forces applied to the beam will be vertical only and applied without eccentricity. The apparatus should be capable of maintaining the span length and distances between load-applying blocks and support blocks constant within ± 0.05 in. [± 1 mm]. The load should be capable of being applied at a uniform rate and in such a manner as to avoid shock.

6. Sampling

6.1 Select the sample to represent a true average of the type or grade of stone under consideration and of the quality supplied to the market under the type designation to be tested. The sample may be selected by the purchaser or his authorized representative from the quarried stone or taken from the natural ledge and shall be of adequate size to permit the preparation of the desired number of test specimens. When perceptible variations occur, the purchaser may select as many samples as are necessary for determining the variations in flexural strength.


NOTE 1—Refer to Guide C1799 for additional information on selecting, preparing, and conditioning test specimens.

7. Test Specimen

7.1 The test specimens shall measure 4 in. [100 mm] wide by 1.25 in. [30 mm] thick by 15 in. [350 mm] long, with a span as tested of 12.5 in. [300 mm]. The sides of the specimen shall be at right angles with the top and bottom. The specimens shall have a fine abrasive finish on the planes perpendicular to the load and a fine saw finish on the other four planes. The dimensions of the specimen shall be measured and recorded to the nearest 0.01 in. [0.1 mm]. A minimum of five specimens shall be tested for each condition of test. The average value of the test results is reported as the flexural strength of the stone.

7.2 Where this test method is specified in the physical requirements of an ASTM C18 Standard Specification for a dimension stone, the test specimens shall meet the requirements under 7.1.

7.3 Where the job thickness has been set (for example, the thickness of the stone panels for the project has been established), it is often requested to perform flexure tests at the job thickness. The following shall govern the specimen size where it is requested to test at the job thickness and the job thickness is other than 1.25 in. [30 mm]. The span as tested shall be 10 times the thickness. The specimen lengths shall be not less than 2 in. [50 mm] and not more than 4 in. [100 mm] greater than the span as tested. Where the thickness is less than 2.67 in. [70 mm], the width of the specimen shall be 4 in. [100 mm]. Where the thickness is greater than 2.67 in. [70 mm] the width shall be 1.5 times the thickness. Where the thickness is other than 1.25 in. [30 mm] and the specimen size is in accordance with the job thickness criteria noted in the foregoing, the average value of the test results shall be reported as the flexural strength of the stone at the job thickness. All other requirements shall be in accordance with 7.1.

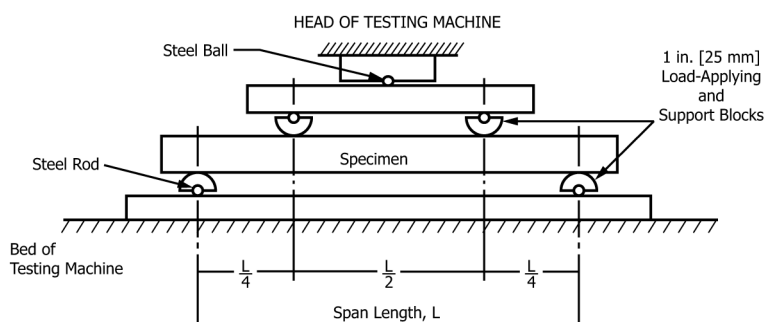

NOTE 1—Apparatus may be used inverted.

FIG. 1 Diagrammatic View of a Suitable Apparatus for Flexure Test of Stone