



Designation: E90 – 23

# Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements<sup>1</sup>

This standard is issued under the fixed designation E90; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

*This standard has been approved for use by agencies of the U.S. Department of Defense.*

## INTRODUCTION

This test method is part of a set for evaluating the sound-insulating properties of building elements. It is designed to measure the transmission of sound through a partition or partition element in a laboratory. Others in the set cover the measurement of sound isolation in buildings (Test Method E336), the laboratory measurement of impact sound transmission through floors (Test Method E492), the measurement of impact sound transmission in buildings (Test Method E1007), the measurement of sound transmission through building facades and facade elements (Guide E966), the measurement of sound transmission through a common plenum between two rooms (Test Method E1414), a quick method for the determination of airborne sound isolation in multiunit buildings (Practice E597), and the measurement of sound transmission through door panels and systems (Test Method E1425).

## 1. Scope

1.1 This test method covers the laboratory measurement of airborne sound transmission loss of building partitions such as walls of all kinds, operable partitions, floor-ceiling assemblies, doors, windows, roofs, panels, and other space-dividing elements.

1.2 Laboratories are designed so the test specimen constitutes the primary sound transmission path between the two test rooms and so approximately diffuse sound fields exist in the rooms.

1.3 *Laboratory Accreditation*—The requirements for accrediting a laboratory for performing this test method are given in Annex A4.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.5 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

*mentations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

## 2. Referenced Documents

2.1 *ASTM Standards*:<sup>2</sup>

- C423 Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method
- C634 Terminology Relating to Building and Environmental Acoustics
- E336 Test Method for Measurement of Airborne Sound Attenuation between Rooms in Buildings
- E413 Classification for Rating Sound Insulation
- E492 Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine
- E966 Guide for Field Measurements of Airborne Sound Attenuation of Building Facades and Facade Elements
- E1007 Test Method for Field Measurement of Tapping Machine Impact Sound Transmission Through Floor-Ceiling Assemblies and Associated Support Structures
- E1111 Test Method for Measuring the Interzone Attenuation of Open Office Components
- E1289 Specification for Reference Specimen for Sound Transmission Loss

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee E33 on Building and Environmental Acoustics and is the direct responsibility of Subcommittee E33.03 on Sound Transmission.

Current edition approved Dec. 1, 2023. Published January 2024. Originally approved in 1955. Last previous edition approved in 2016 as E90 – 09 (2016). DOI: 10.1520/E0090-23.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

**E1332** Classification for Rating Outdoor-Indoor Sound Attenuation

**E1414** Test Method for Airborne Sound Attenuation Between Rooms Sharing a Common Ceiling Plenum

**E1425** Practice for Determining the Acoustical Performance of Windows, Doors, Skylight, and Glazed Wall Systems

**E2235** Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods

**E3091** Specification for Systems to Measure Sound Levels  
2.2 *ANSI Standards*.<sup>3</sup>

**ANSI/ASA S1.6-2016** American National Standard Preferred Frequencies, Frequency Levels, and Band Numbers for Acoustical Measurement

**ANSI/ASA S1.11-2014, Part 1/IEC 61260-1:2014 (R2019)** Specification for Octave-Band and Fractional-Octave-Band Analog and Digital Filters

**ANSI/ASA S1.40-2006** Specifications and Verification Procedures for Sound Calibrators

2.3 *IEC Standards*.<sup>4</sup>

**IEC 60942:2003** Electroacoustics—Sound Calibrators

**IEC 60942:2017** Electroacoustics—Sound Calibrators

**IEC 61672-1:2013** Electroacoustics—Sound Level Meters—Part 1: Specifications

**IEC 61672-3:2013** Electroacoustics—Sound Level Meters—Part 3: Periodic tests

2.4 *ISO Standards*.<sup>5</sup>

**ISO 717-1:2013** Acoustics — Rating of sound insulation in buildings and of building elements — Part 1: Airborne sound insulation

**ISO 3741:2010** Acoustics — Determination of sound power levels and sound energy levels of noise sources using sound pressure — Precision methods for reverberation test rooms

### 3. Terminology

3.1 Terms used in this standard are defined either in Terminology **C634** or within this standard. The definition of terms explicitly given within this standard take precedence over definitions given in Terminology **C634**. The definitions within the terminology section of Terminology **C634** and this standard take precedence over any other definitions found in any other documents, including documents that are referenced in this standard.

3.1.1 For the purposes of this test method, sound transmission loss is operationally defined as the difference in decibels between the average sound pressure levels in the reverberant source and receiving rooms, plus ten times the common logarithm of the ratio of the area of the common partition to the sound absorption in the receiving room (see **Eq 5**).

NOTE 1—Sound transmission coefficient and sound transmission loss

<sup>3</sup> Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

<sup>4</sup> Available from International Electrotechnical Commission (IEC), 3 rue de Varembe, Case postale 131, CH-1211, Geneva 20, Switzerland, <http://www.iec.ch>.

<sup>5</sup> Available from International Organization for Standardization (ISO), ISO Central Secretariat, Chemin de Blandinnet 8, CP 401, 1214 Vernier, Geneva, Switzerland, <https://www.iso.org>.

are related by either of the two equations:

$$TL = 10 \log(1/\tau) \quad (1)$$

$$\tau = 10^{-TL/10} \quad (2)$$

#### 3.2 Definitions of Terms Specific to This Standard:

3.2.1 The following terms are either not defined in the terminology section of Terminology **C634** or have definitions in this document different from those stated in the terminology section of Terminology **C634**.

3.2.2 *average sound pressure level,  $L_p$ , (dB),  $n$ —(1)* in a specified frequency band within a defined measurement region, a continuous time-averaged sound pressure level measured with a moving microphone; (2) for several related time-averaged sound pressure levels measured at different positions for the same length of time either simultaneously or sequentially, ten times the base 10 logarithm of the arithmetic mean of the squared ratios of acoustic pressure to reference pressure (20  $\mu$ Pa) from which the individual sound pressure levels were derived.

3.2.3 *outdoor-indoor transmission class, OITC,  $n$ —of a building façade or façade element*, a single-number rating calculated in accordance with Classification **E1332** using values of sound transmission loss (TL).

### 4. Summary of Test Method

4.1 Two adjacent reverberation rooms are arranged with an opening between them in which the test partition is installed. Care is taken that the only significant sound transmission path between rooms is by way of the test partition. An approximately diffuse sound field is produced in one room, the source room. Sound incident on the test partition causes it to vibrate and create a sound field in the second room, the receiving room. The space- and time-averaged sound pressure levels in the two rooms are determined. In addition, with the test specimen in place, the sound absorption in the receiving room is determined. The sound pressure levels in the two rooms, the sound absorption in the receiving room and the area of the specimen are used to calculate sound transmission loss as shown in Section **11**. Because sound transmission loss is a function of frequency, measurements are made in a series of frequency bands.

4.2 In theory, it is not important which room is designated as the source and which as the receiving room. In practice, different values of sound transmission loss may be measured when the roles are reversed. To compensate for this, the entire measurement may be repeated with the roles reversed; the source room becomes the receiving room and vice versa. The two sets of sound transmission loss values are then averaged to produce the final result for the laboratory.

4.3 Additional procedures that may be followed when testing doors are given in Test Method **E1425**.

### 5. Significance and Use

5.1 Sound transmission loss as defined in Terminology **C634**, refers to the response of specimens exposed to a diffuse incident sound field, and this is the test condition approached by this laboratory test method. The test results are therefore most directly relevant to the performance of similar specimens

exposed to similar sound fields. They provide, however, a useful general measure of performance for the variety of sound fields to which a partition or element may typically be exposed.

5.2 In laboratories designed to satisfy the requirements of this test method, the intent is that only significant path for sound transmission between the rooms is through the test specimen. This is not generally the case in buildings where there are often many other paths for sounds—*flanking sound transmission*. Consequently sound ratings obtained using this test method do not relate directly to sound isolation in buildings; they represent an upper limit to what would be measured in a field test.

5.3 This test method is not intended for field tests. Field tests shall be performed according to Test Method [E336](#).

NOTE 2—The comparable quantity measured using Test Method [E336](#) is called the apparent sound transmission loss because of the presence of flanking sound transmission.

## 6. Test Rooms

6.1 The test rooms shall be so constructed and arranged that the test specimen constitutes the only important transmission path between them. Laboratories must investigate their flanking limit and prepare a report as described in [Annex A5](#).

6.2 The spatial variations of sound pressure level measured in the each room shall be such that the precision requirements in [Annex A2](#) are satisfied at all frequencies.

6.3 *Volume of Rooms*—The minimum volume of each room is 80 m<sup>3</sup>.

NOTE 3—See [Appendix X1](#) for recommendations for new construction.

6.4 *Room Absorption*—The sound absorption in the receiving room should be low to achieve the best possible simulation of the ideal diffuse field condition, and to minimize the region dominated by the direct field of the test specimen. In the frequency range that extends from  $f = 2000/V^{1/3}$  to 2000 Hz, the absorption in the receiving room (as furnished with diffusers) should be no greater than:

$$A = V^{2/3}/3 \quad (3)$$

where:

$V$  = the room volume, m<sup>3</sup>, and

$A$  = the sound absorption of the room, m<sup>2</sup>.

6.4.1 For frequencies below  $f = 2000/V^{1/3}$ , somewhat higher absorption may be desirable to accommodate requirements of other test methods (for example, ISO 3741); in any case, the absorption should be no greater than three times the value given by [Eq 3](#).

NOTE 4—For frequencies above 2000 Hz, atmospheric absorption may make it impossible to avoid a slightly higher value than that given in [Eq 3](#).

6.5 Unless otherwise specified, the average temperatures in each room during all acoustical measurements shall be in the range  $22 \pm 5^\circ\text{C}$  and the average relative humidity shall be at least 30 %.

6.5.1 When testing specimens with temperature sensitive materials, such as systems that incorporate laminated glass, the

average temperature of the specimen and in each room during all acoustical measurements shall be in the range  $22 \pm 2^\circ\text{C}$ .

NOTE 5—The sound damping properties of viscoelastic substrates between panels (glass, metal, etc.) and of viscoelastic materials used to mount glass often depend on temperature. This requirement minimizes any effects this has on measured sound transmission loss.

6.6 During the sound pressure level and the corresponding sound absorption measurements, variations in temperature and humidity in the receiving room shall not exceed 3°C and 3 % relative humidity respectively. Temperature and humidity shall be measured and recorded as often as necessary to ensure compliance.

6.6.1 If a relative humidity of at least 30 % can not be maintained in the receiving room, users of the test method shall verify by calculation that changes in the  $10 \log A_0$  term (see [11.1](#)) due to changes in temperature and humidity do not exceed 0.5 dB.

NOTE 6—Procedures for calculating air absorption are described in Test Method [C423](#).

## 7. Test Specimens

7.1 *Size and Mounting*—Any test specimen that is to typify a wall or floor shall be large enough to include all the essential constructional elements in their normal size, and in a proportion typical of actual use. The minimum dimension (excluding thickness) shall be 2.4 m, except that specimens of doors, office screens, and other smaller building elements shall be their customary size. Preformed panel structures should include at least two complete modules (panels plus edge mounting elements), although single panels can be tested. In all cases the test specimen shall be installed in a manner similar to actual construction, with a careful simulation of normal constraint and sealing conditions at the perimeter and at joints within the field of the specimen. Detailed reporting and installation procedures for particular types of building separation elements are given in [Annex A1](#).

7.2 *Office Screens*—The minimum area of an office screen specimen shall be 2.3 m<sup>2</sup>. Testing an office screen according to this test method is only appropriate when the property of interest is sound transmission through the main body of the screen. Screens that incorporate electrical raceways may allow sound to pass through easily in this region. Such parts of an office screen shall be included as part of the specimen. For a complete test of the screen as a barrier, including the effects of diffraction and leakage, Test Method [E1111](#) is recommended.

7.3 *Operable Door Systems*—Measurements may be in accordance with Test Method [E1425](#) to evaluate door systems in the operable and fully sealed state, and to measure the force required to operate the door.

## 8. Test Signal Sound Sources

8.1 *Signal Spectrum*—The sound signals used for these tests shall be random noise having a continuous spectrum within each test frequency band.

8.2 *Sound Sources*—Sound sources shall consist of one or more loudspeakers in an enclosure.

NOTE 7—Sources should preferably be omnidirectional at all measurement frequencies to excite the sound field in the room as uniformly as possible. Using separate loudspeakers for high and low frequencies will make the system more omnidirectional. Aiming the loudspeakers into corners of the room can reduce the direct field from the loudspeaker system. An approximation to an omnidirectional speaker system can be obtained by mounting an array of loudspeakers on the faces of a polyhedron (cube, octahedron, dodecahedron, etc.). Sources in trihedral corners of the room excite room modes more effectively and laboratory operators may find that this orientation increases the low frequency sound pressure levels in the room.

8.3 *Multiple Sound Sources*—If a laboratory chooses to use multiple sound sources at different locations in the room simultaneously, they shall be driven by separate random noise generators and amplifiers.

NOTE 8—Measured values of sound transmission loss, especially at low frequencies, may change significantly when sound source position is changed. Multiple sound sources driven by uncorrelated noise signals have also been found to reduce the spatial variance of sound pressure level in reverberation rooms and thus make it easier to satisfy the requirements of Annex A2.

## 9. Instrumentation Requirements

9.1 Microphones and analyzers are used to measure average sound pressure levels in the source and receiving rooms and sound decay rates in the receiving room. Various systems of data collection and processing are possible, ranging from a single microphone moving continuously or placed in sequence at several measurement positions to several microphones making simultaneous measurements (see Fig. 1 for two examples). The measurement process must account for spatial and temporal variations of sound pressure level.

9.2 *Microphone Electrical Requirements*—Use microphones that are stable and substantially omni-directional in the frequency range of measurement, with a known frequency response for a random incidence sound field. (A 13-mm (0.5-in.) random-incidence condenser microphone is recom-

mended.) Amplifiers, filters, and electronic circuitry to process microphone signals and perform measurements shall satisfy the requirements of Section 5 and either Section 6 or Subsections 7.1–7.4 of Specification E3091. The system shall also include the ability to measure time-average levels (as required of integrating-averaging sound level meters) as specified in IEC 61672-1:2013, except that A, B, and C weighting networks are not required since one-third octave band filters are used. All microphones used in testing according to this method shall be of the same type.

9.3 *Calibration*—Calibrate each microphone over the whole range of test frequencies as often as necessary to ensure the required accuracy (see IEC 61672-3:2013). A record shall be kept of the calibration data and the dates of calibration.

9.3.1 Calibration checks of the entire measurement system for at least one frequency shall be made at least once during each day of testing. Make the calibration check of the measurement system using an acoustic calibrator that generates a known sound pressure level at the microphone diaphragm and at a known frequency. The class of Calibrator shall be class 1 per ANSI/ASA S1.40-2006, IEC 60942:2003, or IEC 60942:2017.

9.4 *Bandwidth*—The overall frequency response of the filters used to analyze the microphone signals shall, for each test band, conform to the specifications in ANSI S1.11 for a one-third octave band filter set, class 1 or better.

9.4.1 If filtering is applied to the source signals to concentrate the available power in one test band or a few bands, the frequency range of the signal shall always be greater than the frequency range of the microphone filter.

9.5 *Standard Test Frequencies*—Measurements shall be made in all one-third octave bands with mid-band frequencies specified in ANSI S1.11 from 100 to 5000 Hz. For sound transmission loss measurements on building facades, exterior doors or windows, or other building facade elements where the outdoor-indoor transmission class is to be calculated, the minimum frequency range shall be from 80 to 5000 Hz.


NOTE 9—It is desirable in any case that the frequency range be extended to include bands below 125 Hz. Many applications require information on low frequency sound transmission loss and laboratory operators are encouraged to collect and report information down to at least 50 Hz where feasible. Note that larger room volumes are recommended when measuring at lower frequencies (see X1.2).

## 10. Measurement of Average Sound Pressure Levels and Room Sound Absorption

10.1 The microphone system used to obtain the average sound pressure level must satisfy the requirements given in Annex A2.

10.2 *Measurement of Average Sound Pressure Levels,  $L_S$  and  $L_R$* —With the sound sources generating the sound field in one room, the source room, measure the space- and time-averaged sound pressure level in the source room,  $L_S$ , and in the receiving room,  $L_R$ .

10.3 *Adjustment of Average Receiving Room Levels*—With the sound sources not operating, measure the background noise levels in the receiving room for each frequency band at the same microphone positions used to measure  $L_R$ . Make these

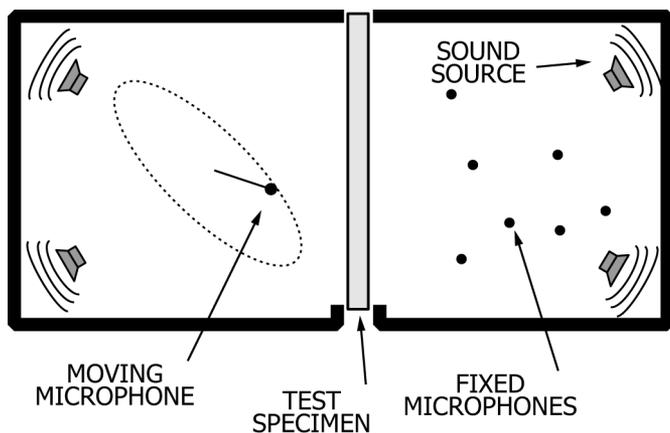

NOTE 1—This figure is not meant to be a design guide but is for illustrative purposes only. As an example, the room on the right has fixed microphones to measure average sound pressure level; the room on the left has a continuously moving microphone to measure average sound pressure level. Usually both rooms will have the same microphone system. The loudspeakers in the rooms generate the incident sound fields for the measurement of level differences or sound decay rates.

FIG. 1 Illustration Showing Conceptual Arrangement of a Wall Sound Transmission Loss Suite

measurements using the same microphone and analyzer gain settings as used for measurements of the received level. This accounts properly for residual noise and the dynamic range in instrumentation.

10.3.1 Average receiving room levels shall be adjusted for background noise interference at each frequency band in accordance with this section. Without any rounding beyond that inherent in the initial recording of the data, calculate the difference between the average background noise level and the average combined level in the receiving room. If the difference is 6 dB or more, the adjusted value of the average receiving room level shall be calculated as follows:

$$L_a = 10 \log [10^{L_r/10} - 10^{L_b/10}] \quad (4)$$

where:

- $L_b$  = the average background noise level in each band, dB,
- $L_R$  = the average receiving room level (level of combined signal and background noise), dB, and
- $L_a$  = the adjusted average receiving room level, dB.

10.3.2 If the difference between the average background noise level and the average combined level in the receiving room is less than 6 dB, then subtract 1.26 dB from the receiving room level and use the result as the adjusted average receiving room level. In this case, the measurements shall only be used to provide an estimate of the lower limit of the sound transmission loss or other derivative result. Identify such measurements in the test report.

NOTE 10—Noise measured by the microphone system in the receiving room when the sound sources are not operating may be due to extraneous acoustical sources or to electrical noise in the receiving system, or both.

10.4 *Determination of Receiving Room Absorption,  $A_R$* —Measure the mean value of the receiving room absorption at each frequency in accordance with Test Method E2235. The determination of  $A_R$  shall be made with the receiving room in the same condition as for the measurement of  $L_S$  and  $L_R$ . Specifically, the test specimen shall remain in place so its effective absorption (which includes transmission back to the source room) is included. Sound sources used for measuring  $A_R$  shall be present during the measurement of  $L_R$ , so their absorption is present during both measurements.

10.4.1 *Room Coupling*—Because the two test rooms are coupled by the test specimen, it is possible that the decay rate measurements in the receiving room will be influenced by sound energy transmitted into the source room and then back again during the decay process (1).<sup>6</sup> Decay curves may be markedly curved or have two pronounced slopes. To ensure the effect will be small the product  $\tau S$  must be smaller than  $A_S$ , the absorption in the source room, or  $A_R$ , the absorption in the receiving room, or  $d_S/d_R$ , the ratio of decay rates in the two rooms, must be larger than unity. The latter requirement may be met by adding absorption to the source room until no further effect is observed on the measured value of  $d_R$ .

NOTE 11—Additional absorption in the source room is required only during measurement of receiving room absorption. It shall not be present during measurement of  $L_S$  and  $L_R$ .

<sup>6</sup> The boldface numbers in parentheses refer to the list of references at the end of this standard.

10.5 For estimates of the direction-averaged sound transmission loss it is necessary to repeat all measurements with the second room acting as the source. This results in four sets of average sound pressure levels and two sets of room absorptions corresponding to the two directions of sound transmission.

## 11. Calculation

11.1 For the chosen test directions), calculate the sound transmission loss at each frequency  $f$  from:

$$TL(f) = L_S(f) - L_R(f) + 10 \log S/A_R(f) \quad (5)$$

where:

- $TL(f)$  = sound transmission loss, dB,
- $L_S(f)$  = average sound pressure level in the source room, dB,
- $L_R(f)$  = average sound pressure level in the receiving room, dB,
- $S$  = area of test specimen that is exposed in the receiving room,  $m^2$ , and
- $A_R(f)$  = sound absorption of the receiving room with the test specimen in place,  $m^2$  (1).

11.2 When measurements are made in both directions, the final value of sound transmission loss to be reported shall be calculated using:

$$TL(f) = (TL_1(f) + TL_2(f))/2 \quad (6)$$

where  $TL_1(f)$  and  $TL_2(f)$  correspond to the two directions of measurement.

11.2.1 If  $TL_1(f)$  or  $TL_2(f)$  is invalid (for example, because of excessive background noise) then the remaining valid measurement shall be used for  $TL(f)$ . Identify in the test report sound transmission loss values that are not averaged as required in 11.2.

11.3 If a laboratory chooses to use only one direction of measurement, then no averaging is required.

11.4 This test method specifies the use of one-third octave bands for measurement and calculation of sound transmission loss. It does not allow measurement of octave band sound transmission losses because these are very sensitive to the shape of the spectrum in the source room and to the details of the sound transmission loss characteristics of the test panel. In applications where octave band sound transmission loss values,  $TL_{oct}$ , are required, they shall be calculated using the expression:

$$TL_{oct, f_c} = -10 \log \left[ \frac{1}{3} \sum_{B=B_c-1}^{B_c+1} 10^{-TL_B/10} \right] \quad (7)$$

where:

- $f_c$  = preferred octave band mid-band frequency as specified in ANSI S1.6.

11.4.1 The summation is made over three one-third octave band  $TL$  values: one at the frequency  $f_c$  with band number  $B_c$  and the adjacent one-third octave bands, with band numbers  $B_c + 1$  and  $B_c - 1$ . The octave band sound transmission loss values calculated from this expression approximate what would be measured if the spectrum in the source room had the same sound pressure level in each one-third octave band.

## 12. Report

12.1 Include the following information in the test report:

12.1.1 A statement, if true in every respect, that the tests were conducted according to this test method and that detailed test procedures, data for flanking limit tests, repeatability measurements and reference specimen tests are available on request.

12.1.2 A description of the test specimen in accordance with the requirements in **Annex A1**. The description must be sufficiently detailed to identify the specimen, at least for those elements that may affect its sound transmission loss, unless the test sponsor wishes to withhold information of a proprietary nature. A designation and description furnished by the sponsor of the test may be included in the report provided that they are attributed to the sponsor. If some details of the specimen construction are withheld at the sponsor's request, the report shall state this.

12.1.3 The dates of construction and testing.

12.1.4 If the test specimen is a screen, include a statement, if true, that sound transmission through raceways and other penetrations are included in the evaluation.

12.1.5 State clearly whether the sound transmission loss values are for a single direction of measurement or are averages of two directions.

12.1.6 A table of sound transmission loss values rounded to the nearest decibel for the frequency bands required in **9.5** and any other bands measured. These data may also be presented as a graph.

12.1.7 Identify data affected by flanking transmission (**Annex A5**) or background noise.

12.1.8 The temperature and humidity in the rooms during the measurements.

12.1.9 The volumes of the source and receiving rooms.

12.1.10 *Single Number Ratings*:

12.1.10.1 *Sound Transmission Class*—If single number ratings are given, the sound transmission class described in Classification **E413** shall be included.

NOTE 12—The weighted airborne sound reduction indexes described in ISO 717 have a similar purpose to STC. These may also be given.

12.1.10.2 *Outdoor-Indoor Transmission Class*—Where the test specimen maybe used as part of a facade of a building, the Outdoor-Indoor transmission class shall be included. This single number rating is intended to rate the effectiveness of building facade elements at reducing transportation noise intrusion. The rating is described in Classification **E1332**.

## 13. Precision and Bias

13.1 *Precision*—Measurements at one laboratory show that the repeatability standard deviation for complete rebuilds of wood joist floor ranged from about 1.5 to 3.5 dB in the frequency range 125 to 4 kHz. This repeatability includes normal variations in materials but minimal changes in construction techniques. The repeatability standard deviation for re-installation of a concrete slab was about 4.5 dB at 100 Hz and below, about 3 dB from 125 to 630 Hz, and about 1.5 dB above 630 Hz. Repeatability for this test method depends on the specimen type and not enough data have been collected to allow more specific statements. From round robin testing on copies of the reference specimen described in Specification **E1289**, it has been determined that the reproducibility standard deviation is 2 dB or less at all frequencies from 125 to 4000 Hz. Further information can be found in reference **(2)**.

13.2 *Bias*—There is no bias in this test method since the true value is defined by the test method.

## 14. Keywords

14.1 airborne sound transmission loss; flanking transmission; sound transmission coefficient; sound transmission loss

## ANNEXES

### (Mandatory Information)

#### A1. PREPARATION AND DESCRIPTION OF TEST SPECIMENS

##### A1.1 *Scope*:

A1.1.1 This annex gives requirements for the preparation, installation and aging of test specimens and the description of the specimen and materials in the test report. The various types of assemblies and materials are categorized and dealt with in separate sections.

A1.1.2 The intent of fully describing the test specimen is that, given only the test report, some other laboratory would be able to construct a specimen that would be practically identical.

NOTE A1.1—The use of sketches and photographs to clarify descriptions of specimens is highly recommended.

##### A1.2 *Construction*:

A1.2.1 The test specimen may either be built into a suitable frame, which is then inserted in the test opening, or built into the opening itself. Specimens shall be built in accordance with usual construction practice except that extra control procedures may be necessary to ensure maintenance of the specified dimensions. The type of installation and the steps in constructing the specimen (for example, plastering techniques) shall be reported in detail.

A1.2.2 A description of the method of installation of the specimen in the test opening, including the location of framing members relative to the edges, and the treatment of the junction with the test opening shall be given in the test report. The use