
Niskonapetostne varovalke – 2-1. del: Dodatne zahteve za varovalke, ki jih uporabljajo pooblašcene osebe (uporaba varovalk zlasti v industriji) – Oddelki I do V: Primeri tipov standardiziranih varovalk (IEC 60269-2-1:1998, spremenjen)

Low-voltage fuses – Part 2-1: Supplementary requirements for fuses for use by authorized persons (fuses mainly for industrial application) – Sections I to V: Examples of types of standardized fuses (IEC 60269-2-1:1998, modified)

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST HD 630.2.1 S4:2005](https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005)

<https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST HD 630.2.1 S4:2005

<https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>

English version

Low-voltage fuses
Part 2-1: Supplementary requirements for fuses
for use by authorized persons
(fuses mainly for industrial application)
Sections I to V: Examples of types of standardized fuses
(IEC 60269-2-1:1998, modified)

Fusibles basse tension
 Partie 2-1: Règles supplémentaires pour
 les fusibles destinés à être utilisés par
 des personnes habilitées
 (fusibles pour usages essentiellement
 industriels)
 Sections I à V: Exemples de fusibles
 normalisés
 (CEI 60269-2-1:1998, modifiée)

Niederspannungssicherungen
 (NH-System)
 Teil 2-1: Zusätzliche Anforderungen
 an Sicherungen zum Gebrauch durch
 Elektrofachkräfte bzw. elektrotechnisch
 unterwiesene Personen
 (Sicherungen überwiegend für
 den industriellen Gebrauch)
 Hauptabschnitte I bis V: Beispiele von
 genormten Sicherungstypen
 (IEC 60269-2-1:1998, modifiziert)

SIST HD 630.2.1 S4:2005
<https://standards.iteh.ai/catalog/standards/sist/12493831-4ad4-469-0100-e88fc855f557/sist-hd-630-2-1-01-2005>

This Harmonization Document was approved by CENELEC on 2000-01-01. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for implementation of this Harmonization Document on a national level.

Up-to-date lists and bibliographical references concerning such national implementation may be obtained on application to the Central Secretariat or to any CENELEC member.

This Harmonization Document exists in three official versions (English, French, German).

CENELEC members are the national electrotechnical committees of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

CENELEC

European Committee for Electrotechnical Standardization
 Comité Européen de Normalisation Electrotechnique
 Europäisches Komitee für Elektrotechnische Normung

Central Secretariat: rue de Stassart 35, B - 1050 Brussels

Foreword

The text of the International Standard IEC 60269-2-1:1998, prepared by SC 32B, Low-voltage fuses, of IEC TC 32, Fuses, together with common modifications prepared by the CENELEC BTTF 56-2, Low-voltage fuses, was submitted to the Unique Acceptance procedure and was approved by CENELEC as HD 630.2.1 S4 on 2000-01-01.

Two draft amendments to the Harmonization Document, prepared by the CENELEC BTTF 56-2, were submitted to the formal vote and were approved by CENELEC for inclusion in HD 630.2.1 S4 on 2000-08-01.

This Harmonization Document supersedes HD 630.2.1 S3:1998.

The following dates were fixed:

- latest date by which the existence of the HD has to be announced at national level (doa) 2001-02-01
- latest date by which the HD has to be implemented at national level by publication of a harmonized national standard or by endorsement (dop) 2001-08-01
- latest date by which the national standards conflicting with the HD have to be withdrawn (dow) 2003-08-01

This HD 630.2.1 S4:2000 is to be used in conjunction with EN 60269-1:1998 and EN 60269-2:1995.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST HD 630.2.1 S4:2005](https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005)

<https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>

Endorsement notice

The text of the International Standard IEC 60269-2-1:1998 was approved by CENELEC as a Harmonization Document with agreed common modifications as given below.

COMMON MODIFICATIONS

1 General

Replace the note by:

The following fuse systems are standardized in respect to their safety aspects. The National Committees shall select at least one complete section of this standard for their standards. The time current characteristics "gD" and "gN" are only relevant for Section V.

Section I – Fuses with fuse-links with blade contacts

1.1 Scope

Insert "see Figure 3(l)" *after* "replacement handle".

Add:

Additional requirements to fuses with fuse-links having gripping-lugs made of insulating material or metallic gripping-lugs fixed in insulating material are also defined in the following.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

2 Definitions

Add to the definitions of EN 60269-1:

[SIST HD 630.2.1 S4:2005](https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005)

2.1.12 <https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>
linked fuse-carrier

a fuse-carrier which is mechanically linked to the fuse-base and gives a defined insertion and withdrawal movement to the fuse-link

NOTE See also EN 60947.

2.1.13

gripping-lugs

the parts of a fuse-link which are engaged with the replacement handle or fuse-carrier. Gripping-lugs may be made of metal or insulating material. Metal gripping-lugs may be live or not live under service conditions

2.1.13.1

live gripping-lugs

metal gripping-lugs electrically connected to the blade contacts of the fuse-link. Metal gripping-lugs without electrical contact to the blade contacts are also deemed to be live in case of inadequate creepage distances and clearances according to this standard

2.1.13.2

isolated gripping-lugs

not-live gripping-lugs made of insulating material or metal. If they are made of metal the required creepage distances and clearances according to the relevant overvoltage category shall be met between the gripping-lugs and the blade contacts as well as between the gripping-lugs and the fuse-base contacts

5.2 Rated voltage

Add:

The rated voltage of fuse-bases according to Figure 2(l) is 690 V.

5.3.1 Rated current of the fuse-link

Add:

A rated current of 224 A is added to the values as given in 5.3.1 of EN 60269-1.

5.6.3 Gates

Add the following values for 224 A in Table III:

1	2	3	4	5
I_n for "gG" A	I_{min} (10 s) ^{***} A	I_{max} (5 s) ^{***} A	I_{min} (0,1 s) A	I_{max} (0,1 s) A
224	680	1 450	2 240	3 980

6.2 Markings of fuse-links

Add:

iTeh STANDARD PREVIEW

Fuse-links with isolated gripping-lugs shall be marked in a place easily visible from the front with the graphical symbol of a gripping-lug in a square.

NOTE See Figure 12(l) for detailed dimensions of the symbol.

<https://standards.itih.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>

7.1.2 Connections, including terminals

Replace table D by the following table for sizes 00 to 2:

Table D — Minimum cross-sectional ranges of unprepared conductors

Size	Range of the rated currents of the fuse-links A	Cross-sectional area ranges mm ²	
		Cu	Al
00	6 to 160	6 to 70	25 to 95
0*	6 to 160	6 to 70	25 to 95
1	80 to 250	25 to 120	35 to 150
2	125 to 400	50 to 240	70 to 300

* Not allowed for new installations except for fuse-links with strikers.

7.1.3 Fuse-contacts

Replace the second sentence by:

If the surface plating of the blade contacts of a fuse-link is other than silver the test according to 8.10 has to be passed with dummies described in 8.10.1.

Add the following note:

NOTE If fuse-links are intended to be removed or inserted under load the construction of the fuse, in particular the fuse-contacts, should be suitable for this purpose.

Add the following subclause:

7.1.5 Construction of fuse-bases

The dynamic short-circuit withstand of the fuse shall - whenever needed -, meet the cut-off currents as given in Table G.

Fuse-bases shall meet the temperature rise test according to 8.3 including all protective covers intended to be used.

7.1.7 Construction of a fuse-link

Add:

Electrically conductive parts of indicators shall not be ejected from the fuse-link during operation.

7.2 Insulating properties

Add:

iTeh STANDARD PREVIEW

The creepage distances and clearances of the fuses and fuse-accessories shall at minimum meet the requirements of IEC 60664-1 for overvoltage category III and pollution degree 3. The minimum clearances are also applicable to metal parts which are not permanently live but may be touched. They shall not be diminished during replacement of the fuse-link. The creepage distances between isolated metal gripping lugs and live parts are chosen according to the rated voltage divided by $\sqrt{3}$.

For insulation stressed only for a short time the creepage distances of isolated metal gripping lugs corresponding to two voltage steps lower may be used.

Insulating parts of the fuse-base supporting live parts have to pass the test at PTI 500 M according to IEC 60112 on five specimens.

7.7 I^2t characteristics

Add the following values for 224 A in Table VI:

I_n for "gG" A	I^2t_{min} $10^3 \times (A^2s)$	I^2t_{max} $10^3 \times (A^2s)$
224	200	520

7.9 Protection against electric shock

Add:

Operation of the fuse-links is considered safe when carried out by authorized persons, instructed in electrical matters, using replacement handles according to this standard or linked fuse-carriers. Insulating covers and/or phase separators may be used where applicable.

8.1.4 Arrangement of the fuse and dimensions

Add:

The requirements of 7.2 are verified on fuse-bases. The fuse-bases are connected to conductors having the minimum and maximum cross-sections of the range as given in Table D.

In case of isolated metal gripping-lugs the creepage distances and clearances of the fuse-link according to 7.2 are verified. The clearances are also verified on a fuse-link inserted into a model fuse-base according to Figure 11(I).

8.2.2 Points of application of the test voltage

Add:

e) between isolated metal gripping-lugs and the terminals of the test fuse-base.

8.2.3 Value of test voltage

Add:

The insulating properties of isolated gripping-lugs may optionally be verified by an impulse withstand voltage test. The relevant rated impulse withstand voltage is given in Table O with reference to the rated voltage of the fuse-link.

Table O — Rated impulse withstand voltage
(standards.iteh.ai)

Rated voltage V	Rated impulse withstand voltage kV
400	4
500	4
690	6

8.2.4 Test method

Add the following subclause:

8.2.4.3 Three impulses of both polarities and of the shape 1,2/50 according to IEC 60060-1 and at the rated withstand voltage level according to table O are applied to the test object. The minimum period between the impulses shall be 1 s.

NOTE 1 If not otherwise specified the impedance of the impulse generator shall not exceed 500 Ω.

NOTE 2 See IEC 60060-1, IEC 60060-3 and IEC 60060-4 for detailed description of the test equipment.

8.2.5 Acceptability of test results

Add the following subclause:

8.2.5.3 No flash-over or puncture shall occur during the test. Partial discharges are ignored.

Fuse-links with metal gripping-lugs without electrical contact to the blade contacts which do not comply with the requirements of 7.2 are not considered as isolated in service. They need, however, to fulfil the requirements of 8.9.2 and 8.11.1.8.

Add the following subclause:

8.2.6 Resistance to tracking

The test of fuse-links and -bases is carried out according to IEC 60112 using test solution B. Five specimens shall be tested and shall pass at PTI 500 M. Ceramic isolators need not be tested.

8.3.1 Arrangement of the fuse

Add:

In case the test arrangement contains more than one fuse the test specimens are mounted in conventional service position on a wooden plate at a distance between center lines of 3 e₂ according to Figure 1(I).

Copper bars as used for 500 A to 1250 A test currents are painted mat black.

8.3.2 Measurement of the temperature rise

Add:

Protective covers and fuse-carriers as provided by the manufacturer are mounted.

8.4.3.1 Verification of conventional non-fusing and fusing current

Add:

ITIH STANDARD PREVIEW
 (standards.iteh.ai)

In case the non-fusing current test is also used for the verification of the time current characteristic a second test specimen shall be used for b).

SIST HD 630.2.1 S4:2005
<https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>

8.5.5.1 Verification of the peak withstand current of a fuse-base

Add at the end of the first sentence:

... or if the minimum withdrawal forces according to 8.11 are exceeded.

8.5.8 Acceptability of test results

Add the following note:

NOTE The fuse or circuit breaker for protection of the source must not operate during this test.

8.7.4 Verification of overcurrent discrimination

Add the following values for 224 A in Table H:

I _n A	Minimum pre-arcing I ² t		Maximum operating I ² t		Discrimination ratio
	Prospective I r.m.s. kA	I ² t A ² s	Prospective I r.m.s. kA	I ² t A ² s	
224	5,900	139 000	10,200	412 000	1 : 1,6

8.11.2.3 Verification of resistance to rusting

Add the following subclauses:

8.11.2.3.1 The test shall be carried out according to EN ISO 6988 with cyclic moist atmosphere containing 0,2 % SO₂ (SFW 0,2 S); number of cycles: 1.

For reasons of test economy this test may be carried out on the test samples used for the non-deterioration test of contacts according to subclause 8.10 after completion of the test.

8.11.2.3.2 The following test is an optional test to be agreed between manufacturer and customer. It considers severe environmental conditions.

Fuse-links and fuse-bases intended to be used in an environment of pollution degree ≥ 3 according to IEC 60664-1 shall be tested with SFW 2,0 S for 5 cycles. They shall be marked accordingly.

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST HD 630.2.1 S4:2005](https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005)


<https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>

Figures

Figure 1(l) Replace the first table of Figure 1(l) for "gG" by:

Size	gG					
	AC 400 V		AC 500 V		AC 690 V	
	I_n A	P_n W	I_n A	P_n W	I_n A	P_n W
00	100/160	5,5/12	100/160	7,5/12	100	12
0	160	12	160	16	100	25
1	250	18	250	23	200	32
2	400	28	400	34	315	45
3	630	40	630	48	500	60
4	-	-	1 000	90	800	90
4a	1 250	90	1 250	110	1000	110

Figure 4(l) Add the time-current on for $I_n = 224$ A.

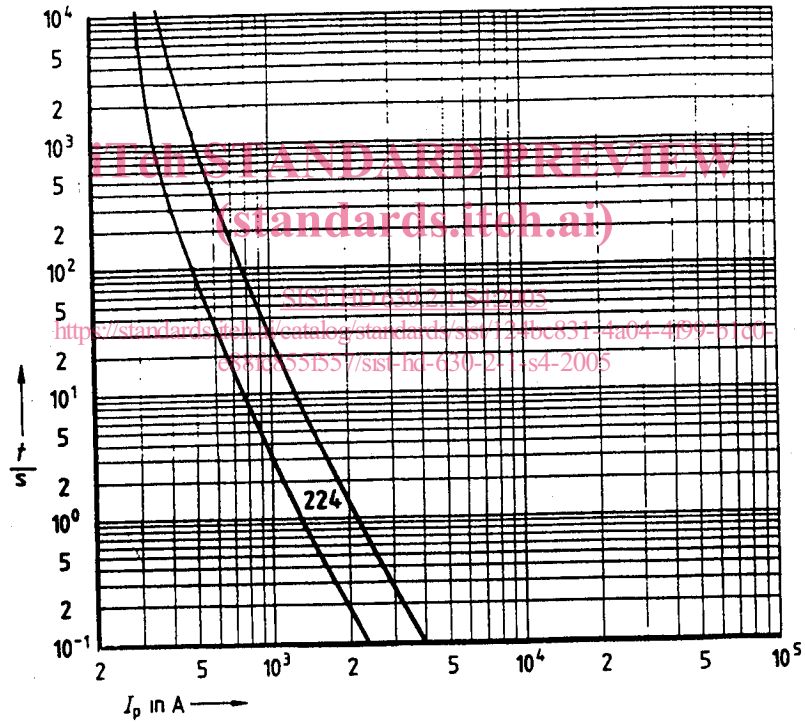

Add the following figures:


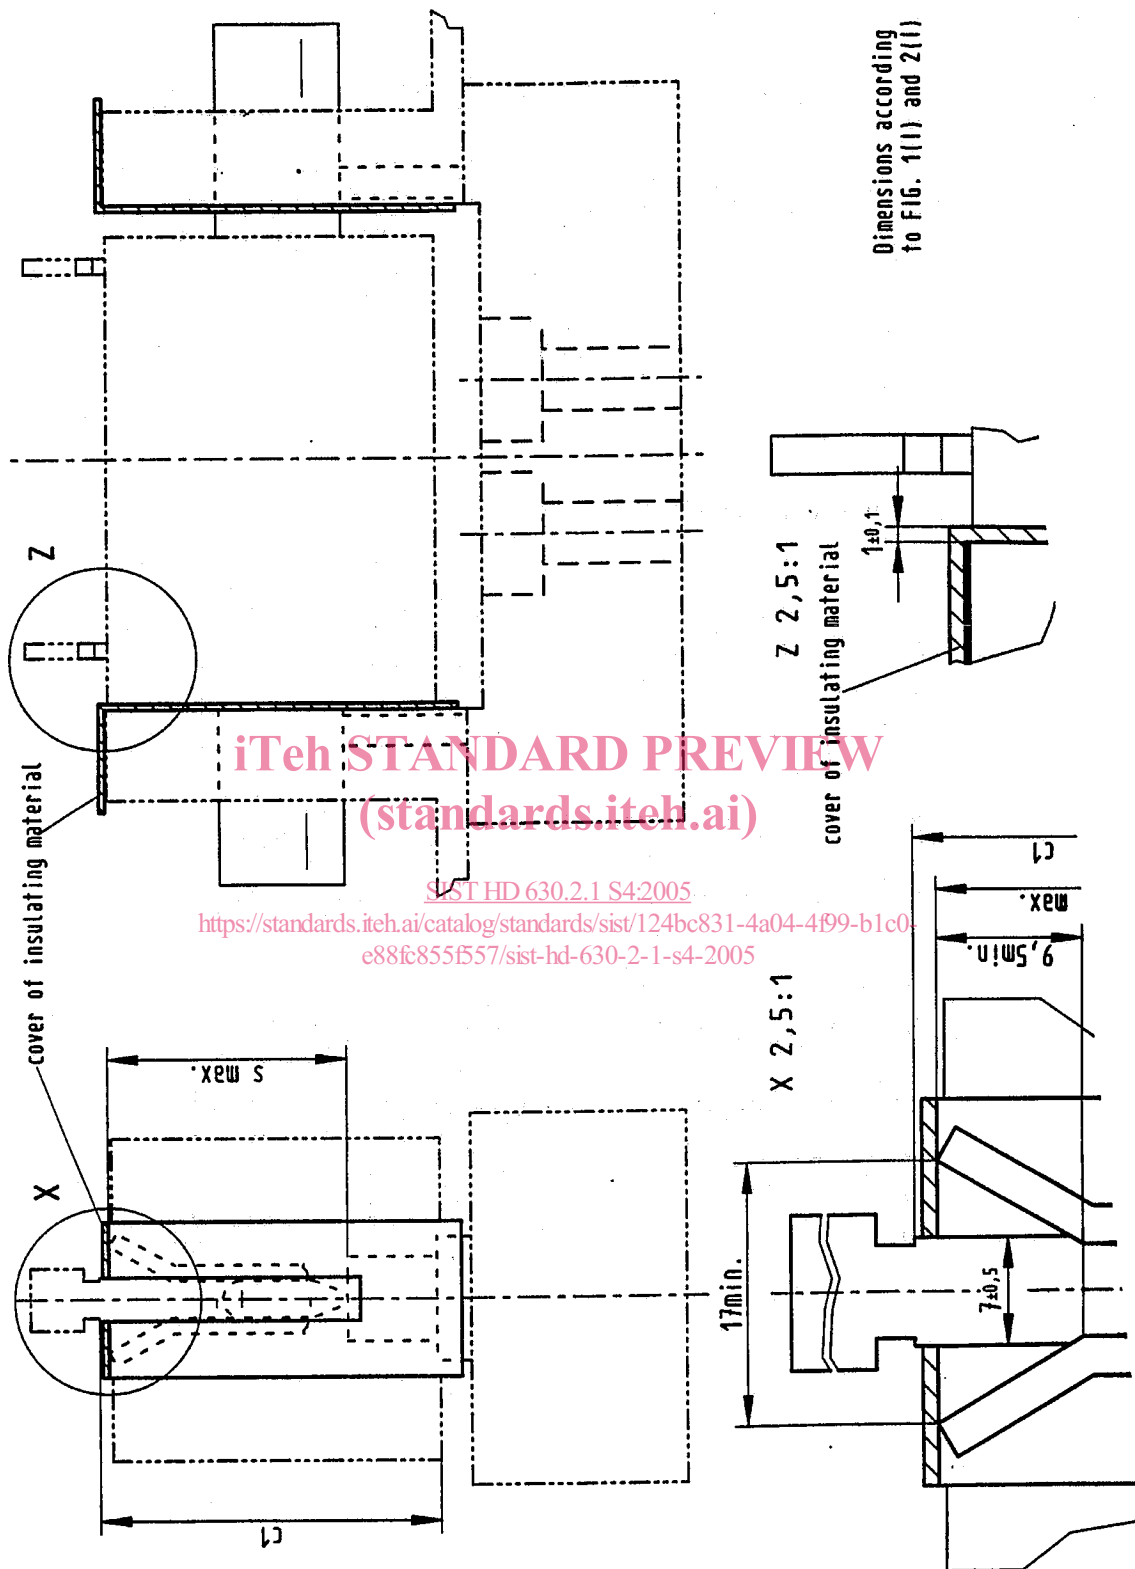


Figure 11(I) — Reference fuse-base

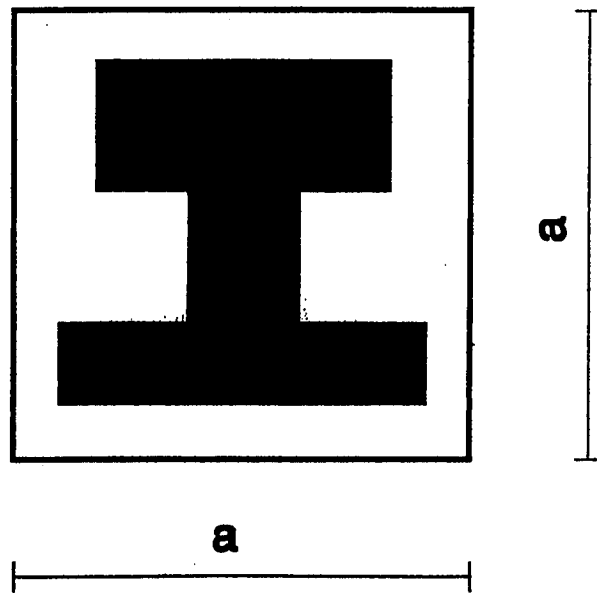

$a \geq 3 \text{ mm}$

Figure 12(l) — Design mark for isolated gripping-lugs
ITeH STANDARD PREVIEW
(standards.iteh.ai)

[SIST HD 630.2.1 S4:2005](https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005)

<https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST HD 630.2.1 S4:2005](#)

<https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-e88fc855f557/sist-hd-630-2-1-s4-2005>

NORME
INTERNATIONALE
INTERNATIONAL
STANDARD

CEI
IEC

60269-2-1

Edition 3.2

2002-04

Edition 3:1998 consolidée par les amendements 1:1999 et 2:2002
Edition 3:1998 consolidated with amendments 1:1999 and 2:2002

Fusibles basse tension –

Partie 2-1:

**Règles supplémentaires pour les fusibles
destinés à être utilisés par des personnes**

**habilitées (fusibles pour usages
essentiellement industriels) –**

Sections I à VI: Exemples de fusibles normalisés

[SIST HD 630.2.1 S4:2005](https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-c86c655297/sist-hd-630-2-1-s4-2005)

[https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-](https://standards.iteh.ai/catalog/standards/sist/124bc831-4a04-4f99-b1c0-c86c655297/sist-hd-630-2-1-s4-2005)

Low-voltage fuses –

Part 2-1:

**Supplementary requirements for fuses
for use by authorized persons**

(fuses mainly for industrial application) –

**Sections I to VI: Examples of types of
standardized fuses**

© IEC 2002 Droits de reproduction réservés — Copyright - all rights reserved

Aucune partie de cette publication ne peut être reproduite ni
utilisée sous quelque forme que ce soit et par aucun procédé,
électronique ou mécanique, y compris la photocopie et les
microfilms, sans l'accord écrit de l'éditeur.

No part of this publication may be reproduced or utilized in
any form or by any means, electronic or mechanical,
including photocopying and microfilm, without permission in
writing from the publisher.

International Electrotechnical Commission
Telefax: +41 22 919 0300

e-mail: inmail@iec.ch

3, rue de Varembe Genève, Switzerland
IEC web site <http://www.iec.ch>



Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

CODE PRIX
PRICE CODE **XF**

*Pour prix, voir catalogue en vigueur
For price, see current catalogue*