

INTERNATIONAL STANDARD

NORME INTERNATIONALE

BASIC EMC PUBLICATION
PUBLICATION FONDAMENTALE EN CEM

**Electromagnetic compatibility (EMC) –
Part 4-34: Testing and measurement techniques – Voltage dips, short
interruptions and voltage variations immunity tests for equipment with mains
current more than 16 A per phase**

**Compatibilité électromagnétique (CEM) –
Partie 4-34: Techniques d'essai et de mesure – Essais d'immunité aux creux de
tension, coupures brèves et variations de tension pour matériel ayant un
courant d'alimentation de plus de 16 A par phase**





THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2009 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC online collection - oc.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 18 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Recherche de publications IEC -

webstore.iec.ch/advsearchform

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études, ...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC online collection - oc.iec.ch

Découvrez notre puissant moteur de recherche et consultez gratuitement tous les aperçus des publications. Avec un abonnement, vous aurez toujours accès à un contenu à jour adapté à vos besoins.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 000 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.



IEC 61000-4-34

Edition 1.1 2009-11
CONSOLIDATED VERSION

INTERNATIONAL STANDARD

NORME INTERNATIONALE

BASIC EMC PUBLICATION
PUBLICATION FONDAMENTALE EN CEM

**Electromagnetic compatibility (EMC) –
Part 4-34: Testing and measurement techniques – Voltage dips, short
interruptions and voltage variations immunity tests for equipment with mains
current more than 16 A per phase**

**Compatibilité électromagnétique (CEM) –
Partie 4-34: Techniques d'essai et de mesure – Essais d'immunité aux creux de
tension, coupures brèves et variations de tension pour matériel ayant un
courant d'alimentation de plus de 16 A par phase**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 33.100.20

ISBN 2-8318-1049-2

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	4
INTRODUCTION.....	6
1 Scope	7
2 Normative references	7
3 Terms and definitions	8
4 General	9
5 Test levels.....	9
5.1 Voltage dips and short interruptions	10
5.2 Voltage variations (optional)	11
6 Test instrumentation	13
6.1 Test generator	13
6.2 Power source	14
7 Test set-up	14
8 Test procedures	14
8.1 Laboratory reference conditions	15
8.2 Execution of the test	15
9 Evaluation of test results	18
10 Test report	18
Annex A (normative) Test generator current drive capability	19
Annex B (informative) Electromagnetic environment classes	21
Annex C (informative) Vectors for three-phase testing	22
Annex D (informative) Test instrumentation	28
Annex E (informative) Dip immunity tests for equipment with large mains current	31
Bibliography	33
Figure 1 – Voltage dip – 70 % voltage dip sine wave graph.....	12
Figure 2 – Voltage variation	12
Figure 3a – Phase-to-neutral testing on three-phase systems	17
Figure 3b – Phase-to-phase testing on three-phase systems – Acceptable Method 1 phase shift.....	17
Figure 3c – Phase-to-phase testing on three-phase systems – Acceptable Method 2 phase shift.....	17
Figure 3d – Not acceptable – phase-to-phase testing without phase shift	17
Figure A.1 – Circuit for determining inrush current drive capability	20
Figure C.1 – Phase-to-neutral dip vectors.....	22
Figure C.2 – Acceptable Method 1 – phase-to-phase dip vectors	24
Figure C.3 – Acceptable Method 2 – phase-to-phase dip vectors	26
Figure D.1 – Schematic of example test instrumentation for voltage dips and short interruptions using tapped transformer and switches.....	28

Figure D.2 – Applying the example test instrumentation of Figure D.1 to create the Acceptable Method 1 vectors of Figures C.1, C.2, 4a and 4b.....	29
Figure D.3 – Schematic of example test instrumentation for three-phase voltage dips, short interruptions and voltage variations using power amplifier.....	30
Table 1 – Preferred test level and durations for voltage dips.....	10
Table 2 – Preferred test level and durations for short interruptions.....	11
Table 3 – Timing of short-term supply voltage variations.....	11
Table 4 – Generator specifications.....	13
Table A.1 – Minimum peak inrush current capability.....	19
Table C.1 – Vector values for phase-to-neutral dips.....	23
Table C.2 – Acceptable Method 1 – vector values for phase-to-phase dips.....	25
Table C.3 – Acceptable Method 2 – vector values for phase-to-phase dips.....	27

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 61000-4-34:2005](#)

<https://standards.iteh.ai/catalog/standards/iec/5efe4d8c-6d1c-40c2-9e17-97a22113d02b/iec-61000-4-34-2005>

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ELECTROMAGNETIC COMPATIBILITY (EMC) –

**Part 4-34: Testing and measurement techniques –
Voltage dips, short interruptions and voltage variations immunity tests
for equipment with mains current more than 16 A per phase**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This consolidated version of the official IEC Standard and its amendment has been prepared for user convenience.

IEC 61000-4-34 edition 1.1 contains the first edition (2005) [documents 77A/498/FDIS and 77A/515/RVD] and its amendment 1 (2009) [documents 77A/670/CDV and 77A/688/RVC].

A vertical line in the margin shows where the base publication has been modified by amendment 1.

International Standard IEC 61000-4-34 has been prepared by subcommittee 77A: Low frequency phenomena, of IEC technical committee 77: Electromagnetic compatibility.

It forms Part 4-34 of IEC 61000. It has the status of a Basic EMC Publication in accordance with IEC Guide 107.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of the base publication and its amendments will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 61000-4-34:2005](#)

<https://standards.iteh.ai/catalog/standards/iec/5efe4d8c-6d1c-40c2-9e17-97a22113d02b/iec-61000-4-34-2005>

INTRODUCTION

IEC 61000 is published in separate parts according to the following structure:

Part 1: General

General considerations (introduction, fundamental principles)

Definitions, terminology

Part 2: Environment

Description of the environment

Classification of the environment

Compatibility levels

Part 3: Limits

Emission limits

Immunity limits (in so far as they do not fall under the responsibility of the product committees)

Part 4: Testing and measurement techniques

Measurement techniques

Testing techniques

Part 5: Installation and mitigation guidelines

Installation guidelines

Mitigation methods and devices

Part 6: Generic standards

[IEC 61000-4-34:2005](https://standards.iteh.ai/catalog/standards/iec/5efe4d8c-6d1c-40c2-9e17-97a22113d02b/iec-61000-4-34-2005)

<https://standards.iteh.ai/catalog/standards/iec/5efe4d8c-6d1c-40c2-9e17-97a22113d02b/iec-61000-4-34-2005>

Part 9: Miscellaneous

Each part is further subdivided into several parts, published either as international standards or as technical specifications or technical reports, some of which have already been published as sections. Others will be published with the part number followed by a dash and a second number identifying the subdivision (example: 61000-6-1).

ELECTROMAGNETIC COMPATIBILITY (EMC) –

Part 4-34: Testing and measurement techniques – Voltage dips, short interruptions and voltage variations immunity tests for equipment with mains current more than 16 A per phase

1 Scope

This part of IEC 61000 defines the immunity test methods and range of preferred test levels for electrical and electronic equipment connected to low-voltage power supply networks for voltage dips, short interruptions, and voltage variations.

This standard applies to electrical and electronic equipment having a rated mains current exceeding 16 A per phase. (See Annex E for guidance on electrical and electronic equipment rated at more than 200 A per phase.) It covers equipment installed in residential areas as well as industrial machinery, specifically voltage dips and short interruptions for equipment connected to either 50 Hz or 60 Hz a.c. networks, including 1-phase and 3-phase mains.

NOTE 1 Equipment with a rated mains current of 16 A or less per phase is covered by publication IEC 61000-4-11.

NOTE 2 There is no upper limit on rated mains current in this publication. However, in some countries, the rated mains current may be limited to some upper value, for example 75 A or 250 A, because of mandatory safety standards.

It does not apply to electrical and electronic equipment for connection to 400 Hz a.c. networks. Tests for equipment connected to these networks will be covered by future IEC standards.

The object of this standard is to establish a common reference for evaluating the immunity of electrical and electronic equipment when subjected to voltage dips, short interruptions and voltage variations.

NOTE 1 Voltage fluctuations are covered by publication IEC 61000-4-14.

NOTE 2 For equipment under test with rated currents above 250 A, suitable test equipment may be difficult to obtain. In these cases, the applicability of this standard should be carefully evaluated by committees responsible for generic, product and product-family standards. Alternatively, this standard might be used as a framework for an agreement on performance criteria between the manufacturer and the purchaser.

The test method documented in this part of IEC 61000 describes a consistent method to assess the immunity of equipment or a system against a defined phenomenon. As described in IEC Guide 107, this is a basic EMC publication for use by product committees of the IEC. As also stated in Guide 107, the IEC product committees are responsible for determining whether this immunity test standard should be applied or not, and if applied, they are responsible for defining the appropriate test levels. Technical committee 77 and its sub-committees are prepared to co-operate with product committees in the evaluation of the value of particular immunity tests for their products.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-161, *International Electrotechnical Vocabulary (IEV) – Chapter 161: Electromagnetic compatibility*

IEC 61000-2-8, *Electromagnetic compatibility (EMC) – Part 2-8: Environment – Voltage dips and short interruptions on public electric power supply systems with statistical measurement results*

IEC 61000-4-30, *Electromagnetic compatibility (EMC) – Part 4-30: Testing and measurement techniques – Power quality measurement methods*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60050-161 as well as the following definitions apply:

3.1

basic EMC standard (ACEC)¹⁾

standard giving general and fundamental conditions or rules for the achievement of EMC, which are related or applicable to all products and systems, and serve as reference documents for product committees

3.2

immunity (to a disturbance)

ability of a device, equipment or system to perform without degradation in the presence of an electromagnetic disturbance

[IEV 161-01-20]

3.3

voltage dip

sudden reduction of the voltage at a particular point of an electricity supply system below a specified dip threshold followed by its recovery after a brief interval

NOTE 1 Typically, a dip is associated with the occurrence and termination of a short circuit or other extreme current increase on the system or installations connected to it.

NOTE 2 A voltage dip is a two-dimensional electromagnetic disturbance, the level of which is determined by both voltage and time (duration).

3.4

short interruption

sudden reduction of the voltage on all phases at a particular point of an electric supply system below a specified interruption threshold followed by its restoration after a brief interval

NOTE Short interruptions are typically associated with switchgear operation related to the occurrence and termination of short circuits on the system or installations connected to it.

3.5

residual voltage (of voltage dip)

minimum value of r.m.s. voltage recorded during a voltage dip or short interruption

NOTE The residual voltage may be expressed as a value in volts or as a percentage or per unit value relative to the reference voltage.

3.6

malfunction

termination of the ability of equipment to carry out intended functions or the execution of unintended functions by the equipment

1) Advisory Committee on Electromagnetic Compatibility (ACEC).

3.7 calibration

set of operations which establishes, by reference to standards, the relationship which exists, under specified conditions, between an indication and a result of a measurement

NOTE 1 This term is based on the "uncertainty" approach.

NOTE 2 The relationship between the indications and the results of measurement can be expressed, in principle, by a calibration diagram.

[IEV 311-01-09]

3.8 verification

set of operations which is used to check the test equipment system (e.g. the test generator and the interconnecting cables) and to demonstrate that the test system is functioning within the specifications given in Clause 6

NOTE 1 The methods used for verification may be different from those used for calibration.

NOTE 2 The procedure of 6.1.2 is meant as a guide to insure the correct operation of the test generator, and other items making up the test set-up so that the intended waveform is delivered to the EUT.

NOTE 3 For the purpose of this basic EMC standard this definition is different from the definition given in IEC 311-01-13.

4 General

Electrical and electronic equipment may be affected by voltage dips, short interruptions or voltage variations of power supply.

Voltage dips and short interruptions are caused by faults in the network, primarily short circuits (see also IEC 61000-2-8), in installations or by sudden large changes of load. In certain cases, two or more consecutive dips or interruptions may occur. Voltage variations are caused by continuously varying loads connected to the network.

Voltage dips at equipment terminals are influenced by the transformer connections between the fault location on the supply system and the equipment connection point. The transformer connections will influence both the magnitude and the phase relationship of the voltage dip experienced by the equipment.

These phenomena are random in nature and can be minimally characterized for the purpose of laboratory simulation in terms of the deviation from the rated voltage, and duration.

Consequently, different types of tests are specified in this standard to simulate the effects of abrupt voltage change. These tests are to be used only for particular and justified cases, under the responsibility of product specification or product committees.

It is the responsibility of the product committees to establish which phenomena among the ones considered in this standard are relevant and to decide on the applicability of the test.

5 Test levels

The voltages in this standard use the rated voltage for the equipment as a basis for voltage test level specification (U_T).

Where the equipment has a rated voltage range the following shall apply:

- if the voltage range does not exceed 20 % of the lower voltage specified for the rated voltage range, a single voltage within that range may be specified as a basis for test level specification (U_T);

- in all other cases, the test procedure shall be applied for both the lowest and highest voltages declared in the voltage range;
- the selection of test levels and durations shall take into account the information given in IEC 61000-2-8.

5.1 Voltage dips and short interruptions

The change between U_T and the changed voltage is abrupt. Unless otherwise specified by the responsible product committee, the start and stop phase angle for the voltage dips and interruptions shall be 0° (i.e. the positive-going voltage zero-crossing on the dipped phase), See 8.2.1. The following test voltage levels (in % U_T) are used: 0 %, 40 %, 70 % and 80 %, corresponding to voltage dips or interruptions with residual voltages of 0 %, 40 %, 70 % and 80 %.

For voltage dips, the preferred test levels and durations are given in Table 1, and an example is shown in Figure 1.

For short interruptions, the preferred test levels and durations are given in Table 2.

The preferred test levels and durations given in Tables 1 and 2 take into account the information given in IEC 61000-2-8.

The preferred test levels in Table 1 are reasonably severe, and are representative of many real world dips, but are not intended to guarantee immunity to all voltage dips. More severe test levels, for example 0 % test level for 1 s, and balanced three-phase dips, may be considered by product committees.

The voltage rise time, t_r , and voltage fall time, t_f , during abrupt changes are indicated in Table 4.

The levels and durations shall be given in the product specification. A test level of 0 % corresponds to a total supply voltage interruption. In practice, a test voltage level from 0 % to 20 % of the rated voltage may be considered as an interruption.

Table 1 – Preferred test level and durations for voltage dips

Classes ^a	Test level and durations for voltage dips (t_s) (50 Hz/60 Hz)			
Class 1	Case-by-case according to the equipment requirements			
Class 2	0 % during 1 cycle	70 % during 25/30 ^c cycles		
Class 3	0 % during 1 cycle	40 % ^d during 10/12 ^c cycles	70 % during 25/30 ^c cycles	80 % during 250/300 ^c cycles
Class X ^b	X	X	X	X
^a Classes as per IEC 61000-2-4; see Annex B. ^b To be defined by product committee. For equipment connected directly or indirectly to public network, the levels must not be less severe than class 2. ^c "25/30 cycles" means "25 cycles for 50 Hz test" and "30 cycles for 60 Hz test", "10/12 cycles" means "10 cycles for 50 Hz test" and "12 cycles for 60 Hz test" and "250/300 cycles" means "250 cycles for 50 Hz test" and "300 cycles for 60 Hz test". ^d May be replaced by product committee with a test level of 50 % for equipment that is intended primarily for 200 V or 208 V nominal operation.				

Table 2 – Preferred test level and durations for short interruptions

Classes ^a	Test level and durations for short interruptions (t_s) (50 Hz/60 Hz)
Class 1	Case-by-case according to the equipment requirements
Class 2	0 % during 250/300 ^c cycles
Class 3	0 % during 250/300 ^c cycles
Class X ^b	X

^a Classes as per IEC 61000-2-4; see Annex B.

^b To be defined by product committee. For equipment connected directly or indirectly to public network, the levels must not be less severe than Class 2.

^c "250/300 cycles" means "250 cycles for 50 Hz test" and "300 cycles for 60 Hz test."

5.2 Voltage variations (optional)

This test considers a defined transition between rated voltage U_T and the changed voltage.

NOTE The voltage change takes place over a short period, and may occur due to change of load.

The preferred duration of the voltages changes and the time for which the reduced voltages are to be maintained are given in Table 3. The rate of change should be constant; however, the voltage may be stepped. The steps should be positioned at zero crossings, and should be no larger than 10 % of U_T . Steps under 1 % of U_T are considered as constant rate of change of voltage.

Table 3 – Timing of short-term supply voltage variations

Voltage test level	Time for decreasing voltage (t_d)	Time at reduced voltage (t_s)	Time for increasing voltage (t_i) (50 Hz/60 Hz)
70 %	Abrupt	1 cycle	25/30 ^b cycles
X ^a	X ^a	X ^a	X ^a


^a To be defined by product committee.

^b "25/30 cycles" means "25 cycles for 50 Hz test" and "30 cycles for 60 Hz test."

For voltage variations in three-phase systems with or without neutral, all the three phases shall be tested simultaneously. Simultaneous voltage variations in three-phase systems are positioned at the zero-crossing of one of the voltages.

This shape is the typical shape of a motor starting with a rapid time for decreasing voltage, t_d , and slower time for increasing voltage, t_i .

Figure 2 shows the r.m.s. voltage as a function of time. Other values may be taken in justified cases and shall be specified by the product committee.

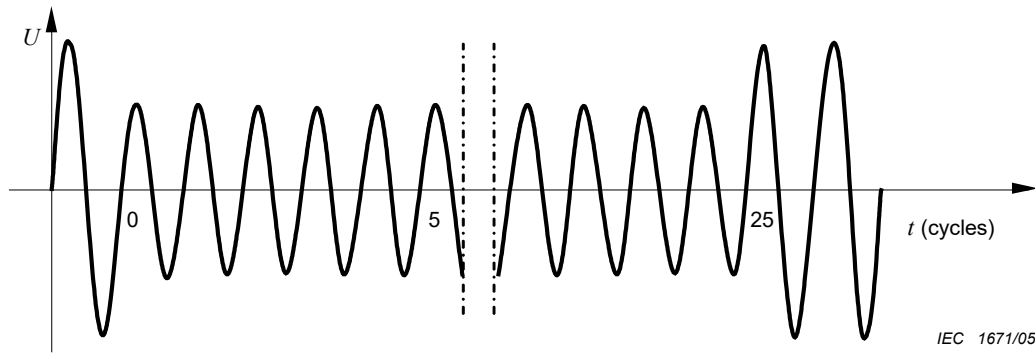

NOTE The voltage decreases to 70 % for 25 cycles (50 Hz). Step at zero crossing.

Figure 1 – Voltage dip – 70 % voltage dip sine wave graph

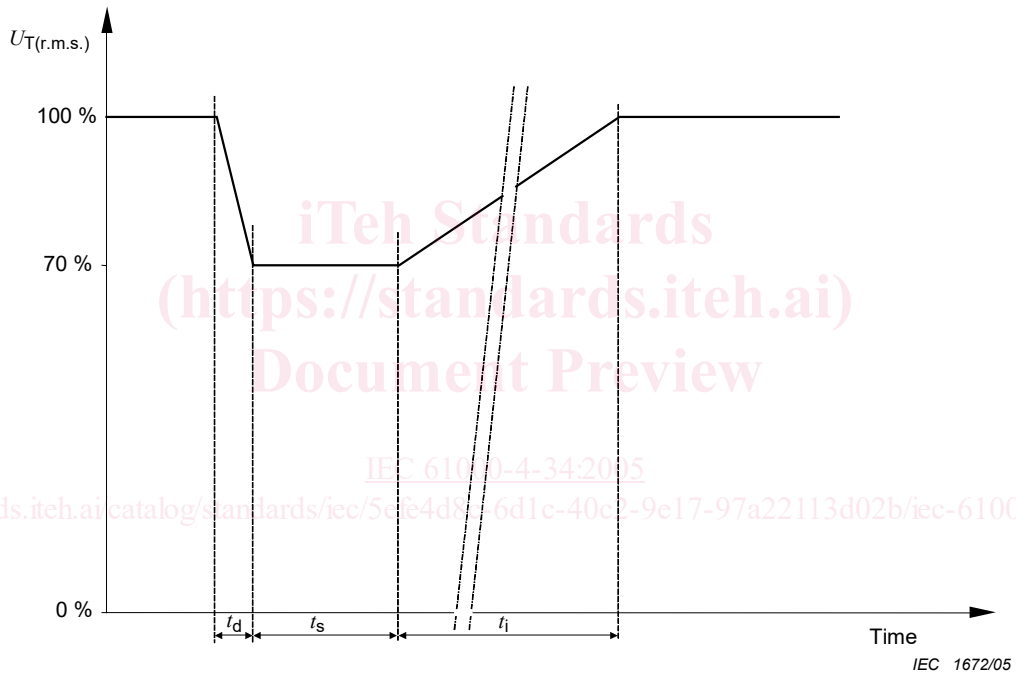


Figure 2 – Voltage variation