



Standard Practices for Determining Moisture-Related Acceptability of Concrete Floors to Receive Moisture-Sensitive Finishes¹

This standard is issued under the fixed designation E 1907; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 These practices include both quantitative and qualitative procedures used to determine the amount of water or water vapor present in or emitting from concrete slabs and criteria for evaluating the moisture-related acceptability of concrete slabs to receive moisture-sensitive manufactured finish products, including certain types of resilient flooring (see Terminology F 141), carpet tiles, carpet, and wood flooring, as well as related adhesives.

1.2 Although coatings, films, and paints are not specifically intended to be included in the category of “moisture sensitive finishes” the procedures included in these practices may be useful for evaluating the moisture-related acceptability of concrete slabs for such finishes.

1.3 These practices do not cover the adequacy of a concrete floor to perform its structural requirements.

1.4 These practices do not include procedures to determine the presence of non-moisture related impediments to the application of finishes.

1.5 These practices do not supersede the specific instructions or recommendations of manufacturers for their flooring finishes.

1.6 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:

- C 33 Specification for Concrete Aggregates²
- C 125 Terminology Relating to Concrete and Concrete Aggregates²
- C 168 Terminology Relating to Thermal Insulating Materials³
- C 330 Specification for Lightweight Aggregate for Structural Concrete²

¹ These practices are under the jurisdiction of ASTM Committee F06 on Resilient Floor Coverings and are the direct responsibility of Subcommittee F06.40 on Practices.

Current edition approved Dec. 10, 1997. Published September 1998.

² Annual Book of ASTM Standards, Vol 04.02.

³ Annual Book of ASTM Standards, Vol 04.06.

- C 332 Specification for Lightweight Aggregate for Insulating Concrete²
- D 2216 Test Method for Laboratory Determination of Water (Moisture) Content of Soil and Rock⁴
- D 4259 Practice for Abrading Concrete⁵
- D 4263 Test Method for Indicating Moisture in Concrete by the Plastic Sheet Method⁵
- D 4397 Specification for Polyethylene Sheeting for Construction, Industrial, and Agricultural Applications⁶
- E 631 Terminology of Building Constructions⁷
- E 1643 Practice for Installation of Water Vapor Retarders Used in Contact with Earth or Granular Fill Under Concrete Slabs⁷
- E 1745 Specification for Plastic Water Vapor Retarders Used in Contact with Soil or Granular Fill under Concrete Slabs⁷
- F 141 Terminology Relating to Resilient Floor Coverings⁸

2.2 Other Sources:

- BS 5325:1983 British Standard Code of Practice for Installation of Textile Floor Coverings⁹
- BS 8203:1987 British Standard Code of Practice for Installation of Sheet and Tile Flooring⁹
- CRI 104-1994, Standard for Installation of Commercial Textile Floorcovering Materials¹⁰
- Addressing Moisture Related Problems Relevant to Resilient Floor Coverings Installed Over Concrete¹¹
- Moisture Guidelines for the Floor Covering Industry¹²

3. Terminology

3.1 Definitions:

- 3.1.1 For terms used in these procedures, see Terminologies C 168, E 631 and F 141.

⁴ Annual Book of ASTM Standards, Vol 04.08.

⁵ Annual Book of ASTM Standards, Vol 06.02.

⁶ Annual Book of ASTM Standards, Vol 08.03.

⁷ Annual Book of ASTM Standards, Vol 04.11

⁸ Annual Book of ASTM Standards, Vol 15.04.

⁹ British Standards Institution, 389 Chiswick High Road, London W4 4AL.

¹⁰ The Carpet and Rug Institute, P.O. Box 2048, Dalton, GA 30722-2048, 706/278-3176, 1994.

¹¹ Resilient Floor Covering Institute, 966 Hungerford Drive, Suite 12-B, Rockville, MD 20850 (301) 340-8580, November 1995.

¹² World Floor Covering Association, 2211 E. Howell Avenue, Anaheim, CA 92806 (800) 624-6880 Fax (714) 978-6066, undated but received August 1995.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *mat*, as in “mat test”—a sample of vapor-retardant sheet resilient floor finish material

3.2.2 *moisture emission*—a term used by the flooring industry in the U.S. to measure moisture emission from concrete floors in lb/[1,000 ft²· 24 h] (56.51 μg/(s·m²)) using the anhydrous calcium chloride test.

3.2.3 *concrete*—concrete made using hydraulic cement as defined in Terminology C 125.

4. Summary of Practice

4.1 This document describes eight procedures, commonly referred to as “tests,” used in the construction industry to determine if unacceptable moisture is present in or being emitted from concrete slabs.

5. Significance and Use

5.1 These practices are intended to be used by applicators of moisture-sensitive floor finish products to determine if there are moisture-related conditions existing in concrete slabs which would adversely impact the successful application and performance of these products.

5.2 These practices can also be used as an aid in the diagnosis of performance failures in moisture-sensitive floor finish products.

5.3 Although these practices are called “tests” for conformity with accepted and familiar industry nomenclature, they are intended to be used only in concert with the judgment and experience of the user. One or more of the practices may be referenced in a floor finish application specification only to establish the procedures the specifier intends the applicator to utilize in assessing the acceptability of a concrete surface for a particular finish product.

5.4 Unless otherwise indicated, these practices are applicable to slabs on grade, slabs below grade, and slabs above grade (see Terminology F 141).

6. Interferences

6.1 Conduct procedures after the internal conditions of the building in which a slab is located have been at normal service temperature and humidity for at least 48 h. Otherwise, results may not accurately reflect the amount of moisture which is present in the slab or would normally be emitted from or through the concrete during normal operating conditions. If the service temperature and humidity is unattainable, the internal conditions of the building in which a slab is located shall have been maintained within the following temperature and humidity range for at least 48 h:

6.1.1 Temperature: 65° to 85°F (18° to 29°C), and

6.1.2 Relatively humidity: 40% to 60%.

6.2 No visible water in liquid form shall be present on the concrete at the time procedures commence.

6.3 Avoid locations in direct sunlight or subject to direct sources of heat.

6.4 The concrete surface shall be free of coatings, finishes, dirt, curing compounds, or other substances which may affect the rate of moisture dissipation or the adhesion of finishes. Non-chemical methods, such as abrasive cleaning or bead-

blasting, including methods described in Practice D 4259, may be used on existing slabs with deleterious residues to achieve an appropriate state for testing. Cleaning, if required, shall take place a minimum of 48 h prior to testing.

6.5 When using procedures involving electronic instruments, the presence of chlorides or carbonates, whether present as deliberate additions or otherwise, and other concrete additives or metallic fibers can result in erroneous readings. The error will depend on the quantity present but, in general, the water content indicated by the test will be the maximum water content.

7. Procedures

7.1 General:

7.1.1 Perform bond and moisture testing procedures on concrete to determine if surfaces are sufficiently dry and free from deleterious substances.

7.1.2 Measure ambient temperature and relative humidity within the structure in which the floor is located at beginning and completion of each procedure.

7.1.3 Sampling

7.1.3.1 Unless otherwise indicated, sampling shall be as follows:

7.1.3.2 Locations shall not be concentrated and shall be distributed around the floor area. One location shall be near the center with others around the perimeter. Selection of locations shall include, but not be limited to, areas of potentially high moisture such as joints and areas closer than 5 ft (1.5 m) from the edge of the slab.¹³

7.1.3.3 Use three sample locations for areas up to 500 ft² (50 m²)

7.1.3.4 Use one additional sample location for each additional 500 ft² (50 m²).

7.2 Polyethylene Sheet Test:

7.2.1 *Summary of Method*—This method uses a vapor-retardant plastic sheet sealed to the floor as a vapor trap to determine if excessive moisture is present.

7.2.2 Significance and Use:

7.2.2.1 See Section 5.

7.2.2.2 This method, described by Test Method D 4263, was developed by Committee D-33 on Protective Coatings and Lining Work for Power Generating Facilities. It is the responsibility of Subcommittee D33.05 on Surface Preparation.

7.2.2.3 Although developed for coating systems preparation, it is also widely used in the flooring industry.

7.2.3 *Apparatus*—none.

7.2.4 Reagents and Materials:

7.2.4.1 Transparent polyethylene sheet Specification D 4397, minimum 4 mils (0.1 mm) thick.

7.2.4.2 Adhesive tape that will adhere to the floor and the sheet, such as duct tape, 2 in (50 mm) wide.

7.2.5 *Preparation of Apparatus*—none.

7.2.6 *Calibration and Standardization*—none.

7.2.7 *Procedure*:

¹³ Placement in a grid array is recommended when an isoplethic analysis is anticipated in order to facilitate documentation and accuracy.

7.2.7.1 Tape a plastic sheet approximately 18 in. by 18 in. (460 mm by 460 mm) tightly to the concrete surface making sure all edges are sealed.

7.2.7.2 After a minimum of 16 h¹⁴, remove the plastic sheet and inspect the underside of the sheet and the concrete surface for presence of moisture.

7.2.8 *Calculation and Interpretation of Results*—Presence of visible liquid water indicates concrete is insufficiently dry for application of finishes.

7.3 *Mat Test:*

7.3.1 *Summary of Method:*

7.3.1.1 This method uses a sample of vapor retardant floor finish material and a water-based adhesive to predict the behavior of moisture-sensitive adhesives.

7.3.2 A variation of this procedure (known as the “bond” test) beyond the scope of this document can be used to test for bond between substrate and floor finish products such as vinyl composition tile, PVC backed carpet, and sheet vinyl.

7.3.3 *Apparatus*—None.

7.3.4 *Reagents and Materials:*

7.3.4.1 Latex multipurpose or water soluble adhesive intended for use with resilient flooring products. It is not necessary to use the type of floor finish product intended for application in this procedure, since the sheet product simply provides a vapor-retardant surface which has sufficient rigidity and weight to remain in place during the procedure.

7.3.4.2 Sheet vinyl, or similar resilient vapor-retardant resilient flooring sheet product.

7.3.4.3 Adhesive tape that will adhere to the floor and the sheet, such as duct tape, 2 in (50 mm) wide.

7.3.5 *Preparation of Apparatus*—Prepare number of mats as required approximately 24 in. by 24 in. (600 mm by 600 mm).

7.3.6 *Calibration and Standardization*—None

7.3.7 *Procedure*—Apply adhesive to an area 24 in. by 24 in. (600 mm by 600 mm). While the adhesive is wet, place the mat, surface or face down, immediately into the adhesive. Seal the perimeter edges using tape. The face is placed down to avoid absorption of water in the adhesive by the backing.

7.3.8 *Calculation or Interpretation of Results:*

7.3.8.1 After 72 h, make a visual inspection to determine the condition of the adhesive.

7.3.8.2 If the adhesive is partially or completely dissolved, is still wet, or has little bond, there is too much moisture present to proceed with the installation of flooring material.

7.3.8.3 If the mat is firmly bonded, or removal of the mat reveals the adhesive to be stringy and with good adhesion, the level of moisture present is considered to be sufficiently low for installation of flooring material.

7.4 *Electrical Resistance Test:*

7.4.1 *Summary of Method*—Determines the moisture content by measuring the electrical conductivity of concrete

between the meter probes.¹⁵ Conductivity varies in proportion to moisture content. Uses proprietary meters and interpretive methods provided by meter manufacturers.

7.4.2 *Significance and Use*—see Section 5.

7.4.3 This procedure provides a relatively quick way to obtain an approximation of the moisture content of concrete.

7.4.4 *Apparatus*—Suitable instrument to measure the conductivity between two electrodes which are placed in contact with the concrete floor surface or placed into two pre-drilled holes one inch (25 mm) deep into the concrete floor.

7.4.5 *Reagents and Materials*—none.

7.4.6 *Preparation of Apparatus*—Follow instrument manufacturer’s instructions.

7.4.7 *Calibration and Standardization*—Follow instrument manufacturer’s instructions

7.4.8 *Procedure*—To use one type of instrument, it is necessary to drill holes in the slab to receive pins. Another type can be used with or without drilling holes, but the readings will be more accurate if holes are drilled and the pins are driven into the holes. Care shall be taken to avoid contact between the probes and any metal incorporated into the slab.

7.4.9 *Calculation or Interpretation of Results:*

7.4.9.1 Generic data to correlate measured electrical resistance to acceptable moisture conditions are not available at this time; however, instrument manufacturers generally publish guides for this purpose specific to the instruments they manufacture.

7.4.9.2 Although a high reading (good conductance) typically indicates high moisture content, a low reading (poor conductance) does not necessarily indicate more than surface dryness, as the concrete may have a higher moisture content below the surface. Conversely, a concrete with low moisture content but containing metal fibers could cause a high reading.

7.4.9.3 Confirmation measurements can be made by taking readings at a number of locations which are then covered by a vapor retarder material such as polyethylene sheeting then taking subsequent readings 24 h later after removing the covers. Where the second reading significantly exceeds the first, it indicates that the concrete has an unacceptable level of moisture.

7.5 *Electrical Impedance Test:*

7.5.1 *Summary of Method*—Uses proprietary meters and interpretive methods provided by meter manufacturers to determine the moisture content of concrete by measuring both conductance and capacitance.

7.5.2 *Significance and Use*—See Section 5.

7.5.2.1 A quick, non-destructive way to determine the moisture content of concrete by measuring the electrical AC impedance. Impedance is an alternating current measurement combining both resistance and capacitance while at the same time overcoming the separate limitations of each (single-line measurement with resistance and shallow depth of penetration of signal with capacitance). With impedance measurement, a

¹⁴ Although Test Method D 4263 specifies 16 h, some authorities recommend a minimum of 24 h.

¹⁵ The most detailed information on this test comes from British Standards Institution (BSI) BS 5325:1983 British Standard Code of Practice for Installation of Textile Floor Coverings and BS 8203:1987 British Standard Code of Practice for Installation of Sheet and Tile Flooring.

field is set up consisting of an area under the footprint of the instrument electrodes (Fig. 1). The depth of the signal penetration will vary depending on the material content of the slab and the moisture content, generally varying from 0.75 in. (20 mm) to 2.0 in. (50 mm).

7.5.3 Apparatus—An electrical impedance meter specifically developed and calibrated for concrete moisture measurement.

7.5.4 Reagents and Materials—none.

7.5.5 Preparation of Apparatus—See instrument manufacturer's instructions.

7.5.6 Calibration and Standardization—See instrument manufacturer's instructions.

7.5.7 Procedure—Follow instrument manufacturer's instructions. Typically, the meter is placed on the concrete slab with its electrodes pressed in direct contact with the surface. When the meter is switched on, low frequency signals are transmitted into the slab, measuring the change in impedance brought about by the presence and level of moisture. The impedance is converted to a percentage moisture content displayed on the instrument dial in both percentage and relative readings. Holes in the slab are typically not required.

7.5.8 Calculation or Interpretation of Results:

7.5.8.1 See instrument manufacturer's instructions.

7.5.8.2 Instructions for calibration of instruments and correlation of impedance meter readings to other methods of

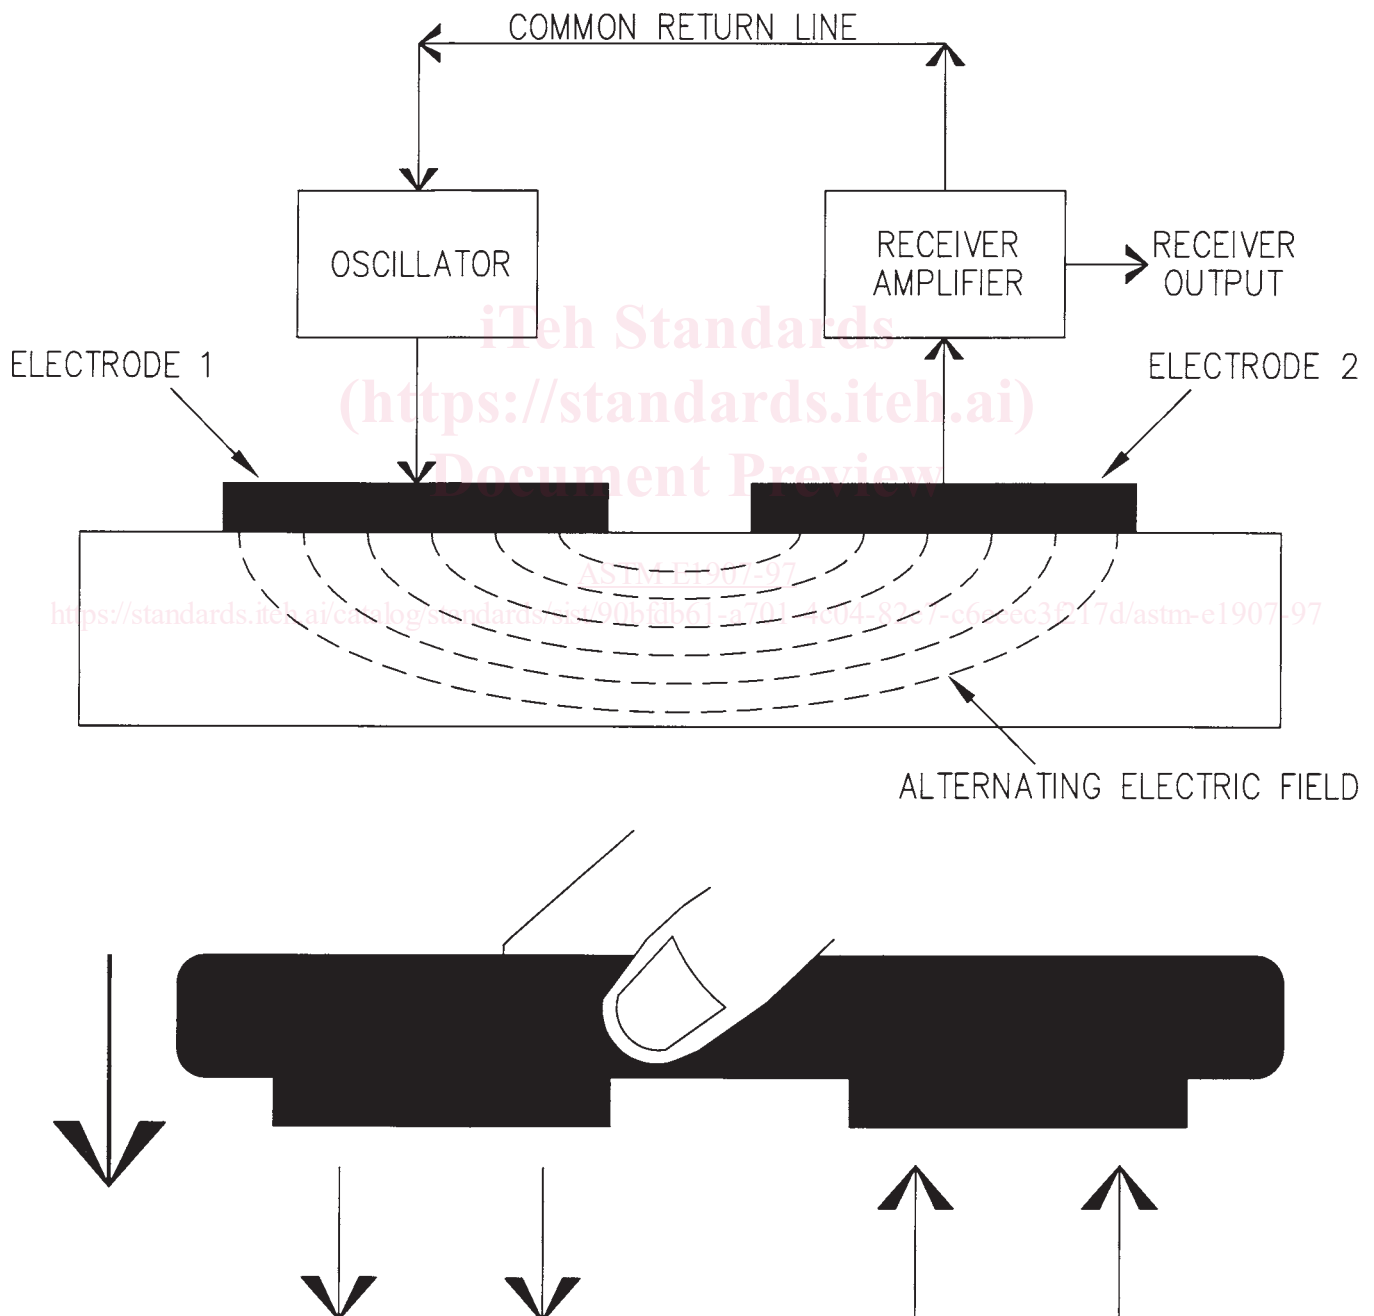


FIG. 1 Basic Schematic of Electrical Impedance Moisture Meter

determining concrete moisture conditions are typically provided by instrument manufacturers.

7.5.8.3 Readings typically indicate percentage moisture content (by mass).

7.5.8.4 Confirmation measurements can be made by taking readings at a number of locations in close proximity to one another. If the readings vary, always use the highest value. Additional confirmation measurements can be made by taking readings at locations which are subsequently covered with a vapor retarder (such as polyethylene sheet), then taking subsequent readings 24 h later. Where the second reading significantly exceeds the first, the concrete is considered to have an unacceptable level of moisture.

7.6 *Qualitative Anhydrous Calcium Chloride Test:*

7.6.1 *Summary of Method*—Detects moisture emission by observing changes in anhydrous calcium chloride (CaCl₂) during a specific period of time. A container of anhydrous calcium chloride is exposed to the atmosphere adjacent to a concrete floor under a vapor-retardant canopy.

7.6.2 *Apparatus*—A transparent, hole-free plastic canopy square or circular in shape about 70-100 in²(450-650 cm²) in area and depth greater than the depth of the cylindrical container of anhydrous calcium chloride, and with 0.5 in (12 mm) flanges around the perimeter of the cover.

7.6.3 *Reagents and Materials:*

7.6.3.1 One container of anhydrous calcium chloride, tape-sealed in the container against moisture or heat-sealed in an air-tight bag to prevent moisture absorption (Fig. 2).

7.6.3.2 A pressure sensitive label to be used to identify the location of the container of anhydrous calcium chloride and to record the date and time the procedure is started and completed.

7.6.3.3 Moisture-tight sealant (gun-grade) or sealant tape to secure and seal the cover to the concrete floor.

7.6.3.4 A brightly colored “CAUTION” label to be placed on the plastic cover as a protective warning while the procedure is being conducted.

7.6.4 *Preparation of Apparatus*—Apparatus may be purchased from a proprietary supplier or assembled by the test agency.

7.6.5 *Calibration and Standardization*—None.

7.6.6 *Procedure:*

7.6.6.1 Pour the anhydrous calcium chloride from its container onto the concrete floor in an area small enough so that the calcium chloride can be entirely covered by the plastic canopy.

7.6.6.2 Apply the sealant in a continuous bead to the flanges of the plastic cover and immediately place the canopy over the anhydrous calcium chloride.

7.6.6.3 Press the flanges, with the sealant applied, to the concrete floor making sure that there is an airtight seal between the flanges of the plastic canopy and the concrete.

7.6.7 *Calculation or Interpretation of Results*—After 72 h, remove the plastic canopy and visually examine the anhydrous calcium chloride. If there is negligible moisture, there will be no visible change in the anhydrous calcium chloride. A small amount of moisture will cause the anhydrous calcium chloride to cake or darken. More moisture will cause drops to form; and, in severe cases, the anhydrous calcium chloride will dissolve.

7.7 *Quantitative Anhydrous Calcium Chloride Test:*

7.7.1 *Summary of Method*—Test moisture emission by measuring the mass of water absorbed by anhydrous calcium chloride (CaCl₂) during a specific period of time. A container of anhydrous calcium chloride is exposed to the atmosphere adjacent to a concrete floor under a vapor-retardant cover.

7.7.2 *Significance and Use:*

7.7.2.1 See Section 5.

7.7.2.2 The anhydrous calcium chloride test was developed by the Rubber Manufacturers Association, Inc., in the early 1950's.^{16,17}

7.7.3 *Apparatus:*

7.7.3.1 A scale for weighing anhydrous calcium chloride with a minimum resolution of 0.1 g.

7.7.3.2 A transparent, hole-free plastic canopy, square or circular in shape, 70 in²(450 cm²) ± 10% in area, depth greater than the depth of the cylindrical container of anhydrous calcium chloride, and with approximately 0.5 in (12 mm) flanges around the perimeter of the cover.

7.7.4 *Reagents and Materials:*

7.7.4.1 One cylindrical plastic container of anhydrous calcium chloride with a cover area of 6 in²(40 cm²) ± 10%. The anhydrous calcium chloride shall be tape-sealed in the container against moisture or heat-sealed in an air-tight bag to prevent moisture absorption (Fig. 2). The mass of the container, the anhydrous calcium chloride, and the tape seal shall be 30 g ± 10%.



FIG. 2 Anhydrous Calcium Chloride Test

¹⁶ The Rubber Manufacturers Association (RMA) is no longer involved with floor coverings and has no records regarding the history of this procedure, although its origins are widely attributed to the RMA. It has been widely used and accepted by the flooring industry since the early 1950's, and quantitatively measures the rate of moisture transmission through or out of a concrete slab.

¹⁷ The World Floor Covering Association describes this as “the only objective quantified test that is practical to run” (Moisture Guidelines for the Floor Covering Industry). The Resilient Floor Covering Institute “subscribes to the use” of this procedure (Addressing Moisture Related Problems Relevant to Resilient Floor Coverings Installed Over Concrete). The Carpet and Rug Institute (CRI 104 - 1994, Standard for Installation of Commercial Textile Floorcovering Materials) states, “All concrete floors should be tested to determine the moisture emission rate by utilizing a calcium chloride moisture test kit available from installation supplies and accessories distributors.”

7.7.4.2 A pressure sensitive label to be used to identify the location of the container of anhydrous calcium chloride and to record the location and the date, time the procedure is started and completed, and its mass.

7.7.4.3 Moisture-tight sealant (gun-grade) or sealant tape to secure and seal the canopy to the concrete floor.

7.7.4.4 A brightly colored “CAUTION” label to be placed on the canopy as a protective warning while the procedure is being conducted.

7.7.5 *Preparation of Apparatus:*

7.7.5.1 Apparatus may be purchased from a proprietary supplier or assembled by the test agency.

7.7.6 *Calibration and Standardization:*

7.7.6.1 The scale shall be re-calibrated prior to each procedure sequence.

7.7.6.2 Weighing shall be done with the same scale for each procedure sequence.

7.7.7 *Procedure:*

7.7.7.1 If the anhydrous calcium chloride is separately packaged, pour it into the container without spilling the contents. Using a scale, determine the mass of the container of anhydrous calcium chloride, the tape (if used) to seal the container, and the cover label to the nearest 0.1 g. Record the value. If sealing tape is used, save the tape to reseal the container after the procedure is completed.

7.7.7.2 Remove the lid of the anhydrous calcium chloride container, and place it underneath the container on the floor.¹⁸

7.7.7.3 Measure and record the area under the canopy.¹⁹

7.7.7.4 Broom, brush, or vacuum the procedure area just prior to placement to remove any dust or debris which could interfere with the sealant bond. Apply the moisture-tight sealant in a continuous bead to flanges of the plastic canopy. If the sealant is tape-type, do not butt-joint; overlap ends to assure there are no gaps. Test for air-tightness by pressing firmly on the center of the canopy. The canopy should resist pressure if properly sealed air-tight. Air-tightness can also be tested by laying strips of tissue paper around the perimeter of the canopy. If the tissues are not disturbed by air movement when the canopy is depressed, it is properly sealed air-tight.

7.7.7.5 On the container cover label record the procedure number, location of the procedure on the floor, the mass, and the date and time the procedure was started.

7.7.7.6 Place the caution label on outside of the canopy as a protective warning, and allow the unit to remain undisturbed for a period of 60 to 72 h.

7.7.7.7 Remove the plastic canopy and immediately place the top back on the anhydrous calcium chloride container. Reseal the container with the original sealing tape. Record on the cover the date and time the procedure was completed.

7.7.7.8 Do not spill any of the anhydrous calcium chloride from the container. If any is spilled, the procedure must be re-run with a new pre-weighed moisture test unit.

7.7.7.9 Weigh the sealed container at the procedure site, along with the tape used to seal it. Record the mass on the label on the container cover, and determine the mass gain.

7.7.8 *Calculation or Interpretation of Results:*

7.7.8.1 Compute moisture emission (ME) as follows

$$ME = \frac{24000\Delta M}{453.6A \cdot T} = 52.91\Delta M/(A \cdot T) \quad (1)$$

where

ΔM = mass gain of anhydrous CaCl_2 in g

A = contact area of CaCl_2 on concrete in ft^2

T = exposure time in h

ME = moisture emission in $\text{lb}/(1,000 \text{ ft}^2 \cdot 24 \text{ h})$

7.7.8.2 To convert results to SI, multiply by 56.51 to obtain $\mu\text{g}/(\text{s} \cdot \text{m}^2)$.

7.7.8.3 To calculate ME in SI units, use the formula $ME = \Delta M/A \cdot T$, where ME is in g, T is in s, and A is in mm^2 .

7.7.8.4 If the plastic canopy is found punctured, the anhydrous calcium chloride in the container has a continuous crust, liquid water is present in the container, or the anhydrous calcium chloride crystals are dissolved, computations will probably indicate an excessively high moisture level but with a higher margin of error than with lower levels of moisture.²⁰

7.7.8.5 Most flooring product manufacturers recommend that the maximum ME considered acceptable for moisture-sensitive flooring systems is $3.0 \text{ lb}/[1,000 \text{ ft}^2 \cdot 24 \text{ h}]$ ($170 \mu\text{g}/(\text{s} \cdot \text{m}^2)$), although $5.0 \text{ lb}/[1,000 \text{ ft}^2 \cdot 24 \text{ h}]$ ($280 \mu\text{g}/(\text{s} \cdot \text{m}^2)$) is considered acceptable for some products.²¹

7.8 *Primer or Adhesive Strip Test:*

7.8.1 *Summary of Method*—This method uses a sample of the proposed floor finish material primer or adhesive to predict the behavior of moisture-sensitive adhesives.

7.8.2 *Apparatus*—none.

7.8.3 *Reagents and Materials*—flooring adhesive or primer.

7.8.4 *Preparation of Apparatus*—none.

7.8.5 *Calibration and Standardization*—none.

7.8.6 *Procedure*—Place several small patches of adhesive or primer approximately 24 in \times 24 in (600 mm \times 600 mm) in size on the slab.

7.8.7 *Calculation or Interpretation of Results*—If after the primer or adhesive has been down 24 h it bonds securely to the slab, the resilient material may be installed. If the primer or adhesive can be peeled from the floor using a putty knife, the slab has unacceptable moisture.

¹⁸ Some users of this procedure have advocated placing the container over a \$0.05 U.S. coin, washer, or similar spacer. A U.S. \$0.05 coin is approximately 0.07 in (2.0 mm) thick by 0.83 in (21.0 mm) diameter. Any coin, washer, or spacer with a thickness greater than 1.5 mm and a diameter less than 25 mm will suffice. Whether or not the use of a spacer affects the results has not been proven, but the consensus of users is that it does not.

¹⁹ Some users of this procedure advocate subtracting the area covered by the anhydrous calcium chloride container if the container is placed directly on the floor rather than over a spacer. Whether or not the subtraction of the covered area affects the results has not been proven, but the consensus of users is that it does not.

²⁰ For greater accuracy in ascertaining moisture emission above the level of normal acceptability or in diagnosing high levels of moisture emission with a lower margin of error, repeat the procedure at the same location with either a shorter duration (60 h minimum), a larger diameter anhydrous calcium chloride container, or both. If the anhydrous calcium chloride container is approximately 3.5 in (90 mm) in diameter, use approximately 30 g of anhydrous calcium chloride. If the anhydrous calcium chloride container is approximately 5 in (130 mm) in diameter, use approximately 40 g of anhydrous calcium chloride. The purpose is to expose optimum surface area to water vapor.

²¹ Armstrong Commercial Flooring, Technical Services Report No. 15, June 1994, recommends 5.0 lb for 1/8 in vinyl composition tile and felt-backed commercial sheet flooring.