

TECHNICAL SPECIFICATION TS 60870-5-601

IEC

First edition
2006-06

**Telecontrol equipment and systems –
Part 5-601:
Conformance test cases for the
IEC 60870-5-101 companion standard**

iTeh Standards

(<https://standards.itih.ai>)

Document Preview

IEC/TS 60870-5-601:2006

<https://standards.itih.ai/catalog/standards/iec/9c2e1a1f-1074-41c3-9cbe-16f172d63514/iec-ts-60870-5-601-2006>



Reference number
IEC/TS 60870-5-601:2006(E)

Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** (www.iec.ch)

- **Catalogue of IEC publications**

The on-line catalogue on the IEC web site (www.iec.ch/searchpub) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.

- **IEC Just Published**

This summary of recently issued publications (www.iec.ch/online_news/justpub) is also available by email. Please contact the Customer Service Centre (see below) for further information.

- **Customer Service Centre**

If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: custserv@iec.ch
Tel: +41 22 919 02 11
Fax: +41 22 919 03 00

TECHNICAL SPECIFICATION TS 60870-5-601

IEC

First edition
2006-06

Telecontrol equipment and systems – Part 5-601: Conformance test cases for the IEC 60870-5-101 companion standard

iTeh Standards

(<https://standards.iteh.ai>)

Document Preview

IEC TS 60870-5-601:2006

<https://standards.iteh.ai/catalog/standards/iec/9c2e3a7f-1074-41c3-9cbe-16f172d63514/iec-ts-60870-5-601-2006>

© IEC 2006 — Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembé, PO Box 131, CH-1211 Geneva 20, Switzerland
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: inmail@iec.ch Web: www.iec.ch



Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

PRICE CODE **XD**

For price, see current catalogue

CONTENTS

FOREWORD.....	4
1 Scope.....	6
2 Normative references	6
3 Terms and definitions	7
4 Abbreviated terms	7
5 Conformance testing for IEC 60870-5-101.....	7
5.1 Overview and legend.....	7
5.2 Configuration Parameters for IEC 60870-5-101	9
5.3 Verification of IEC 60870-5-101 communication	11
5.4 Conformance Test Procedures	42
5.5 Test results chart	77
5.6 Test results of command transmission.....	87
Figure 1 – Test procedure.....	8
Table 1 – Configuration Parameters for IEC 60870-5-101.....	9
Table 2 – Verification of the Physical Level.....	11
Table 3 – Verification of the Link Level	12
Table 4 – Verification of the Data Unit Identifier.....	14
Table 5 – Verification of the object address	15
Table 6 – Verification of ASDUs for Process information in monitor (Normal) direction.....	15
Table 7 – Verification of ASDUs for Process information in control (Normal) direction.....	34
Table 8 – Verification of ASDUs for System information in monitor (Normal) direction.....	36
Table 9 – Verification of ASDUs for System information in control (Normal) direction.....	36
Table 10 – Verification of ASDUs for Parameters in control (Normal) direction.....	38
Table 11 – Verification of ASDUs for File transfer (in monitor (Normal) and control direction).....	39
Table 12 – Link Layer Conformance Test Procedures	42
Table 13 – Data Unit Identifier Conformance Test Procedures	43
Table 14 – Information object address Conformance Test Procedures	44
Table 15 – Station initialisation function (unbalanced systems) Conformance Test Procedures	44
Table 16 – Data acquisition by polling function (unbalanced systems) Conformance Test Procedures	48
Table 17 – Station initialisation function (balanced systems) Conformance Test Procedures	49
Table 18 – Redundant link Conformance Test Procedures	52
Table 19 – Cyclic data transmission function Conformance Test Procedures	53
Table 20 – data acquisition through Read function Conformance Test Procedures.....	54
Table 21 – Acquisition of events function Conformance Test Procedures	54
Table 22 – General interrogation function Conformance Test Procedures	56
Table 23 – Clock synchronisation function Conformance Test Procedures	59

Table 24 – Command transmission function Conformance Test Procedures.....	61
Table 25 – Transmission of integrated totals (telecounting) function Conformance Test Procedures	66
Table 26 – Parameter loading function Conformance Test Procedures.....	69
Table 27 – Test procedure function Conformance Test Procedures.....	70
Table 28 – File transfer procedure function Conformance Test Procedures.....	71
Table 29 – Delay acquisition procedure function Conformance Test Procedures.....	73
Table 30 – Additional Conformance Test Procedures.....	74
Table 31 – Negative Conformance Test Procedures.....	75
Table 32 – PIXIT related Conformance Test Procedures.....	76
Table 33 – Test results chart	77
Table 34 – Test results of single command transmission.....	87
Table 35 – Test results of double command transmission	89
Table 36 – Test results of regulating step command transmission.....	91
Table 37 – Test results of setpoint command transmission.....	93

iTech Standards
(<https://standards.iteh.ai>)
Document Preview

IEC TS 60870-5-601:2006

<https://standards.iteh.ai/catalog/standards/iec/9c2e3a1f-1074-41c3-9cbe-16f172d63514/iec-ts-60870-5-601-2006>

INTERNATIONAL ELECTROTECHNICAL COMMISSION

TELECONTROL EQUIPMENT AND SYSTEMS –

**Part 5-601: Conformance test cases for
the IEC 60870-5-101 companion standard**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- The subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC 60870-5-601, which is a technical specification, has been prepared by IEC technical committee 57: Power systems management and associated information exchange.

The text of this technical specification is based on the following documents:

Enquiry draft	Report on voting
57/738/DTS	57/764/RVC

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above Table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 60870 series, under the general title *Telecontrol equipment and systems*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- transformed into an International standard,
- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

IEC TS 60870-5-601:2006

<https://standards.iteh.ai/catalog/standards/iec/9c2e2a4f-1074-41c3-9cbe-16f172d63514/iec-ts-60870-5-601-2006>

TELECONTROL EQUIPMENT AND SYSTEMS –

Part 5-601: Conformance test cases for the IEC 60870-5-101 companion standard

1 Scope

This part of the IEC 60870-5 series describes test cases for conformance testing of telecontrol equipment, Substation Automation Systems (SAS) and telecontrol systems, including front-end functions of SCADA.

The use of this part of IEC 60870 facilitates interoperability by providing a standard method of testing protocol implementations, but it does not guarantee interoperability of devices. It is expected that using this part of IEC 60870 during testing will minimize the risk of non-interoperability.

The goal of this part of IEC 60870 is to enable unambiguous and standardised evaluation of IEC 60870-5 companion standard protocol implementations. The guidelines and conditions for the testing environment are described in IEC 60870-5-6. The detailed test cases per companion standard, containing among others mandatory and optional mandatory test cases per Basic Application Function, ASDU and transmission procedures, will become available as a technical specification (TS). Other functionality may need additional test cases but this is beyond the scope of this part of IEC 60870. For proper testing, it is recommended to define these additional test cases.

This part of IEC 60870 deals mainly with communication conformance testing; therefore other requirements, such as safety or EMC are not covered. These requirements are covered by other standards (if applicable) and the proof of compliance for these topics is done in accordance with these standards.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.¹

IEC 60870-5-1, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section One: Transmission frame formats*

IEC 60870-5-2, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section 2: Link transmission procedures*

IEC 60870-5-3, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section 3: General structure of application data*

¹ The base standard always takes precedence. In case of ambiguity between this part of IEC 60870 and the base standards (IEC 60870-5-1 to IEC 60870-5-5, IEC 60870-5-101), this part of IEC 60870 needs to be clarified or amended.

When testing negative behavior is not described in the base standard, the behavior described in this part of IEC 60870 shall prevail and shall be observed.

The conformance statement produced after testing shall indicate any lack of conformance to either the test plan or the base standard.

IEC 60870-5-4, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section 4: Definition and coding of application information elements*

IEC 60870-5-5, *Telecontrol equipment and systems – Part 5: Transmission protocols – Section 5: Basic application functions*

IEC 60870-5-6, *Telecontrol equipment and systems – Part 5-6: Guidelines for conformance testing for the IEC 60870-5 companion standards*

IEC 60870-5-101, *Telecontrol equipment and systems – Part 5-101: Transmission protocols – Companion standard for basic telecontrol tasks*

IEEE 754, *Standard for Binary Floating-Point Arithmetic*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60870-5-6 apply.

4 Abbreviated terms

For the purposes of this document, the abbreviations given in IEC 60870-5-6 apply.

5 Conformance testing for IEC 60870-5-101

5.1 Overview and legend

Procedural and functional testing should always start with the Station Initialisation function and proceeds with the next Basic Application Functions. The procedure in each test case should be followed, which means that the DUT is able to function as described in the specific test case.

The test procedures in Tables 1 to 14 should be tested with no errors detected during testing of all the Basic Application Functions in Tables 15 to 32. These tests are preferably automatically performed by the used test platform.

In addition to the performance criteria listed in the test procedures, 5.3 lists the protocol specifications that should be verified automatically by the testing software or verified manually by review of the test history log after execution of the test procedures. The verification should result in no errors detected during the complete test procedure.

This test plan has a direct reference to the PICS and possibly a PIXIT. Without a reference to a PICS or PIXIT, this test plan is obsolete.

Test case numbering syntax is Subclause number + Table number + test case number.

Test cases are Mandatory depending on the description in the column 'Required'. The following situations are possible:

- M = Mandatory test case regardless if enabled in the PICS/PIXIT, not only in one situation but during execution of all the tests as in the PICS and/or PIXIT
- PICS, x.x = Mandatory test case if the functionality is enabled in the PICS (by marking the applicable check box), with a reference to the Subclause number of the PICS (x.x); For example: PICS 8.x always refers to 60870-5-101:2003, Clause 8

PIXIT = Mandatory test case if the functionality is enabled/described in the PIXIT. Verification of these test cases by the user/owner of the PIXIT is required before the test is started.

For each test case, the test results need to be marked in the appropriate column of the test result chart in 5.5 and 5.6. Each test case can either pass the test (Passed), fail the test (Failed), be not applicable when the configuration value is not supported by the device (N.A.), or the test case was not performed (Empty). Ideally there should be no empty boxes when testing is complete.

The test Tables are divided in five subclauses:

- Subclause 5.2 Configuration Parameters for IEC 60870-5-101
- Subclause 5.3 Verification of IEC 60870-5-101 communication
- Subclause 5.4 Conformance Test Procedures
- Subclause 5.5 Test Result Chart
- Subclause 5.6 Test Results of Command Transmission

The procedure to perform all the mandatory test cases according to the PID, is shown in Figure 1.

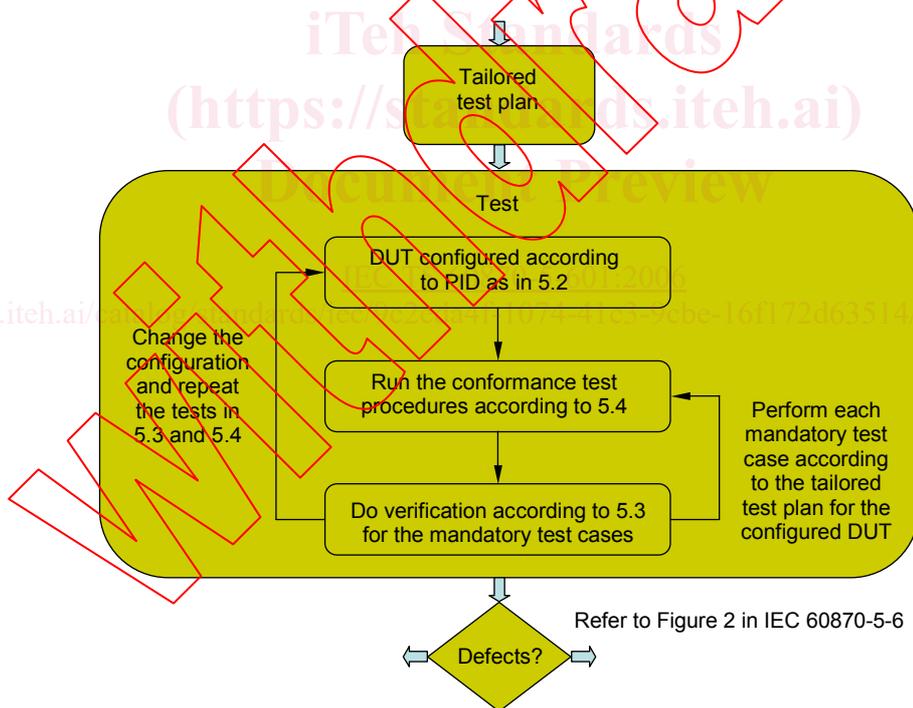


Figure 1 – Test procedure

5.2 Configuration Parameters for IEC 60870-5-101

Table 1 – Configuration Parameters for IEC 60870-5-101

Table 1a – Configuration Parameter Values

Since IEC 60870-5-101 contains a number of configuration parameters affecting protocol behaviour, it should be tested that the functionality in 5.3 and 5.4 is correct for the configuration(s) in Table 1a.

Test No.	Test	Description	Reference	Required
5.2.1.1	System definition	Controlling station test (Master)		PICS, 8.1
5.2.1.2		Controlled station test (Slave)		PICS, 8.1
5.2.1.20	Physical layer	Transmission speed(s) in control direction test maximum baud rate, minimum baud rate, and one other baud rate	IEC 60870-5-101, 5.1	PICS, 8.3
5.2.1.21		Transmission speed(s) in monitor direction test maximum baud rate, minimum baud rate, and one other baud rate	IEC 60870-5-101, 5.1	PICS, 8.3
5.2.1.30	Link Layer	Unbalanced transmission	IEC 60870-5-2, 6	PICS, 8.4
5.2.1.31		Balanced transmission	IEC 60870-5-2, 6	PICS, 8.4
5.2.1.40	Address field of the Link	Zero (0) octets for address field (balanced only)	IEC 60870-5-2, 5.1.3, 6.1.3	PICS, 8.4
5.2.1.41		One (1) octet for address field	IEC 60870-5-2, 5.1.3, 6.1.3	PICS, 8.4
5.2.1.42		Two (2) octets for address field	IEC 60870-5-2, 5.1.3, 6.1.3	PICS, 8.4
5.2.1.50	Frame length	Maximum length L (control direction)	IEC 60870-5-101, 6.2	PICS, 8.4
5.2.1.51		Maximum length L (monitor direction)	IEC 60870-5-101, 6.2	PICS, 8.4
5.2.1.60	Assignment Class 2 messages	Standard assignment of class 2 messages	IEC 60870-5-101, 6.2, 7.4.2	PICS, 8.4
5.2.1.61		Special assignments of class 2 messages	IEC 60870-5-101, 6.2, 7.4.2	PIXIT
5.2.1.70	COMMON ADDRESS OF ASDU	One (1) octet for Common Address of ASDU (CASDU)	IEC 60870-5-101, 7.2.4	PICS, 8.5
5.2.1.71		Two (2) octets for Common Address of ASDU (CASDU)	IEC 60870-5-101, 7.2.4	PICS, 8.5
5.2.1.80	INFORMATION OBJECT ADDRESS	One (1) octet for Information Object Address (structured or unstructured)	IEC 60870-5-101, 7.2.5	PICS, 8.5
5.2.1.81		Two (2) octets for Information Object Address (structured or unstructured)	IEC 60870-5-101, 7.2.5	PICS, 8.5
5.2.1.82		Three (3) octets for Information Object Address (structured or unstructured)	IEC 60870-5-101, 7.2.5	PICS, 8.5
5.2.1.90	CAUSE OF TRANSMISSION	One (1) octet for COT field	IEC 60870-5-101, 7.2.3	PICS, 8.5
5.2.1.91		Two (2) octets for COT field (2 nd octet is Originator address)	IEC 60870-5-101, 7.2.3	PICS, 8.5

Table 1b – Conformance Test Procedures only for system testing (for example in the case of interoperability testing)

Test No.	Test	Description	Reference	Required
5.2.1.100	System definition	System test (in case of interoperability testing)		PICS, 8.1
5.2.1.110	Network configuration	Point-to-point	IEC 60870-5-101, 5.1	PICS, 8.2
5.2.1.111		Multiple point-to-point	IEC 60870-5-101, 5.1	PICS, 8.2
5.2.1.112		Multipoint party line	IEC 60870-5-101, 5.1	PICS, 8.2
5.2.1.113		Multipoint star	IEC 60870-5-101, 5.1	PICS, 8.2
5.2.1.120		Address field of the Link	Link address unstructured	IEC 60870-5-2, 5.1.3, 6.1.3
5.2.1.121	Link address structured		IEC 60870-5-2, 5.1.3, 6.1.3	PICS, 8.4, PIXIT
5.2.1.130	INFORMATION OBJECT ADDRESS	Information Object Address unstructured	IEC 60870-5-101, 7.2.5	PICS, 8.5
5.2.1.131		Information Object Address structured	IEC 60870-5-101, 7.2.5	PICS, 8.5 PIXIT



5.3 Verification of IEC 60870-5-101 communication

This Subclause lists the protocol specifications that should be verified automatically by the testing software or verified manually by review of the test history log after execution of the test procedures. Each test case describes a functionality that has passed the test if the functionality as in the description column was proved to be correct. Correct means: the functionality should be checked either automatically or manually, and also be checked by the test engineer in a human readable format log-file. For example, to test the IV qualifier of some information elements, the ASDU containing this element should be sent with the IV=1. This should be automatically checked by the test software or observed by the test engineer in the log-file. Each test case marked "Passed", should be verifiable during testing and archived in log-files for post assessment.

To identify if a test case is mandatory, it is necessary to read 5.1 carefully.

Table 2 – Verification of the Physical Level

Test No.	Test	Description	Reference	Required
5.3.2.1	BYTEFRAME	Start-/stop-bit, even parity	IEC 60870-5-1, 6.2.4.2	M

Table 3 – Verification of the Link Level

Test No.	Test	Description	Reference	Required	
5.3.3.10	FT1.2 FRAME LAYOUT (Single, Fixed and Variable)	Single control character I: E5 _H	IEC 60870-5-1, 6.2.4.2	PIXIT	
5.3.3.11		Start character of fixed length frames: 10 _H	IEC 60870-5-1, 6.2.4.2	M	
5.3.3.12		0 octets (No-User data) as Link User data length of fixed length frames	IEC 60870-5-1, 6.2.4.2	M	
5.3.3.13		Start character of variable length frames: 68 _H	IEC 60870-5-1, 6.2.4.2	M	
5.3.3.14		Configured number of octets L (repeated) as the maximum number of User Data octets from Controlling to Controlled station in variable length frames: max. 255	IEC 60870-5-1, 6.2.4.2	PICS, 8.4	
5.3.3.15		Configured number of octets L (repeated) as the maximum number of User Data octets from Controlled to Controlling station in variable length frames: max. 255	IEC 60870-5-1, 6.2.4.2	PICS, 8.4	
5.3.3.16		Second start character of variable length frames: 68 _H	IEC 60870-5-1, 6.2.4.2	M	
5.3.3.17		Single octet Control Field	IEC 60870-5-1, 6.2.4.2	M	
5.3.3.18		Configured number of octets for Link address field	IEC 60870-5-1, 6.2.4.2	PICS, 8.4	
5.3.3.19		Checksum (8-bit arithmetic sum)	IEC 60870-5-1, 6.2.4.2	M	
5.3.3.20		Stop character of fixed and variable length frames: 16 _H	IEC 60870-5-1, 6.2.4.2	M	
5.3.3.30		BYTELAG	Line idle intervals (stream of "1" bits) between characters of a frame do not exceed one bit time (octets are received within 110% of raw transmission time)	IEC 60870-5-1, 6.2.4.2 IEC 60870-5-101, 6.1	M
5.3.3.40		CONTROL FIELD	High order bit RES = 0 (unbalanced only)	IEC 60870-5-2, 5.1.2	PICS, 8.4
5.3.3.41			DIR = 1 for messages from Controlling station (A) to Controlled station (B) (balanced only)	IEC 60870-5-2, 6.1.2	PICS, 8.4
5.3.3.42			DIR = 0 for messages from Controlled station (B) to Controlling station (A) (balanced only)	IEC 60870-5-2, 6.1.2	PICS, 8.4
5.3.3.43			PRM = 0 in messages from the Controlled station	IEC 60870-5-2, 5.1.2, 6.1.2	M
5.3.3.44			PRM = 0: only FCODEs 0, 1, 8, 9, 11, 14, or 15 (unbalanced only)	IEC 60870-5-2, 5.1.2	PICS, 8.4
5.3.3.45	PRM = 0: only FCODEs 0, 1, 11, 14, or 15 (balanced only)		IEC 60870-5-2, 6.1.2	PICS, 8.4	
5.3.3.46	PRM = 1 in messages from the Controlling station		IEC 60870-5-2, 5.1.2, 6.1.2	M	
5.3.3.47	PRM = 1: only Primary FCODEs 0, 1, 3, 4, 8, 9, 10 or 11 (unbalanced only)		IEC 60870-5-2, 5.1.2	PICS, 8.4	
5.3.3.48	PRM = 1: only Primary FCODEs 0, 1, 2, 3, 4 or 9 (balanced only)		IEC 60870-5-2, 6.1.2	PICS, 8.4	
5.3.3.49	In case of FCV = 1 and FCB unchanged, the last message is repeated		IEC 60870-5-2, 5.1.2, 6.1.2	M	
5.3.3.50	In case of reset commands F-CODE 0 or 1 FCB = 0 (expect next FCB=1)		IEC 60870-5-2, 5.1.2, 6.1.2	M	
5.3.3.51	DFC = 0 : further messages are acceptable		IEC 60870-5-2, 5.1.2, 6.1.2	M	
5.3.3.52	DFC = 1 : further messages may cause data overflow		IEC 60870-5-2, 5.1.2	M	