



**SLOVENSKI STANDARD**  
**SIST EN 61968-1:2004**

**01-maj-2004**

---

**Application integration at electric utilities - System interfaces for distribution management - Part 1: Interface architecture and general requirements (IEC 61968-1:2003)**

Application integration at electric utilities - System interfaces for distribution management -- Part 1: Interface architecture and general requirements

Integration von Anwendungen in Anlagen der Elektrizitätsversorgung - Systemschnittstellen für Netzführung -- Teil 1: Schnittstellenarchitektur und allgemeine Anforderungen  
(standards.iteh.ai)

Intégration d'applications pour les services électriques - Systèmes d'interface pour la gestion de la distribution -- Partie 1: Architecture des interfaces et spécifications générales

**Ta slovenski standard je istoveten z: EN 61968-1:2004**

**ICS:**

29.240.30	Krmilna oprema za elektroenergetske sisteme	Control equipment for electric power systems
35.200	Vmesniška in povezovalna oprema	Interface and interconnection equipment

**SIST EN 61968-1:2004** en

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

[SIST EN 61968-1:2004](#)

<https://standards.iteh.ai/catalog/standards/sist/b0535166-c498-4742-888b-c114696340d1/sist-en-61968-1-2004>

EUROPEAN STANDARD

**EN 61968-1**

NORME EUROPÉENNE

EUROPÄISCHE NORM

January 2004

ICS 33.200

English version

**Application integration at electric utilities –  
System interfaces for distribution management  
Part 1: Interface architecture and general requirements  
(IEC 61968-1:2003)**

Intégration d'applications pour les services  
électriques –  
Systèmes d'interface pour la gestion  
de la distribution  
Partie 1 : Architecture des interfaces  
et spécifications générales  
(CEI 61968-1:2003)

Integration von Anwendungen in Anlagen  
der Elektrizitätsversorgung -  
Systemschnittstellen für Netzfürung  
Teil 1: Schnittstellenarchitektur  
und allgemeine Anforderungen  
(IEC 61968-1:2003)

**STANDARD PREVIEW**  
**(standards.iteh.ai)**

This European Standard was approved by CENELEC on 2003-12-01. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the Central Secretariat has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

**CENELEC**

European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**Central Secretariat: rue de Stassart 35, B - 1050 Brussels**

## Foreword

The text of document 57/650/FDIS, future edition 1 of IEC 61968-1, prepared by IEC TC 57, Power system control and associated communications, was submitted to the IEC-CENELEC parallel vote and was approved by CENELEC as EN 61968-1 on 2003-12-01.

The following dates were fixed:

- latest date by which the EN has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2004-09-01
- latest date by which the national standards conflicting with the EN have to be withdrawn (dow) 2006-12-01

---

## Endorsement notice

The text of the International Standard IEC 61968-1:2003 was approved by CENELEC as a European Standard without any modification.

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN 61968-1:2004

<https://standards.iteh.ai/catalog/standards/sist/b0535166-c498-4742-888b-c114696340d1/sist-en-61968-1-2004>

# INTERNATIONAL STANDARD

**IEC**  
**61968-1**

First edition  
2003-10

---

---

## Application integration at electric utilities – System interfaces for distribution management –

### Part 1: Interface architecture and general requirements

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

SIST EN 61968-1:2004

<https://standards.iteh.ai/catalog/standards/sist/b0535166-c498-4742-888b-c114696340d1/sist-en-61968-1-2004>

© IEC 2003 — Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembé, PO Box 131, CH-1211 Geneva 20, Switzerland  
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: [inmail@iec.ch](mailto:inmail@iec.ch) Web: [www.iec.ch](http://www.iec.ch)



Commission Electrotechnique Internationale  
International Electrotechnical Commission  
Международная Электротехническая Комиссия

PRICE CODE

**XB**

*For price, see current catalogue*

## CONTENTS

FOREWORD .....	4
INTRODUCTION .....	6
1 Scope .....	7
2 General .....	7
2.1 Overview of the IEC 61968 series .....	7
2.2 An example using the IEC 61968 series .....	8
2.3 Overview of IEC 61968-1 .....	9
3 Interface reference model .....	10
3.1 Domain .....	10
3.2 Business functions .....	10
3.3 Interface reference model .....	11
4 Interface architecture .....	17
4.1 General .....	17
4.2 Requirements analysis methodology .....	18
5 Interface profile .....	18
5.1 Components .....	18
5.2 Component adapters .....	19
5.3 Interface specification .....	20
5.4 Middleware adapter .....	21
5.5 Middleware services .....	22
5.6 Communication services .....	23
5.7 Platform environment .....	23
6 Information exchange model .....	23
6.1 General requirements .....	23
6.2 IEM management related services .....	24
7 Component reporting and error handling .....	25
7.1 General .....	25
7.2 Error message handling .....	25
8 Security and authentication .....	26
8.1 General .....	26
8.2 Security threats .....	26
8.3 Security functions .....	27
8.4 Management of integrity and security .....	28
8.5 Security agent .....	28
9 Maintenance aspects .....	29
Annex A (informative) Distribution management domain .....	30
Annex B (informative) IEC 61968 series development process .....	33
Annex C (informative) Inter-application integration performance considerations .....	58
Annex D (informative) Views of data in a conventional electric utility .....	60
Annex E (informative) Business functions .....	63

Figure 1 – Distribution management system with IEC 61968 compliant interface architecture .....	6
Figure 2 – Example utility implementation of the IEC 61968 series .....	9
Figure 3 – Typical applications mapped to interface reference model .....	11
Figure 4 – Overview of the interface profile and corresponding subclause numbers .....	18
Figure A.1 – Hierarchy of complexity in a system environment .....	30
Figure A.2 – General utility structure .....	31
Figure B.1 – Process 1A: IEC Technical Committee 57 Working Group 14 process for developing future parts of the IEC 61968 series .....	34
Figure B.2 – Process 1B: (Continuation) IEC Technical Committee 57 Working Group 14 process for developing future parts of the IEC 61968 series .....	35
Figure B.3 – Process 2A: Typical business subfunctions of DMS and external systems .....	36
Figure B.4 – Process 2B: (continuation) an overview of an utility's application of the IEC 61968 standard .....	37
Figure B.5 – Typical components of major DMS business functions – Part 1 .....	39
Figure B.6 – Typical components of major DMS business functions – Part 2 .....	40
Figure B.7 – Integration scenario example (from: data acquisition for external EMS) .....	47
Figure B.8 – Message data model example (from use case 46: data acquisition for external EMS) .....	55
Figure B.9 – CIM top level package .....	56
Figure D.1 – Database views depend on the time and user .....	61
Figure E.1 – Map of typical utility systems to the business functions of the IRM .....	63
SIST EN 61968-1:2004 standards/sist/60535166-c498-4742-8881-c114696340d1/sist-en-61968-1-2004	
Table 1 – Document overview for IEC 61968-1 .....	9
Table 2 – Interface reference model .....	12
Table A.1 – Examples of data exchange in a company environment .....	31
Table A.2 – Data categories .....	32
Table B.1 – Use case template .....	42
Table B.2 – Example steps in a Use Case (From: Data Acquisition for External EMS) .....	45
Table B.3 – Information model (from: data acquisition for external EMS) .....	48
Table B.4 – Commonly used verbs .....	50
Table B.5 – OAG verbs .....	53
Table C.1 – Typical load scenario .....	58
Table C.2 – Example of typical transaction volume for DMS .....	59
Table E.1 – Typical information exchanged among business functions of the IRM .....	64

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

APPLICATION INTEGRATION AT ELECTRIC UTILITIES –  
SYSTEM INTERFACES FOR DISTRIBUTION MANAGEMENT –

## Part 1: Interface architecture and general requirements

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the same recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61968-1 has been prepared by IEC technical committee 57: Power system control and associated communications.

The text of this standard is based on the following documents:

FDIS	Report on voting
57/650/FDIS	57/668/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.



IEC 61968 consists of the following parts under the general title *Application integration at electric utilities – System interfaces for distribution management*:

Part 1: Interface architecture and general requirements

Part 2: Glossary<sup>1</sup>

Part 3: Interface standard for network operations<sup>1</sup>

Part 4: Interface standard for records and asset management<sup>1</sup>

The committee has decided that the contents of this publication will remain unchanged until 2005. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

## iTeh STANDARD PREVIEW (standards.iteh.ai)

SIST EN 61968-1:2004


<https://standards.iteh.ai/catalog/standards/sist/b0535166-c498-4742-888b-c114696340d1/sist-en-61968-1-2004>

---

<sup>1</sup> Under consideration.

## INTRODUCTION

The IEC 61968 series is intended to facilitate inter-application integration, as opposed to intra-application integration, of the various distributed software application systems supporting the management of utility electrical distribution networks. Intra-application integration is aimed at programs in the same application system, usually communicating with each other using middleware that is embedded in their underlying runtime environment, and tends to be optimized for close, real-time, synchronous connections and interactive request/reply or conversation communication models. IEC 61968, by contrast, is intended to support the inter-application integration of a utility enterprise that needs to connect disparate applications that are already built or new (legacy or purchased applications), each supported by dissimilar runtime environments. Therefore, IEC 61968 is relevant to loosely coupled applications with more heterogeneity in languages, operating systems, protocols and management tools. IEC 61968 is intended to support applications that need to exchange data on an event driven basis. IEC 61968 is intended to be implemented with middleware services that broker messages among applications, and will complement, but not replace utility data warehouses, database gateways, and operational stores.

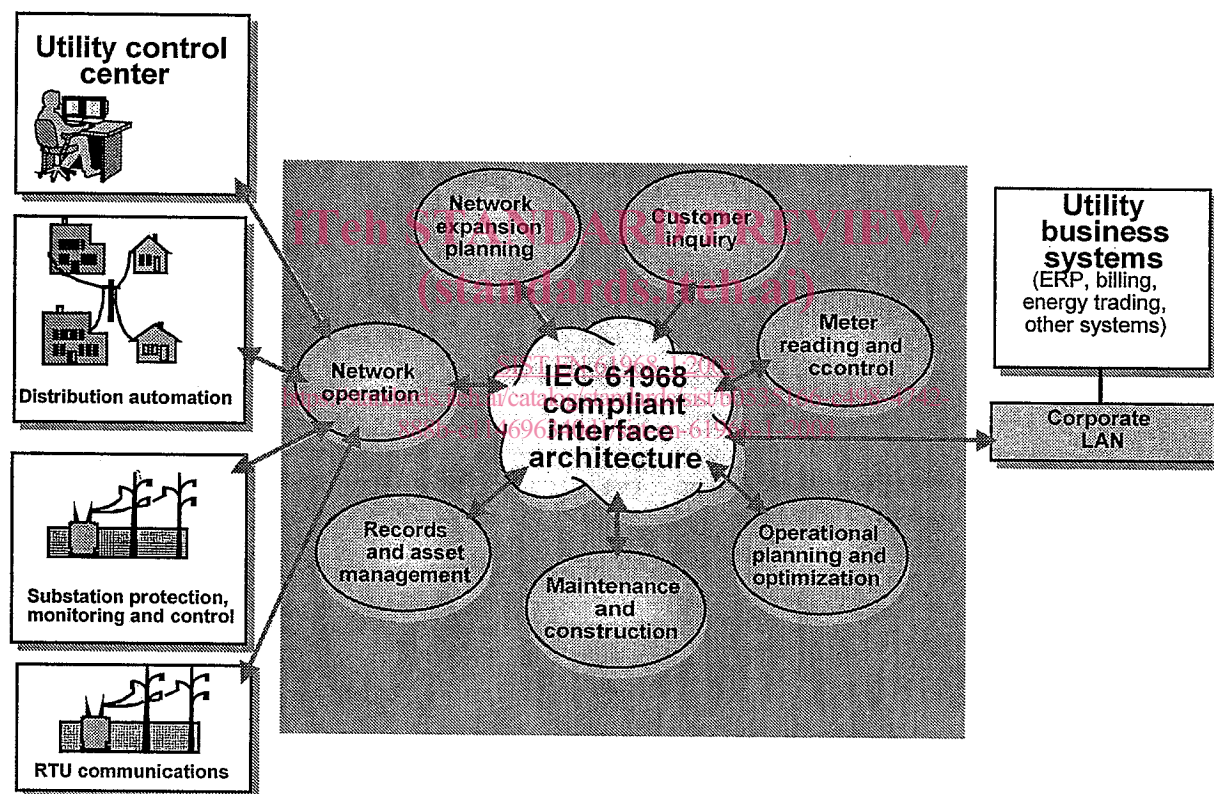

IEC 2315/03

**Figure 1 – Distribution management system with IEC 61968 compliant interface architecture**

Figure 1 clarifies the scope of IEC 61968-1 graphically in terms of business functions and shows a Distribution Management System with IEC 61968 compliant interface architecture.

# APPLICATION INTEGRATION AT ELECTRIC UTILITIES – SYSTEM INTERFACES FOR DISTRIBUTION MANAGEMENT –

## Part 1: Interface architecture and general requirements

### 1 Scope

This part of IEC 61968 is the first in a series that, taken as a whole, defines interfaces for the major elements of an interface architecture for Distribution Management Systems (DMS). This part of IEC 61968 identifies and establishes requirements for standard interfaces based on an Interface Reference Model (IRM). Subsequent parts of this standard are based on each interface identified in the IRM. This set of standards is limited to the definition of interfaces and is implementation independent. They provide for interoperability among different computer systems, platforms, and languages. Methods and technologies used to implement functionality conforming to these interfaces are considered outside of the scope of these standards; only the interface itself is specified in the IEC 61968 series.

As used in the IEC 61968 series, a DMS consists of various distributed application components for the utility to manage electrical distribution networks. These capabilities include monitoring and control of equipment for power delivery, management processes to ensure system reliability, voltage management, demand-side management, outage management, work management, automated mapping and facilities management. The IRM is specified in Clause 4.

(standards.iteh.ai)

### 2 General

SIST EN 61968-1:2004

#### 2.1 Overview of the IEC 61968 series

As used in IEC 61968, a DMS (Distribution Management System) consists of various distributed application components for the utility to manage electrical distribution networks. These capabilities include monitoring and control of equipment for power delivery, management processes to ensure system reliability, voltage management, demand-side management, outage management, work management, automated mapping and facilities management. Standards interfaces are to be defined for each class of applications identified in the Interface Reference Model (IRM), which is described in Clause 4.

IEC 61968 recommends that system interfaces of a compliant utility inter-application infrastructure be defined using Unified Modelling Language (UML).

The eXtensible Markup Language (XML) is a data format for structured document interchange particularly on the Internet. One of its primary uses is information exchange between different and potentially incompatible computer systems. XML is thus well-suited to the domain of system interfaces for distribution management.

Where applicable, future parts of the IEC 61968 series will define the information required for 'message payloads'. Message Payloads will be formatted using XML with the intent that these payloads can be loaded on to messages of various messaging transports, for example OAG, SOAP (Simple Object Access Protocol), etc. The XML encoding rules will be covered in a future part of the IEC 61968 series.

Communication between application components of the IRM requires compatibility on two levels:

- Message formats and protocols.
- Message contents must be mutually understood, including application-level issues of message layout and semantics.


Clause 5 defines abstract middleware services required to support communication between the applications defined in the IRM. These services are intended to be deployed, with little additional software required, by mapping them to commonly available services from various messaging technologies including middleware such as message brokers, Message Oriented Middleware (MOM), Message-Queuing Middleware (MQM), and Object Request Brokers (ORBs). This clause is organized as follows:

- Subclause 5.1 identifies general requirements of the applications identified in the IRM.
- Subclause 5.2 describes how standard information exchange services may either be invoked directly from an application (native mode) or that software may be used to map (adapt) an application to the information exchange services.
- Subclause 5.3 identifies standard services required for applications to exchange information with other applications.
- Subclause 5.4 describes how information exchange services may either be supported directly by middleware or that software may be required to map (adapt) the utility's middleware services to the standard information exchange services.
- Subclauses 5.5 to 5.7 describe environmental requirements for information exchange.

## 2.2 An example using the IEC 61968 series

An example of a typical utility's implementation of the IEC 61968 series is provided in Figure 2. In this example, the utility has used interface adapters as a means of integrating many of its legacy systems with other application systems that are IEC 61968 compliant. Note those legacy systems and IEC 61968 series compliant systems both continue to use proprietary integration techniques among their internal applications; only information that needs to be exchanged among applications at the utility enterprise level is expected to use IEC 61968 series middleware services.

For the purposes of this example, the utility's Outage Management System (OMS) is assumed to already have the capability of issuing controls to and gathering device states from the Distribution Automation System (DAS). As it is working acceptably for the utility, this interface does not need to be changed. However, because other applications need to be notified when distribution devices change state, the DAS publishes state changes through middleware services. Another benefit of publishing events is that they can be recorded by an event history application in a data store; this data can then be used in the generation of various types of reports. As much of the information exchanged among these systems is useful for management decision support, a data warehouse application has also been connected to the IEC 61968 middleware services so that it may receive published information.

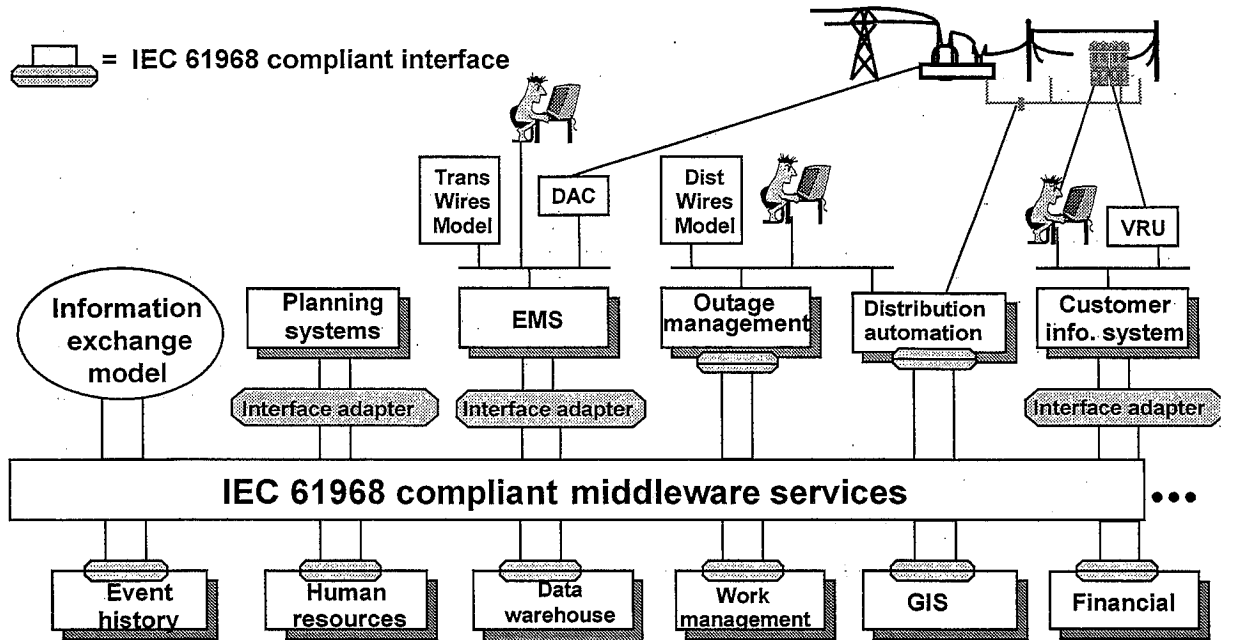

IEC 2316/03

Figure 2 – Example utility implementation of the IEC 61968 series

### 2.3 Overview of IEC 61968-1

The organization of IEC 61968-1 is described in Table 1.

Table 1 – Document overview for IEC 61968-1

Clause	Title	Purpose
1	Scope	Scope of IEC 61968, Part 1.
2	General	Overview and examples.
3	Interface reference model	The domain relevant to the IEC 61968 series is described. For each relevant business function, a list of abstract components is provided, which is described by the functions performed by the component. future parts of the IEC 61968 series will define interfaces for these abstract components.
4	Interface architecture	The interface reference model for utility inter-application integration is provided along with the rationale for its structure.
5	Interface profile	Utility inter-application integration environmental requirements are described. Abstract message passing services are defined that must be available for applications to communicate information to other applications, including publish and subscribe services.
6	Information exchange model	Metadata is used to describe event types that are published by applications. Applications subscribing to receive all messages for a certain event type recognize the fields of a particular event message once they have looked up the metadata for the event type in the information exchange model. While many event types are described in the IEC 61968 series, metadata is the means by which vendors and utilities can add new event types without violating this standard.
7	Component reporting and error handling	Requirements for audit trails and error message handling authentication necessary to support utility inter-application integration are described.
8	Security and authentication	Requirements for security and authentication necessary to support utility inter-application integration are described.
9	Maintenance aspects	General maintenance requirements are specified.
Annex A	Distribution management domain	An overview of business functions required for electric utility distribution management is described.

Annex B	IEC 61968 series Development process	The methodology used to determine interface architecture requirements for utility inter-application integration is described.
Annex C	Inter-application integration performance considerations	Some typical performance requirements necessary to support utility inter-application integration are described. These requirements are of a general nature as specific implementation requirements will vary by utility.
Annex D	Views of data in a conventional electric utility	This annex describes some of the underlying principles of defining the reference data dictionary of a future part of the IEC 61968 series.
Annex E	Business functions	This annex describes the typical data producer and consumer subsystems for each DMS business function.

### 3 Interface reference model

#### 3.1 Domain

Within this part of IEC 61968, the distribution management domain covers all aspects of management of utility electrical distribution networks. A distribution utility will have some or all of the responsibility for monitoring and control of equipment for power delivery, management processes to ensure system reliability, voltage management, demand-side management, outage management, work management, automated mapping and facilities management.

The distribution management domain may be organised as two inter-related types of business, electricity supply and electricity distribution. Electricity supply is concerned with the purchase of electrical energy from bulk producers for sale to individual consumers. Electricity distribution covers the management of the physical distribution network that connects the producers and consumers. In some countries, the responsibility of organisations may be legally restricted and certain sections of the IEC 61968 series will be inapplicable.

A utility domain includes the software systems, equipment, staff and consumers of a single utility organisation, which could be a company or a department. It is expected that within each utility domain, the systems, equipment, staff and consumers can be uniquely identified. When information is exchanged between two utility domains, then identifiers may need to be extended with the identity of the utility organisation in order to guarantee global uniqueness.


#### 3.2 Business functions

Various departments within a utility co-operate to perform the operation and management of a power distribution network; this activity is termed distribution management. Other departments within the organisation may support the distribution management function without having direct responsibility for the distribution network. This segmentation by business function<sup>2</sup> is provided in the Interface Reference Model (IRM), which is described in detail in 3.3.

The use of a business-related model should ensure independence from vendor-produced system solutions. It is an important test of the viability of this standard that the IRM be recognisable to utility staff as a description of their own distribution network operation and management.

Major utility business functions, which provide the top level categories of the IRM, are shown in Figure 3 below.

<sup>2</sup> The work of the CIREN working group on distribution automation, published in 1996, is fully acknowledged in the segmentation.

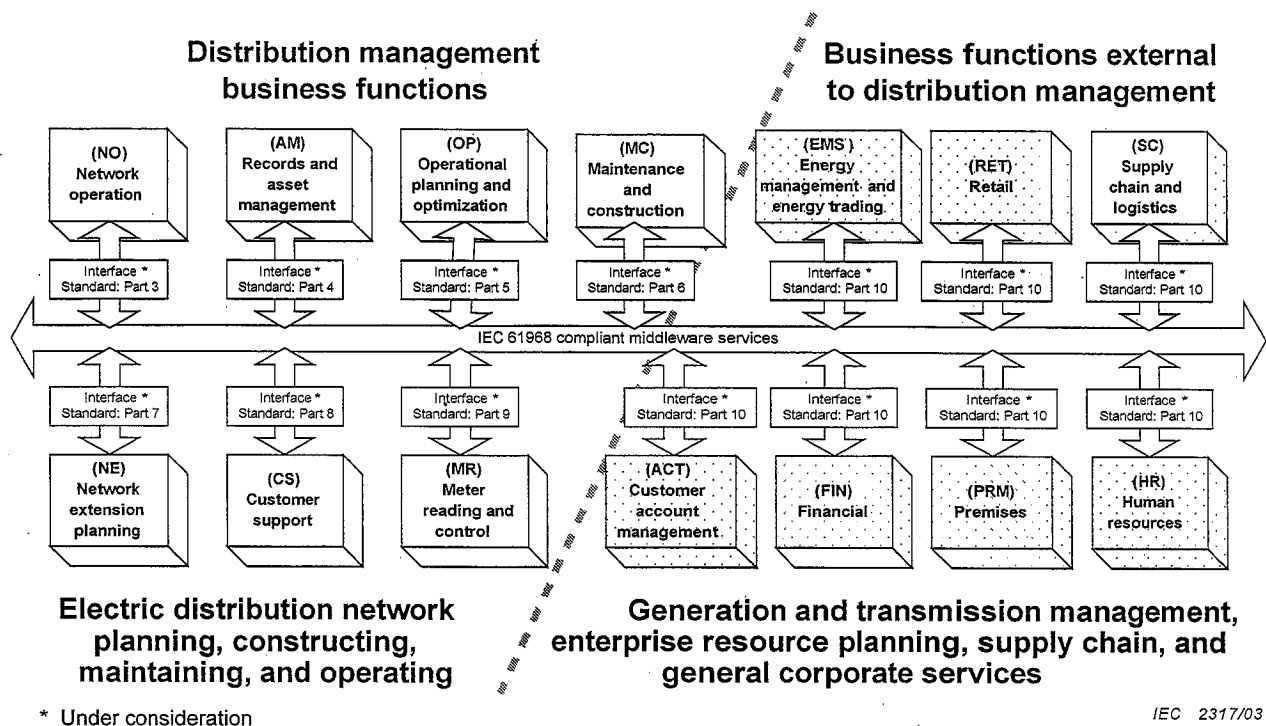

## iTeh STANDARD PREVIEW

Figure 3 – Typical applications mapped to interface reference model

SIST EN 61968-1:2004

<https://standards.iteh.ai/catalog/standards/sist/b0535166-c498-4742-888b-c114696340d1/sist-en-61968-1-2004>

### 3.3 Interface reference model

It is not the intention of this standard to define the applications and systems that vendors should produce. It is expected that a concrete (physical) application will provide the functionality of one or more abstract (logical) components as listed in this standard. These abstract components are grouped by the business functions of the interface reference model.

In this standard, the term abstract component is used to refer to that portion of a software system that supports one or more of the interfaces defined in future parts of the IEC 61968 series. It does not necessarily mean that compliant software is delivered as separate modules.

In this subclause, the definitions of business functions defined in Subclause 3.2 are further extended into:

- Sub-business functions (second column of Table 2).
- Abstract components (third column of Table 2).

NOTE Some abstract components may be used by several different business functions. For example, a component like power flow can be used for network operation, short term operational planning and optimisation, and long term network extension planning. Much of the information exchanged for power flow purposes in each of these areas will therefore use many of the same information exchange message types (see Clause 5).

Applications from different vendors package the functionality of these abstract components in different ways. To use the IEC 61968 services, each application must support one or more of the interfaces for the abstract components.

This part of IEC 61968 describes infrastructure services common to all abstract components whilst future parts of the IEC 61968 series will define the details of the information exchanged for specific types of abstract component.