

TECHNICAL SPECIFICATION



**Recommendations for small renewable energy and hybrid systems for rural electrification –
Part 9-4: Integrated system – User installation**

IEC TS 62257-9-4:2006

<https://standards.iteh.ai/catalog/standards/iec/ae543239-d82d-458e-a70b-b10be8745707/iec-ts-62257-9-4-2006>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2006 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.

Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch
Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00

TECHNICAL SPECIFICATION



**Recommendations for small renewable energy and hybrid systems for rural
electrification –
Part 9-3: Integrated system – User installation**

<https://standards.iteh.ai/catalog/standards/iec/ae543239-d82d-458e-a70b-b10be8745707/iec-ts-62257-9-4-2006>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

PRICE CODE

S

ICS 27.160; 27.180

ISBN 2-8318-8865-4

CONTENTS

FOREWORD.....	3
INTRODUCTION.....	5
1 Scope.....	6
2 Normative reference.....	6
3 Terms and definitions.....	6
4 General considerations.....	7
4.1 General.....	7
4.2 Installation limits.....	7
4.3 User interface.....	7
5 Protection against electric shock.....	8
5.1 Requirements for d.c. parts of installation.....	8
5.2 Requirements for a.c. parts of installation.....	8
6 Protection against overcurrent.....	9
7 Protection against effect of lightning.....	10
7.1 Installation supplied from a microgrid.....	10
7.2 Standalone installation.....	10
8 Selection and erection of electrical equipment.....	10
8.1 Wiring system.....	10
8.2 Isolation and switching.....	16
8.3 Surge protective devices.....	17
8.4 Earthing arrangement, protective conductors and protective bonding.....	17
8.5 User interface.....	17
9 Verification.....	17
9.1 Pre-commissioning checks.....	17
10 Operation and maintenance.....	18
Annex A (informative) Maximum possible length of circuits with different cables and conductors to handle maximum voltage drops (ambient temperature 30°C).....	19
Figure 1 – Installation limits.....	7
Figure 2 – Protection of persons in an installation supplied from a microgrid according to a TN-C-S system.....	8
Figure 3 – Protection of persons in a combined d.c. and a.c. system.....	9
Figure A.1 – Maximum possible length of circuit as a function of current for a voltage drop of 3 % in a.c. system in a cable HO5VVF.....	20
Figure A.2 – Maximum possible length of circuit as a function of current for a voltage drop of 15 % in d.c. system in a cable 1000RO2V.....	21
Table 1 – maximum design current of circuits depending on voltages.....	9
Table 2 – Maximum acceptable voltage drop values in installations.....	11
Table 3 – Cross-sectional area for copper conductors in fixed installations.....	11
Table 4 – Selection of wiring systems.....	12
Table 5 – Installation of wiring systems.....	13
Table 6 – Fuses/circuit breakers rating and selection for overcurrent protection.....	17

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**RECOMMENDATIONS FOR SMALL RENEWABLE ENERGY
AND HYBRID SYSTEMS FOR RURAL ELECTRIFICATION –****Part 9-4: Integrated system – User installation**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- The subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC 62257-9-4, which is a technical specification, has been prepared by IEC technical committee 82: Solar photovoltaic energy systems.

This part of IEC 62257-9 is based on IEC/PAS 62111 (1999); it cancels and replaces the relevant parts of IEC/PAS 62111.

This part of IEC 62257-9 is to be used in conjunction with the IEC 62257 series.

The text of this technical specification is based on the following documents:

Enquiry draft	Report on voting
82/414/DTS	82/441/RVC

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 62257 series, under the general title *Recommendations for small renewable energy and hybrid systems for rural electrification*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- transformed into an international standard;
- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

IMPORTANT – The “colour inside” logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this publication using a colour printer.

INTRODUCTION

The IEC 62257 series intends to provide to different players involved in rural electrification projects (such as project implementers, project contractors, project supervisors, installers, etc.) documents for the setting up of renewable energy and hybrid systems with a.c. nominal voltage below 500 V, d.c. nominal voltage below 750 V and nominal power below 100 kVA.

These documents are recommendations:

- to choose the right system for the right place,
- to design the system,
- to operate and maintain the system.

These documents are focused only on rural electrification concentrating on but not specific to developing countries. They should not be considered as all inclusive to rural electrification. The documents try to promote the use of Renewable energies in rural electrification; they do not deal with clean mechanisms developments at this time (CO₂ emission, carbon credit, etc.). Further developments in this field could be introduced in future steps.

This consistent set of documents is best considered as a whole with different parts corresponding to items for safety, sustainability of systems and at the lowest life cycle cost as possible. One of the main objectives is to provide the minimum sufficient requirements, relevant to the field of application that is: small renewable energy and hybrid off-grid systems.

iteh Standards
(<https://standards.iteh.ai>)
Document Preview

IEC TS 62257-9-4:2006

<https://standards.iteh.ai/catalog/standards/iec/ae543239-d82d-458e-a70b-b10be8745707/iec-ts-62257-9-4-2006>

RECOMMENDATIONS FOR SMALL RENEWABLE ENERGY AND HYBRID SYSTEMS FOR RURAL ELECTRIFICATION –

Part 9-4: Integrated system – User installation

1 Scope

The purpose of this part of IEC 62257 is to specify the general requirements for the design and the implementation of a user's installation.

This part of IEC 62257-9 applies to single phase user's electrical installations with maximum power of 500 VA, in Decentralized Rural Electrification Systems (DRES).

NOTE For installations above 500 VA in decentralized electrification systems, IEC 62257-5 applies.

This part of IEC 62257-9 is applicable to installations supplied by a microgrid (120 V a.c. or 230 V a.c.) and to installations encompassing their own single-unit micropowerplant (120 V a.c. or 230 V a.c. or 12 V d.c. or 24 V d.c.)

The part of IEC 62257-9 applies neither to the electric power production and distribution installations described in the sections concerning microplants and microgrids, nor to user electrical equipment. It details the rules governing the design and construction of consumer's electrical installations for the purpose of ensuring the safety of persons and property, and satisfactory operation in accordance with the purpose for which the installations are designed.

It applies to new installations and modifications of existing installations.

2 Normative reference

The following referenced documents are essential for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60269 (all parts), *Low-voltage fuses*

IEC 60364-5-52, *Electrical installations of buildings – Part 5-52: Selection and erection of electrical equipment – Wiring systems*

IEC 62257 (all parts), *Recommendations for small renewable energy and hybrid systems for rural electrification*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

protective conductor (identification: PE)

conductor provided for purposes of safety, for example protection against electric shock

NOTE In an electrical installation, the conductor identified PE is normally also considered as protective earthing conductor.

[IEV 195-02-09]

3.2**PEN conductor**

conductor combining the functions of a protective earthing conductor and a neutral conductor
[IEV 195-02-12]

3.3**equipotential bonding**

provision of electric connections between conductive parts, intended to achieve equipotentiality

NOTE The role of the equipotential bonding is to decrease the difference in potential that can exist between two exposed-conductive parts of an installation.

3.4**surge arrester**

device designed to protect the electrical apparatus from high transient overvoltages and to limit the duration and frequently, the amplitude of the follow-on current

3.5**supply point**

contractual limit between the grid and the user's installation

NOTE In rural electrification systems, it is generally located on the input terminals (microgrid side) of the user's interface.

3.6**Surge Protective Device
SPD**

device that is intended to protect the electrical apparatus from transient overvoltages and divert surge current; it contains at least one non linear component

4 General considerations**4.1 General**

User installations shall be designed to ensure protection of persons, animal and equipment in compliance with IEC 62257- 5.

Specific requirements for generators associated with stand-alone user installations are provided in the relevant part of the IEC 62257-7 series.

4.2 Installation limits

Installation limits are illustrated in following Figure 1.

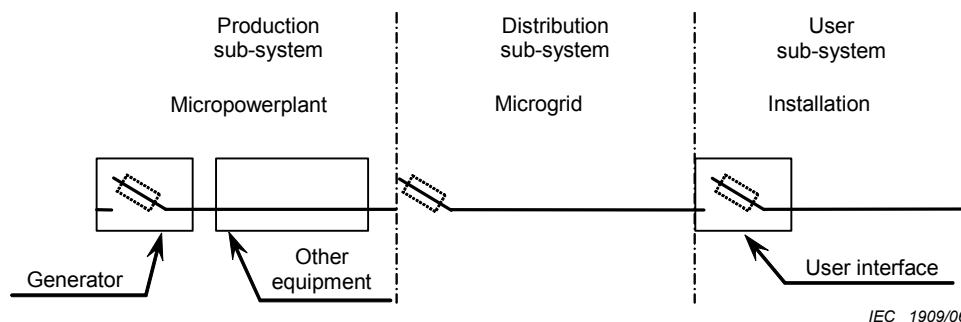


Figure 1 – Installation limits

4.3 User interface

See IEC 62257-9-3.

5 Protection against electric shock

5.1 Requirements for d.c. parts of installation

Simple separation, at least, shall be provided between the d.c. side and the a.c. side of a stand-alone installation (for a PV array, see also IEC 62257-7-1).

5.2 Requirements for a.c. parts of installation

5.2.1 General

The characteristics of the protective devices shall be such that if a fault of negligible impedance occurs anywhere in the installation between a phase conductor and a protective conductor or exposed conductive part, automatic disconnection of the supply will occur within 0,4 s.

A residual current protective device, with a rated operating residual current not exceeding 30 mA shall be provided as additional protection for each installation. It shall be placed in the user's interface housing.

5.2.2 Neutral earthing system

5.2.2.1 Installation supplied from a microgrid or standalone installation encompassing a micropowerplant 230 V or 120 V a.c.

User's electrical installation should be preferably designed according to a TN-S system.

NOTE 1 The TT system is not recommended for the user's installation, because for the TT system, each house is equipped with an earth electrode. For the electrification of remote villages, it could be difficult to install and maintain an effective earth electrode in each house.

Figure 2 illustrates the fault current circulation in TN-C-S systems.

NOTE 2 The "grey box" called "user interface" is specified in IEC 62257-9-3.

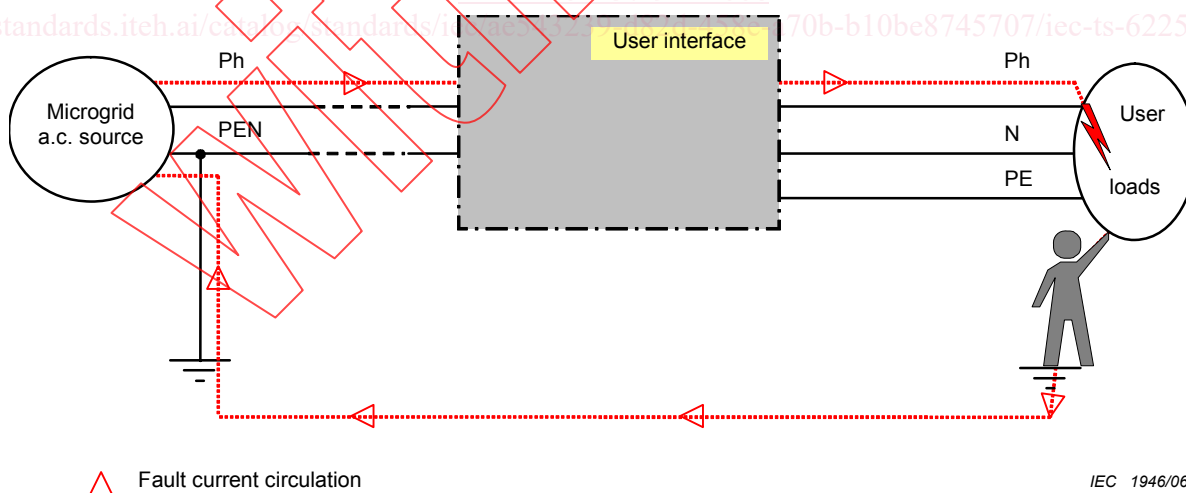


Figure 2 – Protection of persons in an installation supplied from a microgrid according to a TN-C-S system