

TECHNICAL REPORT



Communication networks and systems for power utility automation –
Part 90-1: Use of IEC 61850 for the communication between substations

(<https://standards.iteh.ai>)

Document Preview

[IEC TR 61850-90-1:2010](https://standards.iteh.ai/catalog/standards/iec/c87fd502-a3c3-4fd3-b8cd-8a31b0c219a2/iec-tr-61850-90-1-2010)

<https://standards.iteh.ai/catalog/standards/iec/c87fd502-a3c3-4fd3-b8cd-8a31b0c219a2/iec-tr-61850-90-1-2010>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2010 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.

Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch

Tel.: +41 22 919 02 11

Fax: +41 22 919 03 00

IEC TR 61850-90-1:2010

<https://standards.iteh.ai/catalog/standards/iec/c87fd502-a3c3-4fd3-b8cd-8a31b0c219a2/iec-tr-61850-90-1-2010>

TECHNICAL REPORT



**Communication networks and systems for power utility automation –
Part 90-1: Use of IEC 61850 for the communication between substations**

(<https://standards.iteh.ai>)

Document Preview

[IEC TR 61850-90-1:2010](https://standards.iteh.ai/catalog/standards/iec/c87fd502-a3c3-4fd3-b8cd-8a31b0c219a2/iec-tr-61850-90-1-2010)

<https://standards.iteh.ai/catalog/standards/iec/c87fd502-a3c3-4fd3-b8cd-8a31b0c219a2/iec-tr-61850-90-1-2010>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
2 Normative references	8
3 Terms and definitions	9
4 Abbreviated terms	9
5 Use cases	10
5.1 General.....	10
5.2 Distance line protection with permissive overreach tele-protection scheme	10
5.3 Distance line protection with blocking tele-protection scheme.....	13
5.4 Directional comparison protection.....	15
5.5 Transfer/Direct tripping.....	18
5.6 Interlocking	20
5.7 Multi-phase auto-reclosing application for parallel line systems	22
5.8 Current differential line protection	24
5.9 Phase comparison protection	28
5.10 Other applications	31
5.10.1 General	31
5.10.2 Fault locator system (2, 3 terminals).....	31
5.10.3 System integrity protection schemes (SIPS)	33
5.10.4 Real time predictive generator shedding	36
5.10.5 Out-of-step detection.....	39
5.10.6 Synchrophasors.....	41
5.10.7 Remedial action schemes (RAS)	41
6 Communication requirements for substation-to-substation communication.....	41
6.1 General issues	41
6.1.1 Introduction	41
6.1.2 Logical allocation of functions and interfaces (5.2 in IEC 61850-5)	41
6.1.3 The role of interfaces.....	43
6.1.4 Response behaviour requirements.....	43
6.2 Functions based on substation-substation communication.....	43
6.2.1 Protection functions.....	43
6.2.2 Control functions	44
6.3 Message performance requirements.....	44
6.3.1 Transfer time definition (13.4 in IEC 61850-5)	44
6.4 The introduction and use of message performance classes	47
6.4.1 General	47
6.4.2 Control and protection	47
6.4.3 Metering and power quality.....	49
6.5 General requirements for data integrity	51
6.6 Requirements for teleprotection – Reliability (security and dependability).....	51
6.6.1 General	51
6.6.2 Security requirements for protection schemes according to CIGRE and IEC	51
6.6.3 Dependability requirements for protection schemes according to CIGRE and IEC	52

7	Considerations on security and dependability issues when using Ethernet networks.....	52
7.1	General.....	52
7.2	Security of traffic.....	52
7.3	Dependability of traffic.....	53
7.4	Avoiding GOOSE packets flooding the WAN.....	53
7.5	Summary on recommendations for using Ethernet for communication between substations.....	54
7.5.1	General.....	54
7.5.2	Example of packet delays.....	54
7.6	Useful features of some Ethernet telecommunications networks.....	55
8	Communication aspects.....	55
8.1	Services.....	55
8.2	Communication architecture.....	55
8.2.1	Preliminary notes and definitions.....	55
8.2.2	Tunnelling.....	56
8.2.3	Gateway.....	57
9	Modelling.....	58
9.1	General architecture.....	58
9.2	Communication interface ITPC.....	59
9.3	Communication-aided protection schemes and direct tripping.....	61
9.3.1	Proposed model.....	61
9.3.2	LN PSCH.....	62
9.4	Differential protection schemes.....	62
9.4.1	Proposed model.....	62
9.4.2	LN RMXU.....	65
9.4.3	SV format.....	65
10	Configuration aspects.....	66
10.1	General.....	66
10.2	Direct communication link.....	66
10.2.1	General.....	66
10.2.2	SCL enhancements.....	71
10.2.3	SCL example.....	71
10.3	Tele-protection equipment between substations.....	77
	Bibliography.....	79

Figure 1 – Distance line protection with permissive overreach tele-protection scheme 10

Figure 2 – Distance line protection with blocking tele-protection scheme 13

Figure 3 – Directional comparison with permissive scheme..... 16

Figure 4 – Transfer/Direct tripping 18

Figure 5 – Interlocking – Interoperation..... 20

Figure 6 – Auto-reclosing..... 22

Figure 7 – Current differential line protection 25

Figure 8 – Phase comparison protection 28

Figure 9 – Principle to detect internal fault by phase comparison 28

Figure 10 – Fault locator system (2, 3 terminals) 31

Figure 11 – Example of a system integrity protection scheme 33

Figure 12 – Real time predictive type generator shedding system 36

Figure 13 – Out-of-step detection.....	39
Figure 14 – Logical interfaces between substation A and substation B.....	42
Figure 15 – Transfer time for binary and other signals over a serial connection	45
Figure 16 – Transfer time for binary signal with conventional output and input relays.....	45
Figure 17 – Definition of transfer time t for binary signals in case of line protection.....	46
Figure 18 – Definition of transfer time t over serial link in case of line protection.....	46
Figure 19 – Basic SS-to-SS communication structure	56
Figure 20 – SS-to-SS communication via tunnel	57
Figure 21 – SS-to-SS communication via proxy gateway.....	58
Figure 22 – Allocation of the LN ITPC representing the communication channel and the LNs providing the data to be exchanged between substations.....	59
Figure 23 – Protection application example for permissive underreach distance teleprotection scheme and appropriate logical node modelling	61
Figure 24 – Communication system based on current system	63
Figure 25 – Communication system based on future system	63
Figure 26 – Proposed 2-terminal current differential feeder protection relay model	64
Figure 27 – Proposed 3-terminal current differential feeder protection relay model	64
Figure 28 – SCD files and SED region for SS-to-SS communication	67
Figure 29 – Enhanced engineering process	68
Figure 30 – IED states when exchanging SED files	70
Figure 31 – Proxy gateway method (AA1F3, AA2F3 are Proxy gateways)	78
Document Preview	
Table 1 – Grouping of protection and control interfaces	42
Table 2 – Protection functions using substation-substation communication	43
Table 3 – Control functions using substation-substation communication	44
Table 4 – Change of transfer time and synchronisation method	50
Table 5 – Performance classes for time tagging of events.....	50
Table 6 – Time performance classes for instrument transformer synchronisation	50
Table 7 – The bit error rate as indication for communication quality	51
Table 8 – Logical node ITPC.....	60
Table 9 – Logical node PSCH.....	62
Table 10 – Logical node RMXU.....	65
Table 11 – Sampled value (SV) format definition.....	66
Table 12 – IED engineering control types.....	69

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**COMMUNICATION NETWORKS AND SYSTEMS
FOR POWER UTILITY AUTOMATION –****Part 90-1: Use of IEC 61850 for the communication
between substations**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a technical report when it has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

IEC 61850-90-1, which is a technical report, has been prepared by IEC technical committee 57: Power systems management and associated information exchange.

The text of this technical report is based on the following documents:

Enquiry draft	Report on voting
57/992/DTR	57/1021/RVC

Full information on the voting for the approval of this technical report can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61850 series, under the general title: *Communication networks and systems for power utility automation*, can be found on the IEC website.

The committee has decided that the contents of this amendment and the base publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

When IEC 61850 was prepared, it was intended for use in information exchange between devices of a substation automation system. In the mean time, the concepts are now used as well in other application domains of the power utility system. Therefore, IEC 61850 is on the way to becoming the foundation for a globally standardized utility communication network.

With existing and new applications in the field of power system operation and protection, the requirement to exchange standardized information directly between substations is increasing. IEC 61850 shall be the basis for this information exchange.

IEC 61850 provides the basic features to be used for that information exchange, however, some extensions to IEC 61850 may be required. This technical report provides a comprehensive overview of the different aspects that need to be considered when using IEC 61850 for information exchange between substations. Areas that require extension of specific parts of the existing IEC 61850 standard will later be incorporated in future editions of the affected part of IEC 61850.

A similar report discussing the use of IEC 61850 for communication between substations and control centres is under preparation as IEC 61850-90-2¹⁾. Further, a similar report discussing the use of IEC 61850 for wide-area RAS (remedial action schemes) is being contemplated; this will likely be IEC 61850-90-3¹⁾.

The scope of IEC 61850 is no longer limited to substations. This is reflected in the changed title of the series. New domain specific parts have been added to the series. Working Group 10 of Technical Committee 57 is currently preparing the second edition of the basic parts of IEC 61850.

Document Preview

[IEC TR 61850-90-1:2010](https://standards.iteh.ai/catalog/standards/iec/c87fd502-a3c3-4fd3-b8cd-8a31b0c219a2/iec-tr-61850-90-1-2010)

<https://standards.iteh.ai/catalog/standards/iec/c87fd502-a3c3-4fd3-b8cd-8a31b0c219a2/iec-tr-61850-90-1-2010>

1) Under consideration.

COMMUNICATION NETWORKS AND SYSTEMS FOR POWER UTILITY AUTOMATION –

Part 90-1: Use of IEC 61850 for the communication between substations

1 Scope

This part of IEC 61850 provides a comprehensive overview on the different aspects that need to be considered while using IEC 61850 for information exchange between substations. In particular, this technical report

- defines use cases that require an information exchange between substations;
- describes the communication requirements;
- gives guidelines for the communication services and communication architecture to be used;
- defines data as a prerequisite for interoperable applications;
- does not define implementations which guarantee interoperability between different IEDs;
- describes the usage and enhancements of the configuration language SCL.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

<https://standards.iteh.ai/>
IEC TR 61850-90-1:2010

<https://standards.iteh.ai/> IEC 60044 (all parts), *Instrument transformers* [a3c3-4fd3-b8cd-8a31b0c219a2/iec-tr-61850-90-1-2010](https://standards.iteh.ai/standards/iec-tr-61850-90-1-2010)

IEC 60834-1:1999, *Teleprotection equipment of power systems – Performance and testing – Part 1: Command systems*

IEC 60834-2:1993, *Performance and testing of teleprotection equipment of power systems – Part 2: Analogue comparison systems*

IEC 60870-4, *Telecontrol equipment and systems – Part 4: performance requirements*

IEC/TS 61850-2, *Communication networks and systems in substations – Part 2: Glossary*

IEC 61850 (all parts), *Communication networks and systems for power utility automation*

IEC 61850-3, *Communication networks and systems in substations – Part 3: General requirements*

IEC 61850-5:2003, *Communication networks and systems in substations – Part 5: Communication requirements for functions and device models*

IEC 61850-6:2009, *Communication networks and systems for power utility automation – Part 6: Configuration description language for communication in electrical substations related to IEDs*

IEC 61850-7-2:2010, *Communication networks and systems for power utility automation – Part 7-2: Basic communication structure – Abstract communication service interface (ACSI)*

IEC 61850-7-4:2010, *Communication networks and systems for power utility automation – Part 7-4: Basic communication structure – Compatible logical node classes and data object classes*

IEC 61850-8-1, ___ *Communication networks and systems for power utility automation – Part 8-1: Specific Communication Service Mapping (SCSM) - Mappings to MMS (ISO 9506-1 and ISO 9506-2) and to ISO/IEC 8802-3²⁾*

IEC 61850-9-2, ___ *Communication networks and systems in substations – Part 9-2: Specific Communication Service Mapping (SCSM) – Sampled values over ISO/IEC 8802-3²⁾*

IEC 62053-22, *Electricity metering equipment (a.c.) – Particular requirements – Part 22: Static meters for active energy (classes 0,2 S and 0,5 S)*

IEC/TS 62351-6, *Power systems management and associated information exchange – Data and communication security – Part 6: Security for IEC 61850*

IEC 62439, *High availability automation networks*

ANSI/IEEE 1588, *Standard for a Precision Clock Synchronization Protocol for Networked Measurement and Control Systems / revision of ANSI/IEEE 1588-2002 / Approved 2008-09-10*

IEEE 802.1Q, *Local and metropolitan area networks – Virtual bridged local area networks*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 61850-2 and IEC 61850-7-2 apply.

4 Abbreviated terms

BER	Bit error ratio
Bkr	Circuit breaker
C/S	Client / Server
CE	Central equipment
DCB	Directional comparison blocking
DF	Directional relay to detect forward faults
EHV	Extreme high voltage
HV	High voltage
IF, I/F	Interface
I/F -R	Interface to receive data
I/F -S	Interface to send data
L2TP	Layer 2 tunnelling protocol
MV	Medium voltage
PDH	Plesiochronous digital hierarchy
PMU	Phasor measurement units
QA	Circuit breaker
QB	Line disconnector
QC	Earthing switch
QinQ	802.1Q in 802.1Q (VLAN stacking)
RAS	Remedial action schemes

²⁾ To be published

RO	Overreaching distance zone
RT	Remote terminal
Rx	Receiver
SDH	Synchronous digital hierarchy
SIPS	System integrity protection scheme
SONET	Synchronous optical NETwork transport system
SS	Substation
TPI	Teleprotection interface
Tx	Transmitter
VoIP	Voice over IP (Internet protocol)
VPN	Virtual private network
WAN	Wide area network

NOTE Abbreviations used for the identification of the common data classes and as names of the attributes are specified in the specific clauses of this document and are not repeated here.

5 Use cases

5.1 General


For the purpose of communication between substations, the following functions are considered.

Conventional CTs and VTs are assumed for input to relays in the following use cases. However, they could be replaced by newer technology, such as digital input based on process bus, without any significant change in the descriptions.

5.2 Distance line protection with permissive overreach tele-protection scheme

Summary:

When a distance relay detects a forward fault in the overreach zone, it sends a permissive signal to the remote end, see Figure 1. If that relay also receives a permissive signal (from the remote end), the relay sends a trip signal to the local CB.

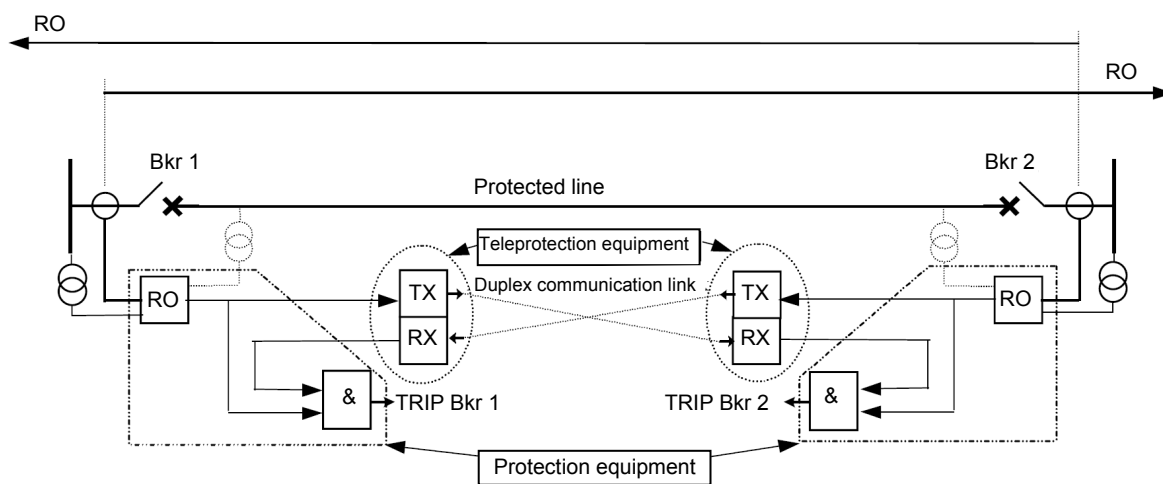

RO Overreaching trip function, must be set to reach beyond remote end terminal

IEC 503/10


Figure 1 – Distance line protection with permissive overreach tele-protection scheme [1]³⁾

3) Figures in square brackets refer to the Bibliography.

Constraints / Assumptions / Design considerations:

- The permissive signal needs a minimum of 1 bit. If it is a phase segregated signal, it needs 3 bits. If it is a phase segregated, and phase-to-phase and phase-to-earth are independent, the signal needs 6 bits. Directional earth fault detection may need another 1 bit.
- Data is sent only when a forward fault is detected.
- For communication channel failure, alternative actions must be considered.
- For fast tripping, the propagation, delay shall be small (e.g.: less than 5 ms).
- A high reliability is needed (e.g. BER less than 10^{-6} , alternative route, duplicated).

Use case diagram:

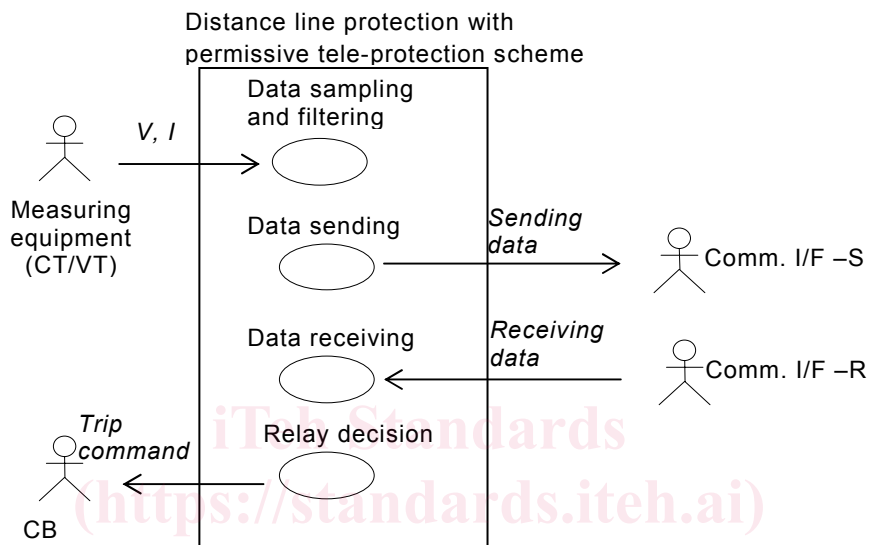

Actor(s):

Name	Role description
Measuring equipment	Measures current and voltage from protected line
Comm. I/F -S	Receives data from the local relay and sends the data to the remote end
Comm. I/F -R	Receives data from the remote end and gives the data to the local relay
CB	Disconnects the protected line from other system (Circuit breaker)

Use case(s):

Name	Services or information provided
Data sampling and filtering	Samples current and voltage data from measuring equipment and filters them
Data sending	Calculates a distance to the fault using filtered data. When a distance protection detects a forward fault, the distance protection sends the permissive signal to Comm. I/F -S (the remote end)
Data receiving	Receives the permissive signal from Comm. I/F -R (the remote end)
Relay decision	When the distance protection detects the forward faults and receives permissive signal from remote end, the distance protection issues a trip command to the CB

Basic flow:

Data sampling and filtering

Use case step	Description
Step 1	Current and voltage are given to distance protection by measuring equipment
Step 2	Distance protection samples an analogue value and converts it to digital data
Step 3	Distance protection removes any unwanted frequency components from the sampled data using a digital filter

Data sending

Use case step	Description
Step 1	Distance protection stores the filtered instantaneous data
Step 2	Distance protection calculates a distance to the fault using filtered data
Step 3	When a distance protection detects a forward fault to a pre-determined distance, a distance protection sends the permissive signal to Comm. I/F –S (in order to send the data to a remote end relay)
Step 4	Comm. I/F –S send the information to remote end

Data receiving

Use case step	Description
Step 1	Comm. I/F –R receives the data from the remote end
Step 2	Comm. I/F –R gives the received data to distance protection
Step 3	Distance protection receives the data

Relay decision

Use case step	Description
Step 1	When the distance protection detects the forward faults in a predetermined zone, and receives a permissive signal from the remote end, the distance protection issues a trip command to the CB

Exceptions / Alternate flow:

N.A.

Pre-conditions:

N.A.

Post-conditions:

N.A.

References:

[1] Protection Using Telecommunication