

INTERNATIONAL STANDARD

NORME INTERNATIONALE

Equipment for general lighting purposes – EMC immunity requirements

**Équipements pour l'éclairage à usage général – Exigences concernant
l'immunité CEM**

<https://standards.iteh.ai/catalog/standards/sist/9036d1f-e0be-4361-8c84-67d150759d8d/iec-61547-2009>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2009 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.

Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch

Tel.: +41 22 919 02 11

Fax: +41 22 919 03 00

A propos de la CEI

La Commission Electrotechnique internationale (CEI) est la première organisation mondiale qui élabore et publie des normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications CEI

Le contenu technique des publications de la CEI est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

- Catalogue des publications de la CEI: www.iec.ch/searchpub/cur_fut-f.htm

Le Catalogue en-ligne de la CEI vous permet d'effectuer des recherches en utilisant différents critères (numéro de référence, texte, comité d'études,...). Il donne aussi des informations sur les projets et les publications retirées ou remplacées.

- Just Published CEI: www.iec.ch/online_news/justpub

Restez informé sur les nouvelles publications de la CEI. Just Published détaille deux fois par mois les nouvelles publications parues. Disponible en-ligne et aussi par email.

- Electropedia: www.electropedia.org

Le premier dictionnaire en ligne au monde de termes électroniques et électriques. Il contient plus de 20 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans les langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International en ligne.

- Service Clients: www.iec.ch/webstore/custserv/custserv_entry-f.htm

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions, visitez le FAQ du Service clients ou contactez-nous:

Email: csc@iec.ch

Tél.: +41 22 919 02 11

Fax: +41 22 919 03 00

INTERNATIONAL STANDARD

NORME INTERNATIONALE

Equipment for general lighting purposes – EMC immunity requirements

Équipements pour l'éclairage à usage général – Exigences concernant l'immunité CEM

<https://standards.iteh.ai/catalog/standards/sist/97036d1f-e0be-4361-8c84-67d150759d8d/iec-61547-2009>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE
CODE PRIX

P

ICS 29.020; 29.140; 33.100.10

ISBN 978-2-88910-534-2

EQUIPMENT FOR GENERAL LIGHTING PURPOSES – EMC IMMUNITY REQUIREMENTS

INTERPRETATION SHEET 1

This interpretation sheet has been prepared by IEC technical committee 34: Lamps and related equipment.

The text of this interpretation sheet is based on the following documents:

ISH	Report on voting
34/180/ISH	34/185/RVD

Full information on the voting for the approval of this interpretation sheet can be found in the report on voting indicated in the above table.

The draft is based on the outcome of documents 34/155/DC and 34/158/INF.

Introduction:

Test conditions of dimmable lighting equipment are unclear in IEC 61547 for dimmable lighting equipment with dim level other than 50 % \pm 10 %. Some HID control units have only one dim level, for example 65 %.

Present text, Clause 7, second paragraph, first sentence:

“Equipment including a regulating control shall be tested at a light output level of 50 % \pm 10 %.”

Interpretation for equipment which could not fulfill the test dim level conditions:

If a light output level of 50 % \pm 10 % is not available for equipment including regulating control, the test shall be done at the level which is closest to 50 %. If two steps equally distant to 50 % are available, the lower level (< 50 %) shall be used for the test.

CONTENTS

FOREWORD.....	4
1 Scope.....	6
2 Normative references	6
3 Terms and definitions	7
4 Performance criteria	8
5 Test specifications.....	9
5.1 General.....	9
5.2 Electrostatic discharges	9
5.3 Radio-frequency electromagnetic fields	10
5.4 Power frequency magnetic fields	10
5.5 Fast transients	10
5.6 Injected currents (radio-frequency common mode)	11
5.7 Surges	12
5.8 Voltage dips and short interruptions	12
5.9 Voltage fluctuations.....	13
6 Application of test specifications.....	13
6.1 General.....	13
6.2 Non-electronic lighting equipment.....	13
6.3 Electronic lighting equipment.....	13
6.3.1 General	13
6.3.2 Self-ballasted lamps	13
6.3.3 Independent auxiliaries.....	14
6.3.4 Luminaires.....	14
7 Conditions during testing.....	14
8 Assessment of conformity.....	15
Figure 1 – Examples of ports	8
Table 1 – Electrostatic discharges – Test levels at enclosure port.....	10
Table 2 – Radio-frequency electromagnetic fields – Test levels at enclosure port	10
Table 3 – Power frequency magnetic fields – Test levels at enclosure port	10
Table 4 – Fast transients – Test levels at ports for signal and control lines	10
Table 5 – Fast transients – Test levels at input and output d.c. power ports.....	11
Table 6 – Fast transients – Test levels at input and output a.c. power ports.....	11
Table 7 – Radio-frequency common mode – Test levels at ports for signal and control lines.....	11
Table 8 – Radio-frequency common mode – Test levels at input and output d.c. power ports	11
Table 9 – Radio-frequency common mode – Test levels at input and output a.c. power ports	12
Table 10 – Surges – Test levels at input a.c. power ports	12
Table 11 – Voltage dips – Test levels at input a.c. power ports	12
Table 12 – Voltage short interruptions – Test levels at input a.c. power ports	13
Table 13 – Application of tests for self-ballasted lamps.....	13

Table 14 – Application of tests for independent auxiliaries 14
Table 15 – Application of tests for luminaires 14

Withhold

iTeh STANDARD PREVIEW
(standards.iteh.ai)

<https://standards.iteh.ai/catalog/standards/sist/97036d1f-e0be-4361-8c84-67d150759d8d/iec-61547-2009>

INTERNATIONAL ELECTROTECHNICAL COMMISSION

EQUIPMENT FOR GENERAL LIGHTING PURPOSES – EMC IMMUNITY REQUIREMENTS

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61547 has been prepared by IEC technical committee 34: Lamps and related equipment.

This second edition cancels and replaces the first edition, published in 1995, and its Amendment 1 (2000). It constitutes a technical revision

The main reason for this revision is to update the dates of the references to the basic standards which also required some editorial changes in the tables. Other changes are:

- 1 Scope: clearly excludes multimedia equipment with lamps (e.g. TV);
- 3.2 Enclosure port: removal of the "earth port" in Figure 1 as in the generic EMC standards; the note below Figure 1 in the first edition relates to a requirement and moved to the main text under 5.1 General;
- 5.6 Injected currents: update of the names of the example CDN's;
- 5.7 Surges: test only at the peak of the mains voltage by deleting the requirement to test at zero crossings;

- 5.8 Voltage dips and interruptions: clarifying that the voltage level changes at the zero crossing;
- 6.3.2 Independent auxiliaries: Table 14 has been simplified because most independent auxiliaries have identical performance criteria;
- 6.3.3 Luminaires: Table 15 has been simplified because most luminaires have identical performance criteria; correcting the error in the injected current column by changing the B into A for luminaires with electronic ballast for discharge lamps; additionally, the requirements for emergency luminaires operating in high risk task areas are updated to meet the levels specified in IEC 60598-2-22;
- 7 Conditions during testing: the "under consideration" for the operating conditions for starting devices has been deleted; the supply voltage and frequency during the test are clearly stated; shortening the immunity test for equipment incorporating a regulating control by testing at one light output level ($50 \% \pm 10 \%$) instead of testing at three light output levels which are difficult to adjust and do not provide extra protection.

The text of this standard is based on the following documents:

FDIS	Report on voting
34/127/FDIS	34/130/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

This standard is to be read in conjunction with the relevant basic and/or product standard(s).

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

The contents of the corrigendum of April 2010 and Interpretation sheet 1 of June 2013 have been included in this copy.

EQUIPMENT FOR GENERAL LIGHTING PURPOSES – EMC IMMUNITY REQUIREMENTS

1 Scope

This International Standard for electromagnetic immunity requirements applies to lighting equipment which is within the scope of IEC technical committee 34, such as lamps, auxiliaries and luminaires, intended either for connecting to a low voltage electricity supply or for battery operation.

Excluded from the scope of this standard is equipment for which the immunity requirements are formulated in other IEC or CISPR standards such as:

- lighting equipment for use in transport vehicles;
- entertainment lighting control equipment for professional purposes;
- lighting devices built into other equipment such as:
 - scale illumination or indicators;
 - photocopiers;
 - slide and overhead projectors;
 - multimedia equipment.

However, in multi-function equipment where the lighting part operates independently from other parts, the electromagnetic immunity requirements of this standard apply to the lighting part.

The requirements of this standard are based on the requirements for domestic, commercial and light-industrial environments as given in IEC 61000-6-1, but modified to lighting engineering practice.

It can be expected that lighting equipment complying with the requirements of this standard will operate satisfactorily in other environments. In some special cases, measures have to be taken to provide higher immunity. It is impracticable to deal with all these possibilities. Such requirements may be established by contractual agreement between supplier and purchaser.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-161, *International Electrotechnical Vocabulary – Chapter 161: Electromagnetic Compatibility*

IEC 60050-845, *International Electrotechnical Vocabulary – Chapter 845: Lighting*

IEC 60598-1:2008, *Luminaires – Part 1: General requirements and tests*

IEC 60598-2-22, *Luminaires – Part 2-22: Particular requirements – Luminaires for emergency lighting*

IEC 61000-4-2:2008, *Electromagnetic compatibility (EMC) – Part 4-2: Testing and measurement techniques – Electrostatic discharge immunity test*

IEC 61000-4-3:2006, *Electromagnetic compatibility (EMC) – Part 4-3: Testing and measurement techniques – Radiated, radio frequency, electromagnetic field immunity test*¹
Amendment 1 (2007)

IEC 61000-4-4:2004, *Electromagnetic compatibility (EMC) – Part 4-4: Testing and measurement techniques – Electrical fast transient/burst immunity tests*

IEC 61000-4-5:2005, *Electromagnetic compatibility (EMC) – Part 4-5: Testing and measurement techniques – Surge immunity test*

IEC 61000-4-6:2008, *Electromagnetic compatibility (EMC) – Part 4-6: Testing and measurement techniques – Immunity to conducted disturbances, induced by radio-frequency fields*

IEC 61000-4-8:1993, *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 8: Power frequency magnetic field immunity test*²
Amendment 1 (2000)

IEC 61000-4-11:2004, *Electromagnetic compatibility (EMC) – Part 4-11: Testing and measurement techniques – Voltage dips, short interruptions and voltage variations immunity tests*

IEC 61000-6-1:2005, *Electromagnetic compatibility (EMC) – Part 6-1: Generic standards – Immunity for residential, commercial and light-industrial environments*

3 Terms and definitions

For the purposes of this document, the terms and definitions of IEC 60050(161) and IEC 60050(845) apply, together with the following.

3.1

port

particular electrical interface of the specified equipment with the external electromagnetic environment


3.2

enclosure port

the physical boundary of the equipment through which electromagnetic fields may radiate or penetrate (see Figure 1)

¹ There exists a consolidated edition 3.1 (2008) that comprises IEC 61000-4-3 and its Amendment 1.

² There exists a consolidated edition 1.1 (2001) that comprises IEC 61000-4-8 and its Amendment 1.

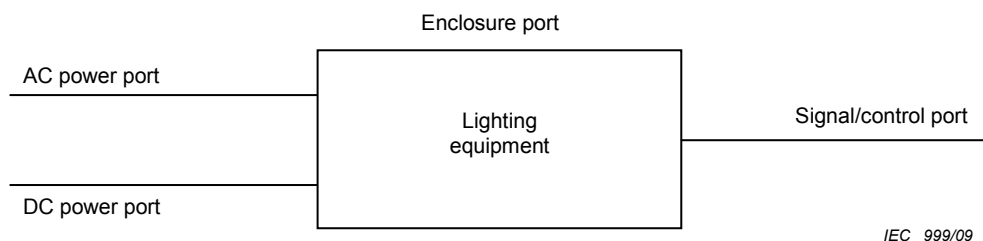

IEC 999/09

NOTE AC/DC power port may include the protective earth conductor.

Figure 1 – Examples of ports

4 Performance criteria

4.1 A functional description of performance criteria during or as a consequence of the immunity testing, shall be provided by the manufacturer and noted in the test report.

The performance of lighting equipment shall be assessed by monitoring:

- the luminous intensity of the luminaire or of the lamp(s);
- the functioning of the control in the case of equipment which includes a regulating control or concerns the regulating control itself;
- the functioning of the starting device, if any.

4.2 The performance criteria given hereafter apply to lighting equipment.

a) Performance criterion A

During the test, no change of the luminous intensity shall be observed and the regulating control, if any, shall operate during the test as intended.

b) Performance criterion B

During the test, the luminous intensity may change to any value. After the test, the luminous intensity shall be restored to its initial value within 1 min. Regulating controls need not function during the test, but after the test, the mode of the control shall be the same as before the test provided that during the test no mode changing commands were given.

c) Performance criterion C

During and after the test, any change of the luminous intensity is allowed and the lamp(s) may be extinguished. After the test, within 30 min, all functions shall return to normal, if necessary by temporary interruption of the mains supply and/or operating the regulating control.

Additional requirement for lighting equipment incorporating a starting device: After the test, the lighting equipment is switched off. After half an hour, it is switched on again. The lighting equipment shall start and operate as intended.

4.3 A change of luminous intensity may be checked by visual observation but, in case of doubt, the following applies.

The luminous intensity of a luminaire or of the lamp(s) shall be measured by means of a illuminance (lux) meter which is positioned in an axis perpendicular to the main plane of the

luminaire or lamp(s), in its centre and at a distance for proper operation of the lux meter. The luminous intensity shall be deemed to be unchanged if the measured intensities do not deviate by more than 15 %.

Care shall be taken to ensure the ambient light level does not influence the measurement results.

Precautions to achieve reproducible results given in the relevant lamp performance standards shall be observed.

4.4 The effects of electromagnetic phenomena (as described in this standard) upon the life of the equipment under test are excluded from this standard.

5 Test specifications

5.1 General

Immunity requirements for equipment defined within the scope concern:

- electrostatic discharges;
- continuous and transient disturbances;
- radiated and conducted disturbances;
- mains supply-related disturbances.

They are given in Subclauses 5.2 to 5.9 on a port by port basis.

Tests are applied to the relevant ports of the equipment as indicated in the respective subclauses. For the purposes of this standard, d.c. power ports for supplying regulating controls are considered to be signal ports. Tests shall be conducted in a well-defined and reproducible manner. Tests shall be carried out as single tests in sequence. The sequence of testing is optional.

It may be determined from consideration of the electrical characteristics and usage of particular equipment that some of the tests are inappropriate and therefore unnecessary. In such cases it is required that the decision not to test be recorded in the test report.

The description of the test, the test generator, the test methods and the test set-up are given in the basic standards, which are referred to in the relevant subclauses.

Test levels are generally based on level 2 values as recommended in the basic standards.

5.2 Electrostatic discharges

These tests are carried out according to IEC 61000-4-2, with test levels as given in Table 1 of this standard. Contact discharge is the preferred test method. Twenty discharges (10 with positive and 10 with negative polarity) shall be applied on each accessible metallic part of the enclosure (terminals are excluded). Air discharges shall be used where contact discharges cannot be applied. Discharges shall be applied on the horizontal or vertical coupling planes, as specified in IEC 61000-4-2.

NOTE "Accessible" means accessible under normal operating conditions including user maintenance.