

INTERNATIONAL STANDARD

High-voltage direct current (HVDC) installations – System tests

(<https://standards.iteh.ai>)
Document Preview

[IEC 61975:2010](#)

<https://standards.iteh.ai/catalog/standards/iec/d11d02d3-5f09-4bb0-ad6c-125e192a2cdd/iec-61975-2010>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2010 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00

IEC 61975:2010

<http://www.iec.ch/catalog/standards/iec/d11d02d3-5f09-4bb0-ad6c-125e192a2cdd/iec-61975-2010>



IEC 61975

Edition 1.0 2010-07

INTERNATIONAL STANDARD

High-voltage direct current (HVDC) installations – System tests

(<https://standards.iteh.ai>)
Document Preview

[IEC 61975:2010](#)

<https://standards.iteh.ai/catalog/standards/iec/d11d02d3-5f09-4bb0-ad6c-125e192a2cdd/iec-61975-2010>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

PRICE CODE **XC**

ICS 29.130.10; 31.080.01

ISBN 978-2-88912-100-7

CONTENTS

FOREWORD.....	4
INTRODUCTION.....	6
1 Scope.....	7
2 Normative references.....	7
3 Terms and definitions	7
3.1 Test classifications terms	7
3.2 Operation state terms	8
4 General	9
4.1 Purpose.....	9
4.2 Structure of the HVDC system	10
4.3 Structure of the control and protection system.....	11
4.4 Logical steps of system test.....	12
4.5 Structure of system test.....	13
4.6 Precondition for site test	13
5 Converter station test.....	16
5.1 General	16
5.2 Converter unit test	17
5.3 Energizing of reactive components.....	18
5.4 Changing the d.c. system configuration.....	19
5.5 Electromagnetic compatibility.....	20
5.6 Trip test.....	21
5.7 Open line test.....	22
5.8 Back-to-back test.....	24
5.9 Short circuit test	25
6 Transmission tests.....	26
6.1 Low power transmission tests	26
6.2 Operator control mode transfer	34
6.3 Changes of d.c. configuration	40
6.4 Main circuit equipment switching.....	43
6.5 Dynamic performance testing.....	47
6.6 AC and d.c. system staged faults	56
6.7 Loss of telecom, auxiliaries or redundant equipment	60
6.8 High power transmission tests	63
6.9 Acceptance tests	67
7 Trial operation	74
7.1 General	74
7.2 Purpose of test	74
7.3 Test precondition.....	74
7.4 Test procedure	74
7.5 Test acceptance criteria.....	75
8 System test plan and documentation	75
8.1 General	75
8.2 Plant documentation and operating manual.....	75
8.3 System study reports and technical specification.....	75
8.4 Inspection and test plan	76
8.5 System test program.....	76

8.6	Test procedure for each test	77
8.7	Documentation of system test results	77
8.8	Deviation report	78
	Bibliography	79
	Figure 1 – Relation among five major aspects of system test	10
	Figure 2 – Structure of the HVDC system	11
	Figure 3 – Structure of the HVDC control and protection	11
	Figure 4 – Structure of system test	15
	Figure 5 – Sequence for low power transmission tests	28
	Figure 6 – Step response test of current control at the rectifier	49
	Figure 7 – Step response test of extinction angle control at the inverter	50
	Figure 8 – Step response test of d.c. voltage control at the inverter	50
	Figure 9 – Step response test of current control at the inverter	51
	Figure 10 – Step response test of power control at the rectifier	51

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 61975:2010](#)

<https://standards.iteh.ai/catalog/standards/iec/d11d02d3-5f09-4bb0-ad6c-125e192a2cdd/iec-61975-2010>

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**HIGH-VOLTAGE DIRECT CURRENT (HVDC) INSTALLATIONS –
SYSTEM TESTS**
FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61975 has been prepared by subcommittee 22F: Power electronics for electrical transmission and distribution systems, of IEC technical committee 22: Power electronic systems and equipment.

This first version of IEC 61975 cancels and replaces IEC/PAS 61975 published jointly in 2004 by IEC and CIGRÉ. It constitutes a technical revision incorporating engineering experience.

The text of this standard is based on the following documents:

FDIS	Report on voting
22F/221/FDIS	22F/227/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version may be issued at a later date.

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 61975:2010](#)

<https://standards.iteh.ai/catalog/standards/iec/d11d02d3-5f09-4bb0-ad6c-125e192a2cdd/iec-61975-2010>

INTRODUCTION

The standard is structured in eight clauses:

- a) Clause 1 – Scope
- b) Clause 2 – Normative references
- c) Clause 3 – Definitions
- d) Clause 4 – General
- e) This clause addresses the purpose of this standard, the HVDC system structure, the control and protection structure, the logical steps of commissioning, the structure of the system test and that of the system commissioning standard.
- f) Clause 5 – Converter station test
- g) This clause addresses the commissioning of converter units and verifies the steady state performance of units as well as switching tests.
- h) Clause 6 – Power transmission tests
- i) This clause concerns the commissioning of the transmission system, and verifies station coordination, steady-state and dynamic performance, interference, as well as interaction between the d.c. and a.c. systems.
- j) Clause 7 – Trial operation
- k) After completion of the system test, the period of trial operation is normally specified to verify the normal transmission.
- l) Clause 8 – System test plan and documentation

Clauses 5 to 7 comprise individual sections providing an introduction and covering objects, preconditions and procedures and general acceptance criteria as well as detailed descriptions of the individual tests.

[IEC 61975:2010](https://standards.iteh.ai/catalog/standards/iec/d11d02d3-5f09-4bb0-ad6c-125e192a2cdd/iec-61975-2010)

<https://standards.iteh.ai/catalog/standards/iec/d11d02d3-5f09-4bb0-ad6c-125e192a2cdd/iec-61975-2010>

HIGH-VOLTAGE DIRECT CURRENT (HVDC) INSTALLATIONS – SYSTEM TESTS

1 Scope

This International Standard applies to system tests for high-voltage direct current (HVDC) installations which consist of a sending terminal and a receiving terminal, each connected to an a.c. system.

The tests specified in this standard are based on bidirectional and bipolar high-voltage direct current (HVDC) installations which consist of a sending terminal and a receiving terminal, each connected to an a.c. system. The test requirements and acceptance criteria should be agreed for back-to-back installations, while multi-terminal systems and voltage sourced converters are not included in this standard. For monopolar HVDC installations, the standard applies except for bipolar tests.

For the special functions or performances that are claimed by specific projects, some extra test items not included in this standard should be added according to the technical specification requirements.

This standard only serves as a guideline to system tests for high-voltage direct current (HVDC) installations. The standard gives potential users guidance, regarding how to plan commissioning activities. The tests described in the guide may not be applicable to all projects, but represent a range of possible tests which should be considered.

Therefore, it is preferable that the project organization establishes the individual test program based on this standard and in advance assigns responsibilities for various tasks/tests between involved organisations (e.g. user, supplier, manufacturer, operator, purchaser etc.) for each specific project.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For updated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60633:1998, *Terminology for high-voltage direct current (HVDC) power transmission*

IEC/TR 60919-2:2008, *Performance of high-voltage direct current (HVDC) systems with line commutated converters – Part 2: Faults and switching*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60633 as well as the following terms and definitions apply.

3.1 Test classifications terms

3.1.1 station test

converter system test including items which verify the function of individual equipment of the converter station in energized state

3.1.2 system test

test verifying functions and performances of HVDC system as a whole as well as the interaction with adjacent a.c. systems

3.1.3 transmission tests

test verifying functions and performances of HVDC system when transmitting power between both terminals

NOTE It is also referred to as an “end to end test”.

3.2 Operation state terms

In the d.c. system, there are 5 defined states: earthed, stopped, standby, blocked, de-blocked.

3.2.1 earthed

state in which the pole or converter is isolated and earthed on the a.c. and d.c. sides and no energizing of the pole or converter equipment is possible

NOTE The earthed state provides the necessary safety for carrying out maintenance work, and is the only one that permits the pole or converter maintenance. In this state maintenance work is possible on the converter transformers, the isolated and earthed part of the a.c. high voltage bus equipment, d.c. and valve hall installed equipment of this pole or converter.

3.2.2 stopped/isolated

state in which the pole or converter is isolated from the a.c. and d.c. side, but all the earthing switches are open

NOTE In this state the d.c. yard can be prepared for power transmission (earth electrode line, pole and d.c. line connect).

3.2.3 standby

state which is to be used when the d.c. system is not being utilized but is ready for power transmission

NOTE In this state the converter transformer is to be ready; tap-changer is automatically brought to the start position, which ensures that the transformer will be energized with minimum voltage to minimize the inrush current. The disconnector of the a.c. bay should be closed, but the circuit breakers in the feeding bay of the converter transformer should be open. In this state the d.c. configuration can still be changed (earth electrode line, pole and d.c. line connect).

3.2.4 blocked

state in which the pole is prepared to transmit power at a moment's notice

NOTE The converter transformer is connected to the energized a.c. bus by means of closing of the respective circuit breaker. The valve cooling system is ready for operation if the cooling water conductivity, flow and temperature are within the specified limits. A defined d.c. configuration shall have been established. Further changes are not possible in this state. The thyristor pre-check is carried out after the converter transformer has been energized. The pre-check is considered as passed when in every valve the redundancy is not lost. To change the blocked state, the states stopped, standby and de-blocked are selectable.

3.2.5 de-blocked

state representing the following two operating modes: power transmission and open line test

NOTE Power transmission is the normal operating mode. In the de-blocked status the pole transmits power in normal operating mode if both terminals are in the deblocked stage and there is a voltage difference between the terminals. A minimum number of a.c. filters should be available.

3.2.6

off-site tests

tests which are performed before on-site testing

4 General

4.1 Purpose

System test completes the commissioning of an HVDC system.

The supplier can verify the suitability of the station equipment installed and the functional completeness of the system. Moreover, adjustments and optimizations can be made.

It is shown for the user that the requirements and stipulations in the contract are met and that there is correlation with studies and previous off-site tests.


For the user, the completion of system test marks the beginning of commercial operation of the HVDC system.

When adapting the HVDC system to the connected a.c. systems, there may be various constraints which require coordination within the economic schedules of the a.c. system operators. System tests prove to the public that tolerable values of phenomena concerning the public interest are not exceeded.

Five major aspects are subject to system tests:

- a) HVDC station equipment and d.c. line/cable/bus including earth electrode, if any;
- b) HVDC control and protection equipment and their settings;
- c) environmental considerations;
- d) a.c./d.c. system interaction;
- e) system performance when jointly operated with a connected a.c. system.

The interrelation between these aspects is shown in Figure 1.

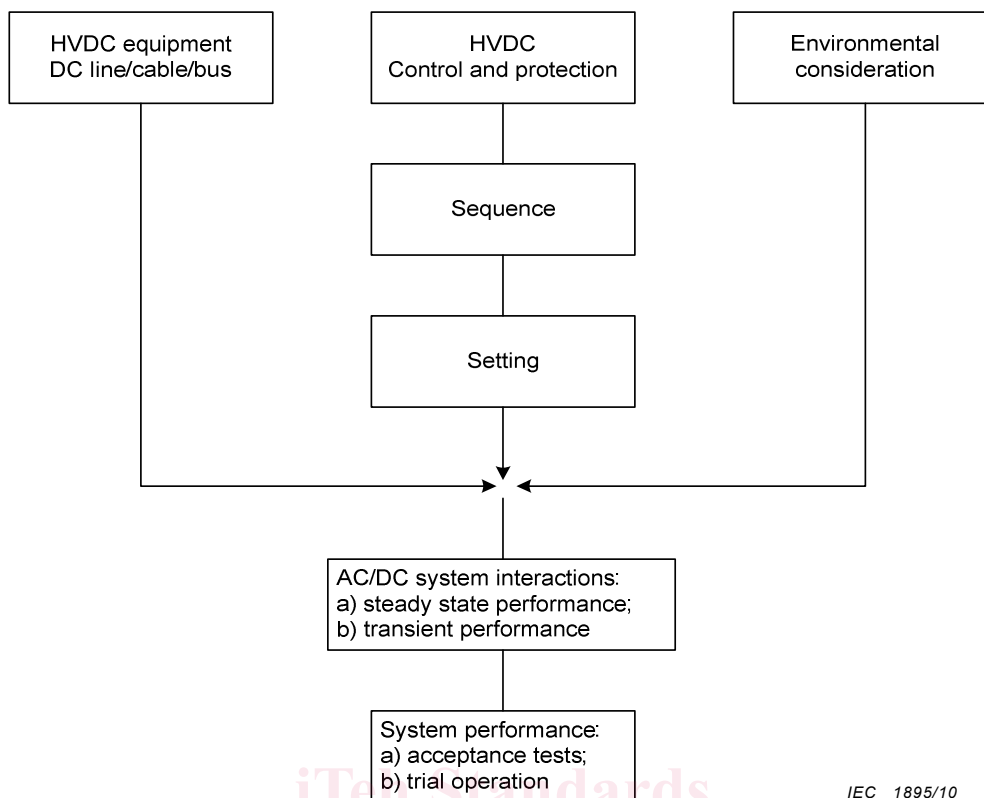

IEC 1895/10

Figure 1 – Relation among five major aspects of system test

Thorough and complete system test of the above components can be achieved with the tests described in the standard.

Acceptance tests shall be defined between supplier and user in advance and may be performed at an appropriate time during the test schedule.

System tests may affect more than the actual contract parties. Those parties shall be informed in time.

The complexity and the diversified areas concerned during system test require thorough planning and scheduling, cooperation of all involved parties, as well as complete and organized documentation.

NOTE The suggested “Test Procedures” are recommendations and alternative test procedures may be used subject to the agreement between supplier and user.

4.2 Structure of the HVDC system

From a functional point of view an HVDC system consists of a sending terminal and a receiving terminal, each connected to an a.c. system. The two terminals have one or several converters connected in series on the d.c. side and in parallel on the a.c. side. The terminals are connected by a transmission line or cable or a short piece of busbar (back-to-back station). Multi-terminal systems are not addressed in this standard.

The structure of the HVDC system is shown in Figure 2.

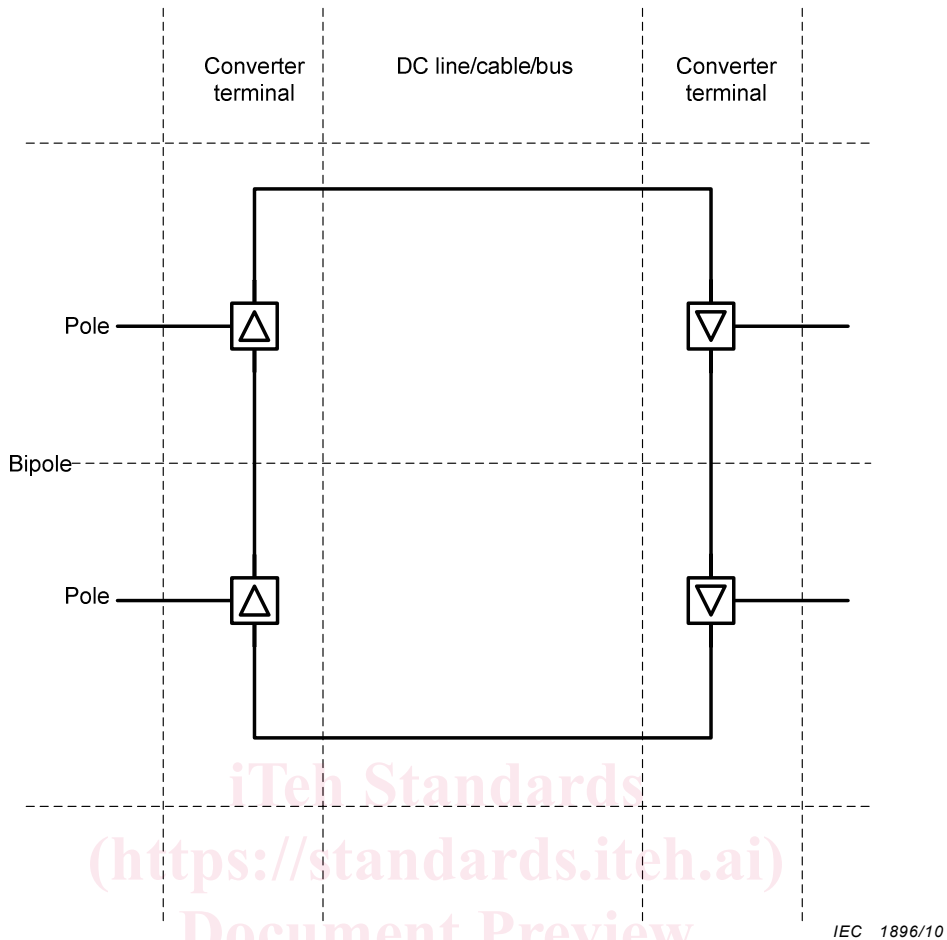


Figure 2 – Structure of the HVDC system

4.3 Structure of the control and protection system

Each of the converter units can be controlled individually. To make the system function correctly as a power transmission system, the converter units should be controlled in a coordinated way by a higher level of the control system. Coordinated controls and protection are essential for the proper functioning of HVDC systems.

The structure of the HVDC control and protection is shown in Figure 3:

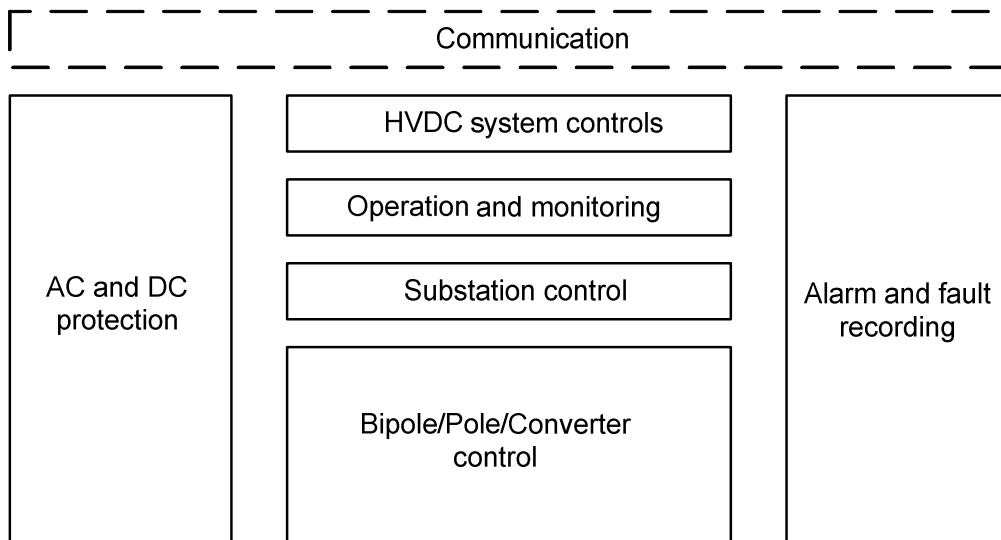


Figure 3 – Structure of the HVDC control and protection

4.4 Logical steps of system test

To ensure proper functioning, the type test and functional performance test should be conducted in factory in order to debug and test the control system before the site test.

In order to provide the power grid data and help to compile the system test plan, the off-line digital simulation should be conducted before and during the simulation test, especially analysis on the power flow, stability and overvoltage.

Considering the complexity of the HVDC system, all limiting design cases may be conducted on the digital simulator in a similar way to those done on site.

Commissioning an HVDC system may affect more than the actual contract parties. The complexity and the diversified areas concerned during system test require thorough planning and scheduling, cooperation of all involved parties and complete and structured documentation. Before a system test can begin on site, the following preconditions should be fulfilled concerning subsystem tests, operator training and safety instructions, system test plan and test procedures, and all necessary test equipment.

- a) All subsystems should have been tested and commissioned, including a.c. filters and the converter transformers with special attention to possible transformer or a.c. filter resonance during energizing.
- b) Operating personnel should be sufficiently trained.
- c) Operating instructions for the station should be available.
- d) Personnel, plant safety and security instructions should be available.
- e) System test plan and documentation (Part 8) should be available and agreed upon.
- f) AC/d.c. power profiles should have been agreed for each test.
- g) Any a.c./d.c. system operating restrictions should have been identified.
- h) Operator voice communications should be available
- i) All necessary test equipment should have been calibrated and in service.
- j) Procedures for the preparation and evaluation of test results should have been agreed upon.

Site system tests should follow the structure of the HVDC system, starting from the smallest, least complex operational unit, usually a 12-pulse converter, and shall end with the total system in operation. The test sequence should be scheduled starting at the local level with simple tests before involving additional locations and the transmission system and more complex tests.

After all preconditions are fulfilled, converter station tests should be conducted and begin from the converter unit test, including energizing of a.c. filter and d.c. yard, electrical magnetic interference, trip test, changing the d.c. system configuration, open line test, and so on.

The power transmission (also called end-to-end) test should start on a monopolar basis, with bipolar operation, with full power being the final step.

Having the complete system running properly, performance of the steady state can be verified. With normal operating ramp settings and automatic switching sequences in place, the effect of a number of disturbances on the d.c. side of the system as well as in the a.c. systems may be checked, and the transient and fault recovery performances may be verified.

Acceptance tests shall be defined between supplier and user in advance and may be performed at an appropriate time during the test schedule.

The acceptance tests necessary to verify whether acceptance criteria have been met, may have been performed wholly or in part during the commissioning period. To avoid unnecessary