

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Adjustable speed electrical power drive systems –
Part 7-303: Generic interface and use of profiles for power drive systems –
Mapping of profile type 3 to network technologies**

**Entraînements électriques de puissance à vitesse variable –
Partie 7-303: Interface générique et utilisation de profils pour les entraînements
électriques de puissance – Mise en correspondance du profil de type 3 avec les
technologies de réseaux**



THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2007 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.
If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.
Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

Useful links:

IEC publications search - www.iec.ch/searchpub

The advanced search enables you to find IEC publications by a variety of criteria (reference number, text, technical committee,...).

It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available on-line and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary (IEV) on-line.

Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

A propos de la CEI

La Commission Electrotechnique Internationale (CEI) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications CEI

Le contenu technique des publications de la CEI est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente. un corrigendum ou amendement peut avoir été publié.

Liens utiles:

Recherche de publications CEI - www.iec.ch/searchpub

La recherche avancée vous permet de trouver des publications CEI en utilisant différents critères (numéro de référence, texte, comité d'études,...).

Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

Just Published CEI - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications de la CEI. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne au monde de termes électroniques et électriques. Il contient plus de 30 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans les langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (VEI) en ligne.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: csc@iec.ch.

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Adjustable speed electrical power drive systems –
Part 7-303: Generic interface and use of profiles for power drive systems –
Mapping of profile type 3 to network technologies**

**Entraînements électriques de puissance à vitesse variable –
Partie 7-303: Interface générique et utilisation de profils pour les entraînements
électriques de puissance – Mise en correspondance du profil de type 3 avec les
technologies de réseaux**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE **XD**
CODE PRIX

ICS 29.200; 35.100.05

ISBN 978-2-83220-713-0

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

| | |
|--|----|
| FOREWORD..... | 7 |
| INTRODUCTION..... | 9 |
| | |
| 1 Scope..... | 12 |
| 2 Normative references | 12 |
| 3 Terms, definitions and abbreviated terms | 13 |
| 3.1 Terms and definitions | 13 |
| 3.2 Abbreviated terms | 16 |
| 4 Mapping to PROFIBUS DP | 19 |
| 4.1 General | 19 |
| 4.2 Mapping to PROFIBUS data types..... | 19 |
| 4.3 Base Model at PROFIBUS DP | 19 |
| 4.3.1 Communication Devices | 19 |
| 4.3.2 Communication Relationship | 20 |
| 4.3.3 Communication Network..... | 21 |
| 4.3.4 Communication Services | 22 |
| 4.3.5 P-Device Communication Model..... | 24 |
| 4.3.6 Base Model State Machine | 25 |
| 4.3.7 Definition of the CO | 26 |
| 4.4 Drive Model at PROFIBUS DP..... | 26 |
| 4.4.1 P-Device | 26 |
| 4.4.2 Drive Unit | 27 |
| 4.5 DO IO Data | 27 |
| 4.5.1 COs for DO IO Data configuration | 27 |
| 4.5.2 Standard telegram configuration | 28 |
| 4.5.3 Cyclic Data exchange between DP-Slaves (DXB) | 30 |
| 4.6 Parameter Access | 39 |
| 4.6.1 RAP for Parameter Access | 39 |
| 4.6.2 Definition of the Base Mode Parameter Access mechanism | 40 |
| 4.7 P-Device Configuration..... | 46 |
| 4.7.1 P-Device Configuration on PROFIBUS DP..... | 46 |
| 4.7.2 Drive Unit Configuration on PROFIBUS DP | 47 |
| 4.7.3 Getting the Drive Object – ID (DO-ID)..... | 49 |
| 4.8 Alarm Mechanism..... | 51 |
| 4.9 Clock Synchronous Operation | 51 |
| 4.9.1 Sequence of an isochronous DP cycle..... | 51 |
| 4.9.2 Time settings..... | 52 |
| 4.9.3 Running-up, cyclic operation | 57 |
| 4.9.4 Parameterisation, configuring (Set_Prm, GSD)..... | 68 |
| 4.9.5 Clock cycle generation (Global Control) and clock cycle save..... | 69 |
| 4.9.6 Monitoring mechanisms | 73 |
| 4.10 PROFIBUS DP specific Parameter | 75 |
| 4.10.1 Overview of the communication interface related parameters | 75 |
| 4.10.2 Definition of the specific parameters | 75 |
| 4.11 Specified communication functions for the Application Classes | 76 |
| 5 Mapping to PROFINET IO | 77 |

| | | |
|--------|--|-----|
| 5.1 | General | 77 |
| 5.2 | Mapping to PROFINET IO data types | 77 |
| 5.3 | Base Model at PROFINET IO | 77 |
| 5.3.1 | Communication Devices | 77 |
| 5.3.2 | Communication Relationship | 78 |
| 5.3.3 | Communication Network | 79 |
| 5.3.4 | Communication Services | 80 |
| 5.3.5 | P-Device Communication Model | 81 |
| 5.3.6 | Base Model State Machine | 83 |
| 5.3.7 | Definition of the CO | 84 |
| 5.4 | Drive Model at PROFINET IO | 84 |
| 5.4.1 | P-Device | 84 |
| 5.4.2 | Drive Unit | 85 |
| 5.4.3 | DO Architecture | 85 |
| 5.4.4 | Definition of the Module Ident Number and API | 87 |
| 5.4.5 | Definition of the Submodule Ident Number | 87 |
| 5.5 | DO IO Data | 88 |
| 5.5.1 | COs for DO IO Data configuration | 88 |
| 5.5.2 | IO Data Producer and Consumer Status | 89 |
| 5.6 | Parameter Access | 89 |
| 5.6.1 | PAPs for Parameter Access | 89 |
| 5.6.2 | Base Mode Parameter Access | 90 |
| 5.7 | P-Device Configuration | 92 |
| 5.7.1 | P-Device Configuration on PROFINET IO | 92 |
| 5.7.2 | Drive Unit Configuration on PROFINET IO | 93 |
| 5.7.3 | Getting the Drive Object – ID (DO-ID) | 93 |
| 5.8 | Alarm Mechanism | 94 |
| 5.8.1 | Use of the Diagnosis Objects | 94 |
| 5.8.2 | Use of the Alarm Mechanism | 94 |
| 5.8.3 | Use of the ChannelDiagnosisData Structure | 95 |
| 5.8.4 | Use of the ChannelErrorType | 96 |
| 5.8.5 | On demand access of Diagnosis Information | 97 |
| 5.9 | Clock Synchronous Operation | 97 |
| 5.10 | PROFINET IO specific Parameter | 99 |
| 5.10.1 | Overview about the communication interface related Parameters | 99 |
| 5.10.2 | Definition of the specific parameters | 99 |
| 5.11 | Specified communication functions for the Application Classes | 100 |
| | Bibliography | 102 |
| | Figure 1 – Structure of IEC 61800-7 | 11 |
| | Figure 2 – PROFIBUS DP Devices in a PROFIdrive drive system | 20 |
| | Figure 3 – PROFIdrive Devices and their Relationship for PROFIBUS DP | 21 |
| | Figure 4 – General Communication Model for PROFIdrive at PROFIBUS DP | 22 |
| | Figure 5 – PROFIBUS DP DXB communication designations | 23 |
| | Figure 6 – Synchronous communication for PROFIdrive at PROFIBUS DP | 24 |
| | Figure 7 – Overview about the P-Device Communication Model on PROFIBUS | 24 |
| | Figure 8 – Mapping of the Base Model State Machine at PROFIBUS DP | 26 |

| | |
|---|----|
| Figure 9 – PROFIBUS DP specific Logical P-Device model (multi axis drive) | 26 |
| Figure 10 – Mapping of PROFIBUS Slot to the PROFIdrive DO | 27 |
| Figure 11 – Application example of DXB communication | 32 |
| Figure 12 – Dataflow inside a Homogeneous P-Device with DXB relations | 35 |
| Figure 13 – Structure of a DXB Subscriber table (inside a Prm-Block) | 36 |
| Figure 14 – Timing diagram of PROFIBUS with slave-to-slave communication | 37 |
| Figure 15 – PAP and Parameter Access mechanism for a PROFIBUS homogeneous P-Device | 39 |
| Figure 16 – PAP and Parameter Access mechanism for a PROFIBUS heterogeneous P-Device | 40 |
| Figure 17 – Telegram sequence via MS1 AR or MS2 AR | 41 |
| Figure 18 – Drive Unit Structure | 48 |
| Figure 19 – Configuration and communication channels for the Modular Drive Unit type at PROFIBUS DP | 49 |
| Figure 20 – Meaning of parameter P978 (list of all DO-Ids) for the DU at PROFIBUS DP | 50 |
| Figure 21 – Example of P978 for a complex Modular Drive Unit at PROFIBUS DP | 51 |
| Figure 22 – Sequence of an isochronous DP cycle | 52 |
| Figure 23 – Time settings | 53 |
| Figure 24 – Example: Simplest DP cycle | 55 |
| Figure 25 – Example: Optimised DP cycle | 56 |
| Figure 26 – Example: Optimised DP cycle ($T_{MAPC} = 2 \times T_{DP}$) | 57 |
| Figure 27 – Running-up (sequence with respect to time) | 58 |
| Figure 28 – Phase 1: Slave parameterisation, configuration | 59 |
| Figure 29 – Phase 2: Synchronization of the PLL to the Clock Global Control | 60 |
| Figure 30 – Phase 3: Synchronization of the slave application with the master's Sign-Of-Life | 62 |
| Figure 31 – State diagram of phases 2 and 3 of the run-up | 63 |
| Figure 32 – Phase 4: Synchronization of the master application to the slave's Sign-Of-Life | 64 |
| Figure 33 – Example: Running-up to cyclic operation (Phase 1) ($T_{MAPC}/T_{DP} = 2/1$) | 65 |
| Figure 34 – Example: Running-up to cyclic operation (Phase 2) ($T_{MAPC}/T_{DP} = 2/1$) | 65 |
| Figure 35 – Example: Running-up to cyclic operation (Phase 3) ($T_{MAPC}/T_{DP} = 2/1$) | 66 |
| Figure 36 – Example: Running-up to cyclic operation (Phase 4) ($T_{MAPC}/T_{DP} = 2/1$) | 67 |
| Figure 37 – Example: Running-up to cyclic operation (Phase 5) ($T_{MAPC}/T_{DP} = 2/1$) | 67 |
| Figure 38 – PLL for clock save in the slave | 71 |
| Figure 39 – Run time compensation | 73 |
| Figure 40 – DP cycle violation | 74 |
| Figure 41 – Example: Clock failure (fault after 4 DP cycles) | 74 |
| Figure 42 – PROFINET IO Devices in a PROFIdrive drive system | 78 |
| Figure 43 – PROFIdrive Devices and their Relationship for PROFINET IO | 79 |
| Figure 44 – General Communication Model for PROFIdrive at PROFINET IO | 80 |
| Figure 45 – Synchronous communication for PROFIdrive at PROFINET IO | 81 |
| Figure 46 – Overview about the P-Device Communication Model on PROFINET IO | 81 |
| Figure 47 – Contents of IO AR and Supervisor AR | 82 |
| Figure 48 – M CR used for Cyclic Data Exchange between P-Devices | 83 |


| | |
|--|----|
| Figure 49 – Mapping of the Base Model State Machine at PROFINET IO | 84 |
| Figure 50 – PROFINET IO specific Logical P-Device model (multi axis drive) | 85 |
| Figure 51 – Representation of the PROFIdrive DO by PROFINET IO Submodules (CO)..... | 86 |
| Figure 52 – Hierarchical model of the P-Device on PROFINET IO..... | 87 |
| Figure 53 – Modularity of the DO IO Data block (example)..... | 89 |
| Figure 54 – Data flow for request and response for the Base Mode Parameter Access | 92 |
| Figure 55 – Configuration and communication channels for the Modular Drive Unit type at PROFINET IO | 93 |
| Figure 56 – Meaning of parameter P978 "list of all DO-IDs" for the DU at PROFINET IO | 94 |
| Figure 57 – Generation of Diagnosis Data according to the fault classes mechanism..... | 96 |
| Figure 58 – Sequence of an isochronous Data Cycle | 98 |
| | |
| Table 1 – Mapping of data types | 19 |
| Table 2 – DP IDs and PROFIdrive IDs of the standard telegrams..... | 28 |
| Table 3 – 1 Drive Axis, standard telegram 3..... | 29 |
| Table 4 – 2 Drive Axes, standard telegram 3..... | 30 |
| Table 5 – 2 Drive Axes, standard telegram 3, per axis one DXB link each with 2 words | 30 |
| Table 6 – 1 Drive Axis, standard telegram 20..... | 30 |
| Table 7 – Slave No.11 (Publisher) | 33 |
| Table 8 – Slave No.12 (Publisher and Subscriber)..... | 33 |
| Table 9 – Configuration of the DXB communication link of the coating drive | 34 |
| Table 10 – Slave No.10 (Subscriber) | 34 |
| Table 11 – Configuration of the DXB communication links of the unwinder..... | 34 |
| Table 12 – Parameters (Set_Prm, GSD) for slave-to-slave communication (Data- eXchange Broadcast)..... | 38 |
| Table 13 – Services used for Parameter Access on PROFIBUS DP | 41 |
| Table 14 – Defined PAPs for Parameter Access | 41 |
| Table 15 – State machine for DP-slave processing | 42 |
| Table 16 – MS1/MS2 AR telegram frame, Write request..... | 42 |
| Table 17 – MS1/MS2 AR telegram frame, Write response..... | 43 |
| Table 18 – MS1/MS2 AR telegram frame, Read request | 43 |
| Table 19 – MS1/MS2 AR telegram frame, Read response..... | 43 |
| Table 20 – Process data ASE telegram frame, Error response | 44 |
| Table 21 – Allocation of Error class and code for PROFIdrive | 44 |
| Table 22 – Data block lengths..... | 45 |
| Table 23 – Limits due to the Process data ASE data block length | 46 |
| Table 24 – GSD parameters for the MS1/MS2 AR services | 46 |
| Table 25 – DP Services for Running-up, cyclic operation | 57 |
| Table 26 – Parameters (Set_Prm, GSD) for "Clock Cycle Synchronous Drive Interface" | 68 |
| Table 27 – Possible synchronization type combinations | 69 |
| Table 28 – Conditions for Isochronous Mode | 70 |
| Table 29 – Input signals of the PLL..... | 71 |
| Table 30 – Output signals of the PLL | 72 |

| | |
|--|-----|
| Table 31 – Overview of the specific PROFIBUS DP parameters for “Communication system interfaces” | 75 |
| Table 32 – PROFIdrive Specific Parameter listed by number | 75 |
| Table 33 – Coding of the baud rate in Parameter 963 | 76 |
| Table 34 – Specified communication functions for the Application Classes | 76 |
| Table 35 – Mapping of data types | 77 |
| Table 36 – Structure of the Submodule-ID | 88 |
| Table 37 – Definition of Submodule-Type Classes | 88 |
| Table 38 – Definition of Parameter Access Modes (PAP) | 90 |
| Table 39 – Use of the AlarmNotification-PDU | 95 |
| Table 40 – Use of ChannelDiagnosisData | 95 |
| Table 41 – Use of ChannelErrorType | 96 |
| Table 42 – Use of the DiagnosisData | 97 |
| Table 43 – Overview of the specific PROFINET IO parameters for “Communication system interfaces” | 99 |
| Table 44 – PROFIdrive Specific Parameter listed by number | 99 |
| Table 45 – Specified communication functions for the Application Classes | 101 |

iTech Standards
(<https://standards.iteh.ai>)
Document Preview

[IEC 61800-7-303:2007](https://standards.iteh.ai/standards/iec/92885bc0-f69a-4f84-a455-079bc363900b/iec-61800-7-303-2007)

<https://standards.iteh.ai/standards/iec/92885bc0-f69a-4f84-a455-079bc363900b/iec-61800-7-303-2007>

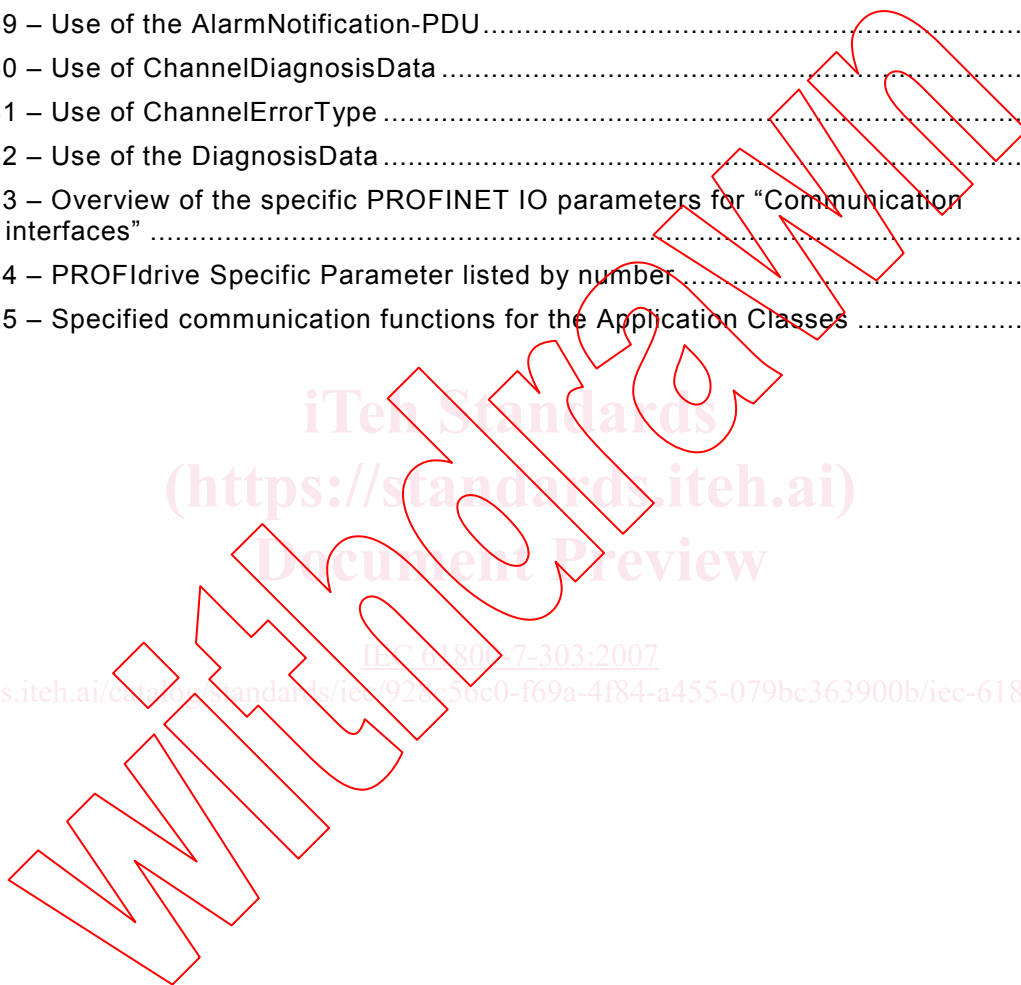

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ADJUSTABLE SPEED ELECTRICAL POWER DRIVE SYSTEMS –**Part 7-303: Generic interface and use
of profiles for power drive systems –
Mapping of profile type 3 to network technologies**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The International Electrotechnical Commission (IEC) draws attention to the fact that it is claimed that compliance with this document may involve the use of a patent concerning the following.

| Publication / Application serial number | Holder | Title | Derwent accession Number | Derwent publication |
|---|--------|--|--------------------------|--|
| EP844542 | [SI] | Numerical control method and control structure for controlling of movement of objects whereby speed control is effected at a higher rate than position control | 1998-274369 | EP844542-A1 27.05.1998; DE59603496-G 02.12.1999; EP844542-B1 27.10.1999 |

The IEC takes no position concerning the evidence, validity and scope of this patent right.

The holder of this patent right has assured the IEC that he is willing to negotiate licences under reasonable and non-discriminatory terms and conditions with applicants throughout the world. In this respect, the statement of the holder of this patent right is registered with IEC. Information may be obtained from

| | |
|------|--|
| [SI] | Siemens AG Corporate Intellectual Property Licensing & Transactions Otto-Hahn-Ring 6 81730 Muinch Germany |
|------|--|

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights other than those identified above. IEC shall not be held responsible for identifying any or all such patent rights.

The International Standard IEC 61800-7-303 has been prepared by subcommittee SC 22G: Adjustable speed electric drive systems incorporating semiconductor power converters, of IEC technical committee TC 22: Power electronic systems and equipment.

This bilingual version (2013-04) corresponds to the monolingual English version, published in 2007-11.

The text of this standard is based on the following documents:

| FDIS | Report on voting |
|--------------|------------------|
| 22G/185/FDIS | 22G/193/RVD |

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

The French version of this standard has not been voted upon.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61800 series, under the general title *Adjustable speed electrical power drive systems*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "http://webstore.iec.ch" in the data related to the specific publication. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

The IEC 61800 series is intended to provide a common set of specifications for adjustable speed electrical power drive systems.

IEC 61800-7 describes a generic interface between control systems and power drive systems. This interface can be embedded in the control system. The control system itself can also be located in the drive (sometimes known as "smart drive" or "intelligent drive").

A variety of physical interfaces is available (analogue and digital inputs and outputs, serial and parallel interfaces, fieldbuses and networks). Profiles based on specific physical interfaces are already defined for some application areas (e.g. motion control) and some device classes (e.g. standard drives, positioner). The implementations of the associated drivers and application programmers interfaces are proprietary and vary widely.

IEC 61800-7 defines a set of common drive control functions, parameters, and state machines or description of sequences of operation to be mapped to the drive profiles.

IEC 61800-7 provides a way to access functions and data of a drive that is independent of the used drive profile and communication interface. The objective is a common drive model with generic functions and objects suitable to be mapped on different communication interfaces. This makes it possible to provide common implementations of motion control (or velocity control or drive control applications) in controllers without any specific knowledge of the drive implementation.

There are several reasons to define a generic interface.

For a drive device manufacturer

- Less effort to support system integrators
- Less effort to describe drive functions because of common terminology
- The selection of drives does not depend on availability of specific support

For a control device manufacturer

- No influence of bus technology
- Easy device integration
- Independent of a drive supplier

For a system integrator

- Less integration effort for devices
- Only one understandable way of modeling
- Independent of bus technology

Much effort is needed to design a motion control application with several different drives and a specific control system. The tasks to implement the system software and to understand the functional description of the individual components may exhaust the project resources. In some cases, the drives do not share the same physical interface. Some control devices just support a single interface which will not be supported by a specific drive. On the other hand, the functions and data structures are often specified with incompatibilities. This requires the system integrator to write special interfaces for the application software and this should not be his responsibility.

Some applications need device exchangeability or integration of new devices in an existing configuration. They are faced with different incompatible solutions. The efforts to adopt a solution to a drive profile and to manufacturer specific extensions may be unacceptable. This will reduce the degree of freedom to select a device best suited for this application to the selection of the unit which will be available for a specific physical interface and supported by the controller.

IEC 61800-7-1 is divided into a generic part and several annexes as shown in Figure 1. The drive profile types for CiA 402¹, CIP Motion^{TM2}, PROFIdrive³ and SERCOS interface^{TM4} are mapped to the generic interface in the corresponding annex. The annexes have been submitted by open international network or fieldbus organizations which are responsible for the content of the related annex and use of the related trademarks.

The different profile types 1, 2, 3 and 4 are specified in IEC 61800-7-201, IEC 61800-7-202, IEC 61800-7-203 and IEC 61800-7-204.

This part of IEC 61800-7 specifies how the profile type 3 (PROFIdrive) is mapped to the network technologies PROFIBUS⁵ and PROFINET⁶.

IEC 61800-7-301, IEC 61800-7-302 and IEC 61800-7-304 specify how the profile types 1, 2 and 4 are mapped to different network technologies (such as CANopen⁷, EtherCAT^{TM8}, Ethernet Powerlink^{TM9}, DeviceNet^{TM10}, ControlNet^{TM11}, EtherNet/IP^{TM12}, and SERCOS interface).

¹ CiA 402 is a trade name of CAN in Automation, e.V. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trade name holder or any of its products. Compliance to this profile does not require use of the trade name CiA 402.

² CIP MotionTM is a trade name of Open DeviceNet Vendor Association, Inc. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trade name CIP MotionTM. Use of the trade name CIP MotionTM requires permission of Open DeviceNet Vendor Association, Inc.

³ PROFIdrive is a trade name of PROFIBUS International. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trade name holder or any of its products. Compliance to this profile does not require use of the trade name PROFIdrive. Use of the trade name PROFIdrive requires permission of PROFIBUS International.

⁴ SERCOSTM and SERCOS interfaceTM are trade names of SERCOS International e.V. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trade name holder or any of its products. Compliance to this profile does not require use of the trade name SERCOS and SERCOS interface. Use of the trade name SERCOS and SERCOS interface requires permission of the trade name holder.

⁵ PROFIBUS is a trade name of PROFIBUS International. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trade name holder or any of its products. Compliance to this profile does not require use of the trade name PROFIBUS. Use of the trade name PROFIBUS requires permission of PROFIBUS International.

⁶ PROFINET is a trade name of PROFIBUS International. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trade name holder or any of its products. Compliance to this profile does not require use of the trade name PROFINET. Use of the trade name PROFINET requires permission of PROFIBUS International.

⁷ CANopen is an acronym for Controller Area Network *open* and is used to refer to EN 50325-4.

⁸ EtherCATTM is a trade name of Beckhoff, Verl. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trade name EtherCATTM. Use of the trade name EtherCATTM requires permission of the trade name holder.

⁹ Ethernet PowerlinkTM is a trade name of B&R, control of trade name use is given to the non profit organization EPSG. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trade name Ethernet PowerlinkTM. Use of the trade name Ethernet PowerlinkTM requires permission of the trade name holder.

¹⁰ DeviceNetTM is a trade name of Open DeviceNet Vendor Association, Inc. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trade name DeviceNetTM. Use of the trade name DeviceNetTM requires permission of Open DeviceNet Vendor Association, Inc.

¹¹ ControlNetTM is a trade name of ControlNet International, Ltd. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trade name ControlNetTM. Use of the trade name ControlNetTM requires permission of ControlNet International, Ltd.

¹² EtherNet/IPTM is a trade name of ControlNet International, Ltd. and Open DeviceNet Vendor Association, Inc. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trade name EtherNet/IPTM. Use of the trade name EtherNet/IPTM requires permission of either ControlNet International, Ltd. or Open DeviceNet Vendor Association, Inc.

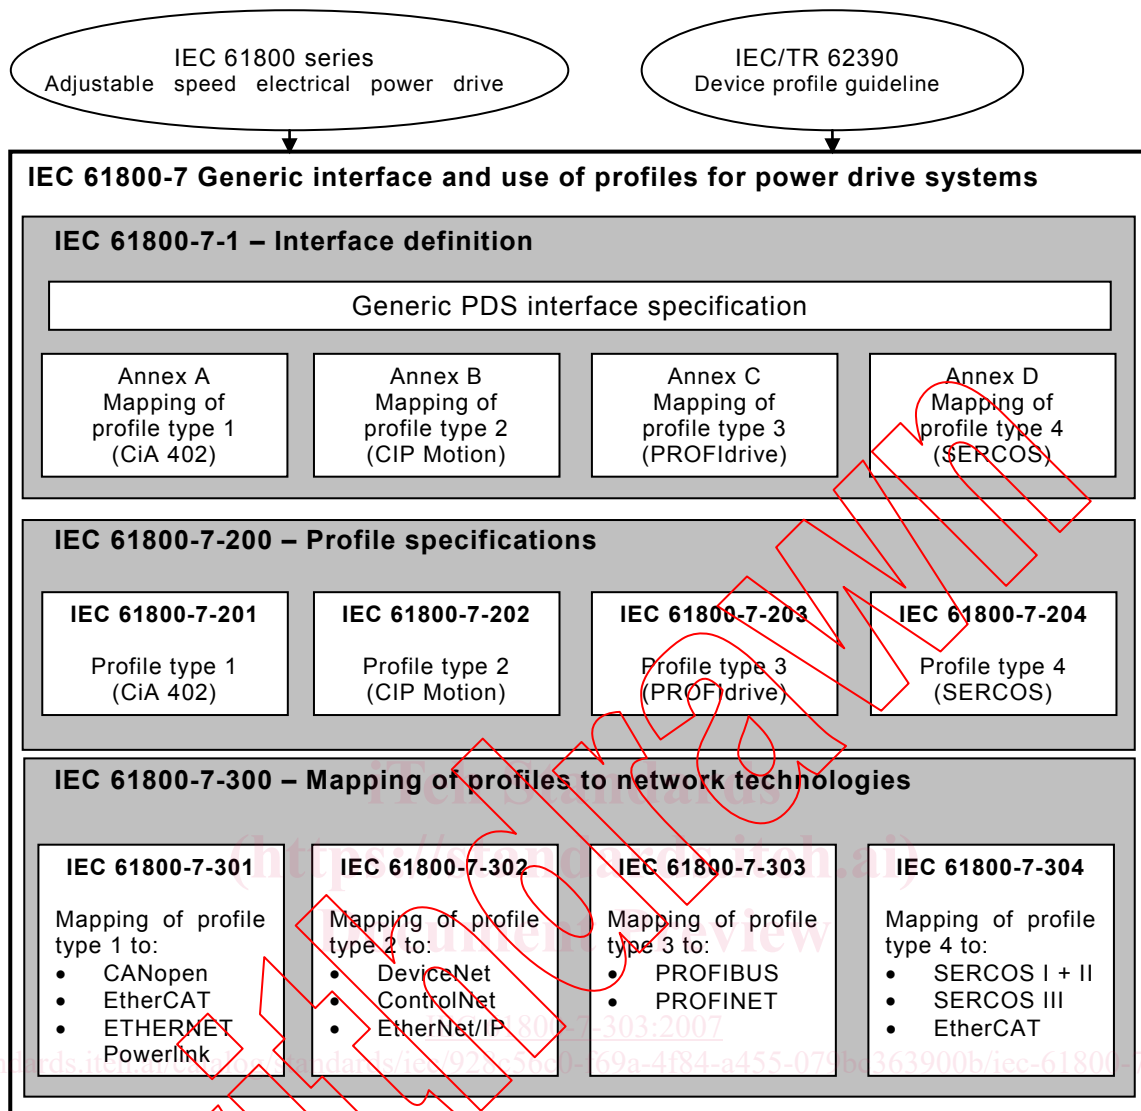


Figure 1 – Structure of IEC 61800-7

ADJUSTABLE SPEED ELECTRICAL POWER DRIVE SYSTEMS –

Part 7-303: Generic interface and use of profiles for power drive systems – Mapping of profile type 3 to network technologies

1 Scope

IEC 61800-7 specifies profiles for Power Drive Systems (PDS) and their mapping to existing communication systems by use of a generic interface model.

The functions specified in this part of IEC 61800-7 are not intended to ensure functional safety. This requires additional measures according to the relevant standards, agreements and laws.

This part of IEC 61800-7 specifies how the profile type 3 (PROFIdrive) specified in IEC 61800-7-203 onto different network technologies.

- PROFIBUS DP, see Clause 4,
- PROFINET IO, see Clause 5.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61158 (all parts), *Industrial communication networks – Fieldbus specifications*

IEC 61158-5-3, *Industrial communication networks – Fieldbus specifications – Part 5-3: Application layer service definition – Type 3 elements*

IEC 61158-5-10, *Industrial communication networks – Fieldbus specifications – Part 5-10: Application layer service definition – Type 10 elements*

IEC 61158-6-3, *Industrial communication networks – Fieldbus specifications – Part 6-3: Application layer protocol specification – Type 3 elements*

IEC 61158-6-10, *Industrial communication networks – Fieldbus specifications – Part 6-10: Application layer protocol specification – Type 10 elements*

IEC 61784-1, *Industrial communication networks – Profiles – Part 1: Fieldbus profiles*

IEC 61784-2, *Industrial communication networks – Profiles – Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3*

IEC 61800-7, (all parts), *Adjustable speed electrical power drive systems – Generic interface and use of profiles for power drive systems*

IEC 61800-7-203, *Adjustable speed electrical power drive systems – Part 7-203: Generic interface and use of profiles for power drive systems – Profile type 3 specification*