

# INTERNATIONAL STANDARD

Industrial communication networks – Profiles –  
Part 5-3: Installation of fieldbuses – Installation profiles for CPF 3

(<https://standards.iteh.ai>)

Document Preview

<https://standards.iteh.ai/standards/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007>

<https://standards.iteh.ai/standards/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007>

Withhold



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2007 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland  
Email: [inmail@iec.ch](mailto:inmail@iec.ch)  
Web: [www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: [www.iec.ch/searchpub](http://www.iec.ch/searchpub)

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: [www.iec.ch/online\\_news/justpub](http://www.iec.ch/online_news/justpub)

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.


- Customer Service Centre: [www.iec.ch/webstore/custserv](http://www.iec.ch/webstore/custserv)

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: [csc@iec.ch](mailto:csc@iec.ch)

Tel.: +41 22 919 02 11

Fax: +41 22 919 03 00

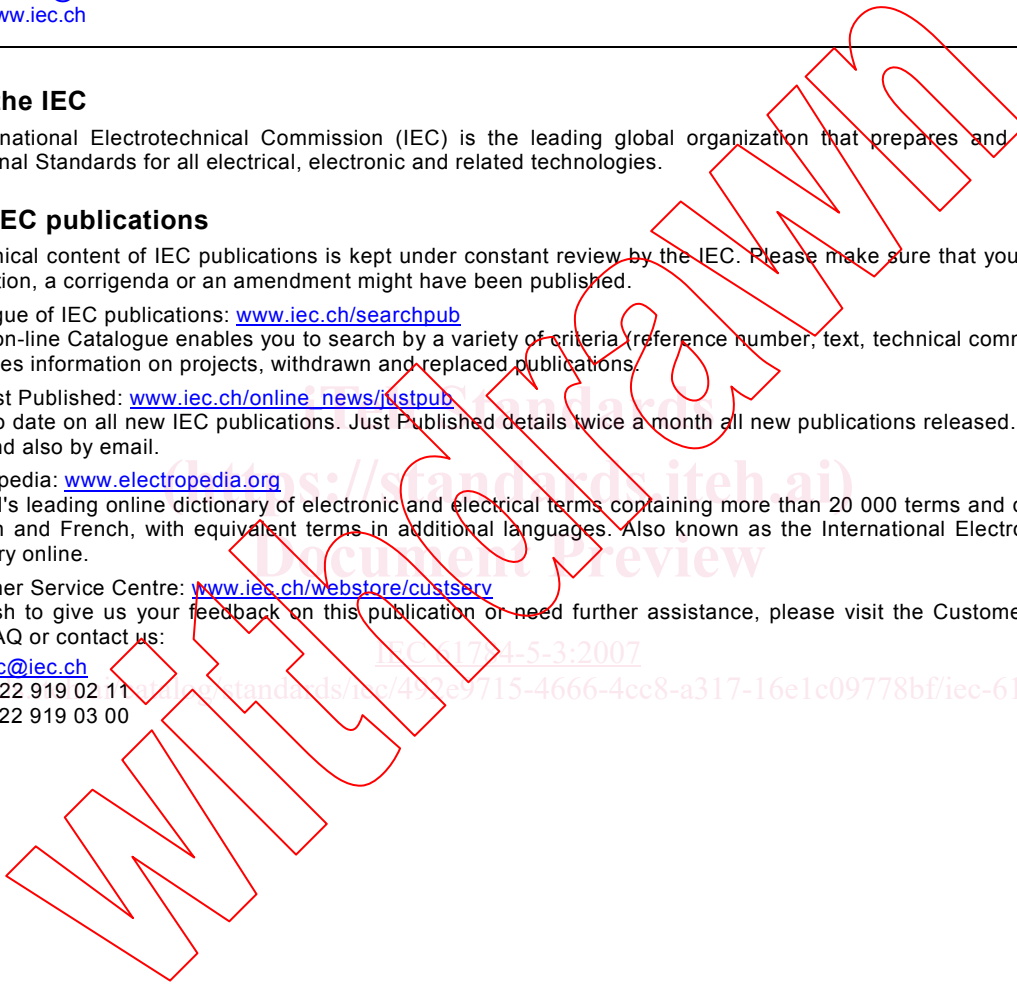

https://standards.itb.com/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007

# INTERNATIONAL STANDARD

---

**Industrial communication networks – Profiles –  
Part 5-3: Installation of fieldbuses – Installation profiles for CPF 3**

Document Preview  
[\(https://standards.iteh.ai/\)](https://standards.iteh.ai/)

<https://standards.iteh.ai/standards/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007>

<https://standards.iteh.ai/standards/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007>

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

PRICE CODE **XE**

## CONTENTS

FOREWORD.....	7
INTRODUCTION.....	9
1 Scope.....	10
2 Normative references .....	10
3 Terms, definitions and abbreviated terms .....	10
4 CPF 3: Overview of installation profiles .....	10
5 Installation profile conventions .....	10
6 Conformance to installation profiles.....	11
Annex A (normative) CP 3/1 specific installation profile .....	12
A.1 Installation profile scope.....	12
A.2 Normative references .....	12
A.3 Installation profile terms, definitions, and abbreviated terms.....	12
A.3.1 Terms and definitions .....	12
A.3.2 Abbreviated terms .....	12
A.3.3 Conventions for installation profiles .....	13
A.4 Installation planning .....	13
A.4.1 Introduction .....	13
A.4.2 Planning requirements.....	13
A.4.3 Network capabilities .....	15
A.4.4 Selection and use of cabling components .....	18
A.4.5 Cabling planning documentation.....	28
A.4.6 Verification of cabling planning specification.....	28
A.5 Installation implementation.....	28
A.5.1 General requirements.....	28
A.5.2 Cable installation.....	28
A.5.3 Connector installation.....	31
A.5.4 Terminator installation.....	35
A.5.5 Device installation .....	35
A.5.6 Coding and labeling.....	35
A.5.7 Earthing and bonding of equipment and device and shielded cabling.....	35
A.5.8 As-implemented cabling documentation.....	36
A.6 Installation verification and installation acceptance test.....	36
A.6.1 Introduction .....	36
A.6.2 Installation verification.....	37
A.6.3 Installation acceptance test .....	38
A.7 Installation administration.....	44
A.8 Installation maintenance and installation troubleshooting .....	44
A.8.1 General .....	44
A.8.2 Maintenance.....	44
A.8.3 Troubleshooting.....	44
A.8.4 Specific requirements for maintenance and troubleshooting .....	44
Annex B (normative) CP 3/2 (PROFIBUS) specific installation profile.....	46
B.1 Installation profile scope.....	46
B.2 Normative references .....	46
B.3 Installation profile terms, definitions, and abbreviated terms.....	46
B.3.1 Terms and definitions .....	46
B.3.2 Abbreviated terms .....	47

B.3.3	Conventions for installation profiles .....	47
B.4	Installation planning .....	48
B.4.1	Introduction .....	48
B.4.2	Planning requirements .....	49
B.4.3	Network capabilities .....	57
B.4.4	Selection and use of cabling components .....	62
B.4.5	Cabling planning documentation .....	77
B.4.6	Verification of cabling planning specification .....	77
B.5	Installation implementation .....	77
B.5.1	General requirements .....	78
B.5.2	Cable installation .....	78
B.5.3	Connector installation .....	79
B.5.4	Terminator installation .....	80
B.5.5	Device installation .....	80
B.5.6	Coding and labelling .....	80
B.5.7	Earthing and bonding of equipment and device and shielded cabling .....	80
B.5.8	As-implemented cabling documentation .....	80
B.6	Installation verification and installation acceptance test .....	80
B.6.1	Introduction .....	80
B.6.2	Installation verification .....	80
B.6.3	Installation acceptance test .....	81
B.7	Installation administration .....	82
B.8	Installation maintenance and installation troubleshooting .....	82
Annex C (normative)	CP 3/3, CP 3/4, CP 3/5, CP 3/6 (PROFINET) specific installation profile .....	83
C.1	Installation profile scope .....	83
C.2	Normative references .....	83
C.3	Installation profile terms, definitions, and abbreviated terms .....	83
C.3.1	Terms and definitions .....	83
C.3.2	Abbreviated terms .....	83
C.3.3	Conventions for installation profiles .....	83
C.4	Installation planning .....	83
C.4.1	Introduction .....	83
C.4.2	Planning requirements .....	84
C.4.3	Network capabilities .....	84
C.4.4	Selection and use of cabling components .....	88
C.4.5	Cabling planning documentation .....	101
C.4.6	Verification of cabling planning specification .....	101
C.5	Installation implementation .....	101
C.5.1	General requirements .....	101
C.5.2	Cable installation .....	101
C.5.3	Connector Installation .....	104
C.5.4	Terminator installation .....	105
C.5.5	Device installation .....	105
C.5.6	Coding and labeling .....	105
C.5.7	Earthing and bonding of equipment and device and shielded cabling .....	105
C.5.8	As-implemented cabling documentation .....	106
C.6	Installation verification and installation acceptance test .....	106
C.6.1	Introduction .....	106
C.6.2	Installation verification .....	106

C.6.3	Installation acceptance test .....	108
C.7	Installation administration .....	109
C.8	Installation maintenance and installation troubleshooting .....	109
	Bibliography .....	110
Table A.1	– Excerpt of MICE definition .....	15
Table A.2	– Basic network characteristics for balanced cabling not based on Ethernet (ISO/IEC 8802-3) .....	16
Table A.3	– Network characteristics for optical fibre cabling .....	17
Table A.4	– Information relevant to copper cable: fixed cables .....	19
Table A.5	– Information relevant to optical fibre cables .....	20
Table A.6	– Connectors for copper cabling CPs not based on Ethernet .....	21
Table A.7	– Optical fibre connecting hardware .....	21
Table A.8	– Parameters for balanced cables .....	29
Table A.9	– Parameters for silica optical fibre cables .....	29
Table A.10	– Parameters for POF optical fibre cables .....	29
Table A.11	– Parameters for hard cladded silica optical fibre cables .....	30
Table A.12	– Use of 9 pin Sub-D connector pins (RS 485) .....	32
Table A.13	– Use of 9 pin Sub-D connector pins (RS 485-IS) .....	33
Table A.14	– Use of M12 connector pins (RS 485) .....	34
Table A.15	– Use of M12 connector pins (RS 485-IS) .....	35
Table A.16	– Maximum fibre channel attenuation for CP 3/1 (PROFIBUS) .....	44
Table B.1	– Valid parameter range of the FISCO model for use as EEx ib IIC / IIB .....	54
Table B.2	– Valid parameter range of the FISCO model for use as EEx ia IIC .....	54
Table B.3	– Power supply (operational values) .....	60
Table B.4	– Minimum line lengths which can be achieved .....	60
Table B.5	– Limit values for distortion, reflection and signal delay .....	61
Table B.6	– Recommended maximum cable lengths including spurs .....	61
Table B.7	– Recommended length of the spurs .....	62
Table B.8	– Maximum length of the splices .....	62
Table B.9	– Information relevant to copper cable: fixed cables .....	63
Table B.10	– Safety limit values for the fieldbus cable .....	64
Table B.11	– Connectors for copper cabling CPs not based on Ethernet .....	65
Table B.12	– Mixing devices from different categories .....	67
Table B.13	– Electrical characteristics of fieldbus interfaces .....	68
Table B.14	– Recommended data sheet specifications for CP 3/2 devices .....	69
Table B.15	– Parameters for balanced cables .....	78
Table B.16	– Contact assignments for the external connector for harsh industrial environments .....	79
Table C.1	– General transmission media selection information .....	85
Table C.2	– Network characteristics for balanced cabling based on Ethernet (ISO/IEC 8802-3) .....	86
Table C.3	– Network characteristics for optical fibre cabling .....	87
Table C.4	– Information relevant to copper cable: CP 3/3, CP 3/4, CP 3/5 and CP 3/6 type A fixed cables .....	88

Table C.5 – Information relevant to copper cable: CP 3/3, CP 3/4, CP 3/5 and CP 3/6 type B fixed cables .....	89
Table C.6 – Information relevant to copper cable: CP 3/3, CP 3/4, CP 3/5 and CP 3/6 type C fixed cables .....	89
Table C.7 – Information relevant to optical fibre cables .....	90
Table C.8 – Requirements for plastic and polymer cladde optical fibre cables .....	91
Table C.9 – Requirements for glass multimode optical fibre cables .....	92
Table C.10 – Requirements for glass singlemode optical fibre cables .....	93
Table C.11 – Information relevant to hybrid cables .....	94
Table C.12 – Connectors for balanced cabling CPs based on Ethernet .....	95
Table C.13 – Optical fibre connecting hardware .....	95
Table C.14 – typical fibre channels common for industrial applications .....	98
Table C.15 – Parameters for balanced cables .....	102
Table C.16 – Parameters for silica optical fibre cables .....	102
Table C.17 – Parameters for POF optical fibre cables .....	102
Table C.18 – Parameters for hard cladde silica optical fibre cables .....	103
Table C.19 – colour coding for CP 3/3, CP 3/4, CP 3/5 and CP 3/6 connectors .....	104
Table C.20 – Maximum fibre channel attenuation for CP 3/3, CP 3/4, CP 3/5 and CP 3/6 (PROFINET) .....	108
Figure 1 – Standards relationships .....	9
Figure A.1 – Recommended combination of shielding and earthing for CP 3/1 networks with RS 485-IS .....	26
Figure A.2 – Sub-D connector pin numberings .....	32
Figure A.3 – 5-pin M-12 female socket .....	33
Figure A.4 – 5 pins M-12 male plug for CP 3/1 .....	34
Figure A.5 – Test circuit A - resistance measurement of data line B and shield .....	39
Figure A.6 – Test circuit B - resistance measurement of data line A and shield .....	39
Figure A.7 – Test circuit C - resistance measurement of data line A, data line B, and shield .....	40
Figure A.8 – Test circuit D - resistance measurement between data line A and B .....	40
Figure A.9 – Resistance measurement without 9-pin Sub-D plug .....	40
Figure A.10 – Loop core resistance (cable type A) .....	41
Figure A.11 – Action and resolution tree for measurement 1 (RS 485 and RS 485-IS) .....	42
Figure A.12 – Action and resolution tree for measurement 2 (RS 485 and RS 485-IS) .....	43
Figure A.13 – Action and resolution tree for measurement 3 (RS 485 and RS 485-IS) .....	43
Figure B.1 – Connection of CP 3/1 networks .....	49
Figure B.2 – Typical fieldbus architecture .....	52
Figure B.3 – Fieldbus with stations supplied by auxiliary power sources .....	52
Figure B.4 – Fieldbus model .....	56
Figure B.5 – Current modulation (Manchester II code) .....	56
Figure B.6 – CP 3/2 topology .....	57
Figure B.7 – Bus topology .....	58
Figure B.8 – Combination of the tree topology and the bus topology .....	58
Figure B.9 – Fieldbus extension .....	59
Figure B.10 – Recommended combination of shielding and earthing .....	72

Figure B.11 – Ideal combination of shielding and earthing .....	73
Figure B.12 – Capacitive grounding .....	74
Figure B.13 – Galvanic isolated field device.....	76
Figure B.14 – Pin assignment of the male and female connectors IEC 60947-5-2 (A-coding) .....	80
Figure C.1 – End-to-end link without interconnections.....	96
Figure C.2 – Assembled end-to-end link .....	96
Figure C.3 – Connectionless optical fibre link .....	97
Figure C.4 – Assembled optical fibre link .....	97
Figure C.5 – Shielded connectors for CP 3/3, CP 3/4, CP 3/5 and CP 3/6 fieldbus networks .....	104
Figure C.6 – Pin-assignment for a straight cable.....	104

Withholding

iTech Standards  
(<https://standards.iteh.ai>)  
Document Preview

<https://standards.iteh.ai/standards/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007>

<https://standards.iteh.ai/standards/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007>



## INTERNATIONAL ELECTROTECHNICAL COMMISSION

## INDUSTRIAL COMMUNICATION NETWORKS – PROFILES

## Part 5-3: Installation of fieldbuses – Installation profiles for CPF 3

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61784-5-3 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial-process measurement, control and automation.

This standard is to be used in conjunction with IEC 61918:2007.

The text of this standard is based on the following documents:

FDIS	Report on voting
65C/471/FDIS	65C/482/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61784-5 series, under the general title *Industrial communication networks – Profiles – Installation of fieldbuses*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

The contents of the corrigendum of February 2009 have been included in this copy.

WITHDRAWN

iTech Standards  
(<https://standards.iteh.ai>)  
Document Preview

<https://standards.iteh.ai/standards/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007>

<https://standards.iteh.ai/standards/iec/452e9715-4666-4cc8-a317-16e1c09778bf/iec-61784-5-3-2007>

## INTRODUCTION

This International Standard is one of a series produced to facilitate the use of communication networks in industrial control systems.

IEC 61918:2007 (Ed. 1.0) provides the common requirements for the installation of communication networks in industrial control systems. This installation profile standard provides the installation profiles of the communication profiles (CP) of a specific communication profile family (CPF) by stating which requirements of IEC 61918 fully apply and, where necessary, by supplementing, modifying, or replacing the other requirements (see Figure 1).

For general background on fieldbuses, their profiles, and relationship between the installation profiles specified in this standard, see IEC/TR 61158-1.

Each CP installation profile is specified in a separate annex of this standard. Each annex is structured exactly as the reference standard IEC 61918 for the benefit of the persons representing the roles in the fieldbus installation process as defined in IEC 61918 (planner, installer, verification personnel, validation personnel, maintenance personnel, administration personnel). By reading the installation profile in conjunction with IEC 61918, these persons immediately know which requirements are common for the installation of all CPs and which are modified or replaced. The conventions used to draft this standard are defined in Clause 5.

The provision of the installation profiles in one standard for each CPF (for example IEC 61784-5-3 for CPF 3), allows readers to work with standards of a convenient size.

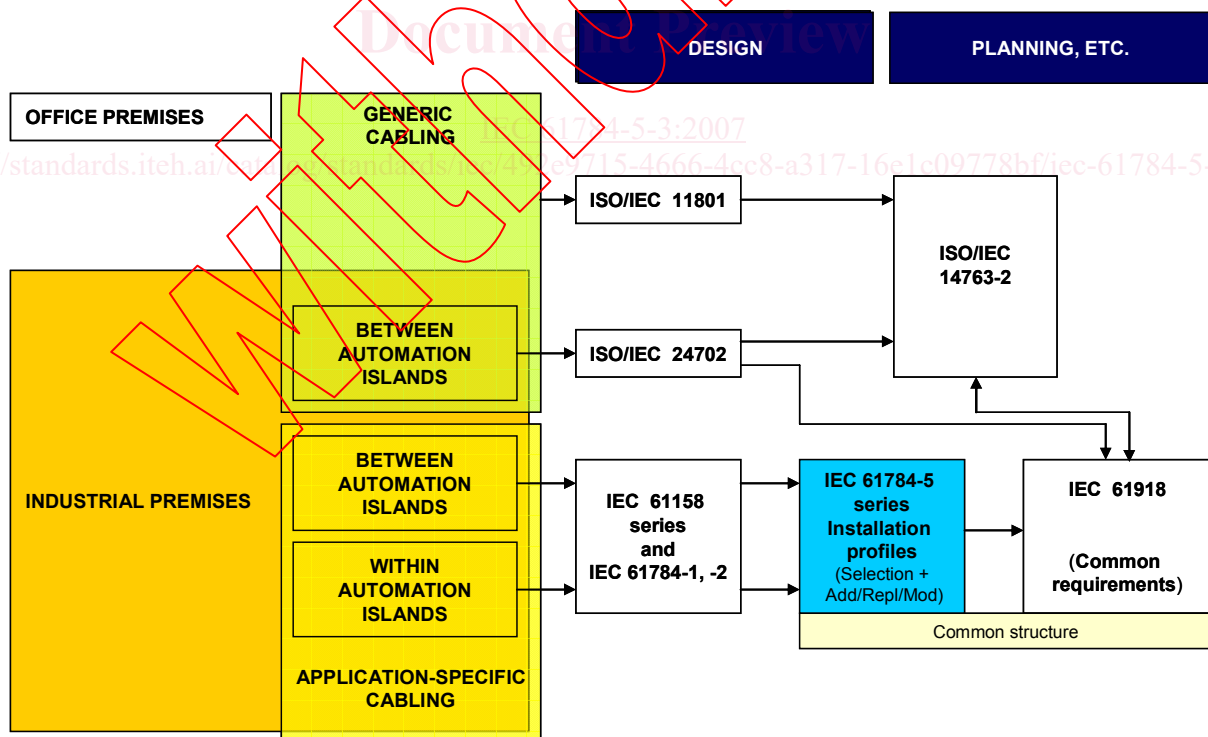


Figure 1 – Standards relationships

## INDUSTRIAL COMMUNICATION NETWORKS – PROFILES

### Part 5-3: Installation of fieldbuses – Installation profiles for CPF 3

#### 1 Scope

This part of IEC 61784 specifies the installation profiles for CPF 3 (PROFIBUS/PROFINET)<sup>1</sup>.

The installation profiles are specified in the annexes. These annexes are read in conjunction with IEC 61918:2007.

#### 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61918:2007, *Industrial communication networks – Installation of communication networks in industrial premises*

The normative references of IEC 61918:2007, Clause 2, apply. For profile specific normative references, see A.2, B.2, and C.2.

#### 3 Terms, definitions and abbreviated terms

For the purpose of this document, the terms, definitions and abbreviated terms of IEC 61918:2007, Clause 3, apply. For profile specific terms, definitions and abbreviated terms see A.3, B.3, and C.3.

#### 4 CPF 3: Overview of installation profiles

CPF 3 consists of six CPs as specified in IEC 61784-1 and IEC 61784-2.

The installation requirements for CP 3/1 (PROFIBUS with physical layer according to RS 485, RS 485-IS, and fibre) are specified in Annex A.

The installation requirements for CP 3/2 (PROFIBUS with physical layer according to MBP, MBP-IS, MBP-LP) are specified in Annex B.

The installation requirements for CP 3/3, CP 3/4, CP 3/5, and CP 3/6 (PROFINET) are specified in Annex C.

#### 5 Installation profile conventions

The numbering of the clauses and subclauses in the annexes of this standard corresponds to the numbering of IEC 61918:2007 main clauses and subclauses.

---

<sup>1</sup> PROFIBUS and PROFINET are trade names of the non-profit organization PROFIBUS Nutzerorganisation e.V. (PNO). This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trade names holder or any of its products. Compliance to this profile does not require use of the trade names. Use of the trade names PROFIBUS and PROFINET requires permission of the trade name holder.

The annex clauses and subclauses of this standard supplement, modify, or replace the respective clauses and subclauses in IEC 61918:2007.

Where there is no corresponding subclause of IEC 61918:2007 in the normative annexes in this standard, the subclause of IEC 61918:2007 applies without modification.

The annex heading letter represents the installation profile assigned in Clause 4. The annex heading number shall represent the corresponding numbering of IEC 61918:2007.

EXAMPLE “Annex B.4.4” in IEC 61784-5-3 means that CP 3/2 specifies the Subclause 4.4 of IEC 61918:2007.

All main clauses of IEC 61918:2007 are cited and apply in full unless otherwise stated in each normative installation profile annex.

If all subclauses of a (sub)clause are omitted, then the corresponding IEC 61918 (sub)clause applies.

If in a (sub)clause it is written “Not applicable”, then the corresponding IEC 61918 (sub)clause does not apply.

If in a (sub)clause it is written “Addition”, then the corresponding IEC 61918 (sub)clause applies with the additions written in the profile.

If in a (sub)clause it is written “Replacement”, then the text provided in the profile replaces the text of the corresponding IEC 61918 (sub)clause.

NOTE A replacement can also comprise additions.

If in a (sub)clause it is written “Modification”, then the corresponding IEC 61918 (sub)clause applies with the modifications written in the profile.

If all (sub)clauses of a (sub)clause are omitted but in this (sub)clause it is written “(sub)clause x has “Addition” (or “Replacement”) or is “Not applicable”, then (sub)clause x becomes valid as declared and all the other corresponding IEC 61918 (sub)clauses apply.

## 6 Conformance to installation profiles

Each installation profile within this standard includes part of IEC 61918:2007. It may also include defined additional specifications.

A statement of compliance to an installation profile of this standard shall be stated<sup>2</sup> as either

Compliance to IEC 61784-5-3:2007<sup>3</sup> for CP 3/n <name> or

Compliance to IEC 61784-5-3 (Ed.1.0) for CP 3/n <name>

where the name within the angle brackets < > is optional and the angle brackets are not to be included. The n within CP 3/n shall be replaced by the profile number 1 to 6.

NOTE The name may be the name of the profile, for example PROFIBUS or PROFINET.

If the name is a trade name then the permission of the trade name holder shall be required.

Product standards shall not include any conformity assessment aspects (including quality management provisions), neither normative nor informative, other than provisions for product testing (evaluation and examination).

<sup>2</sup> In accordance with ISO/IEC Directives

<sup>3</sup> The date should not be used when the edition number is used.

## **Annex A** (normative)

### **CP 3/1 specific installation profile**

#### **A.1 Installation profile scope**

*Addition:*

This standard specifies the installation profile for Communication Profile CP 3/1 (PROFIBUS with a physical layer according to RS 485, RS 485-IS, and fibre). The CP 3/1 is specified in IEC 61784-1.

#### **A.2 Normative references**

*Addition:*

IEC 61508 (all parts), *Functional safety of electrical/electronic/programmable electronic safety-related systems*

ANSI TIA/EIA-485-A, *Electrical Characteristics of Generators and Receivers for Use in Balanced Digital Multipoint Systems*

#### **A.3 Installation profile terms, definitions, and abbreviated terms**

##### **A.3.1 Terms and definitions**

*Addition:*

###### **A.3.1.1**

###### **hazard**

potential source of harm

NOTE The term includes danger to persons arising within a short time scale (for example fire and explosion) and also those that have a long term effect on a person's health (for example release of a toxic substance).

[IEC 61508-4:1998, 3.1.2]

###### **A.3.1.2**

###### **intrinsic safety "i"**

type of protection based on the restriction of electrical energy within apparatus and of interconnecting wiring exposed to the potentially explosive atmosphere to a level below that which can cause ignition by either sparking or heating effects

[IEC 60079-11:2006, 3.1.1]

NOTE No single device or wiring is intrinsically safe by itself (except for battery-operated self-contained apparatus such as portable pagers, transceivers, gas detectors, etc., which are specifically designed as intrinsically safe self-contained devices) but is intrinsically safe only when employed as part of a properly designed intrinsically safe system.

##### **A.3.2 Abbreviated terms**

*Addition:*