



# Standard Practice for Minimum Structural Design Loading for Underground Precast Concrete Utility Structures<sup>1</sup>

This standard is issued under the fixed designation C 857; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This practice describes the minimum live loads and dead loads to be applied when designing monolithic or sectional precast concrete utility structures. Concrete pipe, box culverts, and material covered in Specification C 478 are excluded from this practice.

NOTE 1—For additional information see AASHTO Standard Specification for Highway Bridges, Fifteenth Edition.

NOTE 2—The purchaser is cautioned that he must properly correlate the anticipated loading conditions and the field requirements with the design loads used.

1.2 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are for information only.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

### 2.1 ASTM Standards:

C 478 Specification for Precast Reinforced Concrete Manhole Sections<sup>2</sup>

### 2.2 AASHTO Standard:

Specification for Highway Bridges, Fifteenth Edition<sup>3</sup>

## 3. Terminology

### 3.1 Definitions of Terms Specific to This Standard:

3.1.1 *dead loads*—will consist of any other load that can affect the design of the structure.

3.1.2 *live loads*—will consist of any moving loads that can affect the design of the structure and their associated impact and surcharge loads.

3.1.3 *utility structure*—a structure that is used by electric, gas, communication, or similar industries.

<sup>1</sup> This practice is under the jurisdiction of ASTM Committee C-27 on Precast Concrete Products and is the direct responsibility of Subcommittee C 27.10 on Utility Structures.

Current edition approved Nov. 10, 1995. Published February 1996. Originally published as C 857 – 78. Last previous edition C 857 – 87 (1994).

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 04.05.

<sup>3</sup> Available from American Association of State Highway and Transportation Officials (AASHTO), 444 N. Capitol St., Washington, DC 20001.

## 4. Design Loads

4.1 *Roof*—The design loads for the roof of any structure at or below ground level consists of the live loads including impact and dead loads that can develop as a result of earth pressure, hydrostatic pressure, and construction materials such as used for roadways and walkways.

4.1.1 *Live Loads*—The vehicle and pedestrian load designations are given in Table 1. Live load wheel spacing is shown in Fig. 1.

### 4.1.2 Impact:

4.1.2.1 The live loads A-16, A-12, and A-8 should be increased as follows to sustain the effect of impact:

### 4.1.2.2 Live Load Increase:

0 to 12 in. (0 to 305 mm) below ground level, 30 %  
13 to 24 in. (330 to 610 mm) below ground level, 20 %  
25 to 35 in. (635 to 889 mm) below ground level, 10 %  
36 in. (914 mm) or more below ground level, 0 %

4.1.3 *Dead Loads*—Dead loads will consist of the weight of the roof, roadbed, walkways, earth fill, access opening covers, and any other material that produces a static load.

4.1.3.1 Recommended unit weights of materials for design calculations are as follows:

Concrete, plain, and reinforced	150 lb/ft <sup>3</sup> (2043 kg/m <sup>3</sup> )
Cast iron	450 lb/ft <sup>3</sup> (7208 kg/m <sup>3</sup> )
Steel	490 lb/ft <sup>3</sup> (7850 kg/m <sup>3</sup> )
Aluminum	175 lb/ft <sup>3</sup> (2804 kg/m <sup>3</sup> )
Earth fill (dry)	110 lb/ft <sup>3</sup> (1762 kg/m <sup>3</sup> )
Macadam	140 lb/ft <sup>3</sup> (2243 kg/m <sup>3</sup> )

### 4.1.4 Distribution of Wheel Loads Through Earth Fills:

4.1.4.1 Wheel loads at ground level should be considered applied to a wheel load area as indicated in Fig. 2.

4.1.4.2 Wheel loads should be distributed below ground level as a truncated pyramid, as shown in Fig. 3, in which the top surface is the wheel load area and the distributed load area is equal to the following:

$$DLA = (W + 1.75 H) (L + 1.75 H) \quad (1)$$

where:

$DLA$  = distributed load area, ft<sup>2</sup>(m<sup>2</sup>)  
 $W$  = wheel load width, ft (m),  
 $L$  = wheel load length, ft (m), and  
 $H$  = depth of fill, ft (m).

4.1.4.3 When several distributed load areas overlap, the total load shall be considered as uniformly distributed over the area defined by the outside limits of the individual areas as

**TABLE 1 Vehicle and Pedestrian Load Designations**

Designations	Maximum Loads	Uses
A-16 (HS20-44) <sup>A</sup>	16 000 lbf (71 172 N)/wheel	heavy traffic
A-12 (HS15-44) <sup>A</sup>	12 000 lbf (53 376 N)/wheel	medium traffic
A-8 (H10-44) <sup>A</sup>	8 000 lbf (35 586 N)/wheel	light traffic
A-0.3	300 lbf/ft <sup>2</sup> (14.4 kPa)	walkways <sup>B</sup>

<sup>A</sup>The designations in parentheses are the corresponding AASHTO designations.

<sup>B</sup>Anticipated designs other than those listed should be designated by purchaser.

indicated in Fig. 4. When the dimensions of the composite distributed load area exceeds the roof area only that portion of the distributed load on the roof area shall be considered in the design.

4.1.4.4 The distribution of wheel loads through earth fill may be neglected when the depth of fill exceeds 8 ft (2.5 m).

4.2 *Walls*—The design loads for the walls of any structure at or below ground level will consist of surcharge loads resulting from live loads, dead loads that can develop as a result of earth pressure, hydrostatic pressure, and construction materials such as used for roadways and walkways. Load diagrams of live load surcharge and dead loads are shown in Fig. 5.

#### 4.2.1 *Live Loads*:

4.2.1.1 When traffic can come within a horizontal distance from the structure equal to one half the height of the structure, a live load surcharge pressure of not less than 0.5 % of the wheel loading of the traffic involved should be taken as the live load acting upon the wall of the structure.

4.2.1.2 Surcharge pressures for various live loads transferred to equivalent horizontal fluid pressure are as follows:

A-16	16 000 lbf per wheel × 0.005 = 80 lbf/ft <sup>2</sup> (3830 Pa) per wheel
A-12	12 000 lbf per wheel × 0.005 = 60 lbf/ft <sup>2</sup> (2873 Pa) per wheel
A-8	8 000 lbf per wheel × 0.005 = 40 lbf/ft <sup>2</sup> (1915 Pa) per wheel
A-0.3	Refer to 4.2.2.1

4.2.1.3 Surcharge pressures resulting from live loads may be neglected when the distance from ground level exceeds 8 ft (2.5 m).

#### 4.2.2 *Dead Loads*:

4.2.2.1 The dead loads will consist of an earth pressure above ground water level and hydrostatic pressure plus a modified earth pressure below ground water level. The earth pressure above ground water level and the modified earth pressure below ground water level will be converted to a horizontal pressure using Rankine's Theory on active earth pressure. No structure will be designed for less than a 30 lb/ft<sup>2</sup> (1436 Pa) horizontal pressure.

4.2.2.2 For the general case when structures are placed in areas where the soil surface does not slope the horizontal pressure acting at a point on the wall of the structure above ground water level will be:

$$P = K_a \times W \times H \quad (2)$$

where:

$P$  = horizontal pressure, lbf/ft<sup>2</sup>(Pa)

$K_a$  = coefficient of active earth pressure =  $(1 - \sin \phi)/(1 + \sin \phi)$

$\phi$  = angle of internal friction of the soil, deg (rad),

$W$  = unit weight of soil, lb/ft<sup>3</sup>(kg/m<sup>3</sup>) and

$H$  = distance from ground level to the point on the wall under consideration, ft (m).

4.2.2.3 In special cases, when structures are placed in areas where the soil surface is sloping, the horizontal pressure acting at a point on the structure above ground water level is as follows:

$$P = \cos \delta K_a W_s H \quad (3)$$

where:

$P$  = horizontal pressure, lbf/ft<sup>2</sup>(Pa),

$K_a$  = coefficient of active earth pressure =

$$\cos \delta \frac{\cos \delta - \sqrt{\cos^2 \delta - \cos^2 \phi}}{\cos \delta + \sqrt{\cos^2 \delta - \cos^2 \phi}} \quad (4)$$

$\phi$  = angle of internal friction of the soil, deg (rad),

$\delta$  = angle between the sloping soil surface and the horizontal, deg (rad)

$W_s$  = unit weight of soil, lb/ft<sup>3</sup>(kg/m<sup>3</sup>), and

$H$  = distance from ground level to the point on the wall under consideration, ft (m).

The horizontal pressure below ground water level resulting from the weight of soil above ground water level is equal to the horizontal pressure at ground water level and will remain constant from ground water level to the base of structure.

4.2.2.4 The horizontal pressure that can develop below ground water level will consist of a full hydrostatic pressure plus horizontal pressure resulting from the weight of submerged soil. The hydrostatic pressure acting at a point on the wall of the structure below ground water level is:

$$P_w = W_w H_w \quad (5)$$

where:


$P_w$  = hydrostatic pressure, lbf/ft<sup>2</sup>(Pa),

$W_w$  = unit weight of water, lb/ft<sup>3</sup>(kg/m<sup>3</sup>), and

$H_w$  = distance from ground water level to the point on the wall under consideration, ft (m).

The horizontal pressure acting at a point on the wall of the structure below ground water level resulting from the weight of submerged soil is:

3.1.2.3 LIVE LOAD SPACING

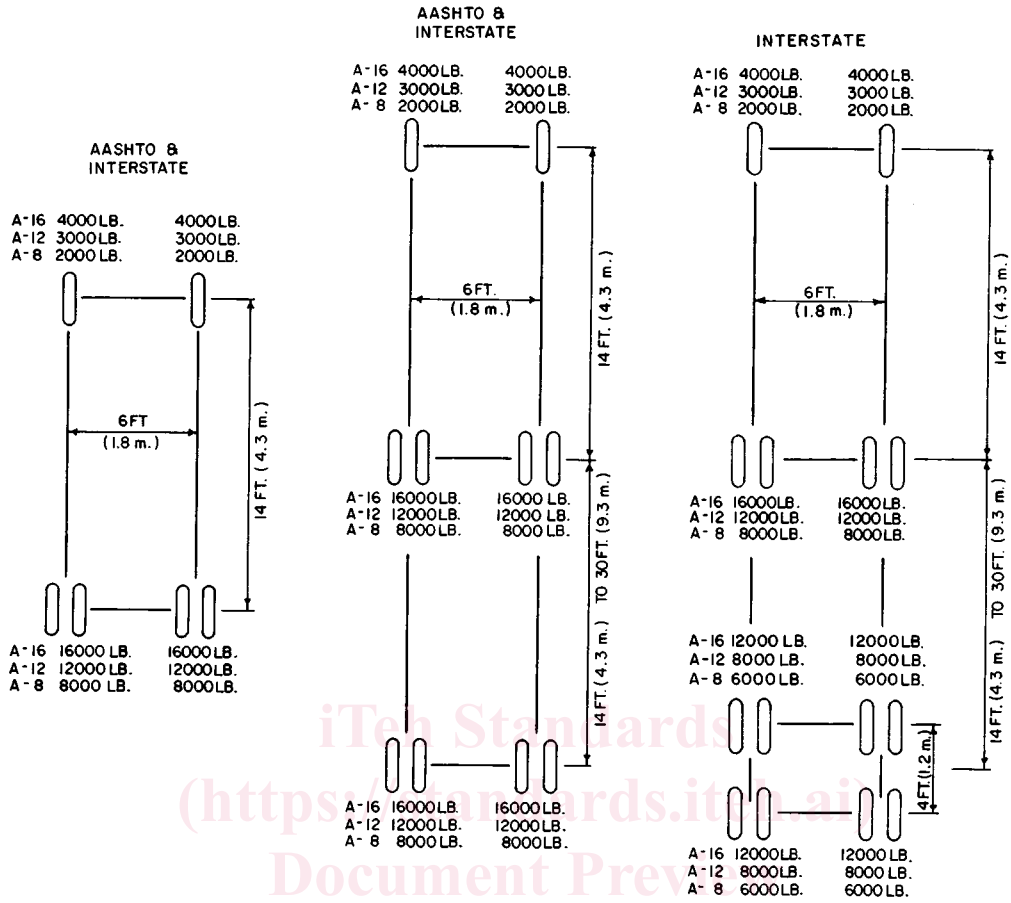

iTea Standards  
 (https://standards.itea.ai)  
 Document Preview

ASTM C857-95

https://standards.itea.ai/catalog/standards/sist/597406-c40c-4906-a5da-6574f9692b37/astm-c857-95

- 2000 LB. ( 907.2 kg )
- 3000 LB. ( 1360.8 kg )
- 4000 LB. ( 1814.4 kg )
- 8000 LB. ( 3628.8 kg )
- 12000 LB. ( 5443.2 kg )
- 16000 LB. ( 7257.6 kg )

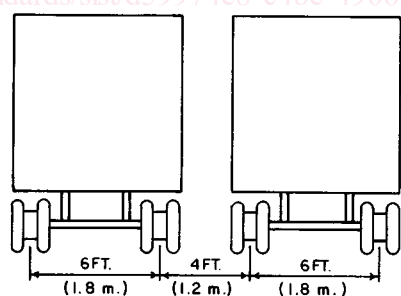


FIG. 1 Live Load Spacing

$$P_s = (W_s - W_w) K_a H_w \quad (6)$$