



## Standard Specification for Reflective Insulation for Building Applications<sup>1</sup>

This standard is issued under the fixed designation C 1224; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

### 1. Scope

1.1 This specification covers the general requirements and physical properties of reflective insulations for use in building applications. These insulation materials consist of one or more low emittance surfaces, such as metallic foil or metallic deposits, unmounted or mounted on substrates. Reflective insulations derive their thermal performance from surfaces with an emittance of 0.1 or less, facing enclosed air spaces.

1.2 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are provided for information only.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

### 2. Referenced Documents

#### 2.1 ASTM Standards:

- C 168 Terminology Relating to Thermal Insulating Materials<sup>2</sup>
- C 177 Test Method for Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded-Hot-Plate Apparatus<sup>2</sup>
- C 236 Test Method for Steady State Thermal Performance of Building Assemblies by Means of a Guarded Hot Box<sup>2</sup>
- C 390 Criteria for Sampling and Acceptance of Preformed Thermal Insulation Lots<sup>2</sup>
- C 518 Test Method for Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus<sup>2</sup>
- C 727 Practice for Use and Installation of Reflective Insulation in Building Constructions<sup>2</sup>
- C 976 Test Method for Thermal Performance of Building Assemblies by Means of a Calibrated Hot Box<sup>2</sup>
- C 1338 Test Method for Determining Fungi Resistance of Insulation Materials and Facings<sup>2</sup>
- C 1363 Test Method for the Thermal Performance of Building Assemblies by Means of a Hot Box Apparatus<sup>2</sup>

<sup>1</sup> This specification is under the jurisdiction of ASTM Committee C-16 on Thermal Insulation and is the direct responsibility of Subcommittee C16.21 on Reflective Insulation.

Current edition approved March 10, 1999. Published May 1999. Originally published as C 1224-93. Last previous edition C 1224-97.

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 04.06.

C 1371 Test Method for Determination of Emittance of Materials Near Room Temperature Using Portable Emis-someters<sup>2</sup>

D 3310 Test Method for Determining Corrosivity of Adhe-sive Materials<sup>3</sup>

E 84 Test Method for Surface Burning Characteristics of Building Materials<sup>4</sup>

E 96 Test Methods for Water Vapor Transmission of Mate-rials<sup>2</sup>

#### 2.2 Other Standard:

TAPPI Standard T 512 om-86, Creasing of Flexible Pack-aging Material Paper Specimens for Testing<sup>5</sup>

### 3. Terminology

3.1 *Definitions*—Terminology C 168 shall apply to the terms in this specification.

#### 3.2 Definitions of Terms Specific to This Standard:

3.2.1 *reflective insulation*—thermal insulation consisting of one or more low emittance surfaces, bounding one or more enclosed air spaces.

### 4. Ordering Information

4.1 Prior to purchase, for sampling and acceptance proce-dures, Criteria C 390 can be agreed upon between the pur-chaser and the manufacturer.

4.2 Specify the required thermal resistance by the direction of the heat flow.

4.3 Specify the width, depth, and total area to be insulated.

4.4 Specify special markings, if required.

### 5. Materials and Manufacture

5.1 Reflective insulation materials shall consist of low emittance surface(s) in combination with substrates and adhe-sives required to meet the specified thermal performance and physical properties.

### 6. Physical Properties Requirements

6.1 Low emittance materials shall have an emittance of 0.1 or less, as determined in accordance with Test Method C 1371.

6.2 *Water Vapor Transmission*—If the reflective insulation is to serve as a vapor retarder, the permeance of the material

<sup>3</sup> *Annual Book of ASTM Standards*, Vol 15.06.

<sup>4</sup> *Annual Book of ASTM Standards*, Vol 04.07.

<sup>5</sup> Available from TAPPI, Technology Park/Atlanta, P.O. Box 105113, Atlanta, GA 30348.

shall not exceed 1 perm, as determined in accordance with Test Methods E 96.

6.3 Multiple layer reflective insulations shall be designed to attain the intended separation of layers in normal application. Such multiple layer insulation shall form an attachment flange suitable for stapling, or other means of attachment.

6.4 *Widths*—Insulation shall be furnished in widths to fit between framing members set at spacings standard in the construction industry, or as specifically agreed upon between the producer and the buyer.

6.5 Surface burning characteristics shall be determined in accordance with Test Method E 84, in a configuration consistent with the intended application.

6.6 *Corrosivity*—The laminates of the reflective insulation shall be tested in accordance with Test Method D 3310. Evidence of corrosion shall be cause for rejection.

6.7 *Adhesive Performance:*

6.7.1 *Bleeding*—Adhesives when used in bonding shall show no sign of bleeding when tested in accordance with the test procedure in 9.2.1. Bleeding at cut edges may be disregarded. Bleeding or delamination, covering over 2 % of the sample area, shall be cause for rejection.

6.7.2 *Pliability*—Specimens tested in accordance with the test procedure in 9.2.2 shall not show cracking or delamination.

6.8 *Mold and Mildew*—Resistance shall be tested in accordance with Test Method C 1338. Use interpretation of results in 7.2 of Test Method C 1338.

6.9 *Thermal Resistance*—Determine the thermal resistance in accordance with procedures in 9.1.

7. Workmanship, Finish, and Appearance

7.1 The insulation shall be manufactured, packaged, and shipped in such a manner that, when received by the customer, it shall be suitable for installation in accordance with Practice C 727.

8. Sampling

8.1 Sampling shall be performed in accordance with Criteria C 390.

9. Test Methods

9.1 *Thermal Performance*—The thermal performance of reflective insulations shall be determined in accordance with Test Methods C 236, C 976 or C 1363 using the following criteria.

9.1.1 In order to determine the thermal performance of the reflective insulation materials used in a test panel, a uniform method of adjustment of the test panel results is needed.


9.1.2 The test panel shall consist of wood framing members sheathed with 3/4 in. thick plywood on each side. The width and depth of the cavities shall be representative of the installation for which the insulation product is intended. (See Sections 5 and 7 of Test Method C 236 or Sections 3 and 6 of Test Method C 976). The reflective insulation shall be installed in the test panel according to the manufacturer’s specifications.

9.1.3 The testing of the reflective insulation shall be performed at a cavity mean temperature of 75 ± 4°F (24 ± 2°C) with a temperature difference across the insulated cavity of 30 ± 2°F (16.5 ± 1°C).

9.1.3.1 To determine the cavity mean temperature and temperature difference, sufficient temperature instrumentation shall be applied to the interior surfaces of the plywood sheathing to measure the average temperature of these surfaces. Recommended temperature sensor layouts for 8 ft by 8 ft guarded and calibrated hot boxes are shown in Fig. 1 and Fig. 2, respectively.

9.1.4 To determine the heatflow in the cavity area, the net heat flow shall be adjusted to account for the heat flow through the framing members. To perform this adjustment, the thermal resistance of the framing material must be known to within ±10 % and the average temperature difference across the framing members shall be measured.

9.1.4.1 A sufficient number of temperature sensors shall be installed to determine the average temperature difference across the framing members. Recommended framing member temperature sensor layouts for 8 ft by 8 ft guarded and calibrated hot boxes are shown in Fig. 1 and Fig. 2, respectively.

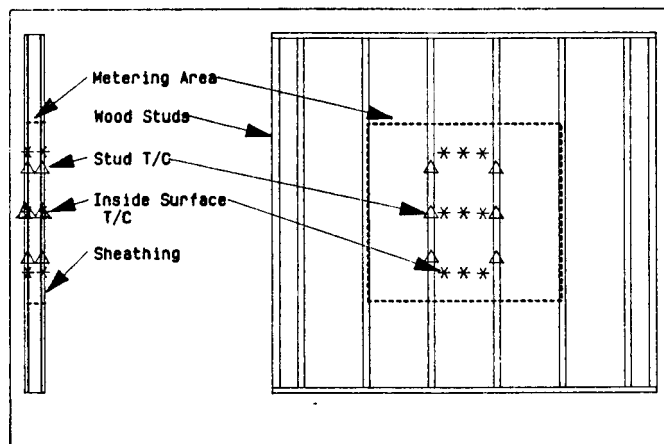

NOTE 1—The diagram shows a total of 30 thermocouples. Eighteen of the thermocouples provide panel surface temperatures, twelve or more of the thermocouples provide stud surface temperatures. As few as 3 thermocouples minimum, per side, may be used to measure stud surface temperature.

FIG. 1 Recommended GHB R-Value Test Panel Inside Surface and Stud T/C Layout for 16 in. OC Stud Spacing