

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Industrial communication networks – Profiles –
Part 5-2: Installation of fieldbuses – Installation profiles for CPF 2**

**Réseaux de communication industriels – Profils –
Partie 5-2: Installation des bus de terrain – Profils d'installation pour CPF 2**

<https://standards.iteh.ai/en/standards/standards/st/26468290-9624-4256-b3d4-8f3b145a7613/iec-61784-5-2-2010>



THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2010 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.
If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.
Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

Useful links:

IEC publications search - www.iec.ch/searchpub

The advanced search enables you to find IEC publications by a variety of criteria (reference number, text, technical committee,...).

It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available on-line and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary (IEV) on-line.

Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

A propos de la CEI

La Commission Electrotechnique Internationale (CEI) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications CEI

Le contenu technique des publications de la CEI est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Liens utiles:

Recherche de publications CEI - www.iec.ch/searchpub

La recherche avancée vous permet de trouver des publications CEI en utilisant différents critères (numéro de référence, texte, comité d'études,...).

Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

Just Published CEI - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications de la CEI. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne au monde de termes électroniques et électriques. Il contient plus de 30 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans les langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (VEI) en ligne.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: csc@iec.ch.

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Industrial communication networks – Profiles –
Part 5-2: Installation of fieldbuses – Installation profiles for CPF 2**

**Réseaux de communication industriels – Profils –
Partie 5-2: Installation des bus de terrain – Profils d'installation pour CPF 2**

<https://standards.iteh.org/standards/iec/61784-5-2-2010>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE **XG**
CODE PRIX

ICS 25.040.40; 35.100.40

ISBN 978-2-88912-947-8

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	7
INTRODUCTION.....	9
1 Scope.....	10
2 Normative references	10
3 Terms, definitions and abbreviated terms	10
4 CPF 2: Overview of installation profiles	10
5 Installation profile conventions	11
6 Conformance to installation profiles.....	12
Annex A (normative) CP 2/1 (ControlNet™) specific installation profile.....	13
Annex B (normative) CP 2/2 (EtherNet/IP™) specific installation profile.....	65
Annex C (normative) CP 2/3 (DeviceNet™) specific installation profile.....	92
Annex D (informative) Additional information	149
Bibliography.....	153
Figure 1 – Standards relationships.....	9
Figure A.1 – Interconnection of CPF 2 networks.....	14
Figure A.2 – Overview of CPF 2/1 networks.....	15
Figure A.3 – Drop cable requirements.....	17
Figure A.4 – Placement of BNC/TNC plugs.....	17
Figure A.5 – Placement of terminators.....	18
Figure A.6 – Extending a network using repeaters.....	18
Figure A.7 – Extending a network using active star topology.....	19
Figure A.8 – Links.....	19
Figure A.9 – Extending the network beyond 99 nodes.....	20
Figure A.10 – Maximum allowable taps per segment.....	27
Figure A.11 – Example of repeaters in star configuration	29
Figure A.12 – Repeater in parallel.....	30
Figure A.13 – Repeater in combination series and parallel.....	30
Figure A.14 – Ring repeater.....	31
Figure A.15 – Installing bulkheads	32
Figure A.16 – Coaxial BNC and TNC terminators.....	33
Figure A.17 – Terminator placement in a segment	33
Figure A.18 – Redundant network icons.....	36
Figure A.19 – Redundant coax media	36
Figure A.20 – Redundant fibre media.....	36
Figure A.21 – Repeater in series versus length difference for coax media.....	37
Figure A.22 – Repeater in series versus length difference for fibre media	38
Figure A.23 – Example of redundant coax network with repeaters.....	38
Figure A.24 – Example of improper redundant node connection.....	38
Figure A.25 – Example tool kit for installing BNC connectors	42
Figure A.26 – Calibration of coaxial stripper.....	43

Figure A.27 – Coax PVC strip length detail	43
Figure A.28 – Memory cartridge and blade.....	44
Figure A.29 – Cable position.....	44
Figure A.30 – Locking the cable.....	45
Figure A.31 – Stripping the cable	45
Figure A.32 – Install the crimp ferrule	46
Figure A.33 – Cable preparation for PVC type cables	46
Figure A.34 – Cable preparation for FEP type cables.....	46
Figure A.35 – Strip guides	47
Figure A.36 – Using the flare tool.....	47
Figure A.37 – Expanding the shields.....	48
Figure A.38 – Install the centre pin	48
Figure A.39 – Crimping the centre pin.....	48
Figure A.40 – Installing the connector body	49
Figure A.41 – Installing the ferrule	49
Figure A.42 – Crimp tool.....	49
Figure A.43 – Sealed IP67 cable.....	50
Figure A.44 – Terminator placement.....	51
Figure A.45 – Mounting the taps	52
Figure A.46 – Mounting the tap assembly using the universal mounting bracket	52
Figure A.47 – Mounting the tap using tie wraps or screws.....	53
Figure A.48 – Redundant network icons.....	53
Figure A.49 – Network test tool.....	56
Figure A.50 – Shorting the cable to test for continuity	56
Figure A.51 – Testing fibre segments.....	59
Figure A.52 – Multi-fibre backbone cable housing	60
Figure A.53 – Repeater adapter module.....	61
Figure A.54 – Short and medium distance fibre module LEDs	63
Figure A.55 – Long and extra long repeater module LEDs	63
Figure B.1 – Interconnection of CPF 2 networks	66
Figure B.2 – Peer to peer connections	68
Figure B.3 – Mated connections.....	70
Figure B.4 – The 8-way modular sealed jack & plug (plastic housing)	75
Figure B.5 – The 8-way modular sealed jack & plug (metal housing).....	75
Figure B.6 – M12-4 connectors	76
Figure B.7 – Simplex LC connector.....	76
Figure B.8 – Duplex LC connector	77
Figure B.9 – IP65/IP67 sealed duplex LC connector	77
Figure B.10 – M12-4 to 8-way modular bulkhead	79
Figure B.11 – The 8-way modular sealed jack & plug (plastic housing)	85
Figure B.12 – The 8-way modular sealed jack & plug (metal housing).....	85
Figure B.13 – M12-4 connectors	85
Figure B.14 – Earthing of cable shield	87

Figure B.15 – Open shield example	87
Figure C.1 – Interconnection of CPF 2 networks	93
Figure C.2 – Connection to generic cabling.....	94
Figure C.3 – DeviceNet cable system uses a trunk/drop line topology.....	96
Figure C.4 – Measuring the trunk length	98
Figure C.5 – Measuring the trunk and drop length.....	98
Figure C.6 – Measuring drop cable in a network with multiports	99
Figure C.7 – Removable device using open-style connectors	99
Figure C.8 – Fixed connection using open-style connector.....	100
Figure C.9 – Open-style connector pin out.....	100
Figure C.10 – Open-style connector pin out 10 position	100
Figure C.11 – Power supply sizing example.....	104
Figure C.12 – Current limit for thick cable for one power supply.....	105
Figure C.13 – Current for thick cable and two power supplies.....	106
Figure C.14 – Worst case scenario	107
Figure C.15 – Example using the lookup method	107
Figure C.16 – One power supply end connected	109
Figure C.17 – Segmenting power in the power bus	110
Figure C.18 – Segmenting the power bus using power taps	110
Figure C.19 – Thick cable construction.....	121
Figure C.20 – Mid cable construction.....	121
Figure C.21 – Thin cable construction.....	122
Figure C.22 – Flat cable construction.....	122
Figure C.23 – Cable preparation.....	123
Figure C.24 – Connector assembly.....	123
Figure C.25 – Micro connector pin assignment.....	123
Figure C.26 – Mini connector pin assignment.....	124
Figure C.27 – Preparation of cable end.....	124
Figure C.28 – Shrink wrap installation.....	125
Figure C.29 – Wire preparation	125
Figure C.30 – Open-style connector (female).....	125
Figure C.31 – Open-style (male plug)	125
Figure C.32 – Flat cable.....	126
Figure C.33 – Aligning the cable	127
Figure C.34 – Closing the assembly.....	127
Figure C.35 – Proper orientation of cable.....	127
Figure C.36 – Locking the assembly	127
Figure C.37 – Driving the IDC contacts in to the cable	128
Figure C.38 – End cap placement	128
Figure C.39 – End cap seated.....	129
Figure C.40 – End cap installation alternate side of cable	129
Figure C.41 – Flat cable IDC connectors.....	130
Figure C.42 – Installing the connectors	130

Figure C.43 – Cable wiring to open-style terminals	131
Figure C.44 – Auxiliary power cable profile	131
Figure C.45 – Pin out auxiliary power connectors.....	132
Figure C.46 – Power supply cable length versus wire size	133
Figure C.47 – Sealed terminator	135
Figure C.48 – Open-style terminator	135
Figure C.49 – Open-style IDC terminator	136
Figure C.50 – Sealed terminator IDC cable	136
Figure C.51 – Direct connection to the trunk	137
Figure C.52 – Wiring of open-style connector.....	137
Figure C.53 – Wiring of open-style 10-position connector	137
Figure C.54 – Diagnostic temporary connections	138
Figure C.55 – Thick cable preterminated cables (cord sets)	139
Figure C.56 – Thin cable preterminated cables (cord sets).....	139
Table A.1 – Basic network characteristics for copper cabling not based on Ethernet (ISO/IEC 8802-3).....	20
Table A.2 – Allowable fibre lengths	21
Table A.3 – Power budgets for ControlNet fibre networks	21
Table A.4 – RG6 coaxial electrical properties.....	22
Table A.5 – RG6 coaxial physical parameters.....	23
Table A.6 – Cable type selection.....	23
Table A.7 – Information relevant to optical fibre cables	24
Table A.8 – Copper connectors for ControlNet.....	25
Table A.9 – Fibre connectors for fieldbus systems	26
Table A.10 – Relationship between FOC and fibre types (CP 2/1).....	26
Table A.11 – Separation from other circuits inside enclosures	35
Table A.12 – Parameters for Coaxial RG6 Cables	40
Table A.13 – Bend radius for coaxial cables outside conduit	40
Table A.14 – Parameters for silica optical fibre cables	41
Table A.15 – Parameters for hard clad silica optical fibre.....	41
Table A.16 – Test matrix for BNC/TNC connectors.....	56
Table A.17 – Wave length and fibre types	59
Table A.18 – LED status table.....	61
Table A.19 – Repeater adapter and module diagnostic	61
Table A.20 – Repeater adapter indicator diagnostic	62
Table A.21 – Repeater module indicator	62
Table A.22 – Short and medium distance troubleshooting chart	63
Table A.23 – Long and extra long troubleshooting chart.....	64
Table B.1 – Network characteristics for balanced cabling based on Ethernet	68
Table B.2 – Network characteristics for optical fibre cabling.....	69
Table B.3 – Fibre lengths for 1 mm POF A4a.2 POF 0.5 NA	69
Table B.4 – Fibre lengths for 1 mm POF A4d POF 0.3 NA	70
Table B.5 – Information relevant to copper cable: fixed cables.....	71

Table B.6 – Information relevant to copper cable: cords.....	71
Table B.7 – TCL limits for unshielded twisted-pair cabling	72
Table B.8 – ELTCTL limits for unshielded twisted-pair cabling	72
Table B.9 – Coupling attenuation limits for screened twisted-pair cabling.....	72
Table B.10 – Information relevant to optical fibre cables	73
Table B.11 – Connectors for balanced cabling CPs based on Ethernet	74
Table B.12 – Industrial EtherNet/IP 8-way modular connector parameters	74
Table B.13 – Industrial EtherNet/IP M12-4 D-coding connector parameters	75
Table B.14 – Optical fibre connecting hardware	76
Table B.15 – Relationship between FOC and fibre types (CP2/2).....	77
Table B.16 – Connector insertion loss.....	77
Table B.17 – Parameters for balanced cables	84
Table B.18 – Parameters for silica optical fibre cables	84
Table B.19 – Parameters for POF optical fibre cables	84
Table C.1 – Basic network characteristics for copper cabling not based on Ethernet (ISO/IEC-8802-3).....	96
Table C.2 – Cable trunk and drop lengths for CP 2/3.....	97
Table C.3 – Summary of available current for trunk cables (CP 2/3).....	101
Table C.4 – Permissible current for thin cable drop lines of various lengths	101
Table C.5 – Power supply specification for DeviceNet.....	102
Table C.6 – Power supply tolerance stack up for DeviceNet.....	102
Table C.7 – Current versus cable length for one power supply thick cable	105
Table C.8 – Current versus length for two power supplies.....	106
Table C.9 – Definition of equation variables.....	108
Table C.10 – Information relevant to copper cable: fixed cables.....	111
Table C.11 – Information relevant to copper cable: cords.....	111
Table C.12 – DeviceNet cables and connector support cross reference	111
Table C.13 – DeviceNet cable profiles	112
Table C.14 – Copper connectors for non-Ethernet based fieldbus	115
Table C.15 – Additional connectors for CP 2/3 (DeviceNet)	115
Table C.16 – Parameters for balanced cables.....	120
Table C.17 – Wire colour code and function.....	126
Table C.18 – Auxiliary power cable colour code	131
Table C.19 – Network power supply requirements.....	132
Table C.20 – Auxillary power supply requirements	133
Table C.21 – Signal wire verification	142
Table C.22 – Shield to earth	142
Table C.23 – Connector pin out	144

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**INDUSTRIAL COMMUNICATION NETWORKS –
PROFILES –****Part 5-2: Installation of fieldbuses –
Installation profiles for CPF 2**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61784-5-2 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial process measurement, control and automation.

This second edition cancels and replaces the first edition published in 2007. This edition constitutes a technical revision.

This edition includes the following technical changes with respect to the previous edition:

- updates pertaining to current installation practices;
- addition of new technology that has become recently available;
- errors have been corrected;
- improved alignment with IEC 61918.

This standard is to be used in conjunction with IEC 61918:2010.

This bilingual version (2012-02) corresponds to the monolingual English version, published in 2010-07.

The text of this standard is based on the following documents:

FDIS	Report on voting
65C/602/FDIS	65C/617/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

The French version of this standard has not been voted upon.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61784-5 series, published under the general title *Industrial communication networks – Profiles – Installation of fieldbuses*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

This International Standard is one of a series produced to facilitate the use of communication networks in industrial control systems.

IEC 61918:2010 provides the common requirements for the installation of communication networks in industrial control systems. This installation profile standard provides the installation profiles of the communication profiles (CP) of a specific communication profile family (CPF) by stating which requirements of IEC 61918:2010 fully apply and, where necessary, by supplementing, modifying, or replacing the other requirements (see Figure 1).

For general background on fieldbuses, their profiles, and relationship between the installation profiles specified in this standard, see IEC/TR 61158-1.

Each CP installation profile is specified in a separate annex of this standard. Each annex is structured exactly as the reference standard IEC 61918:2010 for the benefit of the persons representing the roles in the fieldbus installation process as defined in IEC 61918:2010 (planner, installer, verification personnel, validation personnel, maintenance personnel, administration personnel). By reading the installation profile in conjunction with IEC 61918:2010, these persons immediately know which requirements are common for the installation of all CPs and which are modified or replaced. The conventions used to draft this standard are defined in Clause 5.

The provision of the installation profiles in one standard for each CPF (e.g. IEC 61784-5-2 for CPF 2), allows readers to work with standards of a convenient size.

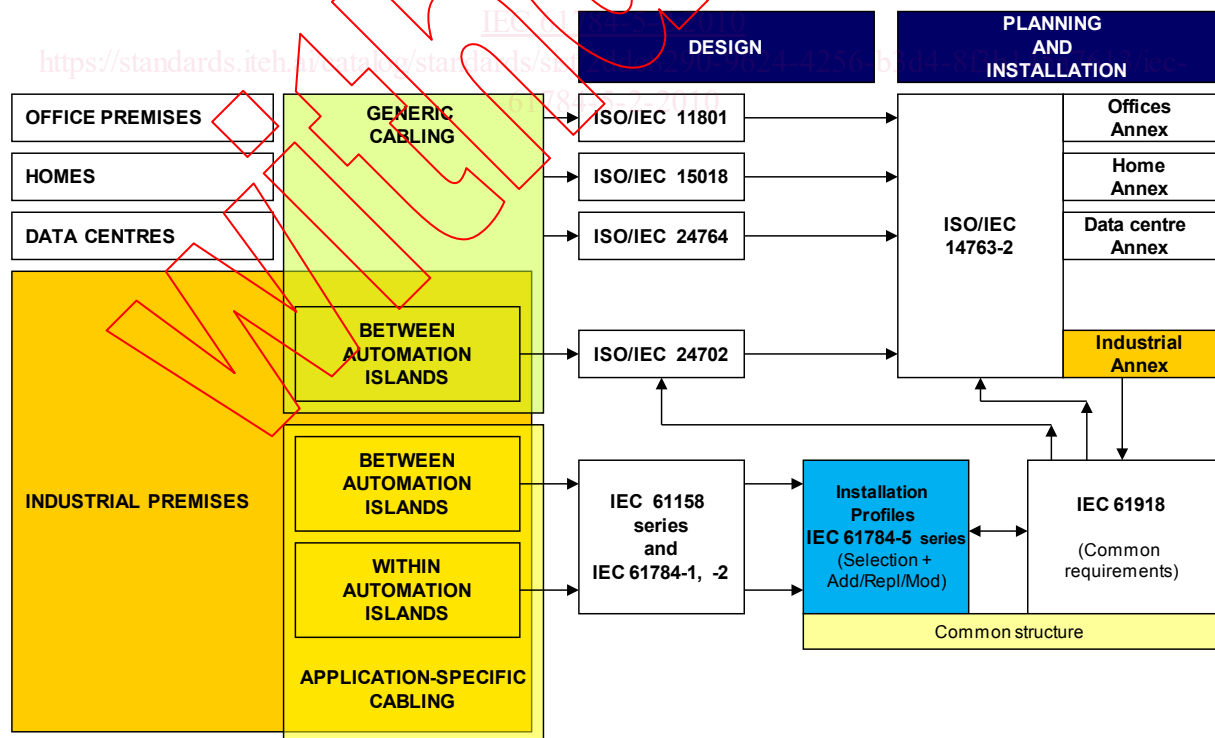


Figure 1 – Standards relationships

INDUSTRIAL COMMUNICATION NETWORKS – PROFILES –

Part 5-2: Installation of fieldbuses – Installation profiles for CPF 2

1 Scope

This part of IEC 61784 specifies the installation profiles for CPF 2 (CIP™¹).

The installation profiles are specified in the annexes. These annexes are read in conjunction with IEC 61918:2010.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61918:2010, *Industrial communication networks – Installation of communication networks in industrial premises*

The normative references of IEC 61918:2010, Clause 2, apply. For profile specific normative references, see Clauses A.2, B.2, and C.2.

3 Terms, definitions and abbreviated terms

For the purposes of this document, the terms, definitions and abbreviated terms of IEC 61918:2010, Clause 3, apply. For profile specific terms, definitions and abbreviated terms see Clauses A.3, B.3, and C.3.

4 CPF 2: Overview of installation profiles

CPF 2 consists of three basic communication profiles as specified in IEC 61784-1 and IEC 61784-2. These profiles share a common upper layers protocol named CIP™ (Common Industrial Protocol).

The installation requirements for CP 2/1 (ControlNet™²) are specified in Annex A.

¹ CIP™ (Common Industrial Protocol) is a trade name of Open DeviceNet Vendor Association, Inc. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this standard does not require use of the trade name CIP™. Use of the trade name CIP™ requires permission of Open DeviceNet Vendor Association, Inc.

² ControlNet™ is a trade name of ControlNet International, Ltd. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trade name ControlNet™. Use of the trade name ControlNet™ requires permission of ControlNet International, Ltd.

The installation requirements for CP 2/2 (EtherNet/IP™³) are specified in Annex B.

The installation requirements for CP 2/3 (DeviceNet™⁴) are specified in Annex C.

5 Installation profile conventions

The numbering of the clauses and subclauses in the annexes of this standard corresponds to the numbering of IEC 61918 main clauses and subclauses.

The annex clauses and subclauses of this standard supplement, modify, or replace the respective clauses and subclauses in IEC 61918.

Where there is no corresponding subclause of IEC 61918 in the normative annexes in this standard, the subclause of IEC 61918 applies without modification.

The annex heading letter represents the installation profile assigned in Clause 4. The annex (sub)clause numbering following the annex letter shall represent the corresponding (sub)clause numbering of IEC 61918.

EXAMPLE “Annex B.4.4” in IEC 61784-5-2 means that CP 2/2 specifies the Subclause 4.4 of IEC 61918.

All main clauses of IEC 61918 are cited and apply in full unless otherwise stated in each normative installation profile annex.

If all subclauses of a (sub)clause are omitted, then the corresponding IEC 61918 (sub)clause applies.

If in a (sub)clause it is written “*Not applicable*”, then the corresponding IEC 61918 (sub)clause does not apply.

If in a (sub)clause it is written “*Addition:*”, then the corresponding IEC 61918 (sub)clause applies with the additions written in the profile.

If in a (sub)clause it is written “*Replacement:*”, then the text provided in the profile replaces the text of the corresponding IEC 61918 (sub)clause.

NOTE A replacement can also comprise additions.

If in a (sub)clause it is written “*Modification:*”, then the corresponding IEC 61918 (sub)clause applies with the modifications written in the profile.

If all (sub)clauses of a (sub)clause are omitted but in this (sub)clause it is written “(sub)clause x has “*addition:*” (or “*replacement:*”, or “*modification:*”) or “(Sub)clause x is not applicable.”, then (sub)clause x becomes valid as declared and all the other corresponding IEC 61918 (sub)clauses apply.

³ EtherNet/IP™ is a trade name of ControlNet International, Ltd. and Open DeviceNet Vendor Association, Inc. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trade name EtherNet/IP™. Use of the trade name EtherNet/IP™ requires permission of either ControlNet International, Ltd. or Open DeviceNet Vendor Association, Inc.

⁴ DeviceNet™ is a trade name of Open DeviceNet Vendor Association, Inc. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this standard does not require use of the trade name DeviceNet™. Use of the trade name DeviceNet™ requires permission of Open DeviceNet Vendor Association, Inc.

6 Conformance to installation profiles

Each installation profile within this standard includes part of IEC 61918:2010. It may also include defined additional specifications.

A statement of compliance to an installation profile of this standard shall be stated⁵ as either

Compliance to IEC 61784-5-2:2010⁶ for CP 2/m <name> or

Compliance to IEC 61784-5-2 (Ed.2.0) for CP 2/m <name>

where the name within the angle brackets < > is optional and the angle brackets are not to be included. The m within CP 2/m shall be replaced by the profile number 1 to 3.

NOTE The name may be the name of the profile, e.g. ControlNet, EtherNet/IP or DeviceNet.

If the name is a trade name then the permission of the trade name holder shall be required.

Product standards shall not include any conformity assessment aspects (including quality management provisions), neither normative nor informative, other than provisions for product testing (evaluation and examination).

⁵ In accordance with ISO/IEC Directives.

⁶ The date should not be used when the edition number is used.

Annex A (normative)

CP 2/1 (ControlNet™) specific installation profile

A.1 Installation profile scope

Addition:

This standard specifies the installation profile for Communication Profile CP 2/1 (ControlNet). The CP 2/1 is specified in IEC 61784-1.

A.2 Normative references

Addition:

IEC 60096-2:1961, *Radio-frequency cables – Part 2: Relevant cable specifications*

A.3 Installation profile terms, definitions, and abbreviated terms

A.3.1 Terms and definitions

A.3.2 Abbreviated terms

Addition:

DVM	Digital voltmeter
HMI	Human machine interface
I/O	Input/Output
IS	Intrinsic Safe
MM	Multi mode
NAP	Network access port (local access to a device, i.e. not via the bus)
OTDR	Optical time domain reflectometer
PLC	Programmable logic controller
PVC	Polyvinyl chloride
RG6	Coaxial cable
SM	Single mode
TDR	Time domain reflectometer

A.3.3 Conventions for installation profiles

Not applicable.