

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Industrial communication networks – Fieldbus specifications –
Part 4-22: Data-link layer protocol specification – Type 22 elements**

**Réseaux de communication industriels – Spécifications des bus de terrain –
Partie 4-22: Spécification du protocole de la couche de liaison de données –
Éléments de Type 22**



THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2010 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.
If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.
Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

Useful links:

IEC publications search - www.iec.ch/searchpub

The advanced search enables you to find IEC publications by a variety of criteria (reference number, text, technical committee,...).

It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available on-line and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary (IEV) on-line.

Customer Service Centre - webstore.iec.ch/csc/iec

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

A propos de la CEI

La Commission Electrotechnique Internationale (CEI) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications CEI

Le contenu technique des publications de la CEI est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Liens utiles:

Recherche de publications CEI - www.iec.ch/searchpub

La recherche avancée vous permet de trouver des publications CEI en utilisant différents critères (numéro de référence, texte, comité d'études,...).

Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

Just Published CEI - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications de la CEI. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne au monde de termes électroniques et électriques. Il contient plus de 30 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans les langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (VEI) en ligne.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: csc@iec.ch.

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Industrial communication networks – Fieldbus specifications –
Part 4-22: Data-link layer protocol specification – Type 22 elements**

**Réseaux de communication industriels – Spécifications des bus de terrain –
Partie 4-22: Spécification du protocole de la couche de liaison de données –
Éléments de Type 22**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE **XB**
CODE PRIX

ICS 25.04.40; 35.100.20; 35.110

ISBN 978-2-88912-861-7

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	9
1.1 General.....	9
1.2 Specifications.....	9
1.3 Procedures.....	9
1.4 Applicability.....	9
1.5 Conformance.....	10
2 Normative references.....	10
3 Terms, definitions, symbols, abbreviations and conventions.....	10
3.1 Reference model terms and definitions.....	10
3.2 Service convention terms and definitions.....	12
3.3 Common terms and definitions.....	13
3.4 Additional Type 22 definitions.....	14
3.5 Common symbols and abbreviations.....	17
3.6 Additional Type 22 symbols and abbreviations.....	18
3.7 Conventions.....	20
4 Overview of the DL-protocol.....	21
4.1 Operating principle.....	21
4.2 Communication model.....	21
4.3 Topology.....	22
4.4 DLPDU processing.....	22
4.5 General communication mechanisms.....	23
4.6 Gateway.....	24
4.7 Interaction models.....	24
5 DLPDU structure.....	24
5.1 Overview.....	24
5.2 Data types and encoding rules.....	25
5.3 DLPDU identification.....	26
5.4 General DLPDU structure.....	27
5.5 Communication management DLPDUs.....	29
5.6 Cyclic data channel (CDC) DLPDUs.....	34
5.7 Cyclic data channel (CDC) DLPDU data.....	35
5.8 Message channel (MSC) DLPDUs.....	36
5.9 Message channel DLPDU data - MSC message transfer protocol (MSC-MTP).....	37
5.10 Time synchronization.....	41
6 Telegram timing and DLPDU handling.....	42
6.1 Communication mechanism.....	42
6.2 Device synchronization.....	44
7 Type 22 protocol machines.....	45
7.1 RTFL device protocol machines.....	45
7.2 RTFN device protocol machines.....	57
7.3 Message channel - message transfer protocol (MSC-MTP).....	59
Bibliography.....	63

Figure 1 – DLPDU sequence.....	43
Figure 2 – Communication relationship RTFN device	44
Figure 3 – Overview RTFL device protocol machines	45
Figure 4 – Protocol machine send DLPDU procedure.....	46
Figure 5 – Protocol machine receive DLPDU procedure	47
Figure 6 – CDCL send cyclic data sequence	48
Figure 7 – CDCL receive cyclic data sequence	49
Figure 8 – MSCL send sequence	50
Figure 9 – MSCL receive sequence	51
Figure 10 – Network management protocol machine	52
Figure 11 – Net management sequence at system boot up	53
Figure 12 – Initialization sequence ordinary device	54
Figure 13 – PCS configuration sequence	55
Figure 14 – Delay measurement principle	56
Figure 15 – Overview RTFN device protocol machines	57
Figure 16 – CDCN connection setup and release	58
Figure 17 – CDCN unpush data.....	59
Figure 18 – Segmentation sequence.....	60
Figure 19 – Expedited transfer sequence.....	60
Figure 20 – Toggling from expedited transfer to segmented transfer	61
Figure 21 – Segmentation sequence for broad- or multicast message without Acknowledgement.....	62
https://standards.iec.org/standards/sst/61158-4-22-2010	
Table 1 – DLPDU element definition	20
Table 2 – Conventions for protocol machine description	21
Table 3 – Transfer syntax for bit sequences.....	25
Table 4 – Transfer syntax for data type Unsignedn	26
Table 5 – Transfer syntax for data type Signedn	26
Table 6 – Type 22 DLPDU inside an ISO/IEC 8802-3.....	27
Table 7 – Type 22 DLPDU inside a VLAN tagged ISO/IEC 8802-3 DLPDU.....	27
Table 8 – Type 22 DLPDU inside an UDP DLPDU.....	28
Table 9 – General structure of a Type 22 DLPDU	28
Table 10 – DLPDU header structure	29
Table 11 – Network verification prepare DLPDU	29
Table 12 – Network verification environment DLPDU	29
Table 13 – Network verification information DLPDU	29
Table 14 – Network verification acknowledgement DLPDU.....	30
Table 15 – RTFN scan network read request DLPDU.....	30
Table 16 – RTFN scan network read response DLPDU	30
Table 17 – Identification data.....	30
Table 18 – PhyLinkPortX	31
Table 19 – RTF support	31
Table 20 – UseDHCP	32

Table 21 – DeviceRole.....	32
Table 22 – RTFN connection management DLPDU	33
Table 23 – CDCN connection still alive DLPDU	33
Table 24 – ID data	33
Table 25 – RTFL control DLPDU	33
Table 26 – RTFL configuration DLPDU	34
Table 27 – RTFL configuration acknowledgement DLPDU	34
Table 28 – CDCL DLPDU.....	35
Table 29 – CDCN DLPDU	35
Table 30 – CDC DLPDU data arrangement	35
Table 31 – CDC DLPDU data.....	36
Table 32 – MSCL DLPDU	36
Table 33 – MSCL control	37
Table 34 – MSCN DLPDU	37
Table 35 – MSC-MTP frame structure	38
Table 36 – Address type	38
Table 37 – MSC-MTP Init structure	39
Table 38 – MSC-MTP Init_Fast structure	39
Table 39 – MSC-MTP Send structure	39
Table 40 – MSC-MTP Acknowledgement structure.....	40
Table 41 – MSC-MTP Abort structure.....	40
Table 42 – Data structure of a message.....	40
Table 43 – DelayMeasurement start encoding.....	41
Table 44 – DelayMeasurement read encoding.....	41
Table 45 – PCS configuration encoding	41
Table 46 – Time synchronization service request.....	41
Table 47 – Time synchronization service response	42

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**INDUSTRIAL COMMUNICATION NETWORKS –
 FIELDBUS SPECIFICATIONS –**
**Part 4-22: Data-link layer protocol specification –
 Type 22 elements**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.

International Standard IEC 61158-4-22 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial process measurement, control and automation.

This standard cancels and replaces IEC/PAS 61158-4-22 published in 2009. This first edition constitutes a technical revision.

This bilingual version published in 2012-01 corresponds to the English version published in 2010-08.

The text of this standard is based on the following documents:

FDIS	Report on voting
65C/605/FDIS	65C/619/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

The French version has not been voted upon.


This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61158 series, published under the general title *Industrial communication networks – Fieldbus specifications*, can be found on the IEC web site.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

NOTE The revision of this standard will be synchronized with the other parts of the IEC 61158 series.

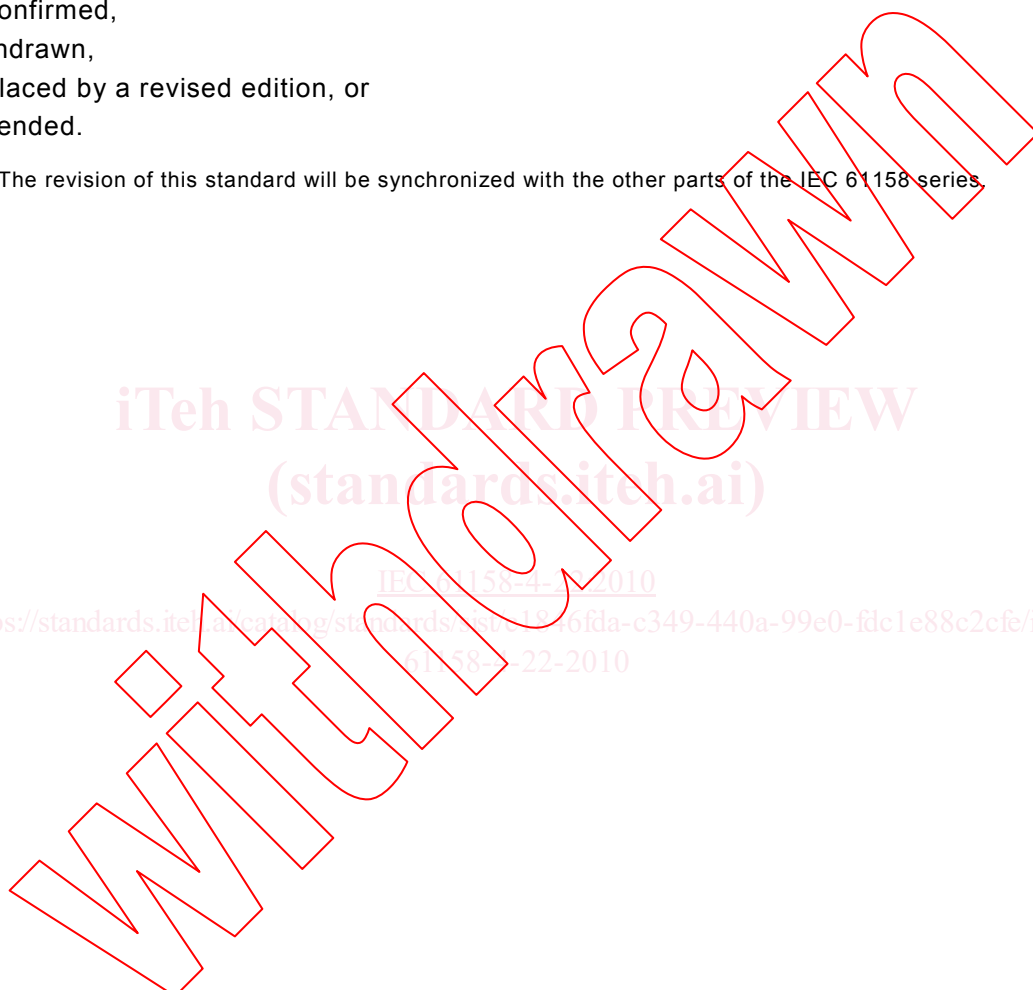

<https://standards.itih.ai/catalog/standards/sist/4876fda-c349-440a-99e0-fdc1e88c2cfe/iec-61158-4-22-2010>

INTRODUCTION

This part of IEC 61158 is one of a series produced to facilitate the interconnection of automation system components. It is related to other standards in the set as defined by the "three-layer" fieldbus reference model described in IEC/TR 61158-1.

The data-link protocol provides the data-link service by making use of the services available from the physical layer. The primary aim of this standard is to provide a set of rules for communication expressed in terms of the procedures to be carried out by peer data-link entities (DLEs) at the time of communication. These rules for communication are intended to provide a sound basis for development in order to serve a variety of purposes:

- a) as a guide for implementers and designers;
- b) for use in the testing and procurement of equipment;
- c) as part of an agreement for the admittance of systems into the open systems environment;
- d) as a refinement to the understanding of time-critical communications within OSI.

This standard is concerned, in particular, with the communication and interworking of sensors, effectors and other automation devices. By using this standard together with other standards positioned within the OSI or fieldbus reference models, otherwise incompatible systems may work together in any combination.

NOTE Use of some of the associated protocol types is restricted by their intellectual-property-right holders. In all cases, the commitment to limited release of intellectual-property-rights made by the holders of those rights permits a particular data-link layer protocol type to be used with physical layer and application layer protocols in Type combinations as specified explicitly in the profile parts. Use of the various protocol types in other combinations may require permission from their respective intellectual-property-right holders.

The International Electrotechnical Commission (IEC) draws attention to the fact that it is claimed that compliance with this document may involve the use of patents concerning Type 22 elements and possibly other types:

- <https://standards.itec.org/standards/iec/61158-4-22/61158-4-22-1876fda-c349-440a-99e0-fdc1e88c2cfe/iec-WO-2006/069691-A1> [PI] Control system with a plurality of spatially distributed stations and method for transmitting data in said control system
- DE - 10 2004 063 213 [PI] Steuerungssystem mit einer Vielzahl von räumlich verteilten Stationen sowie Verfahren zum Übertragen von Daten in einem solchen Steuerungssystem
- B4

IEC takes no position concerning the evidence, validity and scope of these patent rights.

The holder of these patent rights has assured the IEC that he/she is willing to negotiate licences either free of charge or under reasonable and non-discriminatory terms and conditions with applicants throughout the world. In this respect, the statement of the holder of these patent rights is registered with IEC. Information may be obtained from:

Information may be obtained from:

- [PI] Pilz GmbH & Co. KG
Felix-Wankel-Str. 2
73760 Ostfildern
Germany

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights other than those identified above. IEC shall not be held responsible for identifying any or all such patent rights.

ISO (www.iso.org/patents) and IEC (http://www.iec.ch/tctools/patent_decl.htm) maintain on-line data bases of patents relevant to their standards. Users are encouraged to consult the data bases for the most up to date information concerning patents.

Withhold

iTeh STANDARD PREVIEW
(standards.iteh.ai)

IEC 61158-4-22:2010
<https://standards.iteh.ai/catalog/standards/sist/c4876fda-c349-440a-99e0-fdc1e88c2cfe/iec-61158-4-22-2010>

INDUSTRIAL COMMUNICATION NETWORKS – FIELDBUS SPECIFICATIONS –

Part 4-22: Data-link layer protocol specification – Type 22 elements

1 Scope

1.1 General

The data-link layer provides basic time-critical messaging communications between devices in an automation environment.

This protocol provides communication opportunities to all participating data-link entities

- a) in a synchronously-starting cyclic manner, according to a pre-established schedule, and
- b) in a cyclic or acyclic asynchronous manner, as requested each cycle by each of those data-link entities.

Thus this protocol can be characterized as one which provides cyclic and acyclic access asynchronously but with a synchronous restart of each cycle.

1.2 Specifications

This standard specifies:

- a) procedures for the timely transfer of data and control information from one data-link user entity to a peer user entity, and among the data-link entities forming the distributed data-link service provider;
- b) the structure of the fieldbus DLPDUs used for the transfer of data and control information by the protocol of this standard, and their representation as physical interface data units.

1.3 Procedures

The procedures are defined in terms of:

- a) the interactions between peer DL-entities (DLEs) through the exchange of fieldbus DLPDUs;
- b) the interactions between a DL-service (DLS) provider and a DLS-user in the same system through the exchange of DLS primitives;
- c) the interactions between a DLS-provider and a Ph-service provider in the same system through the exchange of Ph-service primitives.

1.4 Applicability

These procedures are applicable to instances of communication between systems which support time-critical communications services within the data-link layer of the OSI or fieldbus reference models, and which require the ability to interconnect in an open systems interconnection environment.

Profiles provide a simple multi-attribute means of summarizing an implementation's capabilities, and thus its applicability to various time-critical communications needs.

1.5 Conformance

This standard also specifies conformance requirements for systems implementing these procedures.

This part of IEC 61158 does not contain tests to demonstrate compliance with such requirements.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61158-3-22:2010¹, *Industrial communication networks – Fieldbus specifications – Part 3-22: Data-link layer service definition – Type 22 elements*

IEC 61588:2009, *Precision clock synchronization protocol for networked measurement and control system*

ISO/IEC 7498-1, *Information technology – Open Systems Interconnection – Basic Reference Model: The Basic Model*

ISO/IEC 7498-3, *Information technology – Open Systems Interconnection – Basic Reference Model: Naming and addressing*

ISO/IEC 8802-3:2000, *Information technology – Telecommunications and information exchange between systems – Local and metropolitan area networks – Specific requirements – Part 3: Carrier sense multiple access with collision detection (CSMA/CD) access method and physical layer specifications*

ISO/IEC 10731, *Information technology – Open Systems Interconnection – Basic Reference Model – Conventions for the definition of OSI services*

IETF RFC 768, *User Datagram Protocol*; available at <<http://www.ietf.org>>

IETF RFC 791, *Internet Protocol*; available at <<http://www.ietf.org>>

IEEE 802.1Q, *IEEE Standard for Local and metropolitan area networks – Virtual Bridged Local Area Networks*; available at <<http://www.ieee.org>>

3 Terms, definitions, symbols, abbreviations and conventions

For the purposes of this document, the following terms, definitions, symbols and abbreviations apply.

3.1 Reference model terms and definitions

This standard is based in part on the concepts developed in ISO/IEC 7498-1 and ISO/IEC 7498-3, and makes use of the following terms defined therein.

¹ To be published.

3.1.1 acknowledgement	[ISO/IEC 7498-1]
3.1.2 DL-address	[ISO/IEC 7498-3]
3.1.3 DL-address-mapping	[ISO/IEC 7498-1]
3.1.4 called-DL-address	[ISO/IEC 7498-3]
3.1.5 calling-DL-address	[ISO/IEC 7498-3]
3.1.6 DL-connection	[ISO/IEC 7498-1]
3.1.7 DL-connection-end-point	[ISO/IEC 7498-1]
3.1.8 DL-connection-end-point-identifier	[ISO/IEC 7498-1]
3.1.9 DL-connection-mode transmission	[ISO/IEC 7498-1]
3.1.10 DL-connectionless-mode transmission	[ISO/IEC 7498-1]
3.1.11 decentralized multi-end-point-connection	[ISO/IEC 7498-1]
3.1.12 DL-duplex-transmission	[ISO/IEC 7498-1]
3.1.13 (N)-entity	[ISO/IEC 7498-1]
DL-entity (N=2)	
Ph-entity (N=1)	
3.1.14 flow control	[ISO/IEC 7498-1]
3.1.15 (N)-layer	[ISO/IEC 7498-1]
DL-layer (N=2)	
Ph-layer (N=1)	
3.1.16 layer-management	[ISO/IEC 7498-1]
3.1.17 DL-local-view	[ISO/IEC 7498-3]
3.1.18 multi-endpoint-connection	[ISO/IEC 7498-1]
3.1.19 DL-name	[ISO/IEC 7498-3]
3.1.20 naming-(addressing)-domain	[ISO/IEC 7498-3]
3.1.21 peer-entities	[ISO/IEC 7498-1]
3.1.22 primitive name	[ISO/IEC 7498-3]
3.1.23 DL-protocol	[ISO/IEC 7498-1]
3.1.24 DL-protocol-connection-identifier	[ISO/IEC 7498-1]
3.1.25 DL-protocol-control information	[ISO/IEC 7498-1]

3.1.26 DL-protocol-data-unit	[ISO/IEC 7498-1]
3.1.27 DL-protocol-version-identifier	[ISO/IEC 7498-1]
3.1.28 DL-relay	[ISO/IEC 7498-1]
3.1.29 reassembling	[ISO/IEC 7498-1]
3.1.30 reset	[ISO/IEC 7498-1]
3.1.31 responding-DL-address	[ISO/IEC 7498-3]
3.1.32 routing	[ISO/IEC 7498-1]
3.1.33 segmenting	[ISO/IEC 7498-1]
3.1.34 sequencing	[ISO/IEC 7498-1]
3.1.35 (N)-service	[ISO/IEC 7498-1]
DL-service (N=2)	
Ph-service (N=1)	
3.1.36 (N)-service-access-point	[ISO/IEC 7498-1]
DL-service-access-point (N=2)	
Ph-service-access-point (N=1)	
3.1.37 DL-service-access-point-address	[ISO/IEC 7498-3]
3.1.38 DL-service-connection-identifier	[ISO/IEC 7498-1]
3.1.39 DL-service-data-unit	[ISO/IEC 7498-1]
3.1.40 DL-simplex-transmission	[ISO/IEC 7498-1]
3.1.41 DL-subsystem	[ISO/IEC 7498-1]
3.1.42 systems-management	[ISO/IEC 7498-1]
3.1.43 DL-user-data	[ISO/IEC 7498-1]

3.2 Service convention terms and definitions

This standard also makes use of the following terms defined in ISO/IEC 10731 as they apply to the data-link layer:

- 3.2.1 acceptor**
- 3.2.2 asymmetrical service**
- 3.2.3 confirm (primitive);
 requestor.deliver (primitive)**
- 3.2.4 deliver (primitive)**
- 3.2.5 DL-confirmed-facility**

3.2.6 DL-facility**3.2.7 DL-local-view****3.2.8 DL-mandatory-facility****3.2.9 DL-non-confirmed-facility****3.2.10 DL-provider-initiated-facility****3.2.11 DL-provider-optional-facility****3.2.12 DL-service-primitive;
primitive****3.2.13 DL-service-provider****3.2.14 DL-service-user****3.2.15 DL-user-optional-facility****3.2.16 indication (primitive);
acceptor.deliver (primitive)****3.2.17 multi-peer****3.2.18 request (primitive);
requestor.submit (primitive)****3.2.19 requestor****3.2.20 response (primitive);
acceptor.submit (primitive)****3.2.21 submit (primitive)****3.2.22 symmetrical service****3.3 Common terms and definitions**

NOTE Many definitions are common to more than one protocol Type; they are not necessarily used by all protocol Types.

3.3.1**DL-segment**

single DL-subnetwork in which any of the connected DLEs may communicate directly, without any intervening DL-relaying, whenever all of those DLEs that are participating in an instance of communication are simultaneously attentive to the DL-subnetwork during the period(s) of attempted communication

3.3.2**extended link**

DL-subnetwork, consisting of the maximal set of links interconnected by DL-relays, sharing a single DL-name (DL-address) space, in which any of the connected DL-entities may communicate, one with another, either directly or with the assistance of one or more of those intervening DL-relay entities

NOTE An extended link may be composed of just a single link.