



Standard Specification for Thermoplastic Accessible and Replaceable Plastic Tube and Tubular Fittings¹

This standard is issued under the fixed designation F 409; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reappraisal. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reappraisal.

This standard has been approved for use by agencies of the Department of Defense.

1. Scope

1.1 This specification covers requirements and test methods for materials, dimensions and tolerances, hydrostatic pressure, joint integrity, and solvent cement for thermoplastic tube and fittings for accessible and replaceable domestic waste connections. Marking requirements are also included. Plastic which does not meet the material requirements specified in Section 5 is excluded.

1.2 The text of this specification references notes, footnotes, and appendixes which provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the specification.

1.3 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are for information only.

1.4 The following safety hazards caveat pertains only to the test methods portion, Section 8, of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:

- D 618 Practice for Conditioning Plastics for Testing²
- D 1600 Terminology for Abbreviated Terms Relating to Plastics²
- D 1784 Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds²
- D 2122 Test Method for Determining Dimensions of Thermoplastic Pipe and Fittings³
- D 2235 Specification for Solvent Cement for Acrylonitrile-Butadiene-Styrene (ABS) Plastic Pipe and Fittings³

D 2564 Specification for Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Piping Systems³

D 2609 Specification for Plastic Insert Fittings for Polyethylene (PE) Plastic Pipe³

D 2657 Practice for Heat Joining of Polyolefin Pipe and Fittings³

D 2661 Specification for Acrylonitrile-Butadiene-Styrene (ABS) Schedule 40 Plastic Drain, Waste, and Vent Pipe and Fittings³

D 2665 Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings³

D 3965 Specification for Rigid Acrylonitrile-Butadiene-Styrene (ABS) Compounds for Pipe and Fittings⁴

D 4101 Specification for Propylene Plastic Injection and Extrusion Materials⁴

F 402 Practice for Safe Handling of Solvent Cements, Primers, and Cleaners Used for Joining Thermoplastic Pipe and Fittings³

F 412 Terminology Relating to Plastic Piping Systems³

F 1498 Specification for Taper Pipe Thread 60° for Thermoplastic Pipe and Fittings³

2.2 Federal Standard:

Fed. Std. No. 123 Marking for Shipment (Civil Agencies)⁵

2.3 Military Standard:

MIL-STD-129 Marking for Shipment and Storage⁵

2.4 ANSI/ASME Standard:

B1.20.1 Pipe Threads, General Purpose (Inch)⁶

2.5 Other Document:

Uniform Plumbing Code⁷

3. Terminology

3.1 *Definitions*—Definitions are in accordance with Terminology F 412, and abbreviations are in accordance with Terminology D 1600, unless otherwise specified.

3.1.1 The plumbing terminology used in this specification is

¹ This specification is under the jurisdiction of ASTM Committee F-17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.63 on Drain, Waste, and Vent Pipe and Tube.

Current edition approved August 10, 1999. Published September 1999. Originally published as F 409 – 75. Last previous edition F 409 – 99.

² *Annual Book of ASTM Standards*, Vol 08.01.

³ *Annual Book of ASTM Standards*, Vol 08.04.

⁴ *Annual Book of ASTM Standards*, Vol 08.02.

⁵ Available from Standardization Documents Order Desk, Bldg. 4 Section D, 700 Robbins Ave., Philadelphia, PA 19111-5094, Attn: NPODS.

⁶ Available from the American National Standards Institute, 11 West 42nd St., 13th Fl., New York, NY 10036.

⁷ Available from the International Association of Plumbing and Mechanical Officials, 20001 E. Walnut Drive, South Walnut, CA 917892825.

in accordance with the definitions given in the Uniform Plumbing Code, unless otherwise indicated.

4. Significance and Use

4.1 The requirements of this specification are intended to provide accessible and replaceable tube and fittings to convey domestic waste from fixtures to the drain, waste, and vent (DWV) system.

5. Materials and Manufacture

5.1 *Tube*—The tube shall be made of one of the following materials:

5.1.1 Virgin acrylonitrile-butadiene-styrene (ABS) plastic which shall meet the requirements of Specification D 3965, Cell Classification 4-2-2-2-2.

5.1.2 Virgin poly(vinyl chloride) (PVC) plastic which shall meet the requirements for 12454C materials in accordance with Specification D 1784, or

5.1.3 Virgin polypropylene plastic which shall meet the requirements of Specification D 4101, Cell Classification PP0110B55140 and PP0105G20A33350.

5.2 *Fittings and Mechanical Joint Components*—The fittings and components of mechanical joints shall be comprised of one or more of the following materials:

5.2.1 Virgin ABS plastic which shall meet the requirements of Specification D 3965, Cell Classification 2-0-2-1-1.

5.2.2 Virgin PVC plastics which shall meet the requirements of 12454C materials as defined in Specification D 1784, or

5.2.3 Virgin polypropylene plastic which shall meet the requirements of Specification D 4101, Cell Classification PP0110B55140 and PP0105G20A33350 .

5.3 *Rework Material*—The manufacturers shall use only their own clean rework tube and fitting material and the tube or fittings produced shall meet all the requirements of this specification. The different types of material shall not be mixed.

5.4 *Solvent Cement*—The solvent cement shall meet the requirements of Specification D 2235 or Specification D 2564. No cement joining of propylene plastic (PP) is permissible.

6. Mechanical Connections

6.1 Compression or threaded connections shall incorporate American National Straight Pipe Thread, Mechanical Joints for Fixtures (NPSM). The thread form shall be the form of American National Straight Pipe Thread and the dimensions shall be in accordance with ANSI B1.20.1 (NPSM). All threads shall have a minimum three-thread engagement for fittings and plastic nuts.

6.2 *Taper Pipe Threads*—For all fittings having taper pipe threads, threads shall conform to Specification F 1498 and be gaged in accordance with 8.5.

6.3 *Straight Pipe Threads (NPSM)*—For all fittings having straight pipe threads, threads shall conform to ANSI B1.20.1 (NPSM) and be gaged in accordance with 8.6.

6.4 All tube and fittings made from propylene plastic shall be assembled by either mechanical connections or by heat fusion, in accordance with Practice D 2657.

7. Requirements

7.1 *General*—The tube and fittings shall be homogeneous throughout and free of visible cracks, holes, foreign inclusions, or other injurious defects. They shall be as uniform as commercially practicable in color, opacity, density, and other physical properties.

7.2 *Dimensions and Tolerances:*

7.2.1 *Tube:*

7.2.1.1 *Tube Dimensions*—The tube dimensions shall meet the requirements given in Table 1 when measured in accordance with Test Method D 2122.

7.2.1.2 *Tube Length*—The tolerance on tube lengths is $\pm \frac{1}{8}$ in. (± 3 mm).

7.2.2 *Fittings:*

7.2.2.1 *Fitting Dimensions*—The dimensions of fittings shall meet the requirements of Table 2 when measured in accordance with Test Method D 2122.

7.2.2.2 *Fitting Laying Length Dimensions*— The laying lengths and other critical dimensions of fittings are shown in Tables 3-13.

7.2.2.3 Where applicable for assembly, refer to Table A1.1 in Specification D 2661, ABS Schedule 40 Fittings.

7.2.2.4 Where applicable for assembly, refer to Table 1 in Specification D 2665, PVC Schedule 40 Fittings.

7.3 *Hydrostatic Pressure*—Tube, fittings, and assemblies shall withstand a hydrostatic pressure of 25 psi (170 kPa) when tested in accordance with 8.3.

7.4 *Axial Stress*—Threaded connections shall withstand a minimum axial load of 50 lbf (220 N) when tested in accordance with 8.4.

8. Test Methods

8.1 *Sampling*—Take at random a sample of the tube, fittings, or assemblies from each lot or shipment that is sufficient to determine conformance with this specification.

8.2 *Conditioning*—Unless otherwise specified, condition the specimens prior to test at 70 to 77°F (23 \pm 2°C) and 50 \pm 5 % relative humidity for not less than 40 h in accordance with Procedure A of Practice D 618 for those tests where conditioning is required and in all cases of disagreement.


8.3 *Hydrostatic Pressure*—Subject the tube and fittings, as an assembly, to an internal hydrostatic pressure of 25 psi (170 kPa) for 1 h. The tube, fittings, and joints shall show no evidence of leaking.

TABLE 1 Dimensions and Tolerances for Outside Diameters and Thickness of Plastic Tube

Nominal Tube Size	Outside Diameter			Wall Thickness
	Average	Tolerance on Average	Out-of-Roundness (maximum minus minimum)	Minimum
in.	in. (mm)	in. (mm)	in. (mm)	in. (mm)
1¼	1.250 (31.75)	± 0.005 (± 0.127)	0.020 (0.51)	0.062 (1.575)
1½	1.500 (38.10)	± 0.005 (± 0.127)	0.020 (0.51)	0.062 (1.575)

TABLE 2 Dimensions and Tolerances for Plastic Tubular Fittings

NOTE 1—Chamfer or flat, optional.
 NOTE 2—Radius or 45° chamfer, optional.
 NOTE 3—Radius or chamfer, optional.

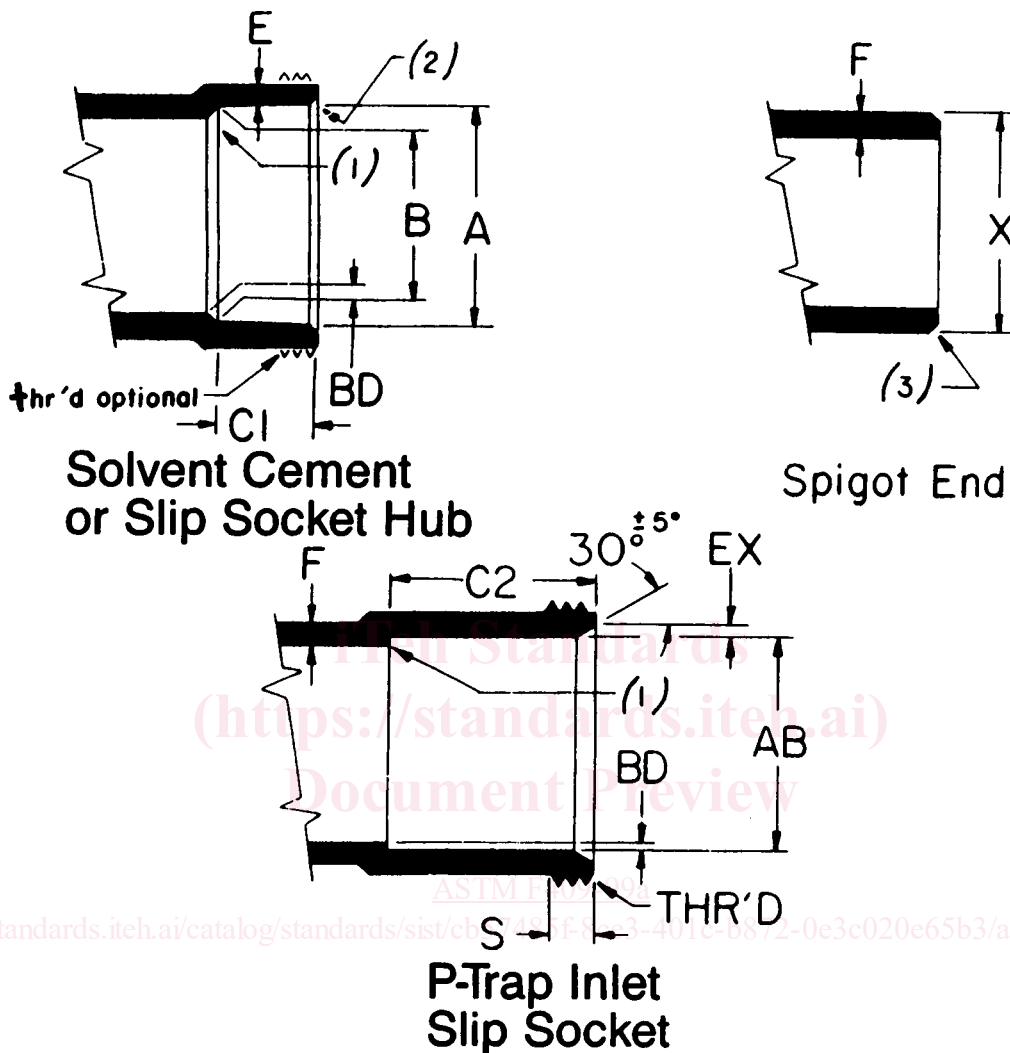

Nominal Tube Size	Thread	A ^A	B ^A	C1	C2	E ^B
in.	in.	±0.005 in. (±0.127 mm)	±0.005 in. (±0.127 mm)	Minimum in. (mm)	Minimum in. (mm)	Minimum in. (mm)
1¼	1¼ - 1½ NPSM	1.265 (32.13)	1.250 (31.75)	1¼/16 (17.46)	1¾ (34.9)	0.062 (1.58)
1½	1½ - 1½ NPSM	1.515 (38.48)	1.500 (38.10)	1¼/16 (17.46)	2 (50.8)	0.062 (1.58)
F ^B	S	X	AB	EX	BD	
Minimum in. (mm)	Minimum in. (mm)	±0.005 in. (±0.127 mm)	Minimum in. (mm)	±0.010 in. (±0.254 mm)	Minimum in. (mm)	Maximum in. (mm)
0.062 (1.58)	17/64 (6.75)	1.250 (31.75)	1.258 (31.95)	0.066 (1.68)	0.015 (0.38)	0.070 (1.78)
0.062 (1.58)	17/64 (6.75)	1.500 (38.10)	1.508 (38.30)	0.066 (1.68)	0.015 (0.38)	0.070 (1.78)

^A Average diameter, the maximum plus minimum diameter divided by 2. The permissible deviation of the diameter from the measured average, often called out-of-roundness, is +0.010 to -0.010 in. (+0.254 to -0.254 mm).

^B The wall thickness is a minimum value except that a ±10% variation resulting from core shift is allowable. In such a case, the average of the two opposite wall thicknesses shall equal or exceed the value shown in the table.

8.4 *Axial Stress*—Mount threaded connections in a tension-testing machine to apply an axial load. Crosshead speed shall be 0.20 to 0.25 in. (5.0 to 6.3 mm)/min. The connection shall show no evidence of cracking or separation at the minimum load specified in 7.4.

8.5 *Taper Pipe Threads*—All taper pipe threads shall be gaged in accordance with Specification F 1498.


8.6 *Straight Pipe Threads (NPSM)*—For all fittings having straight pipe threads, threads shall be gaged in accordance with ANSI B1.20.1 (NPSM).

NOTE 1—Some threads listed in Table 6, Table 9, and Table 12 are not listed in ANSI B1.20.1 (NPSM).

TABLE 3 Fittings^A

NOTE 1—Baffle optional.

NOTE 2—See Table 2 for solvent cement or slip socket hub dimensions.

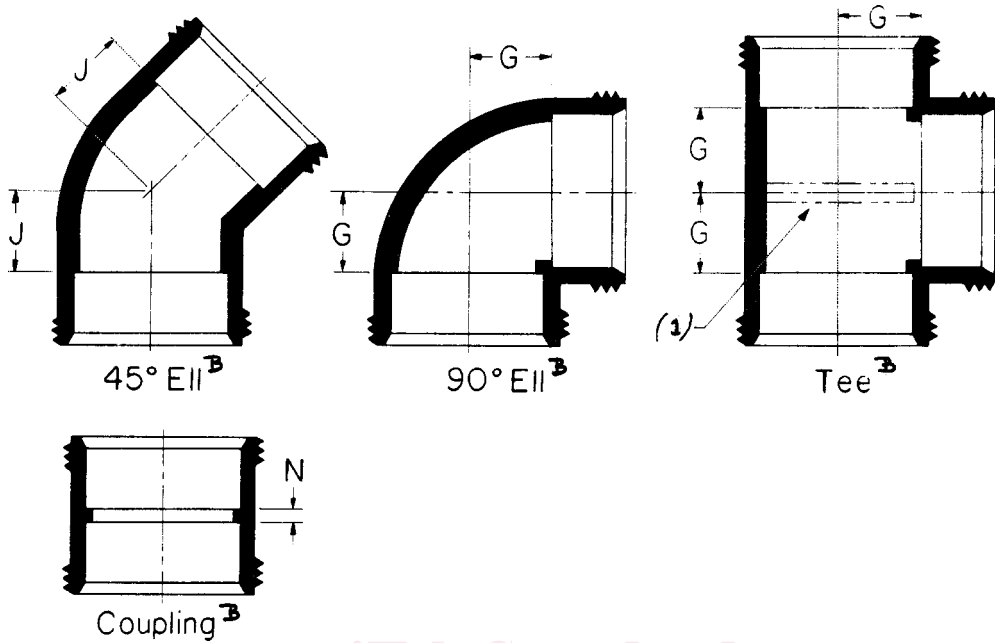

Nominal Tube Size	G	J	N
in.		in. (mm)	
1/2	13/16 (20.6)	13/16 (20.6)	1/16 (1.6) ^B

^A All dimensions are minimum.

^B See Table 2.

iTeh Standards
<http://standards.tch.ai>
 Document Preview

9. Retest and Rejection

9.1 If the results of any test(s) do not meet the requirements of this specification, the test(s) shall be conducted again only by agreement between the purchaser and seller. Under such agreement, minimum requirements shall not be lowered, changed, or modified, nor shall specification limits be changed. If upon request, failure occurs, the quantity of product represented by the test(s) does not meet the requirements of this specification.

10. Product Marking

10.1 *Tube*—The tube shall be marked in letters not less than 1/8 in. (3 mm) high in a contrasting color and shall at least consist of the nominal size, manufacturer’s name or trademark, and “ABS Tubular F 409,” “PVC Tubular F 409,” or “PP Tubular F 409” at intervals of not greater than 2 ft (610 mm).

10.2 *Fittings*—All fittings shall be marked on the body or hub on both sides. The marking shall consist, at least, of the

manufacturer’s name or trademark, the size, and “ABS Tubular F 409,” “PVC Tubular F 409,” or “P Tubular F 409.”

10.3 All baffle tees and such fittings as so required shall be marked with arrows indicating the direction of flow when correctly installed.

11. Quality Assurance


11.1 When the product is marked with this designation, F 409, the manufacturer affirms that the product was manufactured, inspected, sampled, and tested in accordance with this specification and has been found to meet the requirements of this specification.

12. Keywords

12.1 ABS; cellular; DWV; fittings; pipe; plastic; Schedule 40; thermoplastic

TABLE 4 End Outlet Continuous Waste

- NOTE 1—Radius optional.
- NOTE 2—Baffle optional.
- NOTE 3—Arm shall either be one-piece construction or assembled. If assembled, socket shall conform to Table 2.
- NOTE 4—Shall be swivel nut, slip nut, or slip socket connection (shown in Table 5).
- NOTE 5—Dishwasher branch optional.
- NOTE 6—See Table 6.
- NOTE 7—See Table 2.

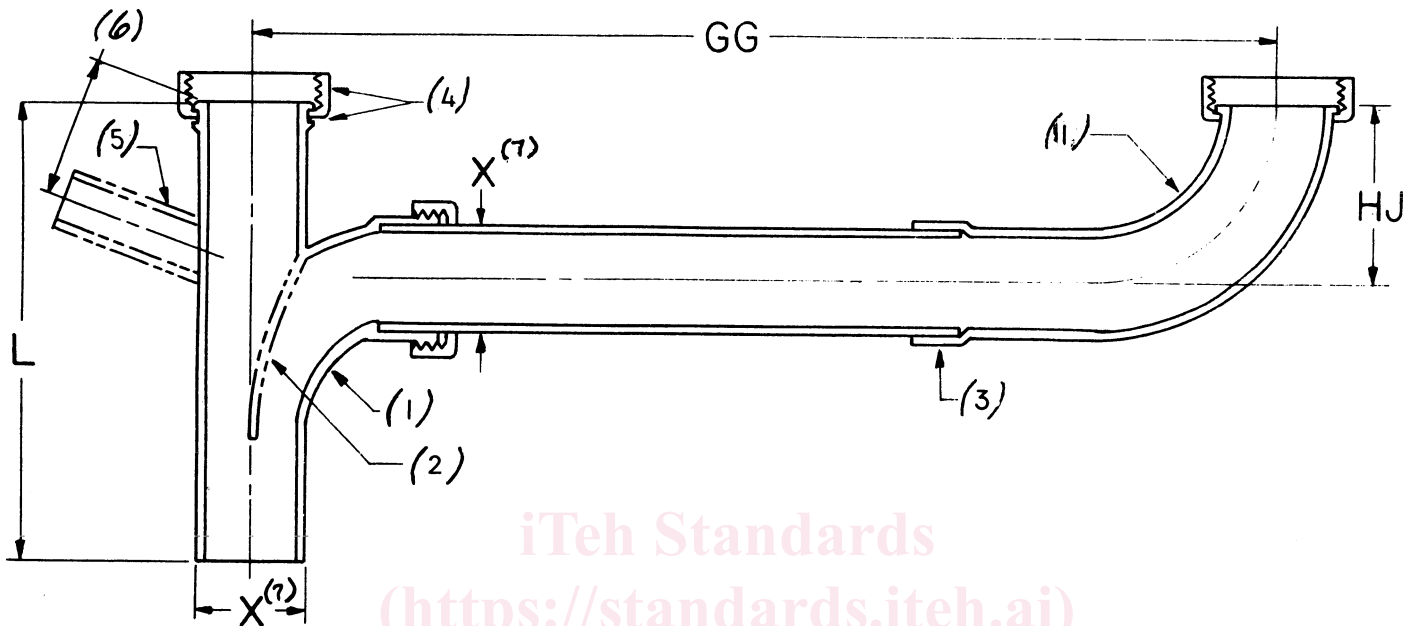


L	HJ	GG		
Minimum in. (mm)	Minimum in. (mm)	Adjustable in four sizes, in. (mm)		
6 (152.4)	1½(38.1)	12 (305)	16 (406)	21 (533)
				25 (635)

ASTM F409-99a

<https://standards.iteh.ai/catalog/standards/sist/cb57485f-8ce3-401c-b872-0e3c020e65b3/astm-f409-99a>

TABLE 5 Center Outlet Continuous Waste

- NOTE 1—See Table 2.
- NOTE 2—Radius optional.
- NOTE 3—Baffle optional.
- NOTE 4—Arm shall be either one-piece construction or assembled. If assembled, socket shall conform to Table 2.
- NOTE 5—Shall also be swivel connection as shown in Table 4.

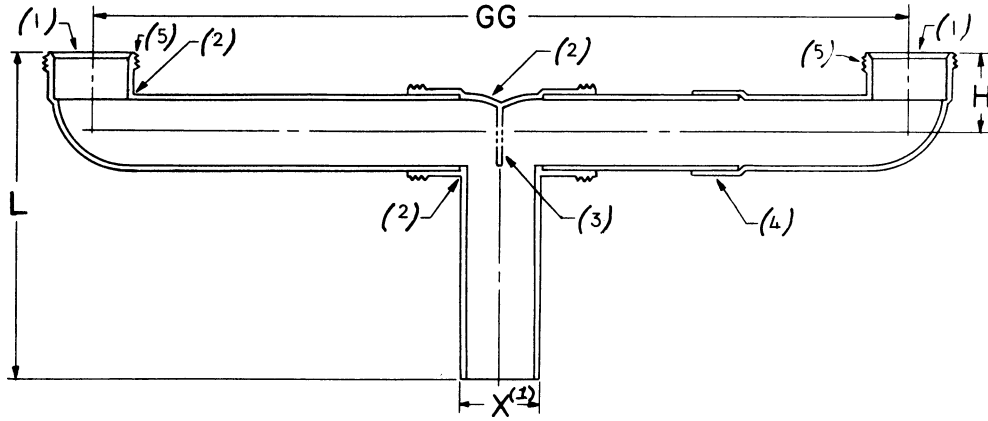

H	L	GG			
Minimum in. (mm)	Minimum in. (mm)	Adjustable in four sizes, in. (mm)			
1½ (38.1)	6 (152.4)	12 (305)	16 (406)	21 (533)	25 (635)

iTeh Standards
 (https://standards.itih.ai)
 Document Preview

ASTM F409-99a

<https://standards.itih.ai/catalog/standards/sist/cb57485f-8ce3-401c-b872-0e3c020e65b3/astm-f409-99a>