

INTERNATIONAL STANDARD



Industrial communication networks – High availability automation networks –
Part 6: Distributed Redundancy Protocol (DRP)

(<https://standards.iteh.ai>)
Document Preview

[IEC 62439-6:2010](#)

<https://standards.iteh.ai/catalog/standards/iec/a6f96e98-3c9b-4f1e-af84-92d6c780f607/iec-62439-6-2010>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2010 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00

IEC 62439-6:2010

<http://www.iec.ch/catalog/standards/iec/a6f96e98-3c9b-4f1e-af84-92d6c780f607/iec-62439-6-2010>



IEC 62439-6

Edition 1.0 2010-02

INTERNATIONAL STANDARD



**Industrial communication networks – High availability automation networks –
Part 6: Distributed Redundancy Protocol (DRP)**

(<https://standards.iteh.ai>)
Document Preview

[IEC 62439-6:2010](#)

<https://standards.iteh.ai/catalog/standards/iec/a6f96e98-3c9b-4f1e-af84-92d6c780f607/iec-62439-6-2010>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

PRICE CODE **XB**

ICS 25.040, 35.040

ISBN 978-2-88910-709-4

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
2 Normative references	8
3 Terms, definitions, abbreviations, acronyms, and conventions	8
3.1 Terms and definitions	8
3.2 Abbreviations and acronyms.....	9
3.3 Conventions	9
4 Overview	9
4.1 Principles	9
4.2 Ring ports	10
4.3 DRP switch node.....	10
4.4 Single ring topology redundancy.....	11
4.5 Double ring topology redundancy	11
4.6 Configuration.....	12
4.6.1 Overview	12
4.6.2 Manufacturer configuration	12
4.6.3 Communication configuration.....	12
4.6.4 Application configuration	13
4.7 Start up	13
5 DRP communications	13
5.1 Overview	13
5.2 Communication procedure.....	15
5.3 Fault detection and recovery	18
5.3.1 General	18
5.3.2 Handling in a single ring network	19
5.3.3 Handling in a double ring network.....	20
5.4 Repairing the inter-switch link fault.....	21
5.5 Repairing time synchronization fault.....	21
5.6 Inserting a repaired switch node.....	22
5.7 Inserting a new switch node	23
6 DRP class specification	23
7 DRP attributes	24
8 DRP services	27
8.1 Read	27
8.2 Write	30
9 DRP protocol specification.....	32
9.1 Basic types encoding	32
9.2 ErrorDescription encoding	32
9.3 Encoding of DRP Class	33
9.4 PDU description	34
9.4.1 Encoding of DRP DLPDU	34
9.4.2 Encoding of DLSDU.....	35
9.4.3 Encoding of VLAN	35
9.4.4 Ethertype.....	35

9.4.5	Encoding of DRP PDU	35
9.4.6	Encoding of DRP_DATA	36
9.4.7	Encoding of Read Service	40
9.4.8	Encoding of Write Service primitives.....	42
9.5	Protocol machine.....	44
9.5.1	Switch node states description	44
9.5.2	Protocol State Machine description.....	44
9.5.3	State transitions	45
9.5.4	Function descriptions.....	52
	Bibliography.....	64
	Figure 1 – DRP communication model	10
	Figure 2 – Single ring topology redundancy	11
	Figure 3 – Double ring topology redundancy	12
	Figure 4 – DRP communication procedure	14
	Figure 5 – Inserting a new switch node into the DRP system	14
	Figure 6 – Fault detection and recovery	15
	Figure 7 – Fault detection and recovery of single ring topology redundancy.....	19
	Figure 8 – Single inter-switch link fault detection and recovery of double ring topology redundancy.....	20
	Figure 9 – Double inter-switch link fault detection and recovery of double ring topology redundancy.....	21
	Figure 10 – Inserting a repaired switch node.....	22
	Figure 11 – DRP protocol state machine.....	45
	Table 1 – Relationship between required recovery time and the TargetTimeSyncClass.....	22
	Table 2 – Parameters of Read service	27
	Table 3 – Parameters of Write service	30
	Table 4 – Error Type definition.....	32
	Table 5 – Error Code definition	33
	Table 6 – Definition of DRP Class	33
	Table 7 – DRP OUI	34
	Table 8 – DRP MulticastMACAddress	35
	Table 9 – Encoding of DLSDU	35
	Table 10 – Encoding of DRP PDU.....	35
	Table 11 – DRP_Type definition	35
	Table 12 – Encoding of RingCheck frame	36
	Table 13 – Encoding of DeviceAnnunciation frame.....	37
	Table 14 – Encoding of RingChange frame	39
	Table 15 – Encoding of LinkCheck frame.....	39
	Table 16 – Encoding of LinkAlarm frame.....	40
	Table 17 – Encoding of LinkChange frame.....	40
	Table 18 – Encoding of Read Request.....	41
	Table 19 – Encoding of Read Service Positive Response	41
	Table 20 – Encoding of Read Service Negative Response	42

Table 21 – Encoding of Write Request	43
Table 22 – Encoding of Write Service Positive Response.....	43
Table 23 – Encoding of Write Service Negative Response	43
Table 24 – DRP state transitions.....	46
Table 25 – SetRingPortState() descriptions	52
Table 26 – LoadRingPortState() descriptions	52
Table 27 – WriteSucceed() descriptions	52
Table 28 – SynchronizationFinished() descriptions	53
Table 29 – ActivePortLinkState() descriptions	53
Table 30 – StandbyPortLinkState() descriptions.....	53
Table 31 – ConfigureInfo() descriptions	53
Table 32 – DRPSendTimer() descriptions	54
Table 33 – SendRingChange() descriptions	54
Table 34 – ForwardingRingCheck() descriptions	54
Table 35 – AnnunciationBlockingPort() descriptions.....	54
Table 36 – LocalDRPSequenceIDSmaller() descriptions	55
Table 37 – RecvAnnunciationWithinTimeLimit() descriptions.....	55
Table 38 – RecvLinkCheckWithinTimeLimit() descriptions.....	55
Table 39 – NoLocalLinkFault() descriptions	55
Table 40 – RecvLinkAlarm() descriptions	56
Table 41 – Clear_FDB() descriptions	56
Table 42 – ChangeRingState() descriptions	56
Table 43 – BlockingPortSelect() descriptions	56
Table 44 – SendLinkChange() descriptions.....	57
Table 45 – DRPSequenceIDCompare() descriptions	57
Table 46 – ChangePortState() descriptions.....	57
Table 47 – ChangeDoublePortState() descriptions.....	57
Table 48 – LocalSendRingCheck() descriptions	58
Table 49 – DRPKeyParaConfigure() descriptions	58
Table 50 – CheckMACAddress() descriptions	58
Table 51 – SetDRPKeyPara() descriptions.....	58
Table 52 – SendDeviceAnnunciation() descriptions.....	59
Table 53 – FaultRecvRingCheck() descriptions.....	59
Table 54 – RecordDeviceState() descriptions	59
Table 55 – DrpRecvMsg() descriptions	59
Table 56 – SendLinkAlarm() descriptions.....	60
Table 57 – TimeUnsynchronization() descriptions	60
Table 58 – PassiveMasterState() descriptions	60
Table 59 – SearchDeviceState() descriptions.....	60
Table A.1 – An example of parameters setting for DRP Class	62
Table A.2 – Parameters for calculation of recovery time.....	63

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**INDUSTRIAL COMMUNICATION NETWORKS –
HIGH AVAILABILITY AUTOMATION NETWORKS –****Part 6: Distributed Redundancy Protocol (DRP)**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.

International Standard 62439-6 has been prepared by subcommittee 65C: Industrial Networks, of IEC technical committee 65: Industrial-process measurement, control and automation.

This standard cancels and replaces IEC 62439 published in 2008. This first edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to IEC 62439 (2008):

- adding a calculation method for RSTP (rapid spanning tree protocol, IEEE 802.1Q),
- adding two new redundancy protocols: HSR (High-availability Seamless Redundancy) and DRP (Distributed Redundancy Protocol),
- moving former Clauses 1 to 4 (introduction, definitions, general aspects) and the Annexes (taxonomy, availability calculation) to IEC 62439-1, which serves now as a base for the other documents,
- moving Clause 5 (MRP) to IEC 62439-2 with minor editorial changes,
- moving Clause 6 (PRP) was to IEC 62439-3 with minor editorial changes,

- moving Clause 7 (CRP) was to IEC 62439-4 with minor editorial changes, and
- moving Clause 8 (BRP) was to IEC 62439-5 with minor editorial changes,
- adding a method to calculate the maximum recovery time of RSTP in a restricted configuration (ring) to IEC 62439-1 as Clause 8,
- adding specifications of the HSR (High-availability Seamless Redundancy) protocol, which shares the principles of PRP to IEC 62439-3 as Clause 5, and
- introducing the DRP protocol as IEC 62439-6.

The text of this standard is based on the following documents:

FDIS	Report on voting
65C/583/FDIS	65C/589/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This International Standard is to be read in conjunction with IEC 62439-1:2010, *Industrial communication networks – High availability automation networks – Part 1: General concepts and calculation methods*.

A list of the IEC 62439 series can be found, under the general title *Industrial communication networks – High availability automation networks*, on the IEC website.

This publication has been drafted in accordance with ISO/IEC Directives, Part 2.

The committee has decided that the contents of this amendment and the base publication will remain unchanged until the stability date indicated on the IEC web site under "http://webstore.iec.ch" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this standard may be issued at a later date.

IMPORTANT – The “colour inside” logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this publication using a colour printer.

INTRODUCTION

The IEC 62439 series specifies relevant principles for high availability networks that meet the requirements for industrial automation networks.

In the fault-free state of the network, the protocols of the IEC 62439 series provide ISO/IEC 8802-3 (IEEE 802.3) compatible, reliable data communication, and preserve determinism of real-time data communication. In cases of fault, removal, and insertion of a component, they provide deterministic recovery times.

These protocols retain fully the typical Ethernet communication capabilities as used in the office world, so that the software involved remains applicable.

The market is in need of several network solutions, each with different performance characteristics and functional capabilities, matching diverse application requirements. These solutions support different redundancy topologies and mechanisms which are introduced in IEC 62439-1 and specified in the other Parts of the IEC 62439 series. IEC 62439-1 also distinguishes between the different solutions, giving guidance to the user.

The IEC 62439 series follows the general structure and terms of IEC 61158 series.

The International Electrotechnical Commission (IEC) draws attention to the fact that it is claimed that compliance with this document may involve the use of a patent concerning about the communication procedure and fault detection and recovery for DRP given in 5.2 and 5.3.

IEC takes no position concerning the evidence, validity and scope of this patent right.

The holder of this patent right has assured the IEC that he/she is willing to negotiate licences either free of charge or under reasonable and non-discriminatory terms and conditions with applicants throughout the world. In this respect, the statement of the holder of this patent right is registered with IEC. Information may be obtained from:

<https://standards.iso.org/9b-4f1e-af84-92d6c780f607/iec-62439-6-2010>

SUPCON Group Co., Ltd & Zhejiang University

Hangzhou

China

Beijing Kyland Technology Co. LTD

No 95 Building

Southeast Corner of Xisanqi Bridge

Haidian

Beijing

China

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights other than those identified above. IEC shall not be held responsible for identifying any or all such patent rights.

ISO (www.iso.org/patents) and IEC (http://www.iec.ch/tctools/patent_decl.htm) maintain on-line data bases of patents relevant to their standards. Users are encouraged to consult the data bases for the most up to date information concerning patents.

INDUSTRIAL COMMUNICATION NETWORKS – HIGH AVAILABILITY AUTOMATION NETWORKS –

Part 6: Distributed Redundancy Protocol (DRP)

1 Scope

The IEC 62439 series is applicable to high-availability automation networks based on the ISO/IEC 8802-3 (IEEE 802.3) (Ethernet) technology.

This part of the IEC 62439 series specifies a recovery protocol based on a ring topology, designed to react deterministically on a single failure of an inter-switch link or switch in the network. Each switch has equal management role in the network. Double rings are supported.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-191, *International Electrotechnical Vocabulary – Chapter 191: Dependability and quality of service*

IEC 61158 (all parts), *Industrial communication networks – Fieldbus specifications*

IEC 61588:2009, *Precision clock synchronization protocol for networked measurement and control systems* (IEEE 1588)

<https://standards.iteh.ai/catalog/standards/iec/a6f96e98-3c9b-4f1e-af84-92d6c780f607/iec-62439-6-2010>

IEC 62439-1:2010, *Industrial communication networks – High availability automation networks – Part 1: General concepts and calculation methods*

ISO/IEC/TR 8802-1, *Information technology – Telecommunications and information exchange between systems – Local and metropolitan area networks – Specific requirements – Part 1: Overview of Local Area Network Standards Technologies de* (IEEE 802.1)

ISO/IEC 8802-3:2000, *Information technology – Telecommunications and information exchange between systems – Local and metropolitan area networks – Specific requirements – Part 3: Carrier sense multiple access with collision detection (CSMA/CD) access method and physical layer specifications*

IEEE 802.1D:2004, *IEEE standard for local Local and metropolitan area networks Media Access Control (MAC) Bridges*

IEEE 802.1Q, *IEEE standards for local and metropolitan area network. Virtual bridged local area networks*

3 Terms, definitions, abbreviations, acronyms, and conventions

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60050-191, as well as in IEC 62439-1, apply, in addition to the following.

3.1.1

active ring port

ring port which is connected in the ring network and works in Blocking or Forwarding state

3.1.2

cycle

shortest time interval after which the communication traffic pattern repeats itself

3.1.3

standby ring port

ring port which is connected in the ring network and works in the Disabled state

3.1.4

time offset

time difference from a specially designated time

3.2 Abbreviations and acronyms

For the purposes of this document, the abbreviations and acronyms given in IEC 62439-1, apply.

3.3 Conventions

This document follows the conventions defined in IEC 62439-1.

4 Overview

4.1 Principles

The Distributed Redundancy Protocol (DRP) defines a high availability network solution based on ISO/IEC 8802-3 (IEEE 802.3) and the functions of ISO/IEC/TR 8802-1 (IEEE 802.1) for communication link redundancy. <https://standards.iteh.ai/catalog/standards/iec/a6f96e98-3c9b-4f1e-af84-92d6c780f607/iec-62439-6-2010>

DRP provides a framework for describing the operational behaviour of the switches in a ring topology to detect a single network failure (such as an inter-switch link failure or a ring switch failure) and recover from it within a deterministic recovery time.

A DRP network has a ring topology with multiple switch nodes, each of which may be a switch or a switching end node. Each node requires an integrated switch with at least two ports (ring ports) connected to the ring, and which is able to detect and recover from failures in accordance with the DRP protocol.


Each node has equal management role in a DRP ring network. It means that each node observes and controls the ring topology by multicasting a ring test frame RingCheck and an inter-switch link test frame LinkCheck cyclically, and reacts on network faults. The LinkCheck test frame provides the mechanism to detect the failure of a switch node.

In a DRP network, each switch node is synchronized using IEC 61588 (IEEE 1588) with either boundary clock or transparent clock according to the application.

NOTE Typically, boundary clock is used according to IEC 61588 (IEEE 1588). In larger-scale application, the transparent clock should be used for better time synchronization.

Optionally, DRP supports double ring topology redundancy. In this case, each switch node shall have at least two pairs of ring ports: one pair of active ring ports and one pair of standby ring ports.

The DRP defines a service entity and a protocol entity, as well as a set of management frames. The service entity specifies the externally visible services for application layer and systems management. The communication model for DRP is shown in Figure 1.

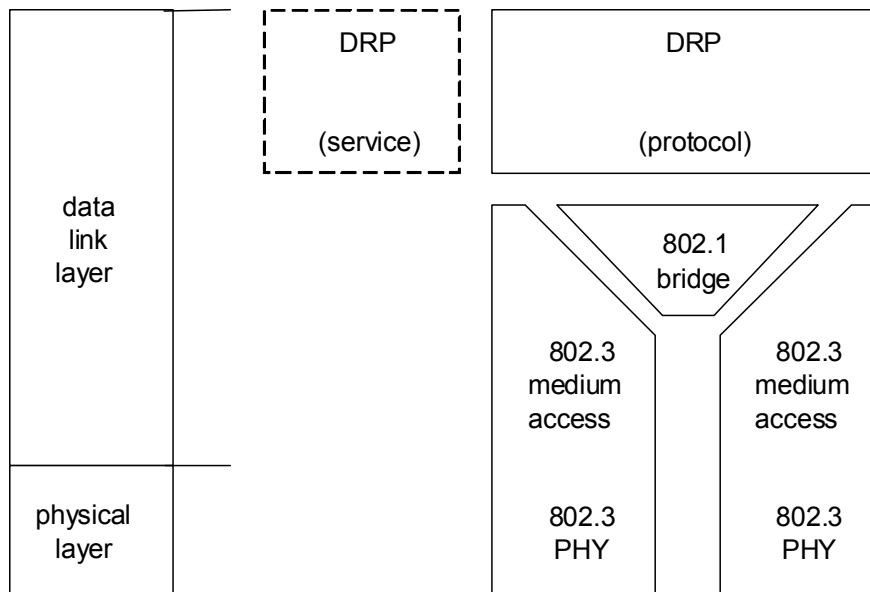

IEC 391/10

Figure 1 – DRP communication model

4.2 Ring ports

Each switch node shall have at least two ring ports connected to the ring network.

Some switch nodes in addition to the ring ports can have one or more non ring ports including leaf link ports. In such cases, the DRP frames (for example RingCheck, LinkCheck, LinkAlarm, LinkChange, DeviceAnnunciation and RingChange) shall not be forwarded to non-ring ports.

The ring ports which support DRP protocol shall have three states as follows:

a) Disabled

- All frames shall be dropped.

b) Blocking

All frames shall be dropped except the following:

- DRP frames, such as RingCheck frame, LinkCheck frame, LinkAlarm frame, LinkChange frame, DeviceAnnunciation frame, RingChange frame.
- Frames specified in IEEE 802.1D (2004) Table 7-10 to pass ports in “Discarding” state (e.g. LLDP, IEC 61588 (IEEE 1588) PTP).
- Frames only produced or consumed by the higher layer entities of this node and never forwarded.

c) Forwarding:

All frames shall be passed through according to the forwarding behaviour of IEEE 802.1D.

4.3 DRP switch node

The communication roles of all switch nodes are equal in the DRP ring. Each switch node may be a switch or a switching end node.

Each switch node has the equal right to periodically multicast ring fault detection frame RingCheck and inter-switch link fault detection frame LinkCheck in both directions of the ring at the scheduled time.

4.4 Single ring topology redundancy

Each switch node shall have two ring ports connected to the ring network, which are called active ports (as shown in Figure 2).

In a DRP single ring network, only one active ring port operates in the Blocking state while all other ring ports operate in the Forwarding state. That is, only one switch node sets one of its active ring ports into the Blocking state, the other active ring port of this node is set into the Forwarding state. All other switch nodes set the two active ring ports into the Forwarding state.


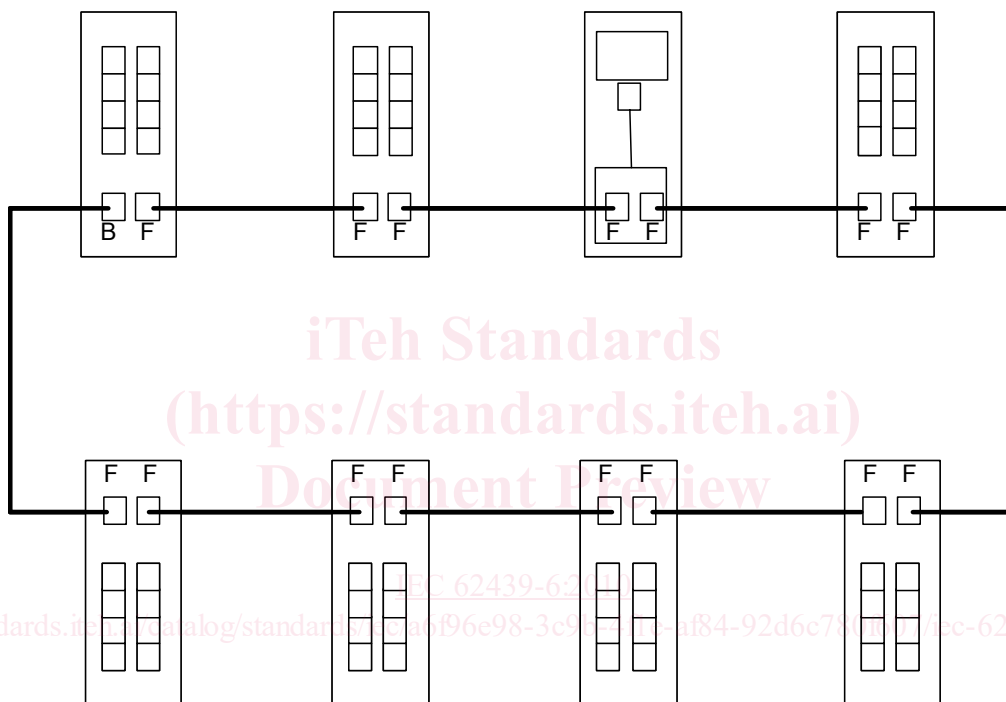


Figure 2 – Single ring topology redundancy

IEC 392/10

4.5 Double ring topology redundancy

As shown in Figure 3, each switch node shall have at least two pairs of ring ports connected to the ring network. One pair of ring ports is active (for example the ports in Ring1) while the other pair of ring ports is standby (for example the ports in Ring2).

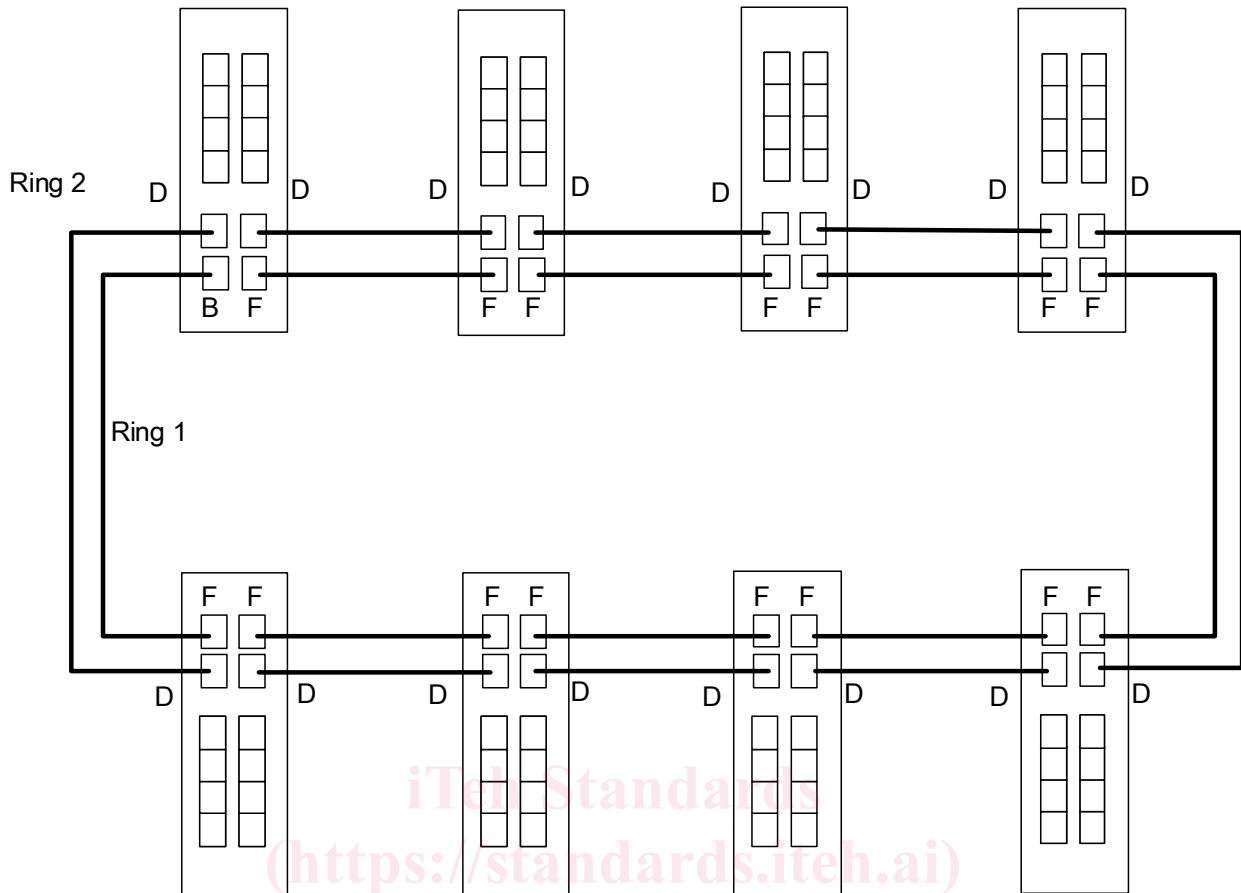

IEC 393/10

Figure 3 – Double ring topology redundancy

In a DRP double ring network, only one switch node sets one of its active ring ports into Blocking state, the other active ring port into the Forwarding state and the two standby ring ports into the Disabled state.

4.6 Configuration

4.6.1 Overview

Before the switch node is connected in a DRP network, it shall be configured using configuration software using the DRP Write service. The configuration shall include manufacturer configuration, communication configuration, and application configuration.

4.6.2 Manufacturer configuration

Manufacturer configuration includes the preset of DeviceID, ManufacturerName, DRPVersion, SoftwareVersion, HardwareVersion, Device MAC Address.

Manufacturer configuration information shall be downloaded in a DRP device only when it is manufactured, and it may be uploaded using the Read service.

4.6.3 Communication configuration

Communication configuration includes the preset of states of standby ring ports, Cycle, Ring Check SendTimeOffset, Ring Check Time Limit, Link Check SendTimeOffset, Link Check Time Limit, SynchronizationClockType, DRPSequenceID, DRPDeviceNumber.

For a single ring network, each switch node shall initialize one active ring port in the Blocking state, and the other ring port in the Forwarding state as described in 4.7.