



## Standard Test Method for Pulse Velocity Through Concrete<sup>1</sup>

This standard is issued under the fixed designation C 597; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

*This specification has been approved for use by agencies of the Department of Defense.*

### 1. Scope

1.1 This test method covers the determination of the velocity of propagation of compressional waves in concrete. This test method does not apply to the propagation of other types of waves within the concrete.

1.2 The values stated in SI units are to be regarded as the standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

### 2. Referenced Documents

#### 2.1 ASTM Standards:

C 215 Test Method for Transverse, Longitudinal, and Torsional Frequencies of Concrete Specimens<sup>2</sup>

C 823 Practice for Examination and Sampling of Hardened Concrete in Constructions<sup>2</sup>

### 3. Summary of Test Method

3.1 Pulses of compressional waves are generated by an electro-acoustical transducer that is held in contact with one surface of the concrete under test. After traversing through the concrete, the pulses are received and converted into electrical energy by a second transducer located a distance  $L$  from the transmitting transducer. The transit time  $T$  is measured electronically. The pulse velocity  $V$  is calculated by dividing  $L$  by  $T$ .

### 4. Significance and Use

4.1 The pulse velocity,  $V$ , of compressional waves in a concrete mass is related to its elastic properties and density according to the following relationship:

$$V = \sqrt{\frac{E(1-\mu)}{\rho(1+\mu)(1-2\mu)}} \quad (1)$$

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee C-9 on Concrete and Concrete Aggregates and is the direct responsibility of Subcommittee C09.64 on Nondestructive and In-Place Testing.

Current edition approved July 10, 1997. Published June 1998. Originally published as C 597 – 67T. Last previous edition C 597 – 83 (1991).<sup>41</sup>

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 04.02.

where:

$E$  = dynamic modulus of elasticity,

$\mu$  = dynamic Poisson's ratio, and

$\rho$  = density.

4.2 This test method may be used to assess the uniformity and relative quality of concrete, to indicate the presence of voids and cracks, to estimate the depth of cracks, and to evaluate the effectiveness of crack repairs. It may also be used to indicate changes in the properties of concrete, and in the survey of structures, to estimate the severity of deterioration or cracking. When used to monitor changes in condition over time, test locations are to be marked on the structure to ensure that tests are repeated at the same positions.

4.3 The degree of saturation of the concrete affects the pulse velocity, and this factor must be taken into consideration when evaluating test results. The pulse velocity of saturated concrete may be up to 5 % higher than in dry concrete.<sup>3</sup> In addition, the pulse velocity in saturated concrete is less sensitive to changes in its relative quality.

4.4 The pulse velocity is independent of the dimensions of the test object provided reflected waves from boundaries do not complicate the determination of the arrival time of the directly transmitted pulse. The least dimension of the test object must exceed the wavelength of the ultrasonic vibrations (Note 1).

NOTE 1—The wavelength of the vibrations equals the pulse velocity divided by the frequency of vibrations. For example, for a frequency of 54 kHz and a pulse velocity of 3500 m/s, the wavelength is  $3500/54000 = 0.065$  m.

4.5 The accuracy of the measurement depends upon the ability of the operator to determine precisely the distance between the transducers and of the equipment to measure precisely the pulse transit time. The received signal strength and measured transit time are affected by the coupling of the transducers to the concrete surfaces. Sufficient coupling agent and pressure must be applied to the transducers to ensure stable transit times. The strength of the received signal is also affected by the travel path length and by the presence and degree of cracking or deterioration in the concrete tested.

4.6 The results obtained by the use of this test method should not be considered as a means of measuring strength nor

<sup>3</sup> Bungey, J. H., *Testing of Concrete in Structures*, 2nd ed., Chapman and Hall, 1989, p. 52.

as an adequate test for establishing compliance of the modulus of elasticity of field concrete with that assumed in the design. The longitudinal resonance method in Test Method C 215 is recommended for determining the dynamic modulus of elasticity of test specimens obtained from field concrete because Poisson's ratio does not have to be known.

NOTE 2—When circumstances permit, a velocity-strength (or velocity-modulus) relationship may be established by the determination of pulse velocity and compressive strength (or modulus of elasticity) on a number of samples of a concrete. This relationship may serve as a basis for the estimation of strength (or modulus of elasticity) by further pulse-velocity tests on that concrete. Refer to ACI 228.1R<sup>4</sup> for guidance on the procedures for developing and using such a relationship.

4.7 The procedure is applicable in both field and laboratory testing regardless of size or shape of the specimen within the limitations of available pulse-generating sources.

NOTE 3—Presently available test equipment limits path lengths to approximately 50 mm minimum and 15 m maximum, depending, in part, upon the frequency and intensity of the generated signal. The upper limit of the path length depends partly on surface conditions and partly on the characteristics of the interior concrete under investigation. The maximum path length is obtained by using transducers of relatively low vibrational frequencies (20 to 30 kHz) to minimize the attenuation of the signal in the concrete. (The resonant frequency of the transducer assembly, that is, crystals plus backing plate, determines the frequency of vibration in the concrete.) For the shorter path lengths where loss of signal is not the governing factor, it is preferable to use vibrational frequencies of 50 kHz or higher to achieve more accurate transit-time measurements and hence greater sensitivity.

4.8 Since the pulse velocity in steel could be up to double that in concrete, pulse-velocity measurements in the vicinity of the reinforcing steel may be higher than in plain concrete of the same composition. Where possible, avoid measurements in close proximity to steel parallel to the direction of pulse propagation.


## 5. Apparatus

5.1 The testing apparatus, shown schematically in Fig. 1, consists of a pulse generator, a pair of transducers (transmitter and receiver), an amplifier, a time measuring circuit, a time display unit, and connecting cables.

5.1.1 *Pulse Generator and Transmitting Transducer*—The pulse generator shall consist of circuitry for generating pulses of voltage (Note 4). The transducer for transforming these electronic pulses into wave bursts of mechanical energy shall have a resonant frequency in the range from 30 to 100 kHz (Note 5). The pulse generator shall produce repetitive pulses at a rate of not less than 3 pulses per second. The transducer shall be constructed of piezoelectric, magnetostrictive, or other voltage-sensitive material (Rochelle salt, quartz, barium titanate, lead zirconate-titanate (PZT), and so forth), housed for protection. A triggering pulse shall be produced to start the time measuring circuit.

NOTE 4—The pulse voltage affects the transducer power output and the maximum penetration of the compressional waves. Voltage pulses of 500 to 1000 V have been used successfully.

<sup>4</sup> "In-Place Methods to Estimate Concrete Strength," ACI 228.1R, American Concrete Institute, PO Box 9094, Farmington Hills, MI.

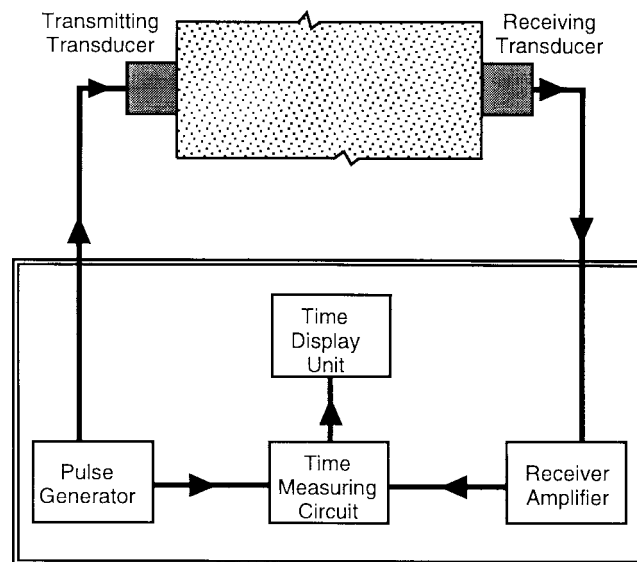

NOTE 1—It is advantageous to incorporate the pulse generator, time measuring circuit, receiver amplifier, and time display into one unit.

FIG. 1 Schematic of Pulse Velocity Apparatus

NOTE 5—Transducers with higher resonant frequencies have been used successfully in relatively small laboratory specimens.

5.1.2 *Receiving Transducer and Amplifier*—The receiving transducer shall be similar to the transmitting transducer. The voltage generated by the receiver shall be amplified as necessary to produce triggering pulses to the time-measuring circuit. The amplifier shall have a flat response between one-half and three times the resonant frequency of the receiving transducer.

5.1.3 *Time-Measuring Circuit*—The time-measuring circuit and the associated triggering pulses shall be capable of providing an overall time-measurement resolution of at least 1  $\mu$ s. It should be initiated by a triggering voltage from the pulse generator and should operate at the repetition frequency of the latter. The time-measuring circuit shall provide an output when the received pulse is detected, and this output shall be used to determine the transit time displayed on the time-display unit. The time-measuring circuit shall be insensitive to operating temperature in the range from 0 to 40°C and voltage changes in the power source of  $\pm 15$  %.

5.1.4 *Display Unit*—Two types of display units are available. Modern units use an interval timer and a direct-reading digital display of the transit time. Older units use a cathode ray tube (CRT) on which the pulses transmitted and received are displayed as deflections of the traces in relation to an established time scale.

5.1.5 *Reference Bar*—A bar of metal or other durable material for which the transit time of compressional waves is known. The transit time shall be marked permanently on the reference bar.

5.1.6 *Connecting Cables*—Where pulse-velocity measurements on large structures require the use of long interconnecting cable, the low-capacitance, shielded, coaxial type shall be used.

5.1.7 *Coupling Agent*—A viscous material (such as oil, petroleum jelly, water soluble jelly, or grease) to ensure efficient transfer of energy between the concrete and the