

# INTERNATIONAL STANDARD



**Explosive atmospheres –  
Part 26: Equipment with Equipment Protection Level (EPL) Ga**

Document Preview  
<https://standards.iteh.ai>

IEC 60079-26:2014

<https://standards.iteh.ai/standards/iec/50185b14-570a-4ccb-939e-db3139bec9/iec-60079-26-2014>

Withhold



**THIS PUBLICATION IS COPYRIGHT PROTECTED**  
**Copyright © 2014 IEC, Geneva, Switzerland**

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

**About the IEC**

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

**About IEC publications**

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

**IEC Catalogue - [webstore.iec.ch/catalogue](http://webstore.iec.ch/catalogue)**

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

**IEC publications search - [webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)**

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

**IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)**

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

**Electropedia - [www.electropedia.org](http://www.electropedia.org)**

The world's leading online dictionary of electronic and electrical terms containing 21 000 terms and definitions in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

**IEC Glossary - [std.iec.ch/glossary](http://std.iec.ch/glossary)**

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

**IEC Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)**

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [sales@iec.ch](mailto:sales@iec.ch).

IEC 60079-26:2014

<https://standards.iteh.ai/standards/iec/500/5b14-570a-4ccb-939e-db3139bece79/iec-60079-26-2014>

# INTERNATIONAL STANDARD



**Explosive atmospheres –  
Part 26: Equipment with Equipment Protection Level (EPL) Ga**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

ICS 29.260.20

ISBN 978-2-8322-1912-6

**Warning! Make sure that you obtained this publication from an authorized distributor.**

# CONTENTS

FOREWORD.....	4
1 Scope.....	7
2 Normative references .....	8
3 Terms and definitions .....	8
4 Requirements for design and construction .....	8
<del>4.1 General.....</del>	<del>8</del>
4.1 Protection measures against ignition hazards of the electrical circuits.....	8
4.1.1 General .....	8
<del>4.2.2 Intrinsic safety as a sole means of protection.....</del>	<del>8</del>
<del>4.2.3 Encapsulation as a sole means of protection.....</del>	<del>8</del>
4.1.2 Application of two independent Types of Protection providing EPL Gb.....	9
4.1.3 Application of a Type of Protection providing EPL Gb and a separation element .....	10
4.2 Equipment with moving parts .....	14
4.2.1 Frictional heating.....	14
4.2.2 Damage arising from failure of moving parts .....	14
4.2.3 Light metals.....	15
<del>4.4 Isolated conductive components.....</del>	<del>16</del>
<del>4.5 Non-conductive enclosures and accessible non-conductive components.....</del>	<del>16</del>
<del>4.5.1 General.....</del>	<del>16</del>
<del>4.5.2 Limitation of the size of chargeable non-conductive surfaces.....</del>	<del>16</del>
<del>4.5.3 Limitation of the thickness of chargeable non-conductive layers.....</del>	<del>16</del>
<del>4.5.4 Provision of a conductive coating.....</del>	<del>16</del>
4.3 Process connection.....	16
5 Type tests .....	16
5.1 Standardized types of protection.....	16
5.2 Separation elements.....	17
5.3 Temperature evaluation .....	17
6 Marking .....	17
6.1 General.....	17
6.2 Examples of marking.....	17
<del>7 Information for use.....</del>	<del>18</del>
7 Instructions.....	18
7.1 Separation elements:.....	18
7.2 Process connection:.....	18
7.3 EPL allocation.....	18
<del>Annex A (informative) Introduction of an alternative risk assessment method encompassing "equipment protection levels" for Ex equipment.....</del>	<del>23</del>
Bibliography.....	23

Figure 1 – Example of a partition wall with a conductor bushing considered as gas diffusion tight .....	11
Figure 2 – Example of a separation element with a cylindrical shaft joint and natural ventilation .....	14
Table 1 – Separation elements .....	13

Witholdawm

iTen Standards  
(<https://standards.iteh.ai>)  
Document Preview

IEC 60079-26:2014  
<https://standards.iteh.ai/standards/iec/50185b14-570a-4ccb-939e-db3139bece79/iec-60079-26-2014>

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

## EXPLOSIVE ATMOSPHERES –

Part 26: Equipment with Equipment Protection Level  
(EPL) Ga

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

**This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.**

International Standard IEC 60079-26 has been prepared by IEC technical committee 31: Equipment for explosive atmospheres.

This third edition cancels and replaces the second edition published in 2006 and constitutes a technical revision.

This edition includes the following significant changes with respect to the previous edition:

Changes	Clause	Type		
		Minor and editorial changes	Extension	Major technical changes
Notes deleted	1	X		
Reference to associated apparatus deleted	1	X		
Additional normative references included	3	X		
Requirements against mechanical and electrostatic ignition hazards deleted (now covered in IEC 60079-0)	4.1	X		
Requirement for separation element detailed regarding external influences	4.1.3.2	X		
Intrinsic safety Ex ia as single type of protection including associated apparatus deleted (now covered by EPL)	4.2.2 (ed.2)	X		
Encapsulation Ex ma as single type of protection deleted (now covered by EPL)	4.2.3 (ed.2)	X		
Conditions a) and b) linked with an "and", therefore requirement of "flameproof joint" deleted in following clause. Both requirements already covered by separation elements and standardised process connections.	4.3	X		
Process connection requires a sufficiently tight joint: IP66 added alternatively to IP67	4.3		X	
Requirement for isolated conductive components deleted (now covered in IEC 60079-0)	4.4 (ed.2)	X		
Requirements for non-conductive enclosures deleted (now covered in IEC 60079-0)	4.5 (ed.2)	X		
Test of partition walls according to 4.1.3.2 b) is specified in more detail	5.2			C1
Marking example for associated apparatus deleted	6.2 b)	X		
Note 3 with an additional example added	6.2	X		
Specification of material of partition wall required in instructions (also required in 4.1.3.2)	7	X		
Alternative risk assessment method deleted (is now generally introduced)	AnnexA (ed.2)	X		

NOTE The technical changes referred to include the significance of technical changes in the revised IEC Standard, but they do not form an exhaustive list of all modifications from the previous version.

## Explanation of the types of changes:

### A) Definitions

#### 1) Minor and editorial changes:

- Clarification
- Decrease of technical requirements
- Minor technical change
- Editorial corrections

These are changes which modify requirements in an editorial or a minor technical way. They include changes of the wording to clarify technical requirements without any technical change, or a reduction in level of existing requirement.

## 2) Extension: Addition of technical options

These are changes which add new or modify existing technical requirements, in a way that new options are given, but without increasing requirements for equipment that was fully compliant with the previous standard. Therefore, these will not have to be considered for products in conformity with the preceding edition.

## 3) Major technical changes:

- addition of technical requirements
- increase of technical requirements

These are changes to technical requirements (addition, increase of the level or removal) made in a way that a product in conformity with the preceding edition will not always be able to fulfil the requirements given in the later edition. These changes have to be considered for products in conformity with the preceding edition. For these changes additional information is provided in Clause B below.

NOTE These changes represent current technological knowledge. However, these changes should not normally have an influence on equipment already placed on the market.

## B) Information about the background of 'Major technical changes'

C1: Introduction of type tests for separation elements according to "4.1.3.2 b)"

The text of this standard is based on the following documents:

FDIS	Report on voting
31/1146/FDIS	31/1155/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 60079 series, published under the general title *Explosive atmospheres*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "http://webstore.iec.ch" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**



## EXPLOSIVE ATMOSPHERES –

### Part 26: Equipment with Equipment Protection Level (EPL) Ga

#### 1 Scope

This part of IEC 60079 specifies ~~the particular alternative~~ requirements for construction, test and marking for electrical equipment that provides Equipment Protection Level (EPL) Ga when single standardised Types of Protection (e.g. Ex “ia” , Ex “ma” , Ex “da” ) cannot be applied. This standard also applies to equipment mounted across a boundary where different Equipment Protection Levels may be required.

EXAMPLE: Equipment installed in the wall of a storage vessel containing Zone 0 (requiring EPL Ga) inside an area defined as Zone 1 (requiring EPL Gb).

This electrical equipment, within the operational parameters specified by the manufacturer, ensures a very high Level of Protection that includes rare ~~faults malfunctions~~ related to the equipment or two ~~faults malfunctions~~ occurring independently of each other.

NOTE A malfunction may result from a failure of the component parts of the electrical equipment or from anticipated externally applied influences. Two independent malfunctions which may occur more frequently and which, separately, would not create an ignition hazard but which, in combination, could create a potential ignition hazard, ~~should be~~ are regarded as occurring together to form a rare ~~fault malfunction~~.

NOTE 2 ~~This electrical equipment is intended for use in zone 0 hazardous areas, in which explosive gas atmospheres caused by mixtures of air and gases, vapours or mists under normal atmospheric conditions are present continuously, for long periods or frequently.~~

~~This standard also applies to equipment mounted across a boundary where different protection levels may be required.~~

EXAMPLE: In the wall of a storage vessel containing zone 0 with an ambient defined as zone 1.

~~This standard also applies to equipment installed in an area requiring a lower protection level, but electrically connected to equipment with equipment protection level (EPL) Ga (associated apparatus).~~

This standard supplements and modifies the general requirements of IEC 60079-0. Where a requirement of this standard conflicts with a requirement of IEC 60079-0, the requirement of this standard takes precedence. ~~and the requirements of the standardized types of protection, in accordance with the IEC 60079 series, to adapt the level of safety provided by those standards in order to provide EPL Ga.~~

NOTE 3 ~~In designing equipment for operation in explosive gas atmospheres under conditions other than the atmospheric conditions given in IEC 60079-0, this standard may be used as a guide. However, additional testing is recommended related specifically to the intended conditions of use. This is particularly important when the types of protection ‘Flameproof enclosures’ (IEC 60079-1) and ‘Intrinsic safety’ (IEC 60079-11) are applied.~~

NOTE 4 ~~The classification of hazardous areas in zones is defined in IEC 60079-10.~~

NOTE 5 ~~There may be other non-electrical sources of ignition (for example ultrasonic, optical or ionizing radiation) that are not addressed by this standard; these should also be taken into consideration (see, for example, EN 1127-1).~~

NOTE 6 ~~This concept provides equipment protection level (EPL) Ga. For further information, see Annex A.~~

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60079-0:~~2004~~, *Explosive atmospheres – Part 0: Equipment – General requirements*

IEC 60079-1, *Explosive atmospheres – Part 1: Equipment protection by flameproof enclosures "d"*

~~IEC 60079-10, *Electrical apparatus for explosive gas atmospheres – Part 10: Classification of hazardous areas*~~

IEC 60079-11, *Explosive atmospheres – Part 11: Equipment protection by intrinsic safety "i"*

~~IEC 60079-18, *Electrical apparatus for explosive gas atmospheres – Part 18: Construction, test and marking of type of protection encapsulation "m" electrical apparatus*~~

IEC 60529, *Degrees of protection provided by enclosures (IP Code)*

IEC 60695-11-10, *Fire hazard testing – Part 11-10: Test flames – 50 W horizontal and vertical flame test methods*

## 3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60079-0 and the following apply.

NOTE Additional definitions applicable to explosive atmospheres can be found in IEC 60050-426.

### ~~3.1~~

#### ~~EPL~~

~~abbreviation of equipment protection level as defined in Annex A~~

### 3.1

#### separation element

mechanical element inside the equipment, which separates different parts of the equipment with different ERLs

Note 1 to entry: A separation element consists of a mechanical partition wall, which may be combined with a flameproof joint or a natural ventilation

## 4 Requirements for design and construction

### ~~4.1 — General~~

~~The equipment shall comply with the requirements of 4.2 for the electrical circuits and with the requirements of 4.3 to 4.6 for mechanical and electrostatic ignition hazards.~~

### 4.1 Protection measures against ignition hazards of the electrical circuits

#### 4.1.1 General

The equipment shall comply with the requirements of ~~either~~

- a) ~~4.2.2 or 4.2.3 in the event of two faults occurring independently of each other in a single equipment means of protection; or~~
- b) ~~4.2.4 or 4.2.5~~ 4.1.2 or 4.1.3 in the event of a failure of one equipment means of protection, by the provision of a second independent means of protection.

NOTE 1 Types of Protection according to EPL Ga do not require a second independent means of protection, e.g. Ex "ia" (IEC 60079-11), Ex "ma" (IEC 60079-18), Ex "da" (IEC 60079-1).

Electrical connections and permanently connected cables of the equipment sited within an area requiring EPL Ga equipment shall comply with the same Level of Protection required by this standard, for example ~~an Ex "e"~~ a cable suitable for EPL Gb containing non-Ex "ia" circuits additionally protected by a flameproof conduit or ~~an Ex "e"~~ a cable suitable for EPL Gb provided with earth leakage protection.

NOTE 2 Detailed cable and installation requirements for ~~non~~ Types of Protection accepted as achieving EPL Ga beyond intrinsically safe circuits ~~providing EPL Ga~~ are under consideration in IEC 60079-14.

NOTE 3 Because of ignition hazards which can arise from faults and/or transient circulating currents in the potential equalization system, galvanic isolation in the power and signal connections to the equipment according to 4.1.2 and 4.1.3 ~~4.2.2, 4.2.3 and 4.2.4 is preferred. Consideration should also be given to minimize~~ is commonly applied along with minimizing the effect of transient fault currents in the potential equalization network by the use of electrical protection equipment such as sensitive earth leakage monitors.

#### ~~4.2.2~~ **Intrinsic safety as a sole means of protection**

~~Intrinsically safe electrical equipment providing EPL Ga and intrinsically safe electrical circuits of associated apparatus entering an area requiring EPL Ga shall comply with the requirements of IEC 60079-11, intrinsic safety "ia".~~

NOTE ~~Intrinsic safety "ib" in accordance with IEC 60079-11 may be considered as one of two independent means of protection according to 4.2.4.~~

#### ~~4.2.3~~ **Encapsulation as a sole means of protection**

~~Electrical equipment which is protected by encapsulation providing EPL Ga shall comply with the requirements of IEC 60079-18, encapsulation "ma".~~

NOTE ~~Encapsulation "mb" in accordance with IEC 60079-18 may be considered as one of two independent means of protection according to 4.2.4.~~

### **4.1.2 Application of two independent Types of Protection providing EPL Gb**

Electrical equipment shall comply with the requirements of two independent Types of Protection that provide EPL Gb. If one Type of Protection fails, the other Type of Protection shall continue to function. The independent Types of Protection shall not have a common mode of failure, except as specified in this clause. **Combined types of protection providing EPL Gb shall depend on different physical protection principles.**

NOTE 1 An example of a common mode of failure is if an Ex "d" enclosure containing arcing ~~contacts components is used~~ installed inside an Ex "e" enclosure. Should the Ex "d" enclosure be compromised, ~~then arcing inside the enclosure will~~ it would also compromise the Ex "e" enclosure.

NOTE 2 ~~Combined types of protection providing EPL Gb should depend on different physical protection principles. For example~~ The combination of Ex "d" and Ex "q" both depend on the avoidance of flame propagation (same physical protection principle) and may not be useful in combination. In practice, some combinations may not be useful, for example the combination of oil immersion "o" and powder filling "q".

Where combined types of protection are used, it shall be possible for each Type of Protection to be tested individually (see 5.1).

Both Types of Protection shall be assessed using the most arduous fault condition of the other Type of Protection. When combining intrinsic safety, Type of Protection "ib", with other Types of Protection, the second Type of Protection shall be assessed, with the most arduous

fault condition applied to the intrinsically safe circuit. ~~Thermal dissipation shall be considered in case of a fault of one Type of protection.~~

When using two Types of Protection, which both rely on the same parameter (for example, the creepage distance combining Ex “ib” with Ex “e”), the most stringent requirement of both Types of Protection shall be applied.

If two Types of Protection are combined which both rely on the enclosure, one of the following shall be met:

- a) if two enclosures are used (one totally enclosed within the other), each enclosure shall comply with the requirements of the respective Type of Protection; or
- b) if only one enclosure is used, the enclosure and the cable glands shall meet the impact test requirements of ~~26.4.2 of~~ IEC 60079-0, using the Group I values.

Examples of **relevant** combinations of two independent Types of Protection are as follows:

- inductive transmitters (for example proximity switches, electrical position sensors) with intrinsic safety “ib” enclosed by encapsulation “mb”. The connections to intrinsically safe “ib” circuits can be protected by the increased safety “e”;
- ~~a lamp with the bulb luminaire designed as increased safety “e”, the lamp circuit with the switch as intrinsic safety “ib”. These components may be incorporated~~ included in a flameproof enclosure “d”;
- measuring transducers with intrinsic safety “ib” and a flameproof enclosure “d”;
- equipment with electrical circuits of intrinsic safety “ib”, additionally protected by powder filling “q”;
- electromagnetic valves with encapsulation “mb”, enclosed by a flameproof enclosure “d”;
- increased safety “e”, with pressurized equipment “pxb”.

#### 4.1.3 Application of a Type of Protection providing EPL Gb and a separation element

##### 4.1.3.1 General

Equipment which is mounted through or forms part of the boundary wall to an area requiring EPL Ga and contains electrical circuits which do not comply with ~~protection level~~ EPL Ga shall comply with at least one of the Types of Protection providing EPL Gb. Additionally, it shall contain a mechanical separation element as part of the equipment to ~~seal off~~ separate the electrical circuits of the equipment from the area requiring EPL Ga.

If the Type of Protection fails, the separation element shall:

- a) prevent flame propagation through the equipment into the area requiring EPL Ga,
- b) maintain its safety characteristics,
- c) ~~not be heated above~~ exceed the maximum surface temperature of the specified temperature class of the equipment (see 5.3).

~~Separation elements consist of a partition wall, possibly combined with a flameproof joint or an air gap with natural ventilation.~~

##### 4.1.3.2 Partition walls

Partition walls shall be constructed of either:

- a) corrosion-resistant metals, glass or ceramics, ~~which are specified in the manufacturer's documentation; or~~
- b) other materials which can be verified to provide the same level of safety. In this case, ~~X-marking or an advisory marking in accordance with 29.2 of IEC 60079-0 shall be applied~~

~~and the certificate shall clearly specify the material and its thermal and mechanical properties to enable the user to confirm the suitability for the particular application the certificate number shall include the "X" suffix in accordance with the marking requirements of IEC 60079-0.~~

~~If the wall thickness is less than 1 mm, the equipment shall be marked with an "X" or an advisory marking according to 29.2 of IEC 60079-0 with a special condition for safe use the certificate number shall include the "X" suffix in accordance with the marking requirements of IEC 60079-0 and the Specific Conditions of Use listed on the certificate shall indicate that the material shall not be subject to environmental conditions which might adversely affect the partition wall.~~

If the partition wall is under constant vibrational stress (for example vibrating membranes), the minimum endurance limit at maximum amplitude shall be defined in the documentation (see Clause 7). ~~Due to specified process pressure, loads or temperature, the separation element shall not impair the Type of Protection.~~


**NOTE 1** A wall thickness less than 1 mm is only permitted in combination with intrinsic safety "ib", or a flameproof joint or natural ventilation (see 4.1.3.3).

**NOTE 2** For glass or ceramics, a minimum thickness of 1/10 of the diameter/maximum dimension but not less than 1 mm is ~~recommended required.~~

In addition to the requirements of 4.1.3.1 to 4.1.3.3, metallic partition walls with a thickness  $\geq 1$  mm may be provided with suitable conductor bushings (see Figure 1).

To avoid a critical concentration of explosive gas atmosphere diffusing from the area requiring EPL Ga into the enclosure containing the electrical circuits, the leakage rate through the bushing shall be low compared to the leakage rate from the enclosure into the free atmosphere.

**NOTE 3** For example this could be done using a standard enclosure with an IP67 rating according to IEC 60529, a bushing with a leakage rate equivalent to a helium-leakage rate less than  $10^{-2}$  Pa·l/s ( $10^{-4}$  mbar·l/s) at a pressure difference of  $10^5$  Pa (1 bar) ~~is sufficient.~~ This can be achieved, for example, by using a glass or ceramic bushing as shown in Figure 1.

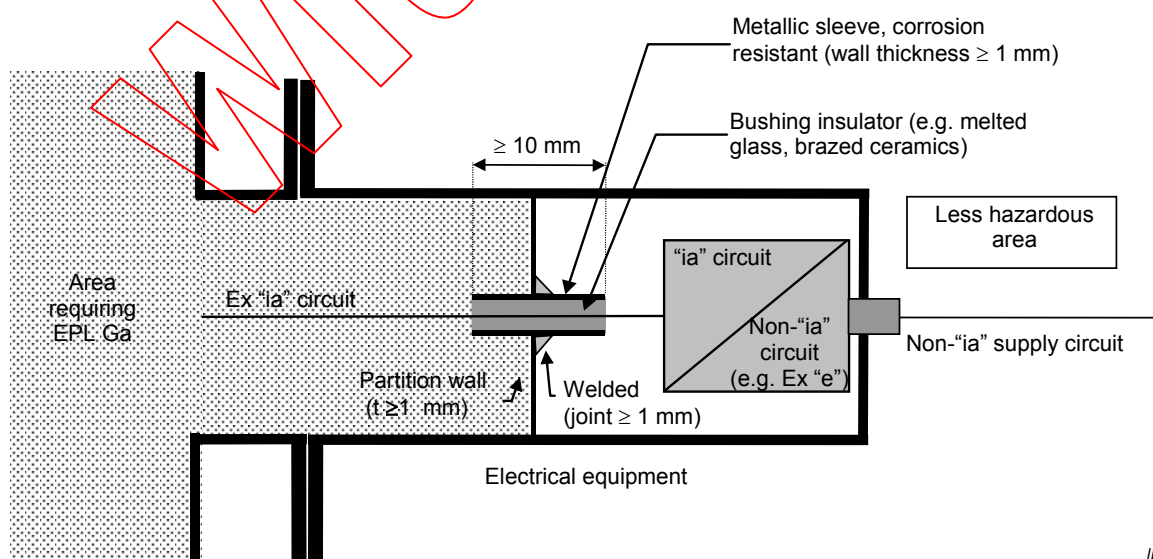

IEC

**Figure 1 – Example of a partition wall with a conductor bushing considered as gas diffusion tight**

#### 4.1.3.3 Requirements depending on the thickness of the partition wall

The combinations of separation elements and additional protective measures depend on the wall thickness,  $t$ , of the partition wall as described below and shown in Table 1:

- i) For homogeneous partition walls with a thickness  $\geq 3$  mm, no additional protection measures are required.
- ii) For homogeneous partition walls with a thickness of  $3 \text{ mm} > t \geq 1 \text{ mm}$ , one EPL Gb type of protection is required (see example a) of Table 1). A homogeneous part of the enclosure of an equipment with a EPL Gb type of protection may form the partition wall, even for types of protection which rely on the enclosure, provided the equipment does not contain an ignition capable source, for example exposed contacts (see example a) of Table 1). If the equipment contains a source of ignition in normal operation, either a flameproof joint (example b) of Table 1) or a ventilated air gap (example c) of Table 1) is also required.
- iii) Behind partition walls of  $1 \text{ mm} > t \geq 0,2 \text{ mm}$ , one of the following protective measures is required:
  - Type of Protection intrinsic safety “ib” according to IEC 60079-11 (example a) of Table 1); or
  - one EPL Gb Type of Protection in combination with a flameproof joint (example b) of Table 1); or
  - one EPL Gb Type of Protection in combination with a ventilated air-gap and a flameproof joint (example c) of Table 1).
- iv) For a partition wall with  $t < 0.2 \text{ mm}$  (for example membranes), a flameproof joint and one EPL Gb Type of Protection are required (example b) of Table 1). If the equipment contains a source of ignition in normal operation (for example by exposed contacts), a ventilated air gap is also required (example type c) of Table 1).

NOTE In the context of this clause, 'homogeneous' means a membrane constructed of a single piece of material without any insertions such as feed-throughs, bushings.

IEC 60079-26:2014

<https://standards.iteh.ai/standards/iec/50185/14-570a-4ccb-939e-db3139bece79/iec-60079-26-2014>