

INTERNATIONAL STANDARD



Wind energy generation systems –
Part 27-2: Electrical simulation models – Model validation
(standards.iteh.ai)

IEC 61400-27-2:2020

<https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020>



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2020 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

[IEC 61400-27-2:2020](https://standards.iec.ch/catalog/standards/sis/dbbd67c8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020)

<https://standards.iec.ch/catalog/standards/sis/dbbd67c8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020>

INTERNATIONAL STANDARD



**Wind energy generation systems –
Part 27-2: Electrical simulation models – Model validation**

STANDARD PREVIEW
(standards.iteh.ai)
IEC 61400-27-2:2020
<https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020>

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 27.180

ISBN 978-2-8322-8506-0

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	6
INTRODUCTION.....	8
1 Scope.....	10
2 Normative references	10
3 Terms, definitions, abbreviations and subscripts.....	11
3.1 Terms and definitions.....	11
3.2 Abbreviations and subscripts	15
3.2.1 Abbreviations.....	15
3.2.2 Subscripts	15
4 Symbols and units	15
4.1 General.....	15
4.2 Symbols (units).....	16
5 Functional specifications and requirements to validation procedures	18
5.1 General.....	18
5.2 General specifications.....	18
5.3 Wind turbine model validation	20
5.4 Wind power plant model validation	20
6 General methodologies for model validation.....	20
6.1 General.....	20
6.2 Test results.....	20
6.3 Simulations	21
6.4 Signal processing	21
6.4.1 General	21
6.4.2 Time series processing	21
6.4.3 Windows error statistics.....	23
6.4.4 FRT windows specification	24
6.4.5 Step response characteristics	25
7 Validation of wind turbine models	27
7.1 General.....	27
7.2 Fault ride through capability	27
7.2.1 General	27
7.2.2 Test requirements.....	28
7.2.3 Simulation requirements	29
7.2.4 Validation results	29
7.3 Active power control	29
7.3.1 General	29
7.3.2 Test requirements.....	29
7.3.3 Simulation requirements	30
7.3.4 Validation results	30
7.4 Frequency control	30
7.4.1 General	30
7.4.2 Test requirements.....	30
7.4.3 Simulation requirements	31
7.4.4 Validation results	31
7.5 Synthetic inertia control	31
7.5.1 General	31

7.5.2	Test requirements	31
7.5.3	Simulation requirements	32
7.5.4	Validation results	32
7.6	Reactive power reference control	32
7.6.1	General	32
7.6.2	Test requirements	32
7.6.3	Simulation requirements	33
7.6.4	Validation results	33
7.7	Reactive power – voltage reference control	33
7.7.1	General	33
7.7.2	Test requirements	33
7.7.3	Simulation requirements	33
7.7.4	Validation results	34
7.8	Grid protection	34
7.8.1	General	34
7.8.2	Test requirements	34
7.8.3	Simulation requirements	34
7.8.4	Validation results	35
8	Validation of wind power plant models	35
8.1	General	35
8.2	Active power control	35
8.2.1	General	35
8.2.2	Test requirements	36
8.2.3	Simulation requirements	36
8.2.4	Validation results	36
8.3	Reactive power reference control	36
8.3.1	General	36
8.3.2	Test requirements	37
8.3.3	Simulation requirements	37
8.3.4	Validation results	37
8.4	Reactive power – voltage reference control	37
8.4.1	General	37
8.4.2	Test requirements	38
8.4.3	Simulation requirements	38
8.4.4	Validation results	38
Annex A (informative)	Validation documentation for wind turbine model	39
A.1	General	39
A.2	Simulation model and validation setup information	39
A.3	Template for validation results	39
A.3.1	General	39
A.3.2	Fault ride through capability	40
A.3.3	Active power control	42
A.3.4	Frequency control	42
A.3.5	Synthetic inertia control	43
A.3.6	Reactive power reference control	43
A.3.7	Reactive power – voltage reference control	44
A.3.8	Grid protection	45
Annex B (informative)	Validation documentation for wind power plant model	46
B.1	General	46

B.2	Simulation model and validation setup information	46
B.3	Template for validation results	46
B.3.1	General	46
B.3.2	Active power control	47
B.3.3	Reactive power reference control	47
B.3.4	Reactive power – voltage reference control	48
Annex C (informative)	Reference grid for model-to-model validation	49
Annex D (informative)	Model validation uncertainty	50
D.1	General	50
D.2	Simulation uncertainties	50
D.3	Measurement uncertainties	50
D.4	Impact of model validation uncertainties	51
Annex E (normative)	Digital 2 nd order critically damped low pass filter	52
Annex F (informative)	Additional performance based model validation methodology for active power recovery in voltage dips	53
F.1	General	53
F.2	Active power recovery criterion	53
F.3	Active power oscillation criterion	53
Annex G (informative)	Generic software interface for use of models in different software environments	55
G.1	Description of the approach	55
G.2	Description of the software interface	56
G.2.1	Description of data structures	56
G.2.2	Functions for communication through the ESE-interface	58
G.2.3	Inputs, outputs, parameters	59
Bibliography	60

Figure 1 – Classification of power system stability according to IEEE/CIGRE Joint Task Force on Stability Terms and Definitions [1]	8
Figure 2 – Signal processing structure with play-back simulation approach applied	22
Figure 3 – Signal processing structure with full-system simulation approach applied	22
Figure 4 – Voltage dip windows [12]	24
Figure 5 – Step response characteristics	26
Figure 6 – Measured and simulated settling time with inexpedient choice of tolerance band	27
Figure A.1 – Time series of measured and simulated positive sequence voltage	40
Figure A.2 – Time series of measured and simulated positive sequence active current	40
Figure A.3 – Time series of measured and simulated positive sequence reactive current	40
Figure A.4 – Time series of calculated absolute error of positive sequence active and reactive current	40
Figure A.5 – Time series of measured and simulated negative sequence voltage	41
Figure A.6 – Time series of measured and simulated negative sequence active current	41
Figure A.7 – Time series of measured and simulated negative sequence reactive current	41
Figure A.8 – Time series of calculated absolute error of negative sequence active and reactive current	41

Figure A.9 – Time series of active power reference, available active power, measured active power and simulated active power	42
Figure A.10 – Time series of frequency reference value and measured input to WT controller	43
Figure A.11 – Time series of available active power, measured active power and simulated active power	43
Figure A.12 – Time series of frequency reference value and measured input to WT controller	43
Figure A.13 – Time series of available active power, measured active power and simulated active power	43
Figure A.14 – Time series of reactive power reference, measured reactive power and simulated reactive power	44
Figure A.15 – Time series of measured active power and simulated active power	44
Figure A.16 – Time series of measured and simulated reactive power	44
Figure B.1 – Time series of active power reference, available active power, measured active power and simulated active power	47
Figure B.2 – Time series of reactive power reference, measured reactive power and simulated reactive power	47
Figure B.3 – Time series of measured active power and simulated active power	47
Figure B.4 – Time series of measured and simulated reactive power	48
Figure C.1 – Layout of reference grid	49
Figure F.1 – Voltage dip active power performance validation parameters	54
Figure G.1 – Sequence of simulation on use of ESE-interface	59
Table 1 – Windows applied for error calculations	25
Table A.1 – Required information about simulation model and validation setup	39
Table A.2 – Additional information required if full-system method is applied	39
Table A.3 – Positive sequence validation summary for each voltage dip and voltage swell validation case	41
Table A.4 – Negative sequence validation summary for each voltage dip and voltage swell validation case	42
Table A.5 – Validation summary for active power control	42
Table A.6 – Validation summary for reactive power control	44
Table A.7 – Validation summary for grid protection	45
Table B.1 – Required information about simulation model and validation setup	46
Table B.2 – Additional information required if full-system method is applied	46
Table B.3 – Validation summary for active power control	47
Table B.4 – Validation summary for reactive power control	47
Table C.1 – Line data for the WECC test system in per-unit	49
Table C.2 – Transformer data for the WECC test system	49

IEC 61400-27-2:2020

<https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020>

INTERNATIONAL ELECTROTECHNICAL COMMISSION

WIND ENERGY GENERATION SYSTEMS –**Part 27-2: Electrical simulation models –
Model validation****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users shall ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61400-27-2 has been prepared by IEC technical committee 88: Wind energy generation systems.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
88/763/FDIS	88/772/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 61400, published under the general title *Wind energy generation systems*, can be found on the IEC website.

Future standards in this series will carry the new general title as cited above. Titles of existing standards in this series will be updated at the time of the next edition.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

iTeh STANDARD PREVIEW (standards.iteh.ai)

[IEC 61400-27-2:2020](https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020)

<https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020>

INTRODUCTION

IEC 61400-27-2 specifies model validation procedures for electrical simulation models of wind turbines and wind power plants.

The increasing penetration of wind energy in power systems implies that Transmission System Operators (TSOs) and Distribution System Operators (DSOs) need to use dynamic models of wind power generation for power system stability studies.

The purpose of this International Standard is to specify validation procedures for dynamic models, which can be applied in power system stability studies. The IEEE/CIGRE Joint Task Force on Stability Terms and Definitions [1]¹ has classified power system stability in categories according to Figure 1.

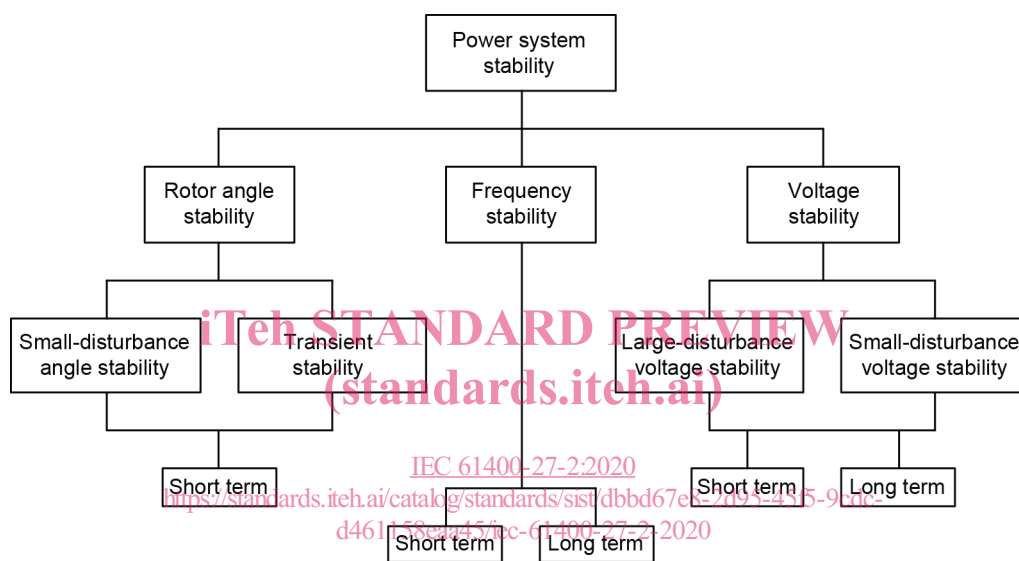


Figure 1 – Classification of power system stability according to IEEE/CIGRE Joint Task Force on Stability Terms and Definitions [1]

Referring to these categories, the models to be validated have been developed to represent wind power generation in studies of large-disturbance short term stability phenomena, i.e. short term voltage stability, short term frequency stability and short term transient stability studies referring to the definitions of IEEE/CIGRE Joint Task Force on Stability Terms and Definitions in Figure 1. Thus, the models are applicable for dynamic simulations of power system events such as short-circuits (low voltage ride through), loss of generation or loads, and system separation of one synchronous area into more synchronous areas.

The validation procedure specified in this document assesses the accuracy of the fundamental frequency response of wind power plant models and wind turbine models. This includes validation of the generic positive sequence models specified in IEC 61400-27-1 and validation of positive sequence as well as negative sequence response of more detailed models developed by the wind turbine manufacturers.

¹ Figures in square brackets refer to the Bibliography.

The validation procedure has the following limitations:

- The validation procedure does not specify any requirements to model accuracy. It only specifies measures to quantify the accuracy of the model^{2,3}.
- The validation procedure does not specify test and measurement procedures, as it is intended to be based on tests specified in IEC 61400-21-1 and IEC 61400-21-24.
- The validation procedure is not intended to justify compliance to any grid code requirement, power quality requirements or national legislation.
- The validation procedure does not include validation of steady state capabilities e.g. of reactive power, but focuses on validation of the dynamic performance of the models.
- The validation procedure does not cover long term stability analysis.
- The validation procedure does not cover sub-synchronous interaction phenomena.
- The validation procedure does not cover investigation of the fluctuations originating from wind speed variability in time and space.
- The validation procedure does not cover phenomena such as harmonics, flicker or any other EMC emissions included in the IEC 61000 series.
- The validation procedure does not cover eigenvalue calculations for small signal stability analysis.
- This validation procedure does not address the specifics of short-circuit calculations.
- The validation procedure is limited by the functional specifications in Clause 5.

The following stakeholders are potential users of the validation procedures specified in this document:

- TSOs and DSOs need procedures to validate the accuracy of the models which they use in power system stability studies;
- wind plant owners are typically responsible to provide validation of their wind power plant models to TSO and/or DSO prior to plant commissioning;
- wind turbine manufacturers will typically provide validation of the wind turbine models to the owner.
- developers of modern software for power system simulation tools may use the standard to implement validation procedures as part of the software library;
- certification bodies in case of independent model validation;
- education and research communities, who can also benefit from standard model validation procedures.

² Specification of requirements to model accuracy is the responsibility of TSOs e.g. in grid codes. The scope of IEC 61400-27-2 is to provide a standard for how to measure accuracy and this way remove indefiniteness.

³ Clause 7 specifies a large number of measures for model accuracy. The importance of the individual measure depends on the type of grid and type of stability study. Annex D describes limits to the possible accuracy of the models.

⁴ Under consideration.

WIND ENERGY GENERATION SYSTEMS –

Part 27-2: Electrical simulation models – Model validation

1 Scope

This part of IEC 61400 specifies procedures for validation of electrical simulation models for wind turbines and wind power plants, intended to be used in power system and grid stability analyses. The validation procedures are based on the tests specified in IEC 61400-21 (all parts). The validation procedures are applicable to the generic models specified in IEC 61400-27-1 and to other fundamental frequency wind power plant models and wind turbine models.

The validation procedures for wind turbine models focus on fault ride through capability and control performance. The fault ride through capability includes response to balanced and unbalanced voltage dips as well as voltage swells. The control performance includes active power control, frequency control, synthetic inertia control and reactive power control. The validation procedures for wind turbine models refer to the tests specified in IEC 61400-21-1. The validation procedures for wind turbine models refer to the wind turbine terminals.

The validation procedures for wind power plant models is not specified in detail because IEC 61400-21-2 which has the scope to specify tests of wind power plants is at an early stage. The validation procedures for wind power plant models refer to the point of connection of the wind power plant.

<https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-11ec10c219/iec-61400-27-2-2020>

The validation procedures specified in IEC 61400-27-2 are based on comparisons between measurements and simulations, but they are independent of the choice of software simulation tool.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-415:1999, *International Electrotechnical Vocabulary (IEV) – Part 415: Wind turbine generator systems* (available at www.electropedia.org)

IEC 61400-21-1:2019, *Wind energy generation systems – Part 21-1: Measurement and assessment of electrical characteristics – Wind turbines*

IEC 61400-27-1, *Wind energy generation systems – Part 27-1: Electrical simulation models – Generic models*

3 Terms, definitions, abbreviations and subscripts

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60050-415 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1.1

application range

specification of the boundaries for the situations where the electrical simulation model is applicable

3.1.2

available active power

predicted optimal active power of wind turbine or wind power plant, either based on power curves and measured wind speeds or as an output from wind turbine controller or wind power plant controller, where more parameters are taken into the calculation

3.1.3

base unit

unit of parameter values, which is the per-unit base value if the parameter is given in per-unit or the physical unit if the value is given in a physical unit

[IEC 61400-27-2:2020](https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020)

3.1.4

generic model

model that can be adapted to simulate different wind turbines or wind power plants by changing the model parameters

3.1.5

integration time step

simulation time interval between two consecutive numerical solutions of the model's differential equations

3.1.6

negative (sequence) component (of a three-phase system)

one of the three symmetrical sequence components which exists only in an unsymmetrical three-phase system of sinusoidal quantities and which is defined by the following complex mathematical expression:

$$\underline{X}_2 = \frac{1}{3} (\underline{X}_{L1} + \underline{a}^2 \underline{X}_{L2} + \underline{a} \underline{X}_{L3})$$

where \underline{a} is the 120 degree operator, and \underline{X}_{L1} , \underline{X}_{L2} and \underline{X}_{L3} are the complex expressions of the phase quantities concerned, and where \underline{X} denotes the system current or voltage phasors

[SOURCE: IEC 60050-448:1995, 448-11-28]

3.1.7

nominal active power

nominal value of active power, which is stated by the manufacturer and is used as a per-unit base for all powers (active, reactive, apparent)

[SOURCE: IEC 61400-21-1:2019, 3.15, modified – Removed “wind turbine” from definition]

3.1.8

nominal voltage

nominal value of line-to-line voltage, which is stated by the manufacturer and is used as a per-unit base

3.1.9

overshoot

difference between the maximum value of the response and the steady-state final value

Note 1 to entry: Overshoot is defined by the response to a step change of a controller reference variable, see Figure 5.

[SOURCE: IEC 61400-21-1:2019, 3.47, modified – The note to entry has been changed]

3.1.10

phasor

complex RMS value

representation of a sinusoidal integral quantity by a complex quantity whose argument is equal to the initial phase and whose modulus is equal to the RMS value

Note 1 to entry: For a quantity $a(t) = \hat{A} \cos(\omega t + \vartheta_0)$ the phasor is $\underline{A} = A \exp(j\vartheta_0)$ where $A = \frac{\hat{A}}{\sqrt{2}}$ is the RMS value and ϑ_0 is the initial phase. A phasor can also be represented graphically.

Note 2 to entry: Electric current phasor \underline{I} and voltage phasor \underline{U} are often used.

Note 3 to entry: The similar representation with the modulus equal to the amplitude is sometimes also called “phasor”.

[SOURCE: IEC 60050-103:2017 103-07-14]

3.1.11

point of connection

reference point on the electric power system where the user's electrical facility is connected

[SOURCE: IEC 60050-617:2009, 617-04-01]

3.1.12

positive (sequence) component (of a three-phase system)

one of the three symmetrical sequence components which exists in symmetrical and unsymmetrical three-phase system of sinusoidal quantities and which is defined by the following complex mathematical expression:

$$\underline{X}_1 = \frac{1}{3} (\underline{X}_{L1} + \underline{a} \underline{X}_{L2} + \underline{a}^2 \underline{X}_{L3})$$

where \underline{a} is the 120 degree operator, and \underline{X}_{L1} , \underline{X}_{L2} and \underline{X}_{L3} are the complex expressions of the phase quantities concerned, and where \underline{X} denotes the system current or voltage phasors

[SOURCE: IEC 60050-448:1995, 448-11-27]

3.1.13

power system stability

capability of a power system to regain a steady state, characterized by the synchronous operation of the generators after a disturbance due, for example, to variation of power or impedance

Note 1 to entry: IEEE/CIGRE Joint Task Force on Stability Terms and Definitions: Power system stability is the ability of an electric power system, for a given initial operating condition, to regain a state of operating equilibrium after being subjected to a physical disturbance, with most system variables bounded so that practically the entire system remains intact.

[SOURCE: IEC 60050-603:1986, 603-03-01, modified – addition of Note 1 to entry]

3.1.14

quasi steady state of a system

short-term steady state, for instance during a voltage dip or voltage swell which is long enough to include a period where the system state variables can be considered sensibly constant

3.1.15

reaction time

elapsed time from test command issued until the change in amplitude reaches 10 % of the measured output variable of the step height

Note 1 to entry: Reaction time is defined by the response to a step change of a controller reference variable, see Figure 5.

[SOURCE: IEC 61400-21-1:2019, 3.48, modified – The note to entry has been changed]

3.1.16

reference variable

input variable to a comparing element in a controlling system, which sets the desired value of the controlled variable and is deducted from the command variable

[SOURCE: IEC 60050-351:2013, 351-48-02, modified – The note to entry and the figure have been deleted]

[IEC 61400-27-2:2020](https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020)

<https://standards.iteh.ai/catalog/standards/sist/dbbd67e8-2d95-45f5-9cdc-d461158eaa45/iec-61400-27-2-2020>

3.1.17

response time

elapsed time from the start of a step change or start of event until the observed value first time enters the predefined tolerance band of the target value

Note 1 to entry: Response time is defined by the response to a step change of a controller reference variable, see Figure 5.

[SOURCE: IEC 61400-21-1:2019, 3.44, modified – The note to entry has been changed]

3.1.18

rise time

time from when the observed value reaches 10 % of the step change until the observed value reaches 90 % of the step change

Note 1 to entry: Rise time is defined by the response to a step change of a controller reference variable, see Figure 5.

[SOURCE: IEC 61400-21-1:2019, 3.46, modified – The note to entry has been changed]

3.1.19

settling time

elapsed time from the start of a step change event until the observed value continuously stays within the predefined tolerance band of the target value

Note 1 to entry: Settling time is defined by the response to a step change of a controller reference variable, see Figure 5.

[SOURCE: IEC 61400-21-1:2019, 3.45, modified – The note to entry has been changed]