



SLOVENSKI STANDARD

SIST EN 300 019-1-3 V2.2.2:2006

01-februar-2006

Environmental Engineering (EE); Environmental conditions and environmental tests for telecommunications equipment; Part 1-3: Classification of environmental conditions; Stationary use at weatherprotected locations

Environmental Engineering (EE); Environmental conditions and environmental tests for telecommunications equipment; Part 1-3: Classification of environmental conditions; Stationary use at weatherprotected locations

(standards.iteh.ai)

SIST EN 300 019-1-3 V2.2.2:2006

<https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ea6630160eca/sist-en-300-019-1-3-v2-2-2-2006>

Ta slovenski standard je istoveten z: EN 300 019-1-3 Version 2.2.2

ICS:

19.040	Preskušanje v zvezi z okoljem	Environmental testing
33.050.01	Telekomunikacijska terminalska oprema na splošno	Telecommunication terminal equipment in general

SIST EN 300 019-1-3 V2.2.2:2006 en

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 300 019-1-3 V2.2.2:2006

<https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ea6630160eca/sist-en-300-019-1-3-v2-2-2-2006>

ETSI EN 300 019-1-3 V2.2.2 (2004-07)

European Standard (Telecommunications series)

**Environmental Engineering (EE);
Environmental conditions and environmental tests
for telecommunications equipment;
Part 1-3: Classification of environmental conditions;
Stationary use at weatherprotected locations**

iTeh STANDARD PREVIEW
(standards.iteh.ai)

[SIST EN 300 019-1-3 V2.2.2:2006](https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ea6630160eca/sist-en-300-019-1-3-v2-2-2-2006)

<https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ea6630160eca/sist-en-300-019-1-3-v2-2-2-2006>



Reference

REN/EE-01027-1-3[3]

Keywords

environment, testing, equipment practice

ETSI

650 Route des Lucioles
F-06921 Sophia Antipolis Cedex - FRANCE

Tel.: +33 4 92 94 42 00 Fax: +33 4 93 65 47 16

Siret N° 348 623 562 00017 - NAF 742 C
Association à but non lucratif enregistrée à la
Sous-Préfecture de Grasse (06) N° 7803/88

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 300 019-1-3 V2.2.2:2006<https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ea6630160e7d/sist-en-300-019-1-3-v2-2-2-2006>**Important notice**

Individual copies of the present document can be downloaded from:

<http://www.etsi.org>

The present document may be made available in more than one electronic version or in print. In any case of existing or perceived difference in contents between such versions, the reference version is the Portable Document Format (PDF). In case of dispute, the reference shall be the printing on ETSI printers of the PDF version kept on a specific network drive within ETSI Secretariat.

Users of the present document should be aware that the document may be subject to revision or change of status. Information on the current status of this and other ETSI documents is available at

<http://portal.etsi.org/tb/status/status.asp>

If you find errors in the present document, send your comment to:

editor@etsi.org

Copyright Notification

No part may be reproduced except as authorized by written permission.
The copyright and the foregoing restriction extend to reproduction in all media.

© European Telecommunications Standards Institute 2004.
All rights reserved.

DECT™, **PLUGTESTS™** and **UMTS™** are Trade Marks of ETSI registered for the benefit of its Members.
TIPHON™ and the **TIPHON logo** are Trade Marks currently being registered by ETSI for the benefit of its Members.
3GPP™ is a Trade Mark of ETSI registered for the benefit of its Members and of the 3GPP Organizational Partners.

Contents

Intellectual Property Rights	4
Foreword.....	4
1 Scope	5
2 References	5
3 Definitions and abbreviations.....	5
3.1 Definitions	5
3.2 Abbreviations	6
4 Environmental classes	6
4.1 Class 3.1: Temperature-controlled locations	6
4.2 Class 3.2: Partly temperature-controlled locations	7
4.3 Class 3.3: Not temperature-controlled locations	9
4.4 Class 3.4: Sites with heat-trap	10
4.5 Class 3.5: Sheltered locations.....	11
4.6 Class 3.6: Telecommunication control room locations	12
5 Environmental conditions.....	13
5.1 Climatic conditions.....	13
5.2 Biological conditions.....	14
5.3 Chemically active substances	14
5.4 Mechanically active substances	15
5.5 Mechanical conditions.....	16
5.6 Earthquake conditions	16
Annex A (informative): Bibliography.....	19
History	20

iTech STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 300 019-1-3 V2.2.2:2006

<https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ea6630160eca/sist-en-300-019-1-3-v2-2-2-2006>

Intellectual Property Rights

IPRs essential or potentially essential to the present document may have been declared to ETSI. The information pertaining to these essential IPRs, if any, is publicly available for **ETSI members and non-members**, and can be found in ETSI SR 000 314: "*Intellectual Property Rights (IPRs); Essential, or potentially Essential, IPRs notified to ETSI in respect of ETSI standards*", which is available from the ETSI Secretariat. Latest updates are available on the ETSI Web server (<http://webapp.etsi.org/IPR/home.asp>).

Pursuant to the ETSI IPR Policy, no investigation, including IPR searches, has been carried out by ETSI. No guarantee can be given as to the existence of other IPRs not referenced in ETSI SR 000 314 (or the updates on the ETSI Web server) which are, or may be, or may become, essential to the present document.

Foreword

This European Standard (Telecommunications series) has been produced by ETSI Technical Committee Environmental Engineering (EE).

The present document is part 1, sub-part 3 of a multi-part deliverable covering the classification of environmental conditions for telecommunications equipment, as identified below:

Part 1: "Classification of environmental conditions"; (see note 1)

Sub-part 0: "Introduction";

Sub-part 1: "Storage";

Sub-part 2: "Transportation";

Sub-part 3: "Stationary use at weatherprotected locations";

Sub-part 4: "Stationary use at non-weatherprotected locations";

Sub-part 5: "Ground vehicle installations";

Sub-part 6: "Ship environments";

Sub-part 7: "Portable and non-stationary use";

Sub-part 8: "Stationary use at underground locations";

Part 2: "Specification of environmental tests" (see note 2).

NOTE 1: Specifies different standardized environmental classes covering climatic and biological conditions, chemically and mechanically active substances and mechanical conditions during storage, transportation and in use. Sub-part 1-0 forms a general overview of part 1.

NOTE 2: Specifies the recommended test severities and test methods for the different environmental classes.

National transposition dates

Date of adoption of this EN:	9 July 2004
Date of latest announcement of this EN (doa):	31 October 2004
Date of latest publication of new National Standard or endorsement of this EN (dop/e):	30 April 2005
Date of withdrawal of any conflicting National Standard (dow):	30 April 2005

1 Scope

The present document defines classes of environmental conditions and their severities to which telecommunication equipment may be exposed. The severities specified are those which will have a low probability of being exceeded; generally less than 1 %.

The present document applies to equipment mounted for stationary use including periods of erection work, down time, maintenance and repair at weatherprotected locations defined in clause 5.

2 References

The following documents contain provisions which, through reference in this text, constitute provisions of the present document.

- References are either specific (identified by date of publication and/or edition number or version number) or non-specific.
- For a specific reference, subsequent revisions do not apply.
- For a non-specific reference, the latest version applies.

Referenced documents which are not found to be publicly available in the expected location might be found at <http://docbox.etsi.org/Reference>.

- STANDARD PREVIEW (standards.iteh.ai)*
- [1] IEC 60721-3-3: "Classification of environmental conditions - Part 3-3: Classification of groups of environmental parameters and their severities - Stationary use at weatherprotected locations".
- [2] IEC 60068-2-27: "Environmental testing. Part 2: Tests. Test Ea and guidance: Shock".
- [3] IEC 60721-2-6: "Classification of environmental conditions. Part 2: Environmental conditions appearing in nature: Earthquake vibration and shock".
- [4] IEC 60068-3-3: "Environmental testing - Part 3: Guidance. Seismic test methods for equipment".
- [5] ETSI EN 300 019-2-3: "Environmental Engineering (EE); Environmental conditions and environmental tests for telecommunications equipment; Part 2-3: Specification of environmental tests; Stationary use at weatherprotected locations".

3 Definitions and abbreviations

3.1 Definitions

For the purposes of the present document, the following terms and definitions apply:

absolute humidity: mass of water vapour in grams which is associated with one cubic metre of dry air in an air/water vapour mixture

air conditioning system: system that fully and automatically controls the climatic parameters air temperature and humidity by heating, cooling, humidifying and dehumidifying

climate-controlling system: system that controls or influences climate, acting at least on one climatic parameter in one direction

cooling system: system that controls or influences climate by decreasing the air temperature only

NOTE: This can decrease the absolute humidity.

forced ventilation system: system that controls or influences climate by introducing outdoor air into the room or expelling air out of the room

heating system: system that controls or influences climate by increasing the air temperature only

NOTE: This can decrease the relative humidity.

relative humidity: ratio of the partial pressure of the water vapour in moist air at a given temperature, to the partial pressure of the water vapour in saturated air at the same temperature

stationary use: The equipment is mounted firmly on the structure, or on mounting devices, or it is permanently placed at a certain site. It is not intended for portable use - but short periods of handling during erection works, down time, maintenance and repair at the location are included.

weatherprotected location: location at which the equipment is protected from direct weather influences:

- totally weatherprotected location (enclosed location):
 - direct weather influences are totally excluded,
- partly weatherprotected location (sheltered location):
 - direct weather influences are not completely excluded.

3.2 Abbreviations

For the purposes of the present document, the following abbreviations apply:

RS	Response Spectrum
ZPA	Zero Period Acceleration

iTech STANDARD PREVIEW
(standards.itech.ai)

4 Environmental classes

The classes shown in parentheses, e.g. (3C1), may be selected for special applications.

4.1 Class 3.1: Temperature-controlled locations

Class 3.1 is a combination of classes 3K3/3Z2/3Z4/3B1/3C2(3C1)/3S2/3M1 in IEC 60721-3-3 [1].

The climatogram is shown in figure 1 in clause 4.1.

Seismic environment: **zone 4** as defined in IEC 60721-2-6 [3]. Option zone 4 (modified Mercalli scale ≥ 9): if earthquake conditions are specified by the customer, the conditions stated in clause 5.6 apply.

This class applies to a permanently temperature controlled enclosed location. Humidity is usually not controlled. The climatogram is shown in figure 1.

Heating, cooling, forced ventilation and humidification are used as necessary to maintain the required conditions - especially where there is a significant difference between the room environment and the external ambient. The climate-controlling systems could be periodically switched on or off but extremely high or low temperatures are prevented.


This class applies to locations:

- where installed equipment may be exposed to solar radiation and to heat radiation. It may also be exposed to movements of the surrounding air due to draughts in buildings. They are not subjected to condensed water, precipitation, water from sources other than rain or icing;
- without particular risks of biological attacks. This includes protective measures, e.g. special product design, or installations at locations of such construction that mould growth and attacks by animals, etc. are not probable;

- with normal levels of contaminants experienced in urban areas with industrial activities scattered over the whole area and/or with heavy traffic;
- without special precautions to minimize the presence of sand or dust, but which are not situated in proximity to sources of sand or dust;
- with insignificant vibration and shock.

The conditions of this class may be found in:

- normal living or working areas, e.g. living rooms, rooms for general use (theatres, restaurants);
- offices;
- shops;
- workshops for electronic assemblies and other electrotechnical products;
- telecommunication centres;
- storage rooms for valuable and sensitive products.

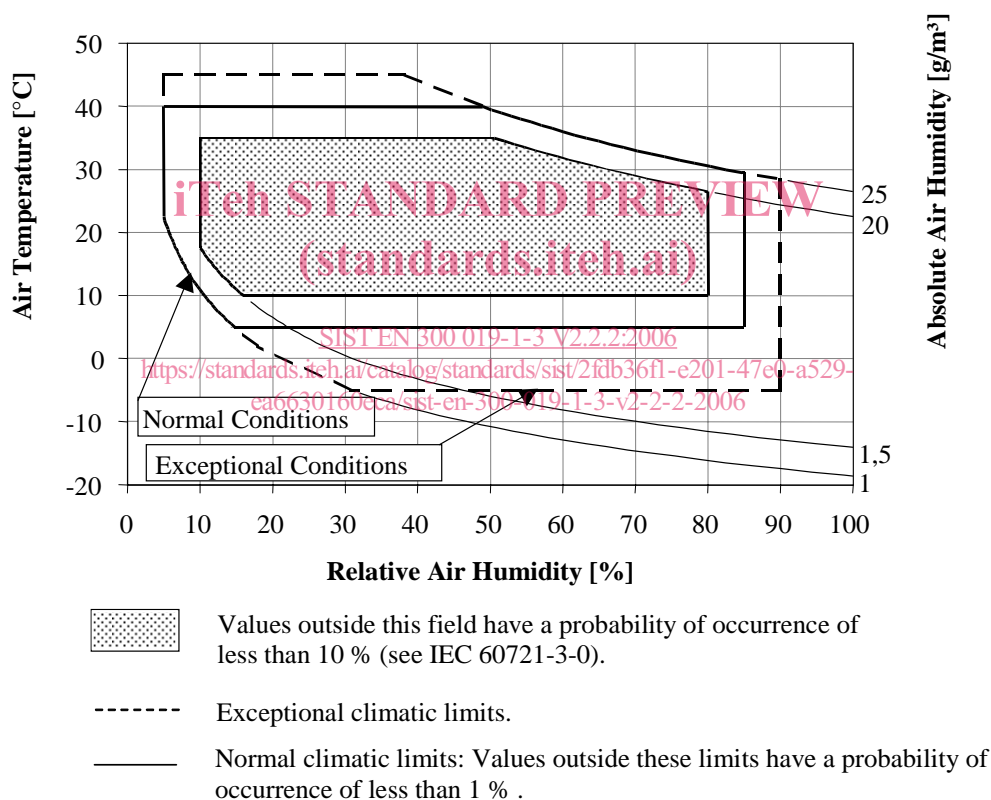

NOTE: Exceptional conditions may occur following the failure of the temperature controlling system. This is described as 3.1E in the tables but it should be noted that there is no separate class 3.1E.

Figure 1: Climatogram for Class 3.1: Temperature-controlled locations

4.2 Class 3.2: Partly temperature-controlled locations

This class is a combination of classes 3K5/3Z2/3Z4/3B2/3C2(3C1)/3S3/3M2 in IEC 60721-3-3 [1] .

Seismic environment: **zone 4** as defined in IEC 60721-2-6 [3]. Option zone 4 (modified Mercalli scale ≥ 9): if earthquake conditions are specified by the customer, the conditions stated in clause 5.6 apply.

This class applies to an enclosed location having neither temperature nor humidity control. The climatogram is shown in figure 2.

Heating may be used to raise low temperatures especially where there is a significant difference between the conditions of this class and the open-air climate. Building construction is designed to avoid extremely high temperatures.

This class applies to locations:

- where installed equipment may be exposed to solar radiation and heat radiation. They may also be exposed to movements of the surrounding air due to draughts in buildings, e.g. through open windows. They may be subjected to condensed water. They are not subjected to precipitation;
- where mould growth or attacks by animals, except termites, may occur;
- with normal levels of contaminants experienced in urban areas with industrial activities scattered over the whole area and/or with heavy traffic;
- in close proximity to sources of sand or dust;
- with vibration of low significance, e.g. for products fastened to light supporting structures subjected to negligible vibrations.

The conditions of this class may be found in:

- entrances and staircases of buildings;
- garages;
- cellars;
- certain workshops;
- buildings in factories and industrial process plants;
- unattended equipment stations; [SIST EN 300 019-1-3 V2.2.2:2006](https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ca065080eca/sist-en-300-019-1-3-v2-2-2-2006)
- certain telecommunication buildings; <https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ca065080eca/sist-en-300-019-1-3-v2-2-2-2006>
- ordinary storage rooms for frost resistant products and farm buildings, etc.

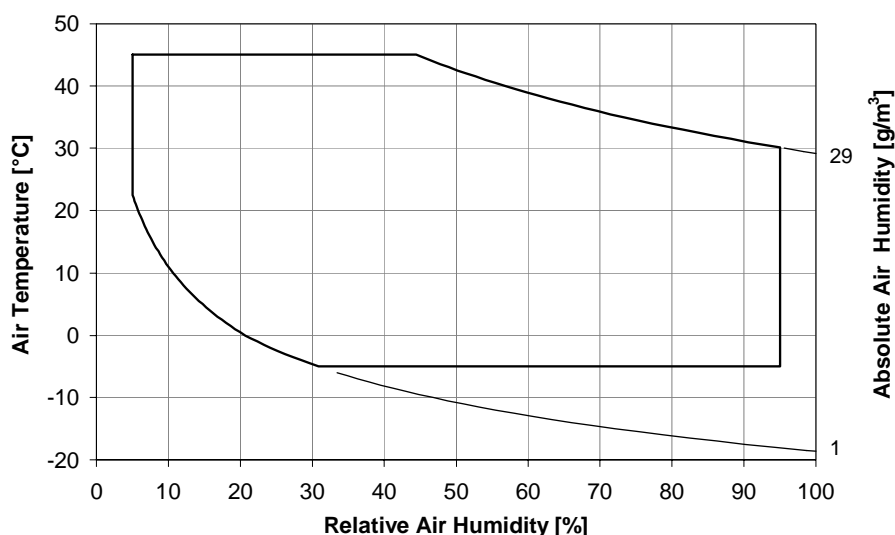


Figure 2: Climatogram for class 3.2: Partly temperature-controlled locations

4.3 Class 3.3: Not temperature-controlled locations

This class is a combination of classes 3K6/3Z2/3Z4/3Z7/3B2/3C2(3C1)/3S3/3M2 in IEC 60721-3-3 [1].

Seismic environment: **zone 4** as defined in IEC 60721-2-6 [3], Option zone 4 (modified Mercalli scale ≥ 9): if earthquake conditions are specified by the customer, the conditions stated in clause 5.6 apply.

This class applies to a weatherprotected location having neither temperature nor humidity control. The location may have openings directly to the open air, i.e. may be only partially-weather protected. The climatogram is shown in figure 3.

The climatic conditions of this class may be affected to a varying extent by the conditions of the open-air climate and the construction of the building.

This class applies to locations:

- where installed equipment may be exposed to solar radiation and temporarily to heat radiation. It may also be exposed to movements of the surrounding air due to draughts e.g. through doors, windows or other openings. It may be subjected to condensed water, to water from sources other than rain and to icing. It may temporarily be subjected to limited wind-driven precipitation, including snow;
- where mould growth, or attacks by animals, except termites, may occur;
- with normal levels of contaminants experienced in urban areas with industrial activities scattered over the whole area and/or with heavy traffic;
- in close proximity to sources of sand or dust;
- with vibration of low significance, e.g. for products fastened to light supporting structures subjected to negligible vibrations.

The conditions of this class may be found in:

- some entrances to buildings; [SIST EN 300 019-1-3 V2.2.2:2006](https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ea6630160eca/sist-en-300-019-1-3-v2-2-2-2006)
- some garages; <https://standards.iteh.ai/catalog/standards/sist/2fdb36f1-e201-47e0-a529-ea6630160eca/sist-en-300-019-1-3-v2-2-2-2006>
- some shacks;
- unattended buildings, etc.

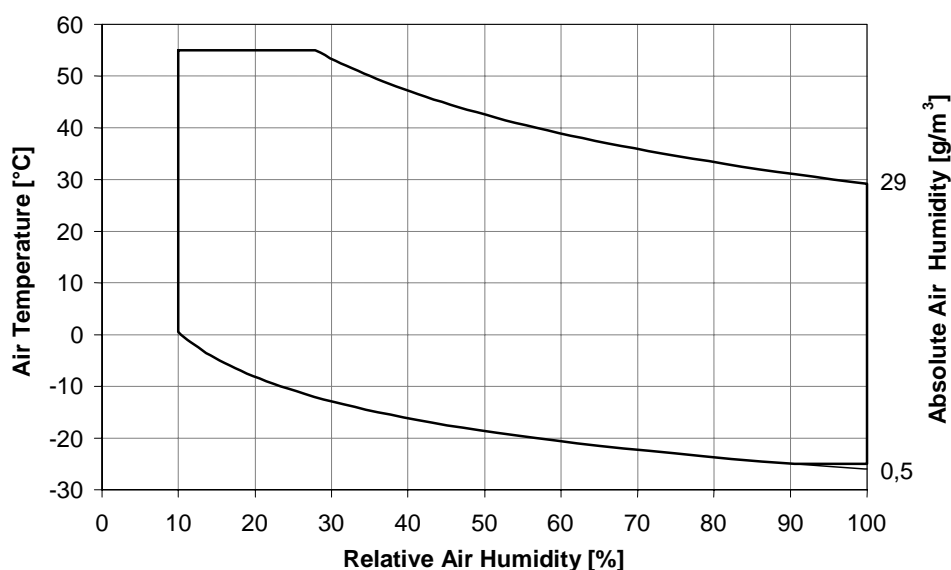


Figure 3: Climatogram for class 3.3: Not temperature controlled locations